

GHQ/SCAP Records (RG 331, National Archives and Records Service)

Description of contents

- (1) Box no. 3103
(2) Folder title/number: (9)
Akasaki Oil Tank Facility - Sasebo

(3) Date: ?

(4) Subject:

Classification	Type of record
9212, 9230	c, r

(5) Item description and comment:

Nagasaki

(6) Reproduction: Yes No

(7) Film no.

Sheet no.

(Compiled by National Diet Library)

Code No.: 27 - 3

Name of Plant: Sasebo Naval Arsenal.

Location of Plant: Sasebo-shi, Nagasaki-ken.

No. of tank Inventory No.	No.	Type & Description	Capacity (Kilo L.)	Accessory		Remarks
				Name	No.	
27-3-1T	1	1 Above ground Round, vertical Steel plate Welding	650	Valve 6in.	1	Evaluated
				ditto 5in.	1	ditto
				ditto 4in.	2	ditto
				ditto 3.1/2in.	1	ditto
				ditto 2.1/2in.	1	ditto
				Pipe 6in. 5M	1	ditto
				ditto 5in. 19M	1	ditto
				ditto 4in. 52M	1	ditto
				ditto 3in. 25M	1	ditto

SURVEY OF OIL STORAGE TANK FACILITIES

Sasebo Naval

Akagaki,
Sasebo-shi,
Nagasaki-ken

Code Location # 27 - 13

Name of Installation: Arsenal

Location Nagasaki-ken

No. of Tanks:	Reported Capacity (Kiloliters per tank)	Approx. Outside Dimensions (meters)	Computed Capacity (Kiloliters per tank)	Reparations Code marking Observed of Tanks	Type & conditions of tanks	Structural installation of tanks	Status of Auxiliary Equipment
---------------	---	-------------------------------------	---	--	----------------------------	----------------------------------	-------------------------------

550	Dia: 11.2 Height: 6.7	650	27 - 3 - 1T	Above Ground Vertical	Steel Welding	Valve: 5 inch: 1 4 " : 2 3 1/2 " : 1 2 1/2 " : 1 Pipe: 6 inch: 5M 5 " : 19M 4 " : 52M 3 " : 25M
-----	--------------------------	-----	-------------	--------------------------	------------------	--

Incl 2

Part A

Report of Individual Tank

1. Identification: 27-3-10871.
2. Owner: Sasebo Naval Arsenal on Dec. 6, 1941. Sasebo Naval Arsenal on Aug. 15, 1945. and ministry of Finance at present.
3. Present User: Former User (Sasebo Naval Arsenal) used this untile Aug. 15, 1945.
4. Present Use: Storing for heavy oil untile Aug. 15, 1945.
5. Type of construction: Above-ground Vertical Steel welded.
6. Capacity: 3,145 barrels. Dia.-46.57ft. Height-19.68ft. Side plates- 4 layers.
7. Present condition: It is serviceable (No damage) but we do not use at present.
8. Accessories: Valves (2) Man hole (1) ladder (1) Oil gauge glass (1)

Part B

Report on Individual Installation

9. Name & Location of Installation:
Sasebo Naval Arsenal Akasaki Heavy Oil Tanks.
Akasaki-cho, Sasebo City, Nagasaki-Ken.
10. Total Number of Tanks: Serviceable 1 Tank.
11. Total Capacity: Serviceable 3,145 barrels.
12. Total Tanks in Use: Dirty 1 tank.
13. Total Tanks Not in Use: None.
14. Routes of communication: 4KM. from Sasebo Rd. Station equipment of pier at the western part of Sasebo Harbour Very convenient from both land and sea.

15. Water Ways: 19.68ft. at low tide and 32.68ft. at high tide.
Max. size of ships that can be tide to the pier
----- tons.

16. Primary Function: Oil Storage.

17. Discharging & Loading Facilities: Pipe lines.


18. Capacity of Operation in Item 17: Pipe length 25m

19. Service ability: All tanks become intact to repair some parts
of pipe, and valves. 95 % serviceable.

SASEBO NAVLAF

NOTE

- ----- TANK
- ⊕ ----- PIPE & VALVE
- ----- BUILDING

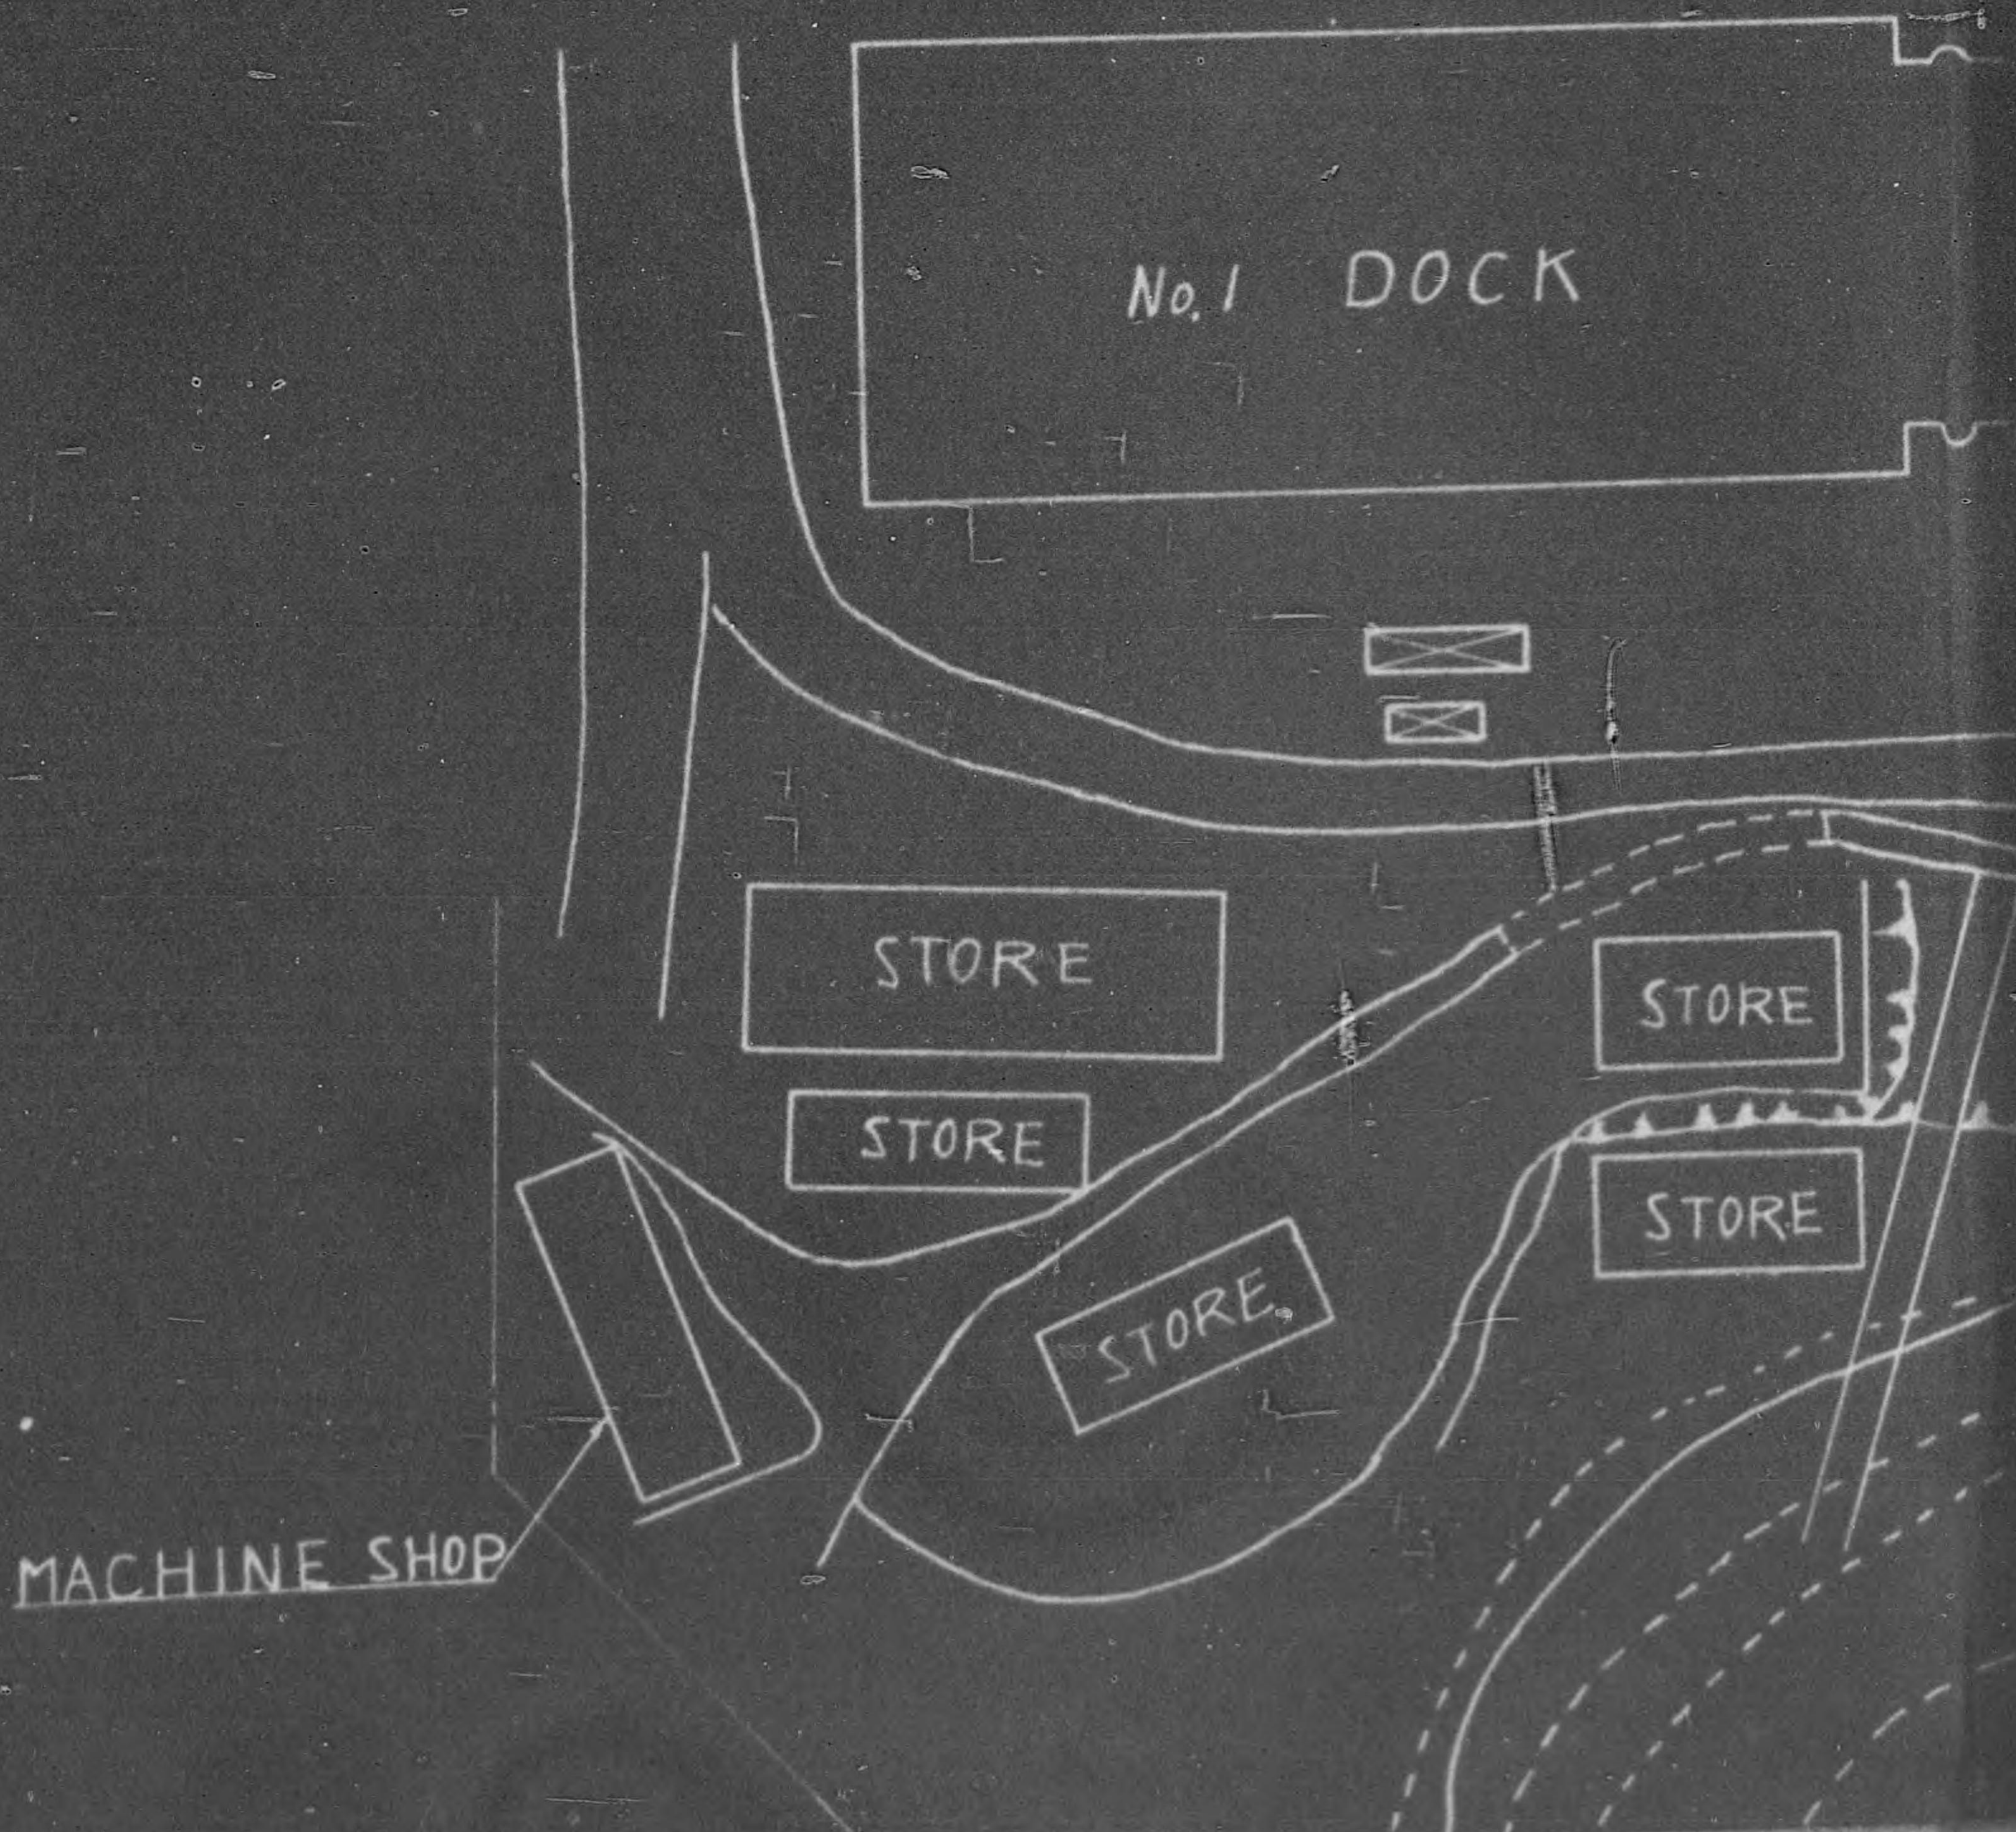

BO NAVL ARSENAL AKASAKI OIL TANK STOP

SASEBO-SHI NAGASAKI-KEN

CODE NO. 27-3

DOCK

SEA


ROAD

STORE

STORE

STORE


27-3-10871 3/45

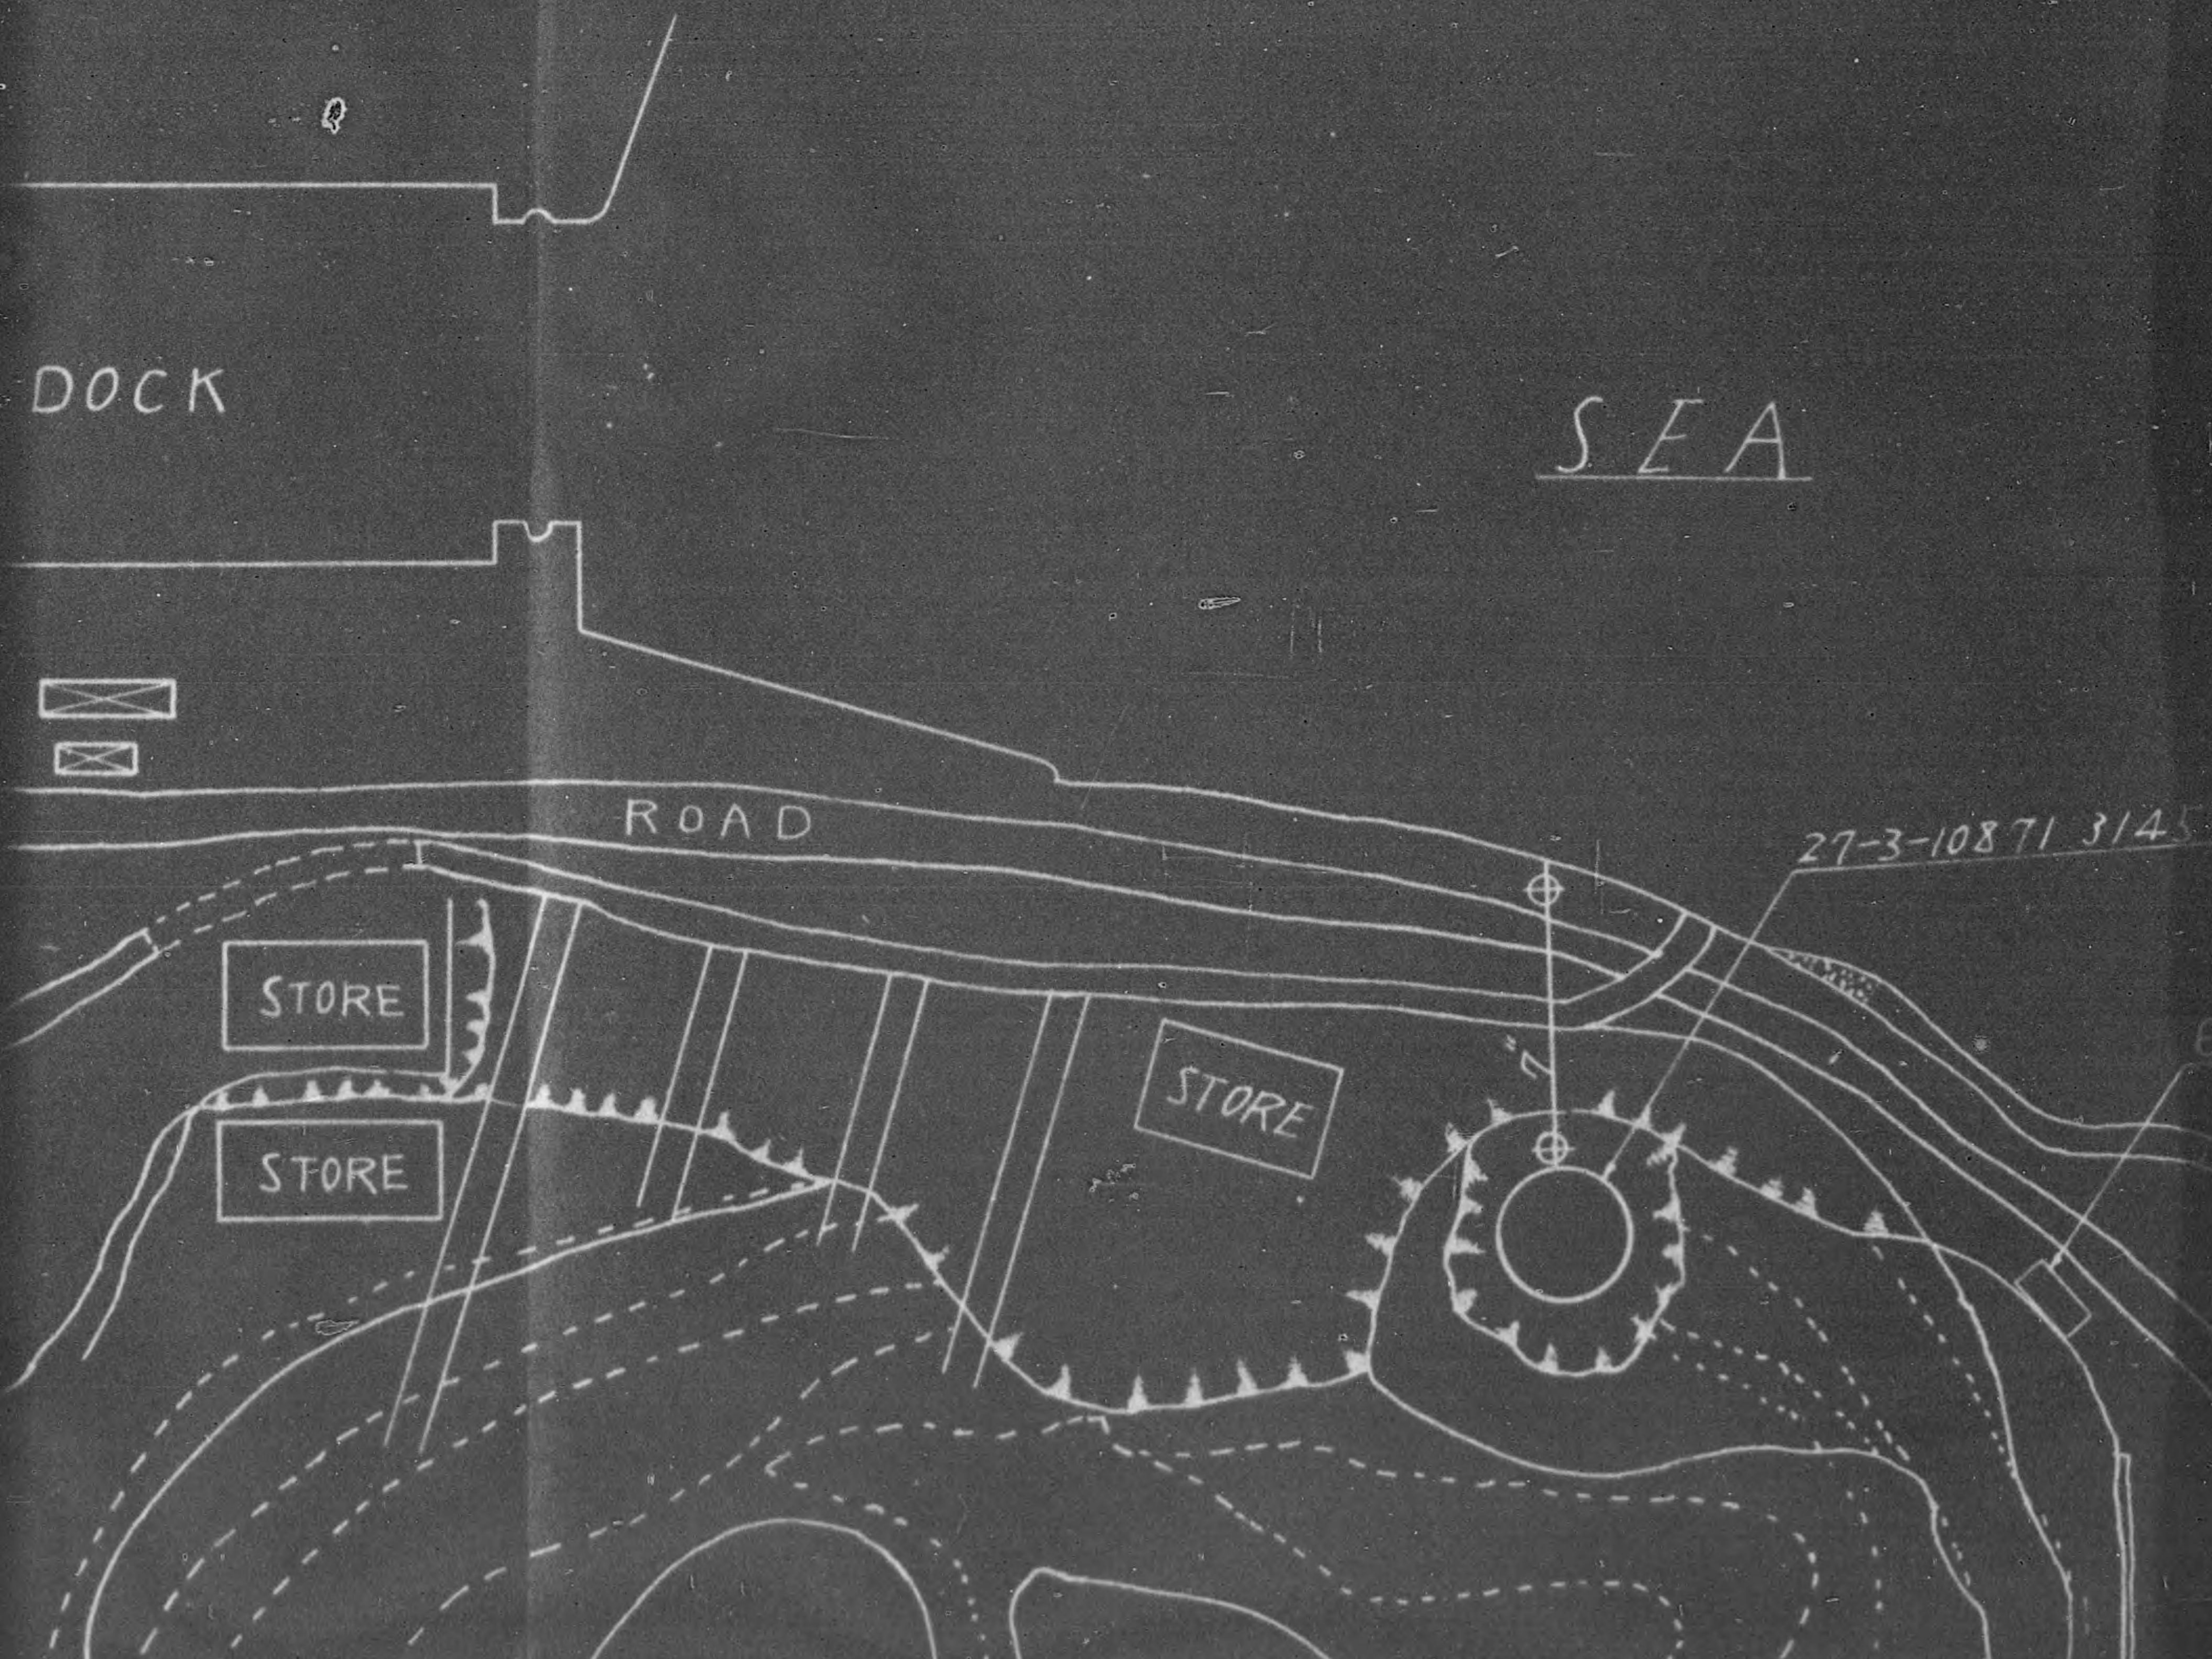

OIL TANK STORAGE FACILITY

NAGASAKI-KEN

-3

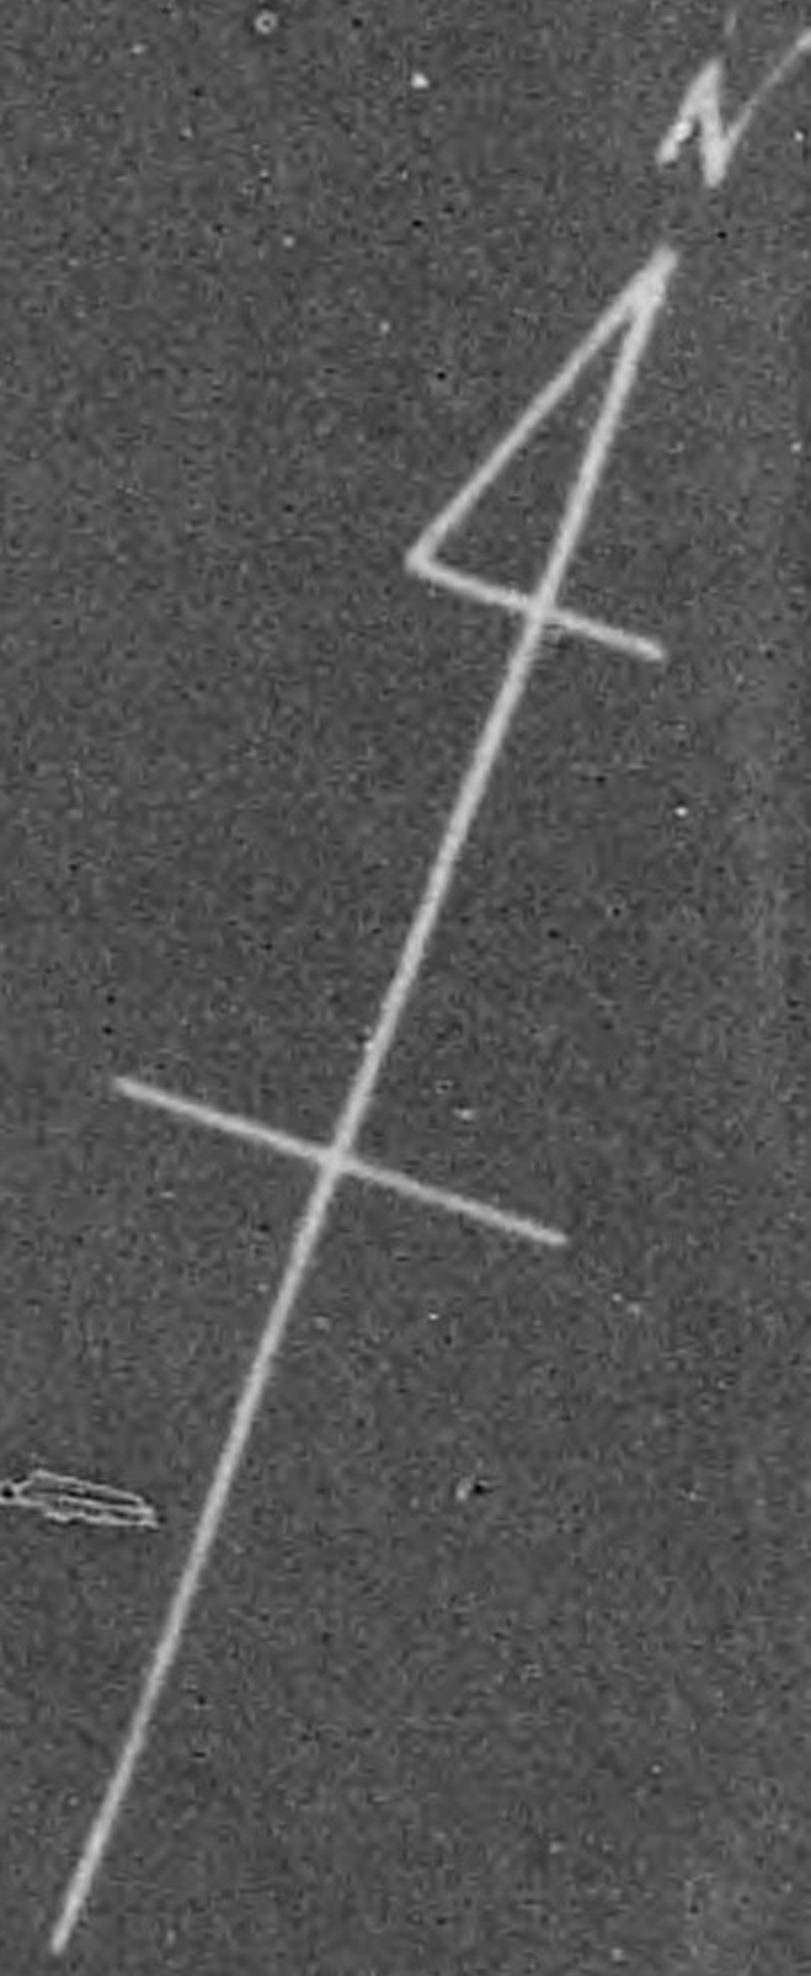

SEA

27-3-10871 3145 BBL

GUARDHOUSE



MACHINE SHOP



STORE


STORE

STORE

STORE

STORE

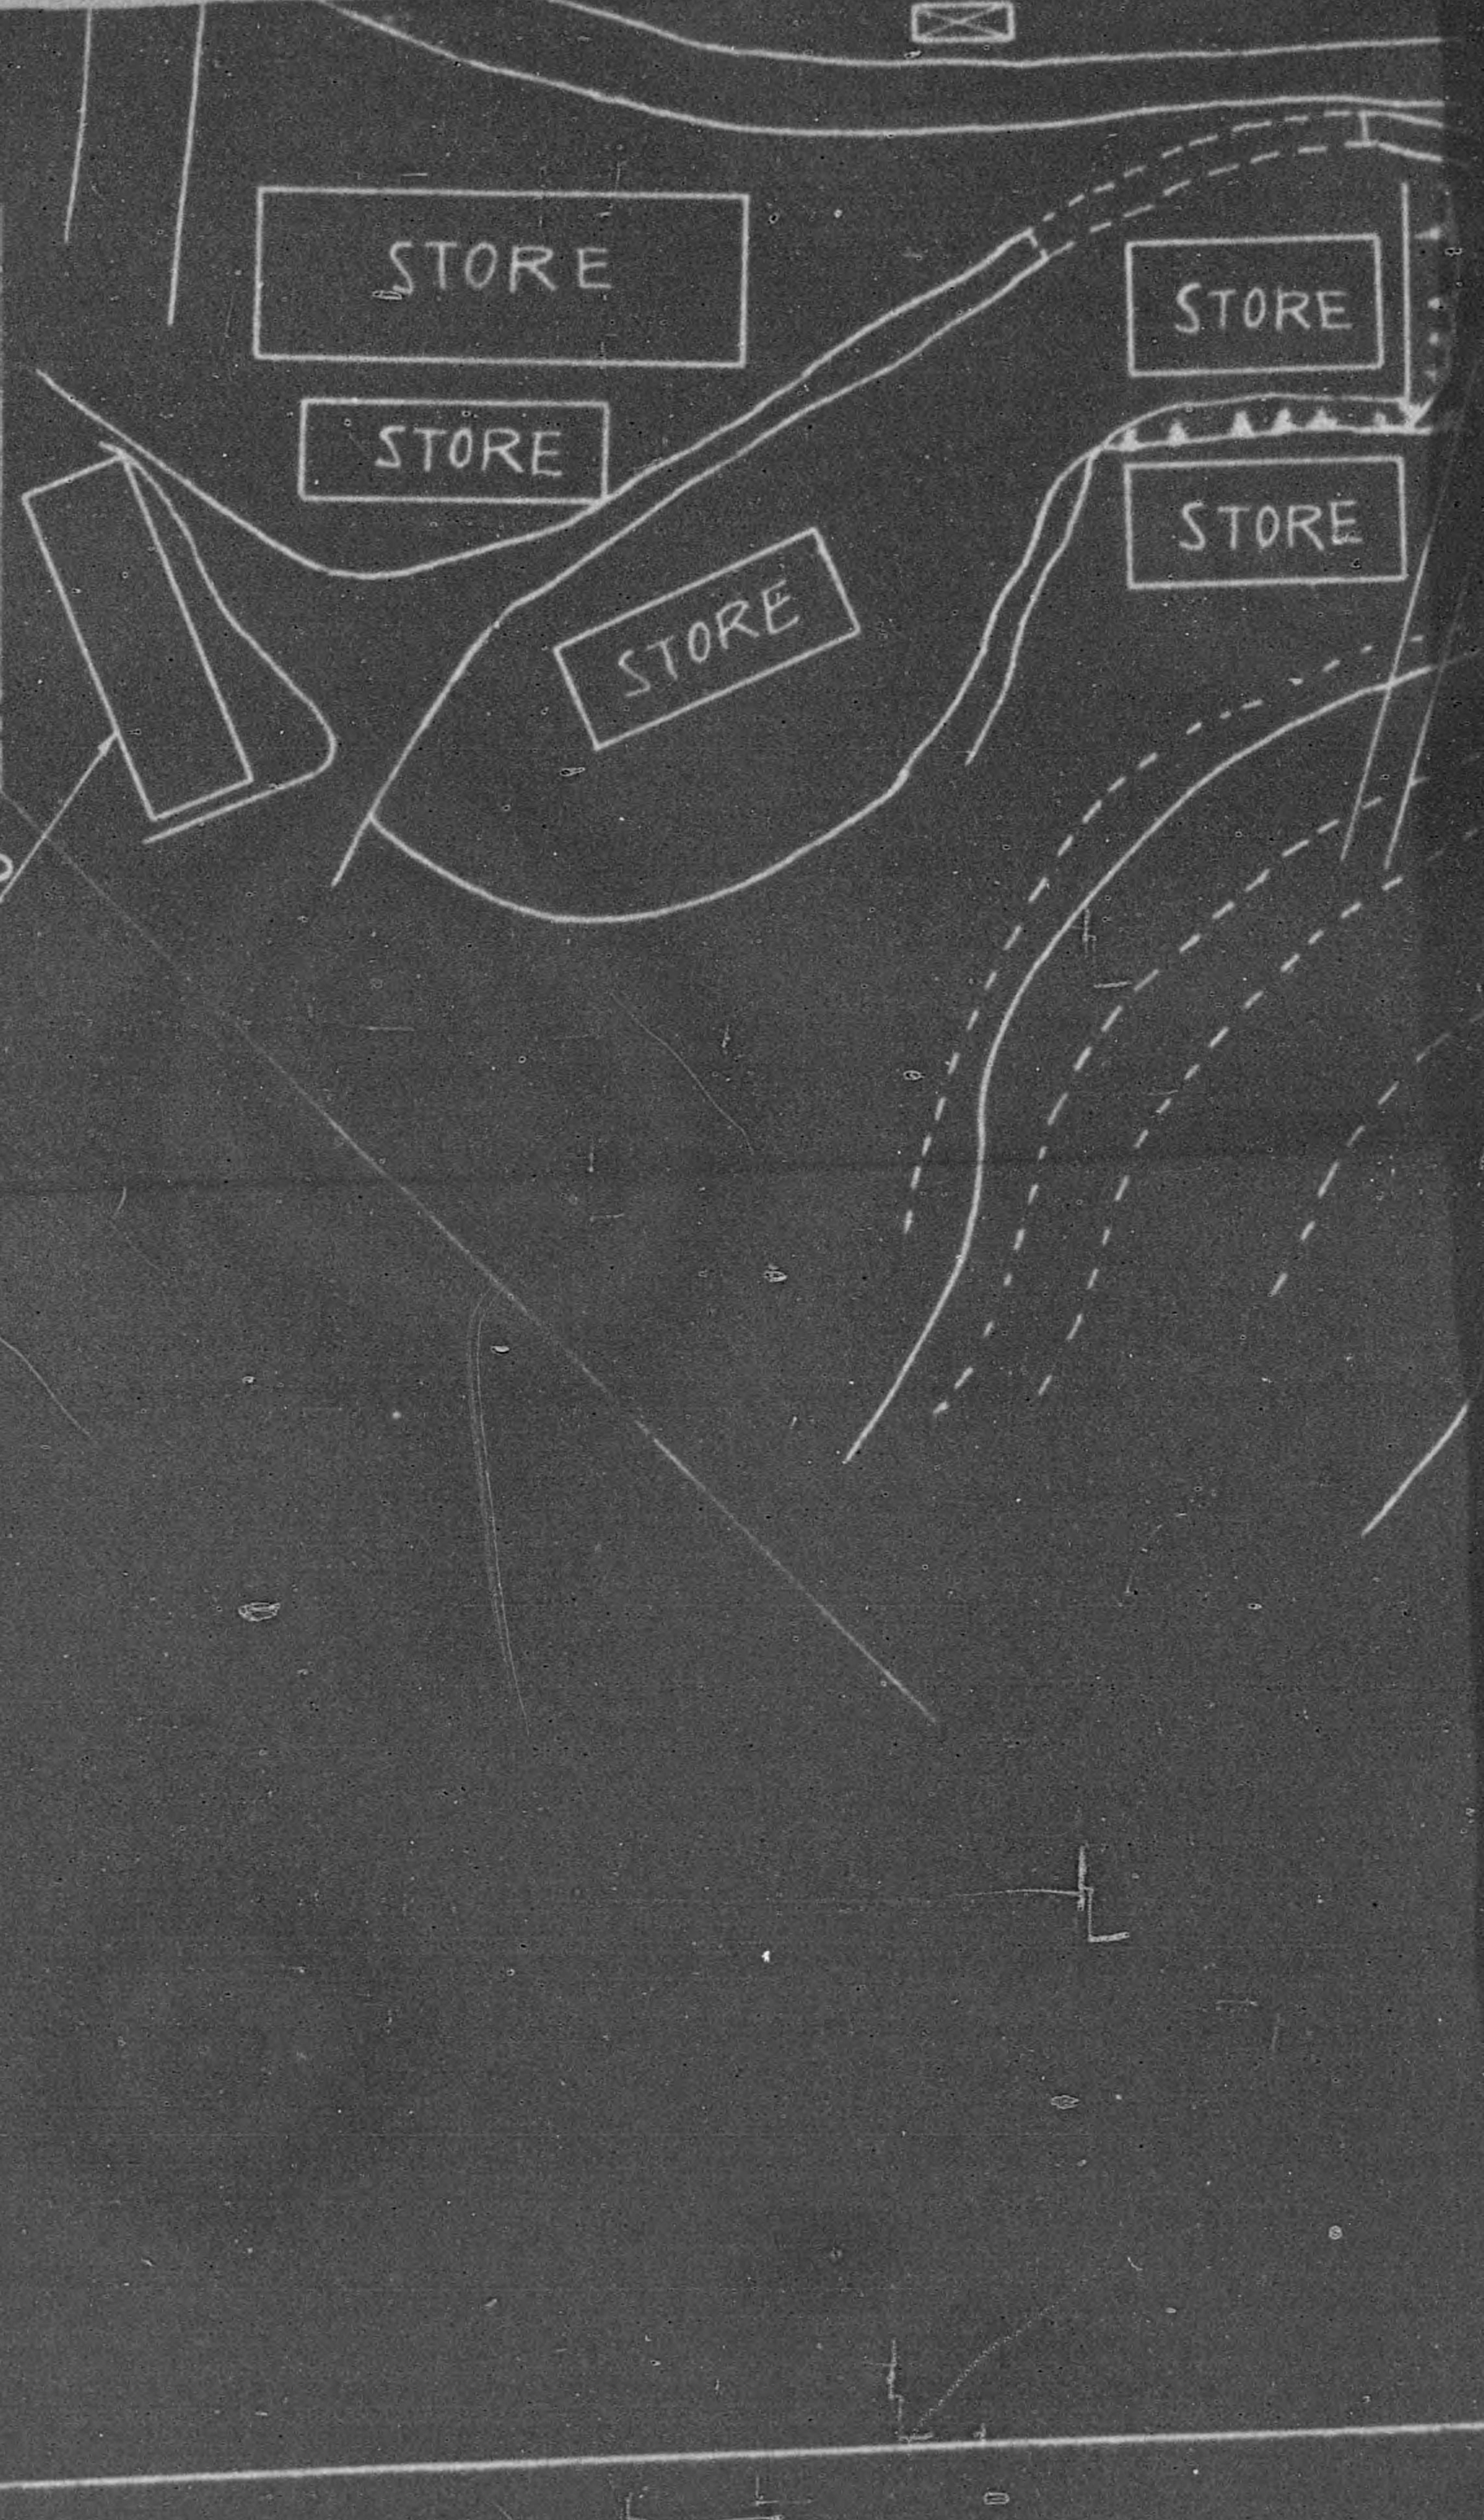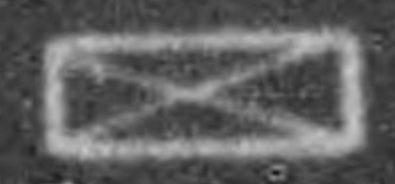

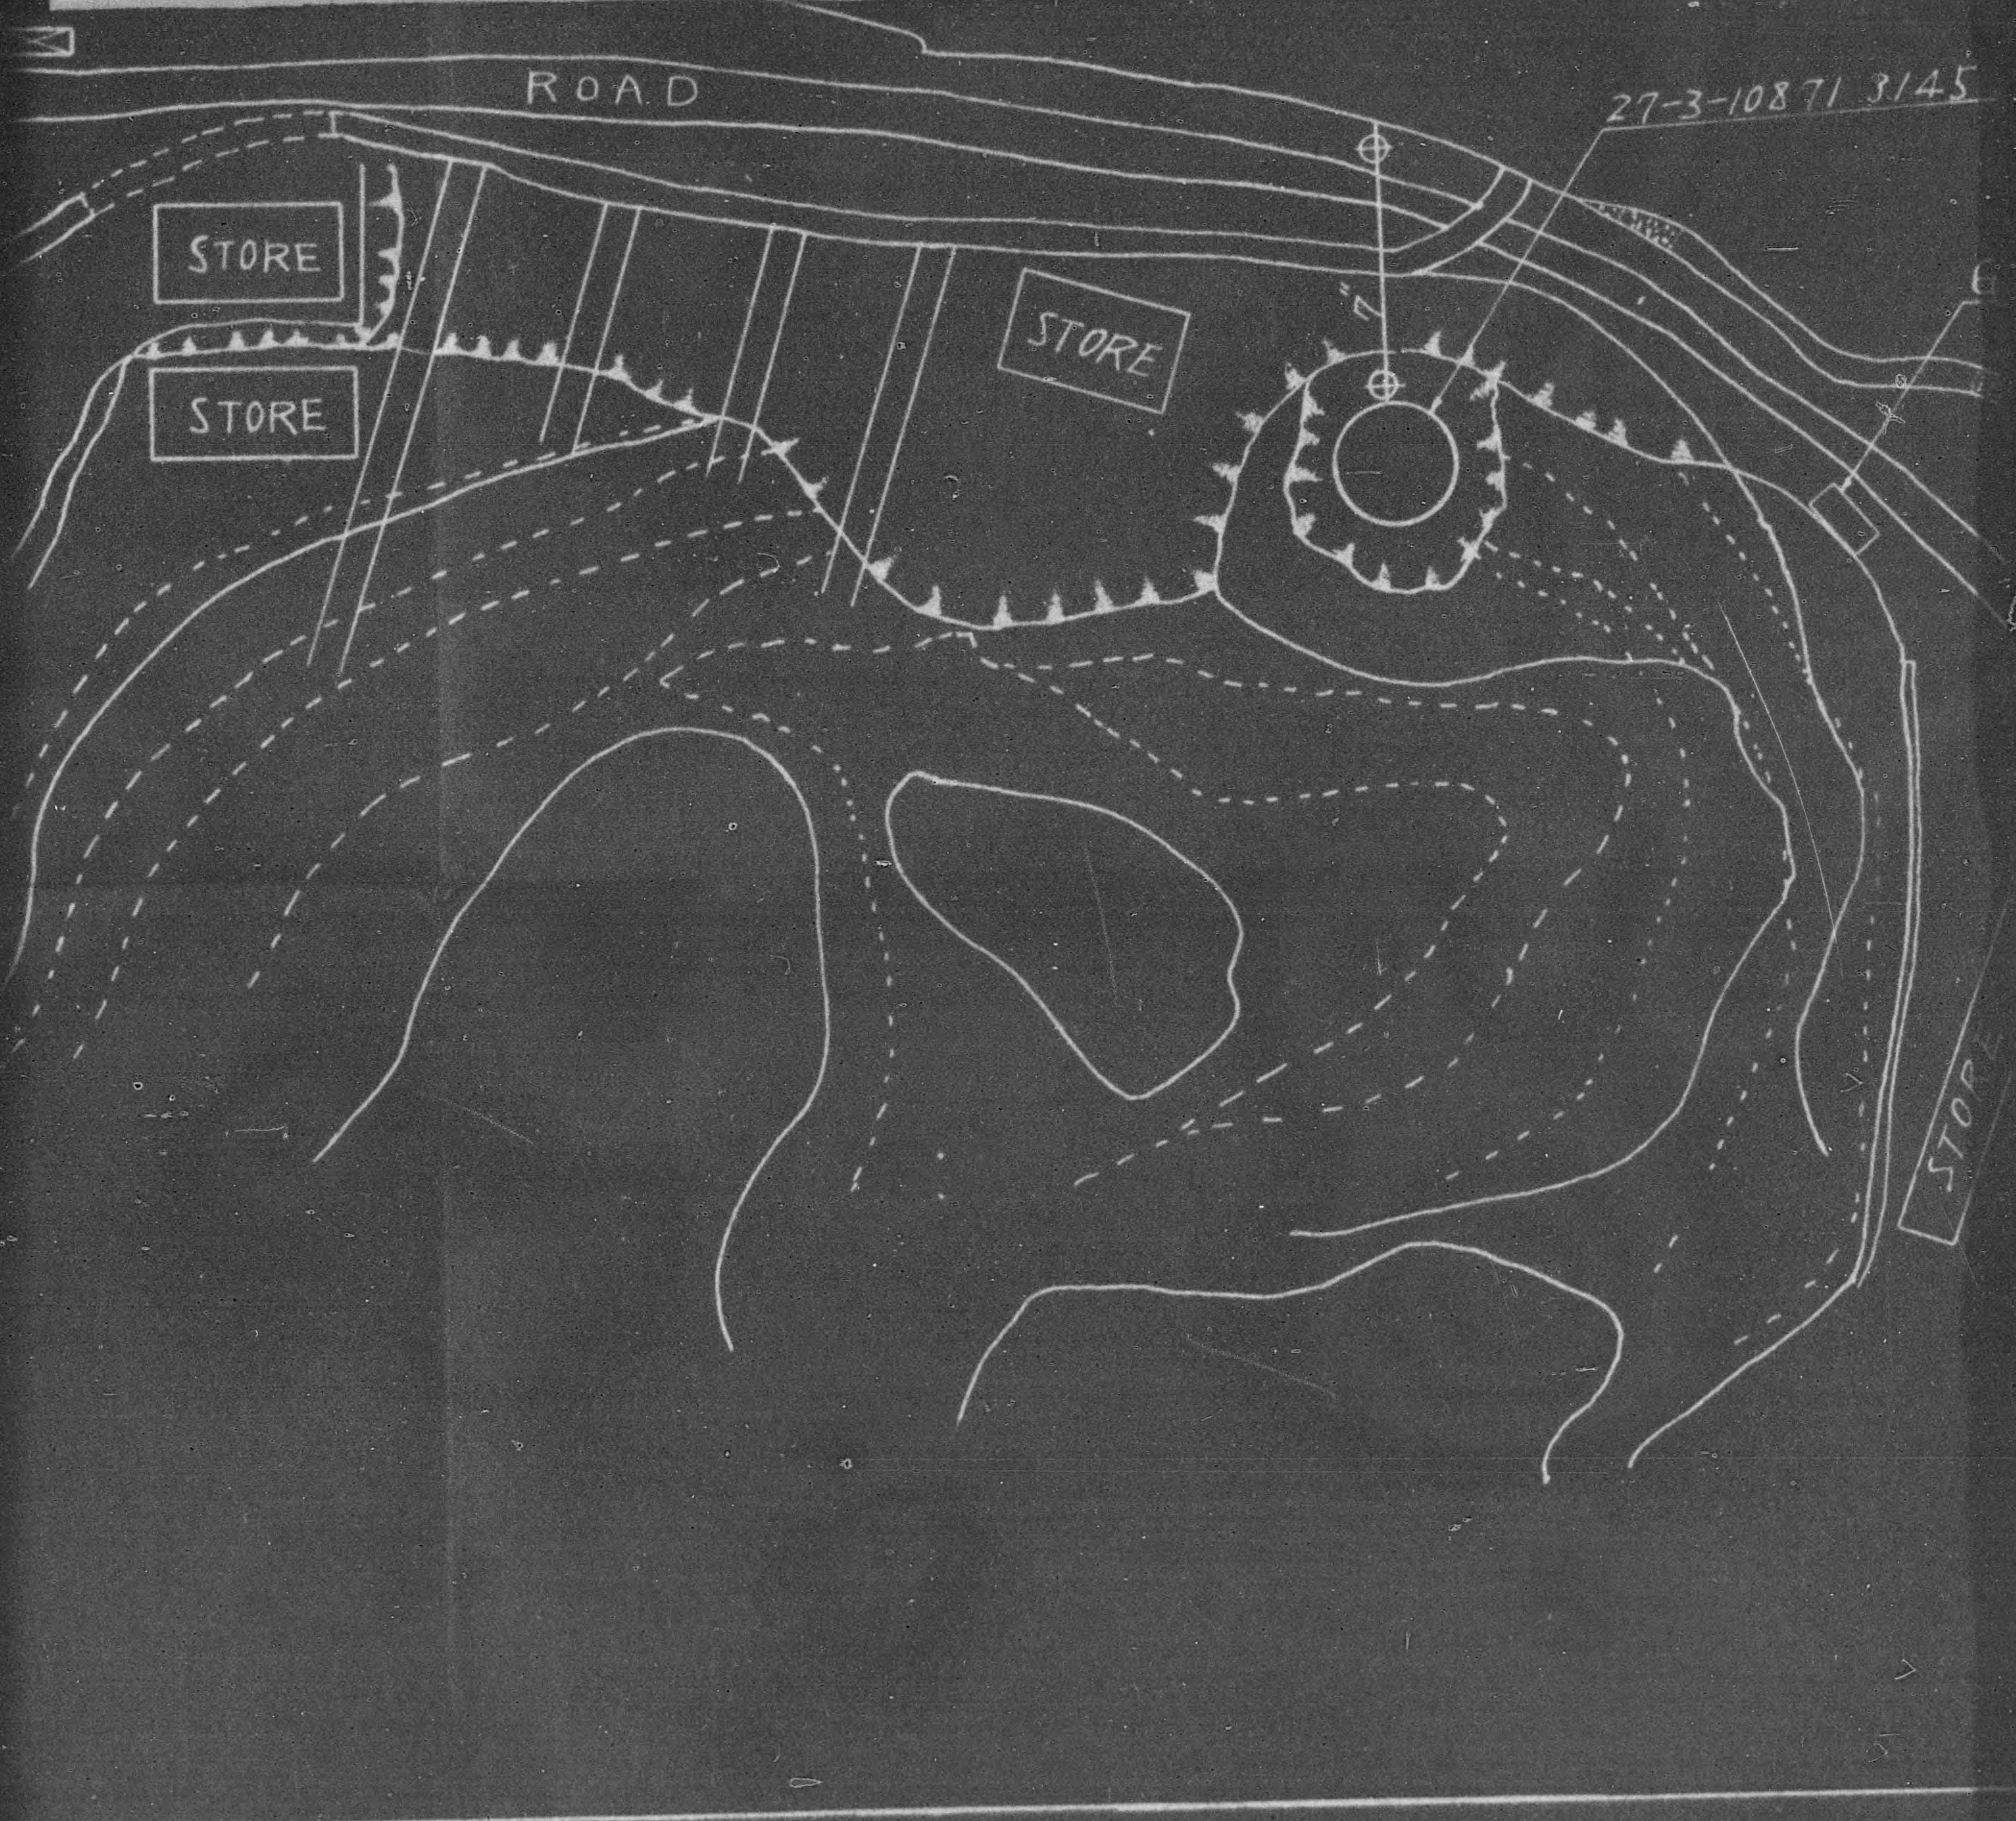

27-3-10871 3145 BBL

GUARDHOUSE

STORE

