


# ALUR TALUK



FLUORIDE CONTENT IN  
DRINKING WATER BOREWELLS

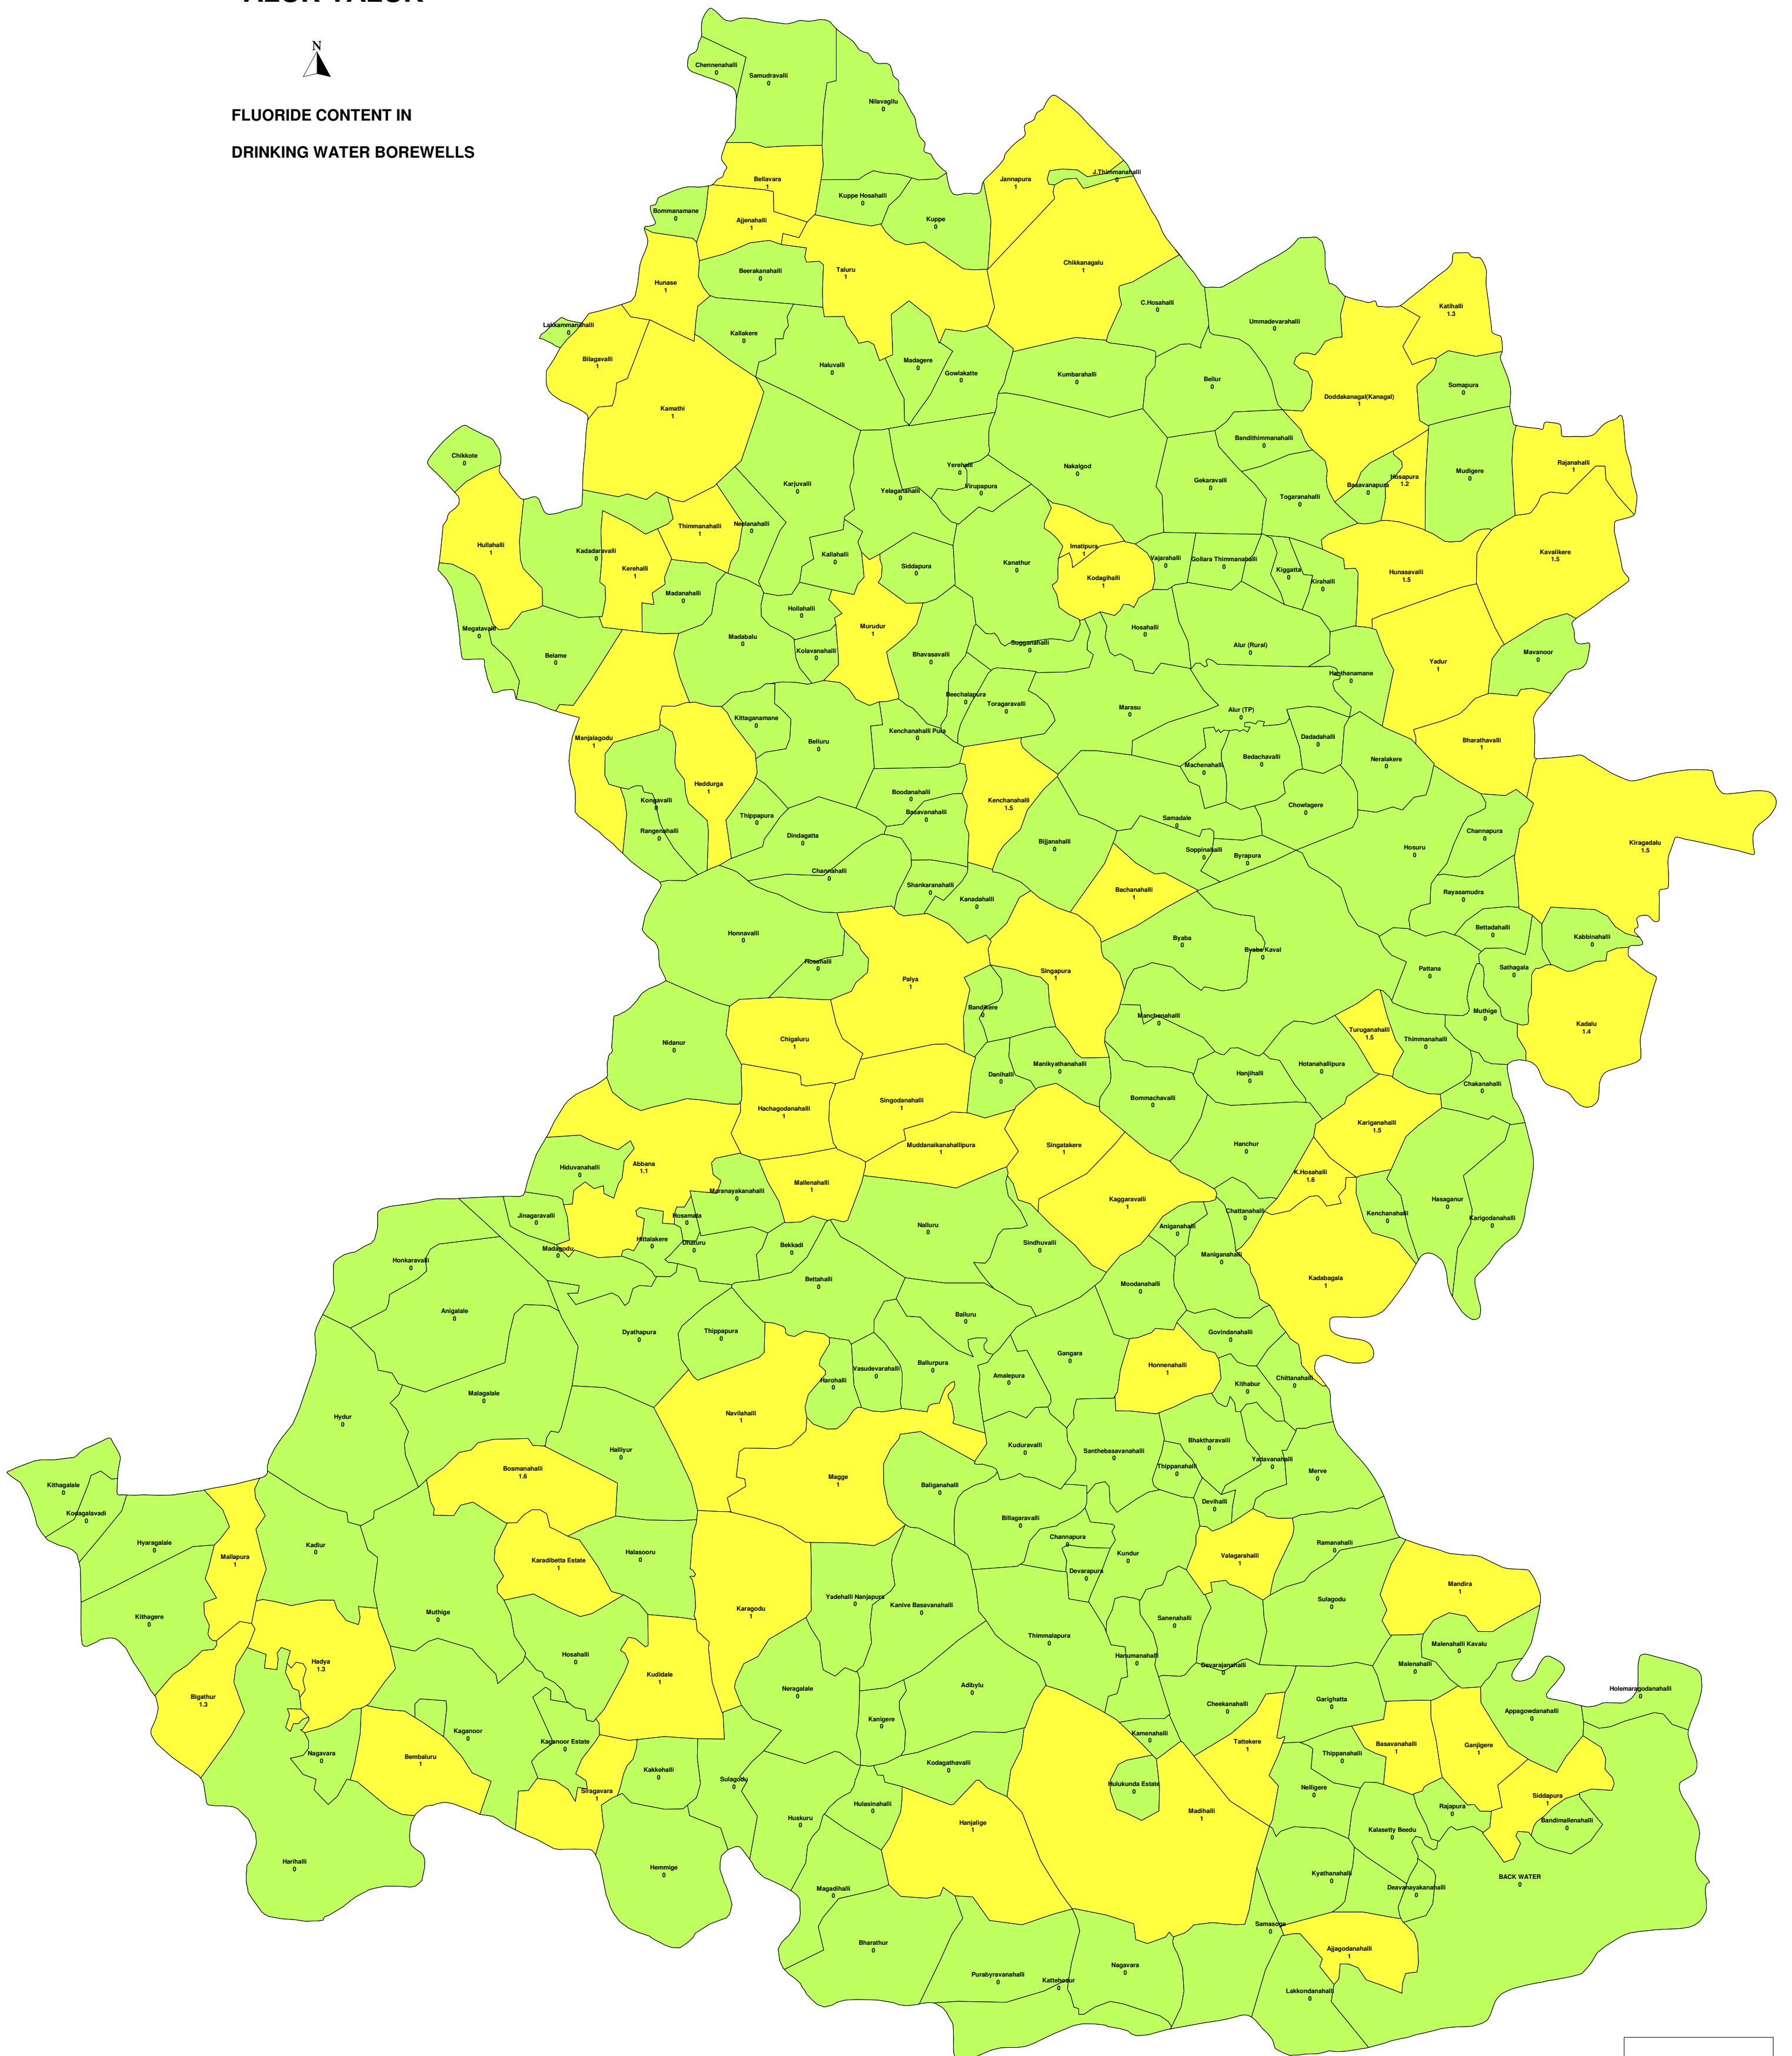

PREPARED AT : NRDMs CENTRE/ZP/HASSAN.

FLUORIDE CONTENT	
<span style="color: lightgreen;">■</span>	<1 (198)
<span style="color: yellow;">■</span>	1 to 1.6 (63)