

TH

7223

A42

**Notes on
Heating and
Ventilation**

96

ALLEN



Class TH 7223

Book .A42

Copyright N^o _____

COPYRIGHT DEPOSIT.

No. 153349

NOTES
ON
HEATING AND VENTILATION

BY

JOHN R. ALLEN

//

JUNIOR PROFESSOR MECHANICAL ENGINEERING
UNIVERSITY OF MICHIGAN

Member American Society Heating and Ventilating
Engineers

Member American Society Mechanical
Engineers

SECOND EDITION

3
3
3

DOMESTIC ENGINEERING
CHICAGO
49-53 NORTH JEFFERSON STREET
1906

~~TH 783~~
~~A42~~

TH 7223
A42

LIBRARY of CONGRESS
Two Copies Received
JUL 3 1908
COPYRIGHT ENTRY
Aug 17 1906
CLASS A XXC. No.
153349
COPY B.

COPYRIGHT
DOMESTIC ENGINEERING
1906

C
C
C
C
C
C
C
C

8-20031

PREFACE.

The chapters comprising this book are a brief resumé of the lectures delivered by the author to the classes in heating and ventilation at the University of Michigan. The subject matter was first published as a series of articles in DOMESTIC ENGINEERING.

The book has been written primarily for the steam-fitter and designer of heating systems. It presupposes a knowledge of the construction and operation of the simpler forms of heating systems and has been reduced to as brief a form as possible so that the reader can readily find the notes or data desired.

The design of heating and ventilating systems has not been reduced to an exact science. The factor of judgment and experience in designing heating plants is a large one. One reason for this is the lack of exact experimental data governing some of the most important factors entering into these calculations. This lack must be filled from the designer's experience.

The tables of heat losses from radiating surfaces and the tests of pipe coverings have been compiled from the results obtained from the experiments made under the direction of Prof. M. E. Cooley, Dean of the Department of Engineering, University of Michigan. The author also has shown illustrations of tunnel sections which have been used by Prof. Cooley in the design of a number of central heating systems.

JOHN R. ALLEN.

Ann Arbor, October 30, 1905.

TABLE OF CONTENTS.

Introduction.

| | |
|---|----|
| Theory of heat and measurement of temperature | 11 |
|---|----|

Chapter I.

| | |
|---|----|
| Heat losses from buildings and rules for determining the heat losses in different constructions | 17 |
|---|----|

Chapter II.

| | |
|---|----|
| Different forms of heating systems; their advantages, disadvantage and relative economy | 36 |
|---|----|

Chapter III.

| | |
|---|----|
| The design of a direct steam heating system and the properties of steam | 49 |
|---|----|

Chapter IV.

| | |
|--|----|
| Design of an indirect steam heating system | 81 |
|--|----|

Chapter V.

| | |
|---|----|
| Steam boilers and steam piping. Determination of size and details of construction | 95 |
|---|----|

Chapter VI.

| | |
|--|-----|
| The connection of mains to risers and risers to radiators, with illustrations of different arrangements in practical use | 122 |
|--|-----|

Chapter VII.

| | |
|--|-----|
| The design of a hot water heating system | 147 |
|--|-----|

Chapter VIII.

| | |
|---|-----|
| Hot water boilers and piping. Determination of size and details of construction | 155 |
|---|-----|

Chapter IX.

| | |
|--|-----|
| Ventilation and the pollution of air by human beings, artificial lighting and chemical processes | 172 |
|--|-----|

Chapter X.

| | |
|--|-----|
| Design of hot air heating system | 186 |
|--|-----|

Chapter XI.

| | |
|---|-----|
| Fan systems of heating, with tables of fan capacities and condensation in heater coil | 200 |
|---|-----|

Chapter XII.

| | |
|--|-----|
| Central heating systems; their design and installation, with discussion of different methods of carrying pipes underground | 226 |
|--|-----|

Chapter XIII.

| | |
|---|-----|
| Pipe coverings, pipe, valves, temperature regulation, air washing and exhaust heating | 252 |
|---|-----|

SUBJECT INDEX.

| | Page. | | Page. |
|------------------------------------|-----------------|-------------------------------------|-------------|
| A | | | |
| Absolute temperature | 12 | Central heating, heat and | |
| Air, changes of, for venti- | | power combined | 222 |
| lation | 177 | high pressure system | 230 |
| dilution of, for chem- | | low pressure | 231 |
| icals | 175 | pump logs | 236 |
| flues88-91-181-191-192 | | size of pipes | 240 |
| loss of pressure in pipes | 218 | systems of distribution | 228 |
| mixing systems | 220 | tunnels | 237 |
| moistening of | 188-264-265 | Coils, heating for fan sys- | |
| piping systems | 263 | tem | 269 |
| pollution of | 173 | pipe, heat loss from | 55-64 |
| registers, location of | 181 | Cold air duct | 189 |
| valves | 170-244-256 | Conduction | 22 |
| velocity of, in pipes | 192-211-214-216 | Connections, mains to | |
| washers | 265 | risers | 122 |
| Anchors for steam pipes | 243 | radiator, single pipe | 134 |
| B | | radiator, two-pipe | 141 |
| Blowers, steel plate | 205-206 | Convection, loss by | 23 |
| Boilers— | | Covering for steam pipe | 252 |
| cast iron, proportions of | 100 | relative value of | 253 |
| central heating | 227 | varying thickness | 254 |
| horsepower of | 99 | varying pressure | 255 |
| hot water | 158 | D | |
| proportions of | 98 | Dampers for hot air flues | 191 |
| types of | 95 | Damper regulators | 264 |
| Boiling point of water | 52 | Dams in return pipes | 102 |
| Brick walls, heat loss | | Direct steam heating | |
| through | 27 | | 41-49-55-75 |
| Buildings, example of heat | | radiation, example of | 77 |
| loss from | 33 | Disc fans | 22-223 |
| heat loss from | 17-27-28 | Doors, heat loss from | 27 |
| materials, heat loss from | 12 | Draining of steam pipes | 102 |
| C | | Drips | 101 |
| Carbon dioxide, amount al- | | Ducts, cold air | 189 |
| lowable | 177 | for fan system | 214 |
| Cast iron boilers, propor- | | for recirculating | 190 |
| tions of | 100 | underground piping | 235 |
| radiators, heat loss from | 55 | E | |
| Ceilings, heat loss from | 27 | Economizers | 250 |
| Central heating, air valves | | Economy of different heat- | |
| for | 244 | ing systems | 36-46 |
| boilers for | 227 | Example, direct steam | |
| carrying of pipes for | 235 | heating | 75 |
| design and location | 226 | fan heating | 223 |
| gravity system | 229 | heat loss from buildings | 33 |

| | Page. |
|---|---------|
| Example, heat lost by con- duction | 23 |
| heat lost by radiation.. | 21 |
| hot air heating..... | 196 |
| hot water heating..... | 152 |
| indirect heating | 90 |
| specific heat | 14 |
| size of steam main..... | 113 |
| in use of steam tables.. | 53 |
| Exhaust steam heating... | 232 |
| steam and hot water heating | 249 |
| Expansion of steam pipes. | 101-118 |
| tanks | 157 |
| Evaporation, latent heat of | 52 |
| total heat of..... | 52 |

F

| | |
|--|------------|
| Factors for exposure..... | 27 |
| Fan coils | 209-212 |
| heaters, dimensions of.. | 13 |
| loss of heat from... | 210-215 |
| heating, air to be sup- plied | 203 |
| systems of heating.. | 44-200 |
| Fans, disc | 222-223 |
| steel plate | 205-206 |
| Fahrenheit temperature... | 12 |
| Fittings | 260 |
| Flow main | 157 |
| riser | 157 |
| of hot water in pipes.. | 168 |
| Floors, heat lost from... | 27 |
| Flues, foul air..... | 193 |
| friction in | 218 |
| hot air | 91-191 |
| materials for | 220 |
| proportions of | 192 |
| recirculating | 190 |
| for indirect radiators... | 91 |
| Flue radiators | 65-92-94 |
| Furnaces, for hot air..... | 39-187-195 |
| Fuel | 99 |

G

| | |
|----------------------------|---------|
| Gases, specific heat of... | 15 |
| Grates, heating by..... | 37 |
| Grates, proportions of .. | 98-195 |
| Gravity system | 110-229 |

H

| | |
|--------------------------------------|-------|
| Hangers for pipes..... | 243 |
| Heat | 11 |
| conduction of | 22 |
| convection of | 23 |
| latent | 51-52 |
| given off by human be- ings | 175 |
| given off by illuminants. | 177 |

Page.

| | |
|---|----------------|
| Heat loss from buildings.. | 17-25-27-28-31 |
| loss from direct radia- tors | 55 |
| loss; effect of height on. | 25 |
| loss from fan heater coils | 210 |
| loss from flue radiators. | 65 |
| loss from hot water ra- diators | 149 |
| loss from indirect ra- diators | 65 |
| loss from pipe cover- ings | 253 |
| radiation of | 18 |
| specific | 14 |
| transmission of, in build- ings | 27 |
| unit of | 13 |
| relation to work..... | 13 |
| Heater coils for fan sys- tem | 209-212 |
| Heating apparatus, classi- fication of | 36 |
| by direct steam..... | 49 |
| by exhaust steam..... | 232 |
| by fan system..... | 200 |
| by hot air | 186 |
| by hot water..... | 147 |
| by high pressure steam. | 230 |
| by indirect steam..... | 81 |
| by low pressure steam.. | 232 |
| surface | 98 |
| Horsepower of steam boil- ers | 100 |
| for disc fan..... | 222 |
| for steel plate fan.. | 205-206 |
| Hot air, heating, example of | 196 |
| furnace | 39-187-194 |
| flues | 91-191-192 |
| Hot water heating, boil- ers | 155-158 |
| pump system | 249 |
| mains, size of..... | 169 |
| natural system | 147 |
| open and closed circuits. | 166 |
| piping | 157-160-169 |
| piping, velocity of flow in | 168 |
| radiators | 148 |
| risers, size of..... | 171 |
| rules for | 152 |
| single pipe system.... | 166 |
| Humidity | 188-264 |

I

| | |
|---------------------------------------|----|
| Indirect heating, example of | 90 |
| rules for | 89 |

| | |
|------------------------------|----------|
| | Page. |
| Indirect heating, hot water. | 43 |
| radiators | 82-85-88 |
| steam | 43-81 |

L

| | |
|----------------------------|-------|
| Latent heat | 51-52 |
| Lighting, pollution of air | |
| by | 174 |
| heat given off by..... | 177 |

M

| | |
|-------------------------------|---------|
| Magnesia pipe covering. | |
| loss from | 253 |
| Mains, return.101-115-116-122 | |
| steam ..101-112-114-116-122 | |
| Moistening of air..... | 188-265 |
| Mineral wool covering..... | 253 |

O

| | |
|--------------------------|-----|
| Overhead steam mains.... | 110 |
| hot water mains..... | 162 |

P

| | |
|-----------------------------|-------------|
| Pipe covering | 252 |
| Pipes, expansion of..... | 118 |
| Piping | 101-155-260 |
| hangers and anchors for.. | 243 |
| capacity of | 114-169 |
| for steam ..101-104-112-122 | |
| for hot water..157-160-169 | |
| pitch of | 102-158-160 |
| underground systems...153 | |
| Properties of steam..... | 49 |
| Pump logs | 237 |

R

| | |
|------------------------------|-------------------|
| Radiation | 18 |
| Radiators, connection of.. | 134 |
| flue | 65-94 |
| heat loss from..... | 68 |
| hot water | 148-152-169 |
| indirect steam ..82-85-89-90 | |
| installation of indirect. 85 | |
| steam | 54-56-68-69-71-75 |
| tappings | 85 |
| Registers | 88-181-191 |
| Regulation of tempera- | |
| ture | 261 |
| Reliefs | 101 |
| Resistance of air flues.... | 218 |
| Return mains.101-112-116-157 | |
| Risers | 101-122-157 |
| Rules for, direct steam | |
| heating | 72-73 |
| fan heating coil..... | 211 |
| heat lost from build- | |
| ings | 29-31 |
| horsepower of fan..... | 207 |

| | |
|----------------------------|-------|
| | Page. |
| Rules for, hot water heat- | |
| ing | 151 |
| hot water piping..... | 170 |
| hot air heating..... | 195 |
| hot air piping..... | 194 |
| indirect steam heating.. | 89 |
| steam pipe sizes..... | 114 |

S

| | |
|----------------------------|-------------------------|
| Siphon | 102 |
| Skylights, heat loss from. | 27 |
| Specific heat | 14 |
| Steam boilers | 95-98 |
| cast iron | 100 |
| heating, direct | |
| | 41-47-104-114 |
| by exhaust | 232 |
| indirect | 43-81 |
| mains | |
| | 102-112-114-116-121-122 |
| piping | 101-104-122 |
| pipes, expansion of..... | 118 |
| radiators, direct | 54-56 |
| flue | 65 |
| indirect | 82 |
| resistance in pipes..... | 242 |
| tables | 51 |
| traps | 104 |
| Steel plate blowers..... | 204 |
| Stoves, heating by..... | 38 |

T

| | |
|----------------------------|-------------|
| Tables, air dilution for | |
| chemicals | 176 |
| changes of air for venti- | |
| lation | 179 |
| conducting power | 22 |
| example for direct ra- | |
| diation | 77 |
| example for hot water | |
| heating | 153 |
| example of hot air sys- | |
| tem | 197 |
| example of indirect heat- | |
| ing | 92 |
| fan heater dimensions.. | 213 |
| heat loss from direct ra- | |
| diation | 55-68 |
| heat loss from flue ra- | |
| diators | 65 |
| heat loss from indirect | |
| radiators | 67-84 |
| heat loss from hot water | |
| radiators | 149 |
| heat loss from fan coils. | |
| | 210-215-216 |
| heat loss from pipe cover- | |
| ings | 253-254-255 |
| heat given off by illumi- | |
| nants | 177 |

| | Page. |
|-----------------------------|---------|
| Tables, hot air systems, | |
| proportions of | 194 |
| porportions of cast iron | |
| boilers | 100-158 |
| products of respiration | |
| from human beings.. | 174 |
| products of combustion | |
| from sources of light. | 174 |
| properties of steam | 52 |
| radiating power | 19 |
| resistance of air flows.. | 218 |
| size of flues for indirect | |
| radiation | 88 |
| size of hot water mains. | |
| | 169-171 |
| size of steam and return | |
| mains | 114-116 |
| specific heat | 14 |
| speed and capacity of | |
| disc fans | 222 |
| speed and capacity of | |
| steel plate fans.. | 205-206 |
| temperature of air leav- | |
| ing indirect radiators | 85 |

| | Page. |
|------------------------------|-------|
| Tables, velocity of flow in | |
| hot water system.... | 168 |
| Thermal units | 11 |
| Temperature absolute | 12 |
| of air leaving hot air | |
| furnace | 195 |
| Fahrenheit | 12 |
| regulation | 261 |
| Tunnels | 237 |

V

| | |
|--------------------------|-------------|
| Vacuum heating systems.. | 268 |
| Valves | 121-233-260 |
| air | 244-256 |
| Ventilation | 172-180 |

W

| | |
|----------------------------|-----|
| Water hammer | 103 |
| line in heating system.. | 102 |
| seal | 102 |
| Windows, heat lost from.. | 27 |
| Wooden houses, heat lost | |
| from | 27 |
| Work, relation to heat.... | 13 |

NOTES ON HEATING AND VENTILATION

INTRODUCTION.

HEAT.

Heat is a form of motion. The modern scientific conception of heat is that it is produced by the motion of the particles of matter which compose any body. All matter is conceived as being made up of small particles called molecules. These particles do not exist in a state of rest, but are in constant vibration. If these particles move slowly the body is at a low temperature; if they move more rapidly the body is at a higher temperature, the temperature of the body being determined by the rapidity of the motion of the particles. In measuring heat there are two properties to be considered—the intensity and the quantity. This may be compared to measuring water in a pipe. We measure the pressure of the water in the pipe by means of a gauge in pounds per square inch. The quantity of water is measured in pounds. In the same way the intensity of heat is measured by the thermometer in degrees and the quantity of heat is

measured by comparison with the quantity of heat which a pound of water will absorb.

Temperature, which is a measure of the intensity of the heat of a body, might also be considered as measuring the velocity of the molecules of the body. In mechanical engineering all measurements of temperature are made on the Fahrenheit scale. On this scale the freezing point is taken at 32° and the boiling point as 212° , the tube of the thermometer between these points being divided into 180 equal parts called degrees.

We never know the total amount of heat in a body. As it is impossible to bring any body to a condition of absolutely no heat, the heat in any body must always be measured from some assumed zero point and in the Fahrenheit scale this assumed zero point is 32° below the freezing point. For theoretical purposes, however, it is highly desirable to have some absolute standard of heat. A perfect gas at 32° contracts about $1/493$ of its volume for each degree Fahrenheit that it is reduced in temperature. If, then, we keep on decreasing the temperature of a perfect gas from 32° , until it reaches a point 493° below 32° Fahrenheit, it would have, theoretically, no volume. If it has no volume, the amount of heat which it contains must be zero. This point, then, is called the absolute zero. This point is manifestly an ideal one. To find the absolute tempera-

ture in degrees it is necessary to add to the Fahrenheit temperature 461 degrees, that is, 32° Fahrenheit corresponds to 493° absolute.

Heat is not a substance and it can not be measured as we would measure water in pounds or cubic feet, but it must be measured by the effect which it produces. **Unit of Heat.**

Suppose it requires a certain amount of heat to raise a pound of water from 39° to 40° Fahrenheit. It would require three times that quantity of heat to raise a pound of water from 39° to 42° Fahrenheit. The heat required to raise a pound of water one degree Fahrenheit is called a British thermal unit, and is designated by letters B. T. U.

Work is measured in foot-pounds. The unit of work is the work required to raise one pound through a height of one foot.

Ten units of work or ten foot-pounds would be the amount of

**Relation Between
Heat and Work.**

work done in raising ten pounds one foot high or one pound ten feet high. Heat is a form of motion, hence there must be some definite relation between heat and work. This relation was first determined by Joule. By a series of experiments Joule found that one heat unit was equivalent to 778 foot-pounds. It is possible, then, to express heat either in heat units or in foot-pounds.

Different substances require very different quantities of heat to produce the same change of temperature for the same weight. As

Specific Heat. for example, to raise one pound of water one degree requires one B. T. U.; to raise one pound of ice one degree requires .504 B. T. U.'s; to raise one pound of wrought iron one degree requires .1138 B. T. U. The heat necessary to raise one pound of a substance one degree, expressed in British thermal units, is called specific heat. The following table gives the specific heat of the principal substances which we meet with in engineering work:.

| SUBSTANCE— | B. T. U. |
|--------------------|----------|
| Water | 1 |
| ice | .504 |
| Glass | .197 |
| Cast iron | .1298 |
| Soft steel | .1165 |
| Wrought iron | .1138 |
| Copper | .0951 |
| Brass | .0939 |
| Tin | .0569 |
| Lead | .0314 |

It is required to raise the temperature of a cast iron radiator weighing 300 pounds from 70° to 212°. The temperature through

Example. which the iron would be raised would then be 212 minus 70° or 142°. From the table we see that it would require to raise one pound of cast iron one degree .1298 heat

units, then to raise one pound 142° would require 142 times .1298 or 18.43 heat units, and to raise 300 pounds one degree would require 300 times this amount or 5,529 B. T. U.'s, the heat required to heat the radiator.

In solid substances the change in volume when they are heated is so small that it is not considered. In gases, however, the change in volume when the gas is heated without being confined, depends directly upon the absolute temperature and may be very large. When air is confined and is heated, it cannot expand; if it does not expand there is no work done because, from our definition of work, it is necessary when work is done, that the body have some movement. On the other hand, when air receives heat and is free to expand it does work. For instance, if air were confined in a cylinder by a piston, and this air were heated, the air would expand and the piston would be moved out. As the piston is moved through a certain space there must be work done. On the other hand, if the piston were blocked so that it could not move, then the air on being heated would do no work. Then in these two cases different amounts of heat will be required to raise the substance one degree, depending upon whether there is external work done or not.

It is necessary in gases that we consider two specific heats, the specific heat of constant volume and the specific heat of constant pressure. For air

the specific heat of constant volume is .1689, for constant pressure it is .2375. It is seldom that we use air in a confined space, so that, so far as this work is concerned, we shall in most cases consider the specific heat of air as .2375—that is, to raise one pound of air one degree requires .2375 B. T. U., the pressure being constant.

CHAPTER I.

HEAT LOSS FROM BUILDINGS.

Heat is lost from a room in three ways—by the direct transmission of the heat through the walls and windows; by the passage of air up the foul air flues, and by the filtration of air through the

**Loss of Heat.
From Buildings.**

walls and air leakage around doors and windows. The first two losses are easily determined, but the determination of the loss by filtration must always involve a large factor of judgment and experience.

All building construction is more or less porous. This is well exemplified by the old experiment made with a common brick. Two cornucopias of paper are pasted on opposite sides of a common brick, the large end of the cornucopias being fastened to the brick. Opposite the small end of the cornucopia at one side is placed a lighted candle. By blowing into the cornucopia on the opposite side, the candle may be blown out, the air having passed directly through the brick.

The experiments which have been made in order to determine this loss generally tend to show that in the ordinary well-constructed building the air in the room will change about once per hour, when all doors and windows are closed.

In order to study the other heat losses from a room it will be necessary to study the laws of cooling. A body may be cooled in three different ways—by radiation, by conduction and by convection (contact of air). In order to understand these losses more thoroughly, each will be considered separately.

The heat that passes from a body by radiation may be considered similar to the light which is given off by a lamp. There is always a transfer of radiant heat from the body of a higher temperature to the body of lower temperature. The amount of heat radiated will depend upon the difference in temperature between the bodies and the substance through which this heat passes and the condition of the surface from which the heat is radiated.

The losses by radiation may be better understood by referring to Fig. 1. Suppose the plate PP to be of cast iron 1 foot square and 1 inch thick. Let us suppose this plate to be on both sides at a temperature of 60° . Let this plate form one side of a room, the walls WWW being non-conducting substances and at a temperature of 59° , the air in this space being at a temperature of 60° . Since the plate and the air in the space are at the same temperature, there will be no loss of heat from the air to the walls, but all the heat that passes from the plate PP to the walls must pass by radiation. For ordinary temperatures of heating surfaces, say 60 or 70° , the

loss by radiation will equal the difference in temperature between the hot body and the cold body multiplied by a factor representing the radiating power of the body. The following table gives the radiating power of different substances :

Table II—Radiating Power.

| Radiating power of bodies, expressed in heat units, given off per square foot per hour for a difference of one degree Fahrenheit. (Péclet.) | |
|---|-------|
| Copper, polished | .0327 |
| Iron, sheet | .0920 |
| Glass | .595 |
| Cast iron, rusted..... | .648 |
| Building stone, plaster, wood, brick..... | .7358 |
| Woolen stuffs, any color..... | .7522 |
| Water | 1.085 |

Heat is radiated in straight lines exactly as light is given off from the source of light. We may have heat shadows the same as we have light shadows and the intensity of the heat is inversely proportional to the square of the distance from the source. Some bodies are transparent to heat and other bodies absorb heat, the same as some bodies are transparent to light and others absorb light. The transparency of bodies to heat is called diathermancy. Gases, such as air, oxygen, nitrogen, and hydrogen, are almost perfectly transparent to heat, while wood, hair, felt and other non-conducting bodies are almost perfectly opaque to the transmission of heat. The loss of heat by radiation is independent of the form of a body so long as it does not

radiate heat to itself. The color or condition of the surface of different bodies affects their radiant power. Smoothly polished surfaces radiate less heat than rough surfaces. As, for instance, a sur-

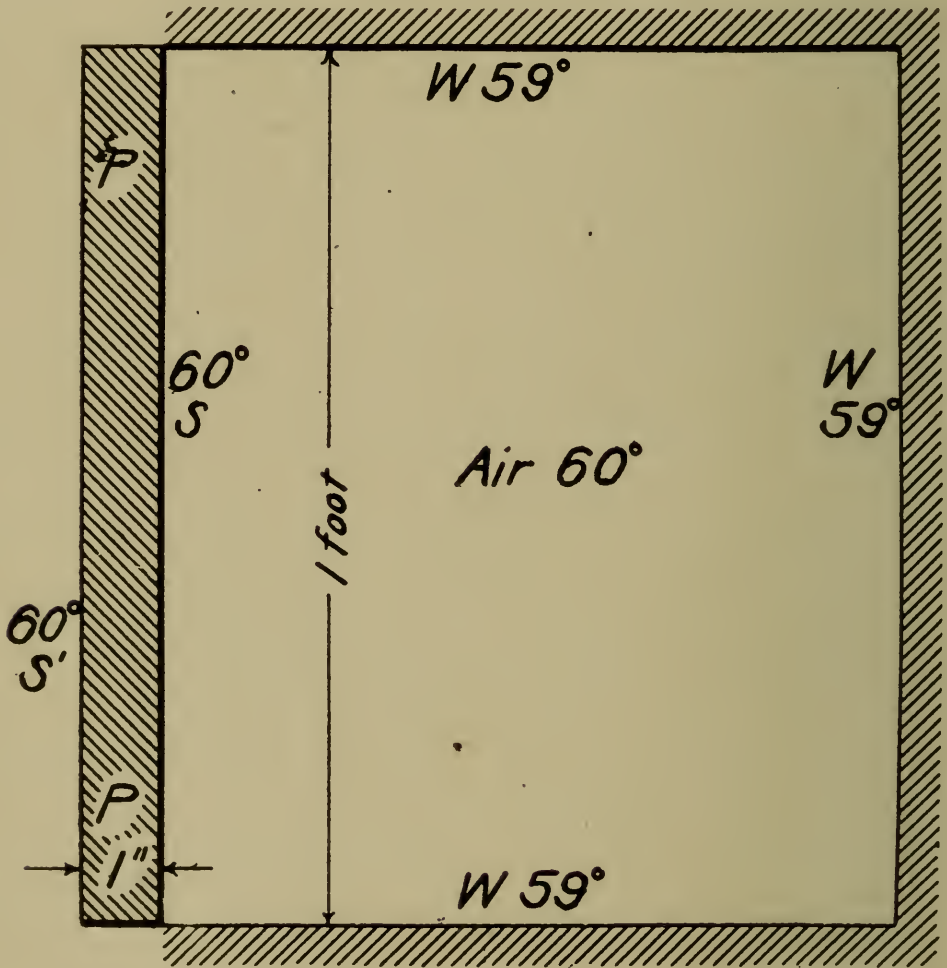


Figure 1.

face painted with lamp black will radiate over 13 times as much heat as a polished copper surface.

Suppose we have a glass surface five square feet in area. The glass surface is at a temperature of

70° and the objects surrounding it are at a temperature of zero.

Example.

From the table we see that one square foot of glass (surface) loses .595 heat units in an hour for a difference of one degree between

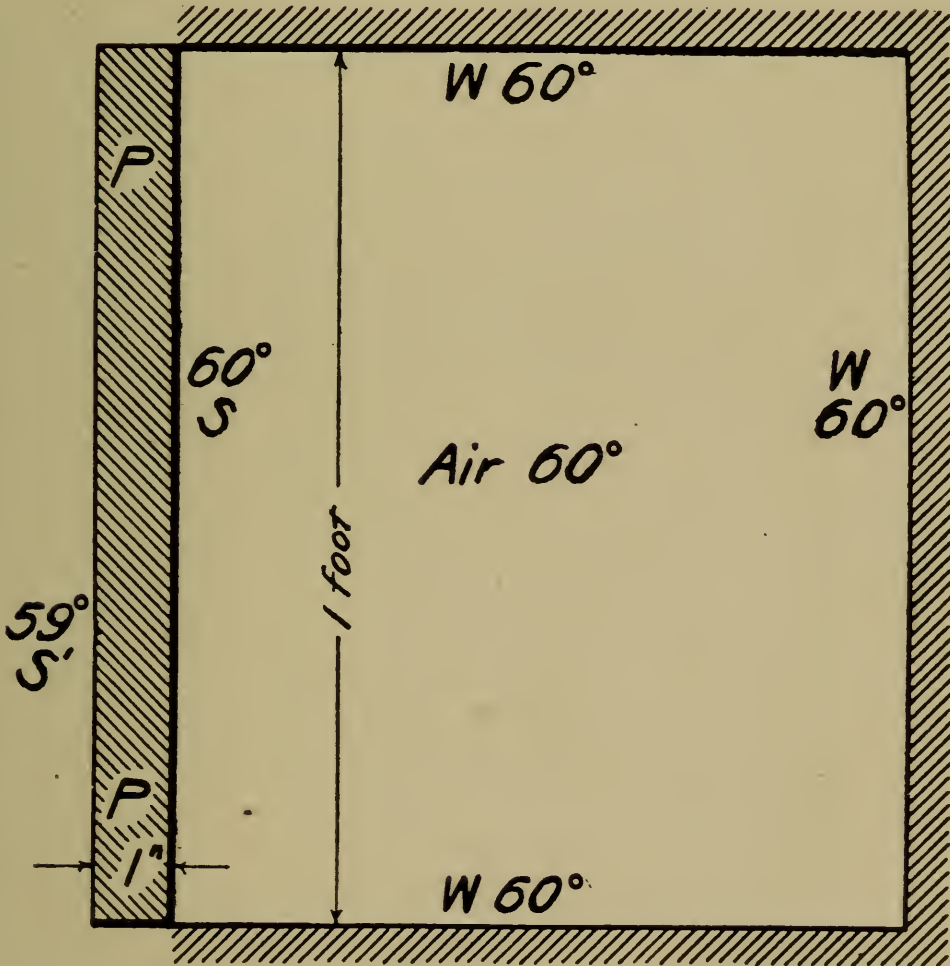


Figure 2.

it and the surrounding objects. For a difference of 70°, then, each square foot of glass would lose 70 times that amount, or 41.5 heat units, and 5 square

feet of glass would lose 5 times that amount, or 207.5 heat and units per hour.

The heat transmitted by conduction is the heat which is transmitted through the body itself. For

example, take the condition
Conduction. shown in Fig. 2. PP is a plate,
 one side of which is enclosed by

the walls WW. Let the temperature of the plate outside be 59°, the temperature on the inside of the plate be 60°; the temperature of the walls be 60°,

Table III—Conducting Power.

The conducting power of materials, expressed in the quantity of heat units transmitted per square foot per hour by a plate one inch thick, the surfaces on the two sides of the plate differing in temperature by one degree. (Peclet.)

| | B. T. U's. |
|--------------------|------------|
| Copper | 515 |
| Iron | 233 |
| Lead | 113 |
| Stone | 16.7 |
| Glass | 6.6 |
| Brick work | 4.8 |
| Plaster | 3.8 |
| Pine wood | .75 |
| Sheep's wool | .323 |

the temperature of the air in the room be 60°. Then all the heat that is lost by the room must be lost by direct conduction through the plate PP. The amount of heat conducted will depend upon the material of which the conductor is composed and in addition it will also depend upon the difference in temperature between the two sides of the plate and upon the thickness of the plate. The conduction through any plate may be calculated as follows:

Multiply the factor given in Table III by the difference in temperature between the two sides of the plate and divide the result by the thickness of the plate in inches. The quotient will be the heat transmitted by conduction per square foot of surface.

Suppose a boiler plate 5 feet square, $\frac{1}{2}$ -inch thick, to have a temperature of 70° on one side and a temperature on the opposite of 200° .

The difference in temperature of the two sides of the plate would be 130° . The amount of heat conducted would then be $233 \times 130 \div 1/2 = 15145$ B. T. U.'s, the heat transmitted per square foot of plate. Then five square feet would transmit five times this amount, or 75,725 B. T. U.'s in one hour.

Example.

Loss by convection is sometimes termed loss by contact of air. Take, for example, the condition shown in Fig. 3. Let P be a vertical plane of metal one foot square, having its surfaces main-

Convection.

tained at 60° temperature. Let the walls WW also be at a temperature of 60° . Let the air in the room be 59° . In this case there will be no loss of heat from the walls to the plate by radiation and there will be no loss through the plate by conduction, but heat will be transmitted from the walls and the plate to the air of the room. The air which comes in contact with the warmer walls will be heated. As air is heated it becomes lighter and rises and a current

is formed. This produces a circulation of air, and this circulation of air gives rise to a loss of heat by convection or contact of air.

The loss of heat by convection is independent of the nature of the surface, wood, stone or iron losing

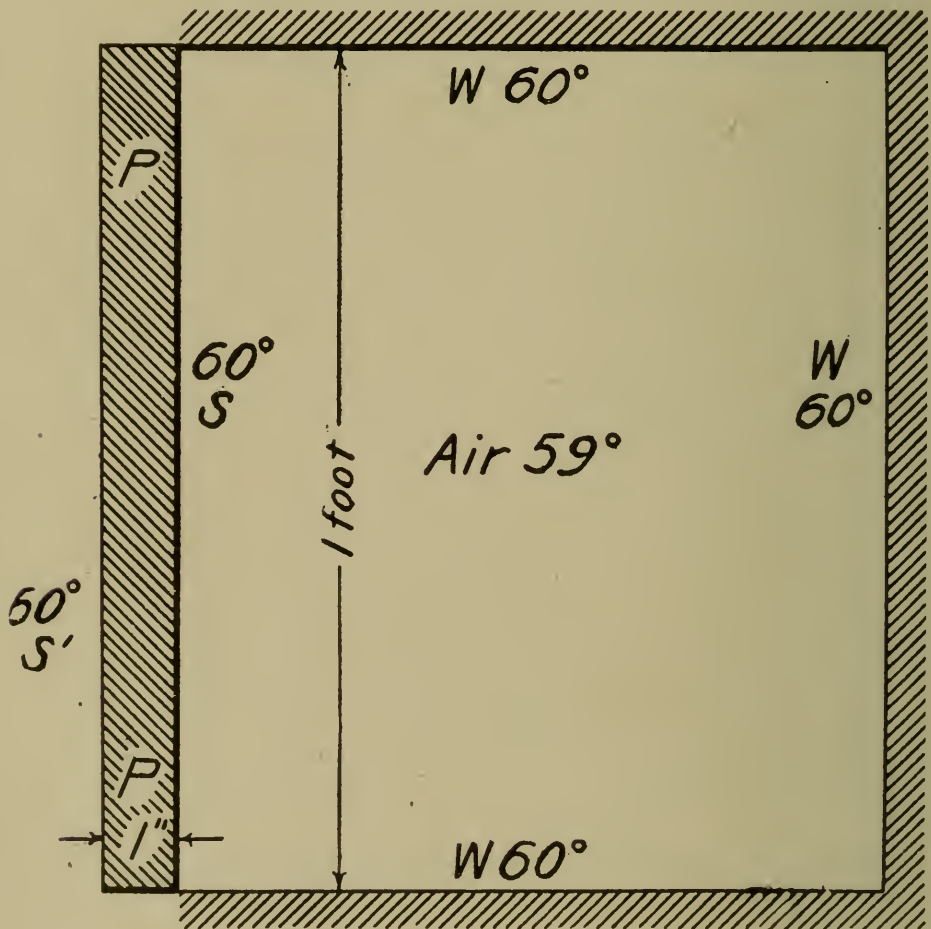


Figure 3.

the same quantity of heat, but it is affected by the form of the body—that is, a cylinder and a sphere would lose different amounts of heat per square foot. Take the steam radiator, for example. The

air nearest the radiator becomes heated and rises; as it rises its place is taken by other colder air coming off the floor so that a current of air is established. In the ordinary type of radiator, the loss by contact of air represents about half the loss of heat, the balance being loss by radiation.

The calculation of the heat lost by convection is quite complicated and different expressions have been derived for this loss for different forms of surfaces. Those developed by Peclet are given in Box's treatise on Heat.

**Calculation of
Convection
Losses.**

The rules given for convection in the text-books on heat cannot, as a rule, be applied to the loss of heat from buildings. All these rules assume that the air surrounding the object is in a perfectly quiescent state. In buildings this is not the case, for the air surrounding a building is rapidly circulated by the winds. Theoretically a high building would lose proportionally less heat than a low building, because in the upper stories there would be a smaller difference in temperature between the air inside the room and the air outside than in the lower stories. This, however, is not the case, as the wind circulates the air outside the building and makes the temperature of the air surrounding the building on the outside practically the same at all levels.

Inside the room, however, the air at the top of the

room is much warmer than that at the floor. The result is that the rate of transmission of heat in rooms with high ceilings is appreciably higher than in rooms with low ceilings, as in the room with a high ceiling we have a greater difference of temperature between the inside and the outside air at the ceiling. This difference is not ordinarily considered unless the height of the room exceeds ten feet. If the height of the room does not exceed ten feet the temperature taken five feet above the floor line may be assumed at the average temperature in the room.

The loss of heat from buildings was first investigated both experimentally and theoretically by Peclet. The greater part of his work is given in Box's treatise on Heat. The results obtained by Peclet are difficult to apply practically and nearly all the rules that are used to determine the loss of heat from a building are largely empirical. The constants determined by the German government are probably the most reliable we have. They are given in the following table, the results being expressed in the heat units transmitted per square foot of surface per degree difference of temperature.

It is found that the thickness of glass in the window makes a difference in the heat transmission. Plate glass transmits about 30 per cent less than single glass, but this is only approximate. In the table below double glass refers to two sheets of

glass with an air space between, what is sometimes called double glazing. Where brick walls are made double with air space between the air space will reduce the loss of heat about 20 per cent below that given by a solid wall.

The heat losses given in the following table should be increased as follows: Where the room has a north exposure and the winds are severe, add 10 per cent. When the building is heated in the day time only and allowed to cool during the night, add 10 per cent. When the building is heated occasionally—for ex-

Factors for Exposure.

| SURFACE. | B T. U per hour per sq ft. per degree difference of temperature. |
|---|--|
| Window, single glass..... | 1.03 |
| Window, double glass..... | .518 |
| Skylight, single glass..... | 1.118 |
| Skylight, double glass..... | .621 |
| Brick wall 4 inches thick..... | .68 |
| Brick wall 8 inches thick..... | .46 |
| Brick wall 12 inches thick..... | .32 |
| Brick wall 16 inches thick..... | .26 |
| Brick wall 20 inches thick..... | .23 |
| Outer doors..... | .42 |
| Floors, wooden beams, planked..... | .083 |
| Floors, fireproof, floored with wood..... | .124 |
| Ceilings, wooden beams, planked..... | .104 |
| Ceilings, fireproof construction..... | .145 |
| Ordinary wooden house construction..... | .25 |

ample, a church—add from 40 to 50 per cent. Where a room has a northerly exposure and is subjected to extremely high winds, add 30 per cent. It is usually advisable to assume for unwarmed spaces, such as

cellars and attics, a temperature of about 32° . For vestibules and entrances unheated, which are being frequently opened to the outer air, a temperature of 20° may be assumed.

In determining the loss of heat from a building all surfaces should be considered which have on the side opposite the room a lower temperature than the temperature in the room. If a room is situated over a portion of the cellar which is not heated, the loss of heat through the floor should be considered. If the room has over it an unheated attic the loss through the ceiling should be considered. The loss through the sides of a room which is surrounded by rooms at the same temperature may be neglected. Doors entering directly into a room are considered to lose the same amount of heat as the windows.

A common rule for the loss of heat from a building is that given by Professor R. C. Carpenter in his book on "Heating and Ventilation." This rule is developed from the following consideration. Referring to Table IV., we notice that one square foot of glass conducts approximately four times as much heat as a brick wall 20 inches thick. If, then, we divide the wall surface by 4, the result will give us

**Determination of
the Loss of Heat
From a Building.**

**Rules for Determining the Loss
of Heat.**

the number of square feet of glass surface, which would lose the same quantity of heat. Adding to this the actual glass surface would give us the total equivalent glass surface. In addition to this heat transmitted through the walls we must add the heat which is lost by the air which passes directly through the walls themselves. It is assumed that for ordinary sized rooms the air in the room will be changed about once an hour, so that we must figure on heating the entire air in the room about once per hour. One cubic foot of air weighs, approximately, $1/13$ of a pound. To raise a pound of air one degree requires .238 B. T. U.'s. Then to raise one cubic foot of air one degree would require $.238 \times 1/13 = .0183$ B. T. U. or one heat unit will heat $1 \div .0183 = 54.6$ cubic feet, or in round numbers say 55. If, then, we divide the contents of a room by 55 we will have the heat lost by filtration through the walls. Adding these factors together will give the total heat lost from the room. This rule may be expressed more concisely as follows:

RULE 1.—Divide the contents of the room by 55; add the glass surface and to this the wall surface divided by 4. The sum will be the heat lost from the room per degree difference of temperature between the air in the room and the air outside the room. Multiply this sum by the difference in temperature between the air inside the room and

that outside of the room and the product will be the heat lost from the room.

This rule can be expressed algebraically as follows:

Let C represent the volume of the room, W the wall surface, G the glass surface and d the difference of temperature between the air outside and the air inside the room. The heat loss from the room per hour expressed in B. T. U.'s would be

$$\left[\frac{Cn}{55} + \frac{W}{4} + G \right] d$$

where n is a factor which depends upon the tightness of the room and varies in value from 1—3. For ordinary room $n=1$, for corridors 1.5, for vestibules 2 to 3.

It is quite customary to assume the difference in temperature between the air in a room and the air outside to be 70° . Where the windows are poorly fitted or the house loosely built the loss by filtration should be doubled, and in halls where the doors are being opened and closed frequently this should be multiplied by three.

There is one criticism on this method of figuring the heat lost in the room. The diffusion loss is assumed to depend upon the cubic contents of the room. This of course is manifestly not correct, as the diffusion loss occurs through the walls and windows and must depend upon the area of the walls and windows. The rule, however, will work

very well for rooms of average size, but where the rooms have excessive wall and window surfaces, or where the cubic contents of the room is large compared to the wall and window surfaces, this rule will give inconsistent results. The following rule seems to the author to be capable of a much wider application:

RULE 2.—Divide the wall surface by 4; add the glass surface; multiply this sum by the difference in temperature between the air in the room and the air outside, and then multiply the result by $1\frac{1}{2}$. This rule is for a well constructed building. If the building is old and poorly built, then instead of multiplying by $1\frac{1}{2}$ the result should be multiplied by 2; entrance halls multiplied by $2\frac{1}{2}$.

This rule may be expressed algebraically as follows:

Let W represent the wall surface, G the glass surface and d the difference of temperature between the air outside and the air inside the room. Then the heat loss from the room per hour expressed in

B. T. U.'s would be $\left[\begin{array}{c} W \\ - + G \\ 4 \end{array} \right] d n$, where n is a factor which depends upon the construction of the house or location of the room and varies in value from 1.5 to 2.5 as stated above.

In figuring the radiating surface for any room the cubic contents should always be taken into con-

sideration. In a large room with a small exposed wall surface, if only enough radiation is put in to cover the loss from walls and windows, the room will be slow to heat. In addition to taking care of the loss from walls and windows it is necessary for the radiator to heat the air in the room itself. In order to do this a large proportion of this air must either pass through the heating device or be carried out by the ventilating flues, so that where the cubic contents of a room is large it is advisable to add from 10 to 20 per cent to the radiating surface to allow for the heating of the air in the room itself. The above remark applies only when the building is intermittently heated; when the building is continuously heated it is not necessary to consider the volume of the room.

The following temperatures are usually assumed in determining the heat losses :

Table V—Temperatures Assumed in Heating.

| | Degrees |
|---|----------|
| Temperature of the outside air..... | 0 |
| Temperature of stores | 68 |
| Temperature of residences | 70 |
| Temperature of halls and auditoriums..... | 64 |
| Temperature of prisons | 68 |
| Temperature of factories..... | 60 to 68 |
| Temperature of cellars not warmed..... | 32 |
| Temperature of attics not warmed..... | 32 |
| Temperature of outside entrances..... | 20 |

The average temperature for the period of the year during which buildings are heated throughout

the Central States may be assumed to be approximately 35° .


The following examples will show the method to be pursued in determining the heat lost from a building.

Suppose a room, as shown in Fig. 4. Let the temperature be maintained in the room at 70 degrees, the temperature of the outside air be 0 . Let the walls be of brick 8 inches thick, plastered on the inside, the windows be $2\frac{1}{2} \times 6$ feet, the ceiling of the room be 10 feet high. Let the room be on the second floor of the building, the rooms above and below heated. The window surfaces are $2 \times 2\frac{1}{2} \times 6 = 30$ square feet. The total wall surface is $20 \times 10 = 200$ square feet. The net wall surface is $200 - 30 = 170$ square feet. Then the heat lost from the room per degree difference of temperature by rule 2 would be $170 \div 4 + 30 = 72\frac{1}{2}$. As the difference between the outside and inside temperature is 70° , the total heat lost is $72\frac{1}{2} \times 70 = 5075$ B. T. U. per hour.

Example 1.

Example 2.

Take the same room as in Example 1, except that the room is covered by a flat tin roof. The air space between the ceiling of the room and roof should be assumed to be at a temperature of 32° . Then, in addition to the loss figured in Example 1, there will have to be added the loss due to

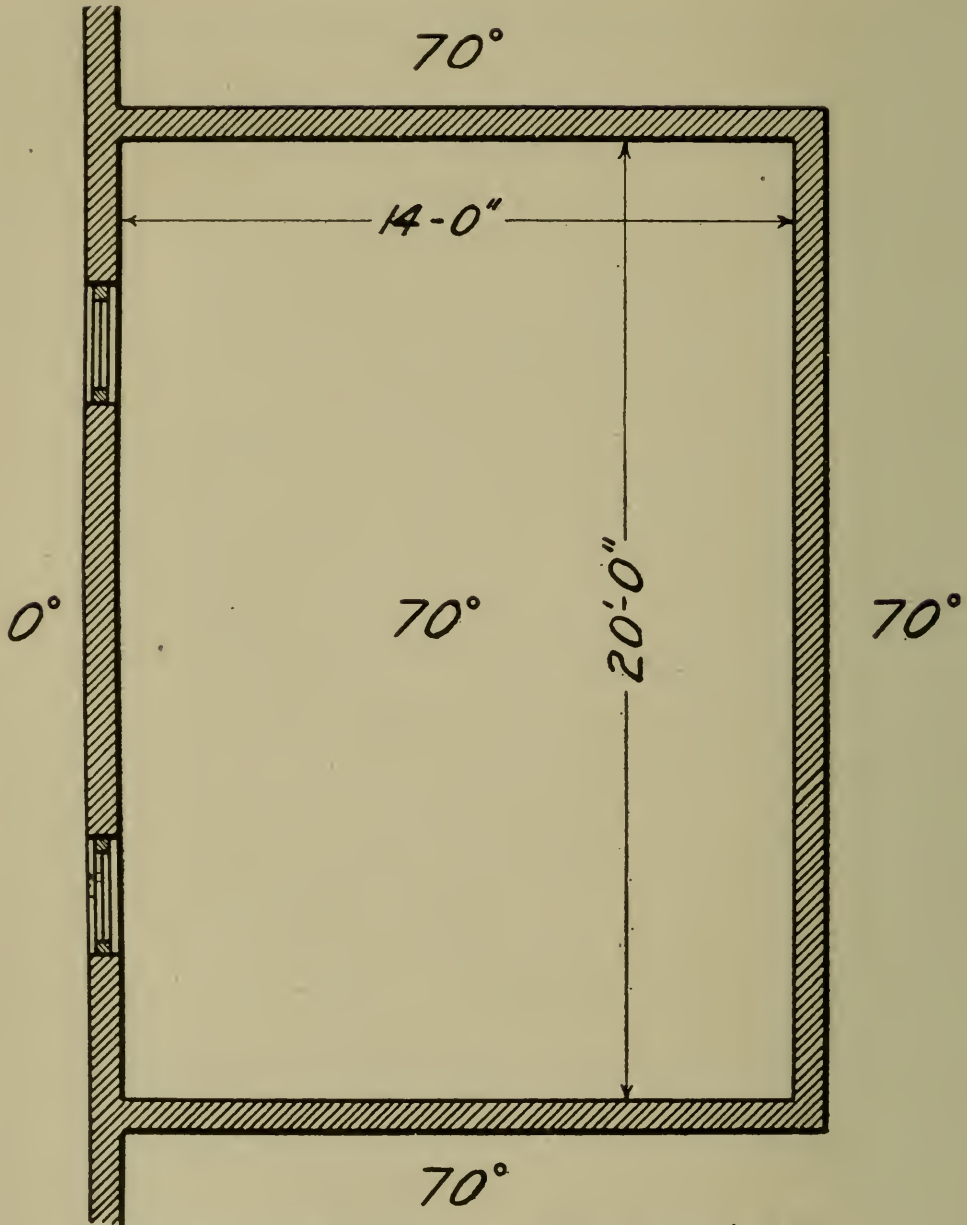

Note: Windows 2'-6" x 6'-0" .

Figure 4.

the tin roof. The area of the ceiling of the room would be $14 \times 20 = 280$ square feet. Referring to Table IV we find the loss per hour through ceilings

of wooden construction to be .104 B. T. U.'s per degree difference of temperature; then the loss through this ceiling would be, per degree of temperature, $.104 \times 280 = 29.1$ B. T. U.'s. The room being at 70° and the attic space 32° , the difference in temperature would be $70 - 32 = 38$ degrees. The total loss through the ceiling would then be $29.1 \times 38 = 1105.8$ B. T. U.'s. Adding this to the loss found in Example 1 we have a total loss from the room, $5,075 + 1105.8 = 6180.8$ B. T. U.'s.

CHAPTER II.

DIFFERENT FORMS OF HEATING.

The different heating systems may be classed under two general heads—Direct and Indirect. In direct heating the heating surfaces are placed in the rooms to be heated, as, for instance, stoves, steam radiators or hot water radiators. In indirect heating systems the heating apparatus is usually placed in some other room and the heat carried to the room to be heated by means of pipes. Under this head would be included hot air furnaces and the various systems of heating in which fresh cold air is made to pass over steam or hot water radiators on its way to the room.

The indirect systems of heating naturally divide themselves into two other classes, those using natural draft and those using forced draft. A good example of natural draft indirect heating is the hot air furnace, where the circulation of air through the house is produced by the difference in temperature between the air in the hot air flues and the cold air outside the flues. The fan systems of heating, used in heating school buildings and churches, are good examples of the forced draft system. In

this case the draft is largely produced by mechanical means, usually a disc fan or a pressure blower.

In order to understand better a discussion of the various forms of heating which will come later, it is desirable to understand in general the advantages and disadvantages of the various forms of heating.

The most primitive form of heating apparatus is the grate. In the grate the air which passes through the fire and is heated by the fire all passes up the chimney and only the heat given off by radiation to the walls and objects in the room is effective in heating the room. In grates of better construction this is somewhat improved by surrounding the grate by fire brick so arranged that the brick will become highly heated and radiate heat to the room. But the fact that all the air heated by the grate passes up the stack makes this a very uneconomical form of heating. In the best form of open grates only about 20 per cent of the heat of the fuel is effective in heating the room. This form of heating, however, has been defended by many. It is a very popular form of heating throughout England and Scotland. The feeling of a grate-heated room is quite different from that of a room heated by other systems. All the heat is given off by radiation and the air in a grate-heated room is at a considerably lower temperature than the objects and persons in

Grates.

the room, owing to the fact that radiated heat does not heat the air through which it passes. The air of the room being at a lower temperature, its capacity for moisture is not increased as much as it would be were the air heated to a higher temperature. The result is that the air contains proportionally more moisture than is the case in other forms of heating. This, no doubt, is an advantage. On the other hand it is impossible to heat the room uniformly, and a person is hot or cold, depending upon his distance from the grate. Heating by means of grates is practiced only in the more moderate climates. The grate is useful in houses heated by other forms of heating, as it serves as a most efficient foul air flue. The introduction of a large number of grates into a house adds materially to the ease with which the house may be ventilated.

The stove is a marked improvement over the grate as a form of heating, particularly from the standpoint of economy. The modern

Stoves. base burner stove is one of the most economic and efficient forms of heating, making use of from 70 to 80 per cent of the heat in the fuel. In heating by a stove the heat is given off both by radiation and by convection. The hot surface of the stove being at a higher temperature than the surrounding objects in the room, radiates its heat directly to these objects. In addition the air surrounding the stove is

heated and rises, passing along the ceiling to the cold wall and window surfaces where it is cooled, drops to the floor and passes along the floor back to the stove to be again heated. In selecting a stove to heat a given room care should be taken to select one of ample size so that only in the coldest weather would it be necessary to crowd it; that is, keep on the drafts in order to heat the room. At the present time the stove as a general source of heat is being rapidly discarded because of the attendance required, the space occupied and the unsightly appearance of the stove. Another serious objection to the stove is the fact that it does not furnish ventilation to the room which it heats.

The hot air furnace is a natural outgrowth of the stove. In this system one large stove is placed in the basement of the building, the air is taken from the outside, passed over the surfaces of the stove or furnace, carried up through the flues to the rooms to be heated. The principal advantage of the hot air furnace is that it provides a cheap method of furnishing both heat and ventilation, it requires little attendance and does not deteriorate rapidly when properly taken care of. (The greatest disadvantage of this system is in the fact that the circulation of the heated air depends entirely upon natural draft; that is, it depends upon the difference in weight between the air inside the flue and the air

Hot Air Furnaces.

outside the flues. This difference of weight is extremely small, so that the force producing circulation in the flue is always small. This force is easily overcome either by the winds or by the resistance of the piping. When a very strong wind blows against one side of the house it is difficult to heat the rooms on that side of the house. If the system is carefully designed, however, this difficulty can be overcome in a measure. Another serious objection to the hot air furnace is that it is seldom dust tight and dust and ashes are carried into the room. In general, however, the hot air furnace may be considered as a very good type of heating plant for small residences.

In the case of the hot air furnace the heat is carried to the room by convection, as all heat is carried from the furnace by the air which passes around the furnace and enters the rooms from the flues. This air circulates in the room and heats the objects and air in the room. The efficiency of the hot air system will vary, depending on the relative proportion of the air taken from outside and upon the temperature of the air entering the room. If the cold air entering the furnace is taken from the house itself and not from outside the efficiency of the hot air furnace will be almost the same as that of a steam furnace; that is, from 70 to 75 per cent of the heat of the coal will go into the rooms. If, however, the cold air is taken from outside, then

the heat used in heating the air from the temperature of the outside air to the temperature of the room will be lost, and under ordinary conditions of operation the efficiency would be from 50 to 60 per cent.

From the standpoint of ventilation direct steam heat has little advantage over a stove, as it gives no means of supplying fresh air. Its use in general should be confined to rooms which require little or no ventilation. Mechanically, however, it has many advantages over the stove or the hot air furnace. The boiler for a building having this form of heating can be located anywhere in the basement, and the rooms are free from dirt or gas. The modern radiator is easily adapted to almost any location in the room, it is not affected by wind or local conditions, and a distant room may be heated as easily as one close to the furnace. The efficiency of the direct steam heating system is about the same as that of a stove, and with a well-installed plant from 70 to 80 per cent of the heat of the fuel will be delivered by the radiator to the room.

**Steam Heating,
Direct.**

The application of direct hot water radiators as a method of heating is similar to that of steam, with the exception that the surfaces are at a much lower temperature and hence more radiating surface will be required. It has an advan-

Hot Water, Direct.

tage over steam in that the temperature of the heating surface can be controlled easily, and can be anywhere from the temperature of the room to 200 degrees. In the steam radiator the surface is usually not less than 212 degrees. The principal disadvantage of this system is in the fact that the circulation of the system is by natural circulation; that is, the circulation is produced by a difference in weight between the water in the hot leg of the system and in the cold leg of the system. This difference in temperature is usually about 10 degrees, so that the difference in weight between these two columns of water is small and the resulting force producing circulation is, of course, small. It is necessary to be very careful in designing the piping for the hot water system, as the circulation may be easily affected by resistance of the pipe. In addition it will be affected by the height of the radiator above the boiler; the greater the height above the boiler, the greater will be the difference in weight between the two columns of water and the stronger will be the force producing circulation. This system in general requires more careful design and construction than the steam system. The efficiency of the hot water system is practically the same as that of steam, and we may expect to obtain in the room from 70 to 80 per cent of the heat in the coal.

In heating with indirect steam radiation cold air

is drawn from the outside, passed through and around the hot radiator, which is usually situated in the basement, and delivered by pipes to the rooms to be heated. The rules governing the introduction of air into the rooms and the method of running pipes is similar to that employed with hot air furnaces. The principal advantages of indirect steam over hot air are: Each room has a separate source of heat, the system is not affected by the winds and no dust or obnoxious gases are carried to the rooms.

Indirect Steam Heating.

The air entering the room will always be as pure as the air which furnishes the source of supply. The source of heat being independent of the position of the boiler, it is possible to place the indirect radiator anywhere in the building and long hot air pipes are not necessary. This makes the indirect radiator much more efficient and more certain in operation than the hot air furnace. The efficiency of this system, from the standpoint of coal consumption, will be much less than in direct forms of heating and about the same as the hot air furnace; that is, from 50 to 60 per cent of the heat of the coal will be used effectively in heating.

The application of hot water indirect is similar to that of steam and the efficiency is practically the same. The use of hot water indirects has

Indirect Hot Water Heating.

been much more limited than the use of steam indirects. The installation of hot water indirects must be done with great care so that each radiator will at all times have the proper amount of hot water circulating through it. In the hot water indirect radiators, if for any reason the water in the radiator becomes cooled, the radiator will be in danger of freezing. In mild climates this difficulty would not be as serious as in locations where the weather is extremely cold.

In buildings of a public or semi-public character, where a large number of people are to be assembled in a relatively small space, it is necessary to provide adequate ventilation. In the systems that have been previously described it is impossible to introduce into the room sufficient quantities of air to ventilate the rooms properly. It may be said in general that no system of natural circulation has ever produced satisfactory ventilation in a room occupied by a large number of people; it is necessary to provide some means of mechanically circulating the air. This is done in the fan system by means of a pressure blower or a disc fan.

In the fan system the pressure produced by the fan makes the circulation so positive that it is not affected by winds or by the distance of the room from the fan itself. The air is taken from the out-

side, passed through the heating coils and forced into the building by the fan.

There are two general methods of heating and ventilating with the fan system. In one system the air is first passed through a tempering coil, then taken by the fan and delivered through a heating coil. Each room has a connection both to the hot air and to the tempered air chamber. The temperature of the air in the room is adjusted by taking the air either from the hot air chamber or from the tempered air chamber. In the second system the rooms themselves are heated by means of direct radiation and the fan delivers air to the rooms only for the purpose of ventilation. In this case no heating coils would be necessary.

In the first method the economy of the system is low, as owing to the large amount of air required for ventilation the quantity of air introduced into the room is ordinarily greater than is necessary for the purpose of heating the room. The economy of this form of fan system depends very largely upon the amount of air necessary, but in most cases its efficiency would not exceed from 40 to 50 per cent; that is, only 40 to 50 per cent of the heat units in the coal would be effective in heating. In the combined fan system, where direct radiation is used for heating and the fan system for ventilation, the economy of the system is better, probably from 50 to 60 per cent.

The increase in economy of this system is due to the fact that it is necessary to run the fans only when it is necessary to ventilate the building.

In addition to the combination just described, of direct radiation and fan ventilation, there have been devised innumerable combinations, combinations of direct and indirect steam, direct and indirect water, water and hot air, steam and hot air. Probably the combinations which have been most used have been combinations of direct and indirect steam and the combinations of hot water and hot air.

The economy of any heating system depends upon the completeness with which the coal in the furnace is burned and the heat lost by the chimney and the ventilating flues. If, with each of the above systems the coal was completely burned and all the heat given off were used, then each one of the systems would have perfect efficiency.

The losses from any system, given in detail, are as follows: *Loss through imperfect combustion of coal, through the escape of hot gases up the chimney and the loss of heat in the air passing up the ventilating flue.*

If the furnace is properly constructed and insures good combustion, the loss due to imperfect combustion is small. The loss of heat passing up the

chimney will depend upon the temperature at which the gases leave the chimney and the amount of air used to burn a pound of coal. The loss by the ventilating flue will depend upon the amount of air it is necessary to supply to the rooms for ventilation.

If the hot gases leave the heating apparatus at the same temperature and the same amount of air is used for ventilation, then the efficiency of each system will be practically the same. If the rooms are not ventilated, then, of course, the loss due to the heat passing up the ventilating flues will be saved and the system will be more economical. In fact, strictly speaking, the loss by ventilation should not be considered as entering into the efficiency of the system. This loss is entirely independent of the system used and depends entirely upon the amount of air which must be supplied for purpose of ventilation. It is quite obvious that any system involving ventilation will require a greater amount of coal. The loss due to ventilation is due to the fact that all the heat which is given to the air between the temperature of the air outside the building and the air in the room is ineffective in heating and is lost up the ventilating flues. It would be poor policy, however, for the designers of heating systems to cut down the amount of ventilation in a room in order to save coal. In several States there are general State laws which require that a certain amount of air be furnished each person per

hour in school buildings and other buildings of a public character. The necessity and importance of ventilation will be discussed under another head.

CHAPTER III.

THE DESIGN OF A DIRECT STEAM-HEATING SYSTEM.

Steam heating is usually done by direct or by indirect radiation or by combination of both direct and indirect radiation. In small residences occupied by only three or four persons it is customary to use only direct radiation. The practice, however, is a questionable one, and it seems desirable, even in small residences, that some indirect radiation be used so as to provide a means of ventilation. Oftentimes only one indirect radiator is used, bringing its air either into the room most used or into the main hall so that it may be distributed throughout the house. In factories and office buildings where a large amount of air is introduced by the opening and closing of doors it is customary to use only direct radiation, and in such buildings this is permissible.

In order to understand thoroughly the operation of a steam heating system the nature and properties of steam should be studied.

Steam is a watery vapor, and as used in ordinary radiator prac-

Nature and Properties of Steam.

tice always contains a certain amount of water in suspension, as does the atmosphere in foggy weather.

When water is heated in a steam boiler the temperature is slowly increased from the initial temperature of the water to the temperature of the boiling point. When the water reaches the boiling point small particles of the water are changed from water to steam, rise through the mass of water and escape to the surface; the water is then said to boil. The temperature at which the water boils depends entirely upon the pressure in the boiler and obviously, as the boiling point increases more and more, heat is required to produce steam.

Take, for instance, a given case. Suppose we start with water in the boiler at 40 degrees and the pressure in the boiler at atmospheric pressure, that is, 14.7 pounds. Under this condition it will be necessary to increase the temperature of the water in the boiler to 212 degrees, at which point water will commence to boil. It will be necessary to add $212 - 40 = 172$ B. T. U's for every pound of water in the boiler. In order to convert all the water into steam it will be necessary to supply 965.7 heat units for each pound, in addition to the 172 heat units consumed in raising the water to the boiling point. During the operation of boiling, however, the temperature of the water remains constant and the 965 heat units added in order to change the water at the temperature of the boiling point into steam are consumed in separating the molecules of water and changing the water from a

liquid into a gas. This last quantity is termed the *latent heat* and it is the latent heat of water which is used primarily in furnishing heat to the room in steam heating. As the pressure in the boiler increases the latent heat diminishes. The relation of these various quantities has been very carefully determined by Regnault and compiled in the form of steam tables. The following is an abbreviated steam table. More complete tables will be found in Peabody's Steam Tables, or in any of the mechanical engineering handbooks.

STEAM TABLES.

Column 1 of the Steam Table gives the pressure of the steam above the atmosphere in pounds per square inch and below the atmosphere in inches of mercury. Column 2 gives the corresponding temperature of the steam. Column 3 gives the heat of the liquid or the heat necessary to raise one pound of water from 32 degrees to the boiling point, corresponding to the pressure. Column 4 gives the latent heat necessary to change a pound of water at the temperature of the boiling point into steam at the same temperature. Column 5 is the sum of columns 3 and 4, and represents the amount of heat necessary to raise a pound of water from 32° to the boiling point and then change it into steam at the temperature of the boiling point. The quantities given in this column are called total heat.

Table VI.—Properties of Steam.

| Pressure or vacuum | Temperature | Heat of the Liquid | Latent Heat | Total Heat | Volume of 1 lb. of steam |
|--------------------|-------------|--------------------|-------------|------------|--------------------------|
| Inches mercury | | | | | |
| —24 | 137 | 105 | 1019 | 1124 | 135 |
| —20 | 160 | 128 | 1003 | 1131 | 78.3 |
| —16 | 175 | 143 | 992 | 1135 | 55.9 |
| —14 | 187 | 155 | 984 | 1139 | 43.6 |
| — 8 | 197 | 165 | 977 | 1142 | 35.8 |
| — 2 | 205 | 173 | 971 | 1144 | 30.6 |
| Pounds per sq. in. | | | | | |
| 0 | 212 | 180.9 | 965.7 | 1146.6 | 26.36 |
| 1 | 215 | 184 | 964 | 1148 | 25 |
| 2 | 219 | 188 | 961 | 1149 | 23 |
| 3 | 222 | 191 | 959 | 1150 | 22.3 |
| 4 | 224 | 193 | 957 | 1150.5 | 21.2 |
| 5 | 227 | 196 | 955 | 1151 | 20.16 |
| 10 | 239 | 208 | 946 | 1154 | 16.3 |
| 15 | 249 | 218.8 | 939.3 | 1158.1 | 13.7 |
| 20 | 258.7 | 228 | 932.5 | 1161 | 11.85 |
| 25 | 266.7 | 236.2 | 927.1 | 1163.3 | 10.36 |
| 30 | 273.9 | 243.5 | 922 | 1165.5 | 9.34 |
| 35 | 280.5 | 250.2 | 917.3 | 1167.5 | 8.45 |
| 40 | 286.5 | 256.3 | 913 | 1169.3 | 7.73 |
| 45 | 292.2 | 262.1 | 909 | 1171.1 | 7.11 |
| 50 | 297.5 | 267.5 | 905.2 | 1172.7 | 6.61 |
| 55 | 302.4 | 272.6 | 901.6 | 1174.2 | 6.16 |
| 60 | 307.1 | 277.2 | 898.4 | 1175.6 | 5.77 |
| 65 | 311.5 | 281.8 | 895.1 | 1176.9 | 5.43 |
| 70 | 315.8 | 286.1 | 892.1 | 1178.2 | 5.13 |
| 75 | 319.8 | 290.3 | 889.1 | 1179.4 | 4.86 |
| 80 | 323.7 | 294.3 | 886.3 | 1180.6 | 4.63 |
| 85 | 327.4 | 298.1 | 883.6 | 1181.7 | 4.41 |
| 90 | 330.9 | 301.8 | 881 | 1182.8 | 4.20 |
| 95 | 334.4 | 305.4 | 878.5 | 1183.9 | 4.02 |
| 100 | 337.6 | 308.9 | 876 | 1184.9 | 3.83 |
| 110 | 343.9 | 315.4 | 871.4 | 1186.8 | 3.57 |
| 120 | 349.8 | 321.5 | 867.1 | 1188.6 | 3.33 |
| 130 | 355 | 327.5 | 863 | 1190.3 | 3.1 |
| 140 | 360 | 333.5 | 859.1 | 1191.9 | 2.92 |
| 150 | 365.7 | 338.3 | 855.4 | 1193.4 | 2.75 |

Column 6 gives the volume of one pound of steam at the different pressures.

EXAMPLES IN USE OF STEAM TABLE.

EXAMPLE 1.—It is required to convert 10 pounds of water at 32° into steam at 100 pounds gauge pressure.

SOLUTION.—We see from column 5 that the total heat of 1 pound of steam at 100 pounds pressure is 1,184.9 heat units. Then to form 10 pounds of steam would require 10 times this amount, or 11,849 heat units.

2. How many heat units will be required to form 5 pounds of steam from feed water at 100° in temperature into steam at 10 pounds gauge pressure?

SOLUTION.—The total heat of steam at 10 pounds pressure above 32° is 1,154 heat units. In this case the feed water already contains in it above 32° , $100 - 32 = 68$ heat units. The specific heat of water being 1, the heat units required to form a pound of steam will be $1,154 - 68 = 1,086$, and to form 5 pounds of steam would require $5 \times 1,086 = 5,430$.

3. A steam pipe is 8 inches in diameter. The pressure of steam in the pipe is 10 pounds gauge. The steam pipe is to transmit 1,600 pounds of steam per hour. What will be the velocity of steam in the pipe?

SOLUTION.—From column 6 of the table we see that the volume of 1 pound of steam at 10

pounds, gauge pressure is 16.3 cubic feet. Then $1,600 \times 16.3 = 26,080$ cubic feet, the volume of steam passing per hour. This divided by 3,600 equals 7.2, the number of cubic feet passing per second. An 8-inch pipe has an area of 50 square inches; $50 \div 144 = .347$ square feet; $7.2 \div .347 = 20.8$ feet per second, which represents the velocity of the steam passing through the pipe. This velocity is very high. Ordinarily the velocity in steam pipes should not exceed 100 feet per second, even in very large pipes.

LOSS OF HEAT FROM RADIATORS.

In designing a direct steam system it will be necessary first to compute the heat losses from the various rooms by the rules previously given. After these losses are determined it will be necessary to place sufficient radiating surface in the room to supply these losses. In order to know the amount of surface that should be placed in a room it is necessary to know the amount of heat given off per square foot by the different forms of radiators. Heat losses for the different forms of direct radiators are given in the following table:

Column 5 is the column which shows the relative effectiveness of the various types of radiators. It is obtained in the following manner: Take, for example, the two-column cast iron radiators, results of which are given in line 2 of the table. A pound of steam at 226° , as we see from the steam tables,

gives up its latent heat in condensing which amounts to 965 heat units. This radiator condensed .265 pounds of steam per square foot of surface per hour. Then $965 \times .265 = 255.7$, the heat units given

Table VII—Loss from Wrought Iron Pipe and Cast Iron Radiators.

| Type of Radiator | No. of sq. ft. in radiator | Temperature of steam in radiator | Temperature of the air in the room | No. lbs steam condensed per sq. ft. per hour | B. T. U's per sq. ft. per hour per deg. diff. of temp. between steam and room |
|---|----------------------------|----------------------------------|------------------------------------|--|---|
| CAST IRON RADIATORS, 38 INCHES. | | | | | |
| 1 column... | 48 sq. ft. | 226 | 105 | .212 | 1.82 |
| 2 column... | 48 sq. ft. | 226 | 76 | .265 | 1.70 |
| 3 column... | 45.3 sq. ft. | 226 | 88 | .204 | 1.42 |
| 6 column... | 36 sq. ft. | 225 | 71 | .217 | 1.35 |
| WROUGHT IRON RADIATORS, 38 INCHES. | | | | | |
| 1 column... | 12 sq. ft. | 221 | 89 | .446 | 3.27 |
| 2 column... | 42 sq. ft. | 222 | 83 | .284 | 2. |
| 3 column... | 48 sq. ft. | 229 | 70 | .294 | 1.77 |
| 4 column... | 48 sq. ft. | 226 | 73 | .202 | 1.27 |
| 1" wall coil, 1 pipe high. | | 212 | 70 | .41 | 2.8 |
| 1" wall coil, 4 pipes high. | | 228 | 65 | .425 | 2.48 |

up by the radiator per square foot per actual surface per hour. The steam in the radiator was at a temperature of 226° and the air in the room at a temperature of 76° , the difference in temperature being 150° . If we divide 255.7 by 150 the result is approximately 1.7. This result represents the B. T. U's transmitted per square foot of rated surface per hour per degree difference of tem-

perature between the steam inside the radiator and the air in the room. This is the quantity which should be used in comparing the relative merits of the various forms of heating surfaces.

The results of a series of experiments made at the University of Michigan, extending over a period of a number of years, together with the results shown in the foregoing table, lead to the following conclusions:

Radiators with different steam volumes do not give essentially different results, except as the volume is so small as to restrict the passage of steam.

Single column radiators, as shown in Fig. 5, usually show larger results than those with more than one column. The condensation per square foot of radiator per degree difference of temperature as shown in column 5 of Table VII shows a rapid decrease as the number of columns increases. The reason for this is quite apparent when we consider the position of the radiating surfaces in a single pipe radiator as compared with the surface in a three-pipe radiator. Referring to Fig. 6, tube B, you will note that this tube can radiate heat in all directions without interference, except those lines which radiate to columns A and C. Columns A and C being at the same temperature, no radiant heat passes between them, so that all the surface of column B

**Different Types
of
Relative Efficiency.**



Fig. 5. Single-Column Cast Iron Radiator.

which would radiate its heat to columns A and C is unaffected. The amount of surface which does this, however, is extremely small.


Suppose we take point 1 on column B. The heat from that point radiates in a straight line in all directions. But all the rays of heat between ray 2 and ray 3 strike on column A and are lost because column A is the same temperature as column B. The number of rays that do this are extremely small in a single column radiator.

If we consider column B in a three-column radiator and take point 1 on column B we see that all the rays between 2 and 3, 4 and 5, 6 and 7, 8 and 9, 10 and 11 are lost and become ineffective for heating as columns A, C, D, E, F, are at the same temperature and intercept rays passing into the room.


When the columns in a radiator have been increased from 5 to 6 then the inner columns have practically no effect in giving off radiant heat, and the only heat they give off is given by convection due to the passage of air through the radiator.

In addition to the experiments given in the table a series of experiments were made on radiators painted different colors and on unpainted radiators. The results of these experiments seem to show that the painting of a radiator does not materially affect the heat given off by the radiator.

By glancing at Fig. 6 we see that the greater the distance between the columns or pipes of a radiator the smaller would be the number of rays of radiant heat intercepted by other columns of the radiator

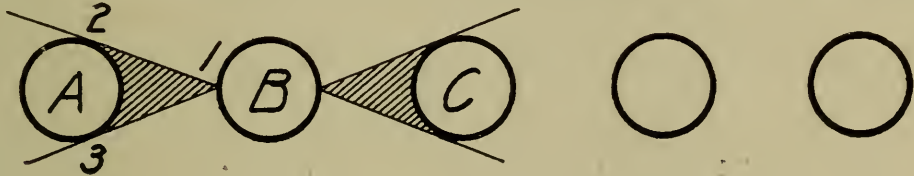

Single Column.

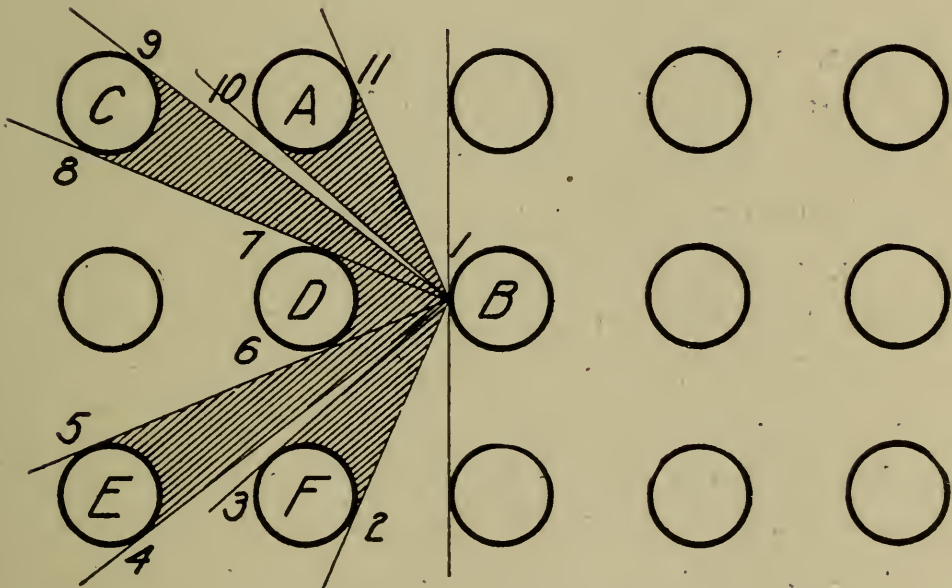

Three Column.

Fig. 6.

and the larger would be the radiating effect; the wider the space between the columns of the radiator the more effective does the radiator become in giving off heat.

The writer has had opportunity to make a series of tests on radiators of the two-column type, having the sections of one radiator spaced at $2\frac{1}{2}$ inches and the sections of the other radiator $3\frac{1}{8}$ inches. The increase of $\frac{5}{8}$ inch in the length of space added approximately 10 per cent to the effectiveness of the radiator.

Radiators are made in standard heights. The height most used is 38 inches. They can be purchased, however, in varying heights from 15 to 45 inches. The radiators of various heights are rated at a certain number of square feet per section. For instance, a 38-inch two-column radiator, as shown in Fig. 7, is rated at 4 square feet per section. As a rule, however, radiators are slightly overrated. A radiator containing 48 square feet has an actual surface, when measured, of about 47 square feet in most two-column radiators. In some cases, particularly in radiators having a large number of columns, the radiators are very much overrated. In one instance a radiator rated at 36 square feet had an actual surface of only 27 square feet. In purchasing a radiator, therefore, it is important to know that it has approximately the surface given in the catalogue of the manufacturer, as the radiating power depends primarily upon the square feet of surface it contains.

Comparing lines 2 and 6 of Table VII you will notice that the two-column wrought iron radiator



Fig. 7. Two-Column Cast Iron Radiator.



Fig. 8. Three-Column Cast Iron Radiator.


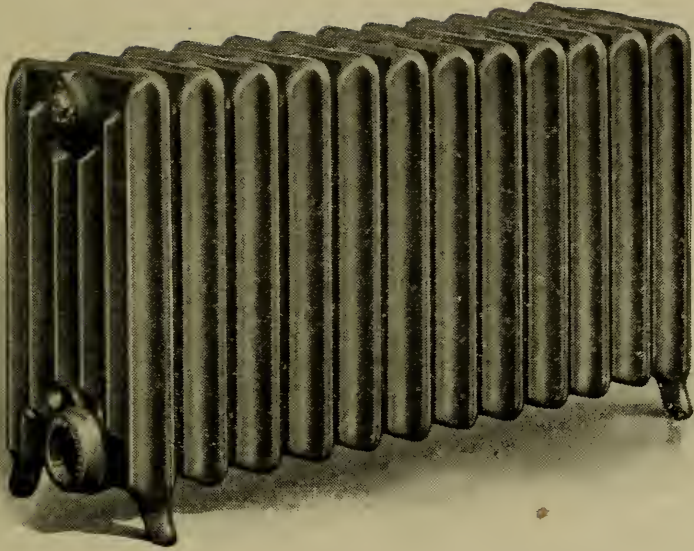


Fig. 9. Six-Column Cast Iron Radiator.

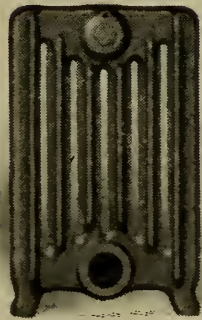

End view of section.

transmits about 10 per cent more heat than the two-column cast iron radiator. This is undoubtedly due not so much to the difference of material as to the difference in the spacing of the columns composing the radiators. Wrought iron pipe wall coil, as shown in the last line of the table, condenses almost twice as much steam as the cast iron radiator; in other words, it gives off about twice as much heat as the radiator. The reason for this is not so much the difference in material as the difference of location. In the case of the cast iron radiator the air at the base becomes heated, rises along the radiator, becoming more and more heated as it comes nearer to the top, so that at the top of the radiator there is little difference between the temperature of the air surrounding the radiator and the temperature of the radiator itself. This reduces the transmission of heat near the top of the radiator. In the wall coil, the sections being placed in a horizontal position, the air remains in contact with the coil for a short time only, so that the air surrounding all portions of the coil is practically at the same temperature. To state this in another way, in the cast iron radiator, with the sections placed vertically, the difference in temperature between the air outside the radiator and the steam inside the radiator is much less than in the wall coil, where the pipes are placed horizontally, making the wall coil much more effective per square foot of

surface. Approximately we can say that a wall coil will do twice as much per square foot as a cast iron radiator. Their extensive use, however, excepting in shop buildings, is always more or less questionable, owing to their unsightly appearance and the difficulty of installation in many places.

Besides the usual radiator in which a large proportion of the heat is given off by radiation and a smaller portion by convection, there is what are known as **Flue Radiators**. In a flue radiator each section, as shown in Fig. 10, has a projecting flange at the outer edge, so that there is confined in the radiator itself a series of narrow hot air flues. In these radiators only the external sur-

Table VIII—Heat Loss from Flue Radiators.

| | A | B |
|--|------------|------------|
| 1. Size of radiator..... | 6 sec. 38" | 6 sec. 38" |
| 2. Rated surface, square feet..... | 42 | 42 |
| 3. Actual surface, square feet..... | 39 | 39.41 |
| 4. Temperature steam..... | 226 | 226.9 |
| 5. Temperature external air..... | 103.3 | 103.5 |
| 6. Difference between steam and air.. | 123 | 123.4 |
| 7. Condensation per sq. ft. rated surface | .1847 | .1922 |
| 8. B. T. U.'s per deg. diff. per sq. ft. rated surface | 1.437 | 1.5 |
| 9. Temperature of air entering flues.. | 106 | 102 |
| 10. Temperature of air leaving flues.. | 187 | 182 |
| 11. Cubic feet of air leaving flues per minute | 37.59 | 45.77 |
| 12. Average velocity of air leaving, ft. per minute | 150.3 | 171.3 |
| 13. Percentage of heat transmitted by flues | 36 | 41 |
| 14. Percentage of heat radiated..... | 64 | 59 |



Fig. 10. Cast Iron Flue Radiator.

face of the radiator acts as radiating surface. The interior surfaces of the radiator act as indirect radiators to heat the air which is drawn up from below the radiator. The heat losses from two well-known forms of flue radiators are given in Table VIII, which gives the loss by radiation from the radiator as separated from the loss due to the heat transmitted to the air in the flues.

The action of the flue radiator depends upon the design of the flues. There should be no point of restricted flue area; that is, the air should be given a free passage from the base of the radiator to the top. Flue radiators are particularly serviceable in rapidly circulating the air in the room and can be used in a large room having small window surfaces to assist in heating the air in the room more rapidly than is done by the ordinary radiator. The flue radiator is also used in connection with ventilation, in which case the base of the radiator is closed and

Table IX—Heat Transmission.

| Difference in temperature. | B. T. U.'s transmitted per deg. diff. per hr. |
|----------------------------|---|
| 80 | 1.56 |
| 90 | 1.57 |
| 100 | 1.58 |
| 110 | 1.6 |
| 120 | 1.615 |
| 130 | 1.63 |
| 140 | 1.645 |
| 150 | 1.65 |
| 160 | 1.675 |
| 170 | 1.69 |
| 180 | 1.705 |
| 190 | 1.72 |

is connected with the outside air. This phase will be taken up more in detail under the head of Ventilation.

In the foregoing tables it has been assumed that the heat lost per degree of difference of temperature between the steam in the radiator and the air outside the radiator was a constant quantity. In general this may be assumed as true for the ordinary conditions under which radiators operate. Where radiators are operated on very high or very low temperatures there is a difference in the amount of heat transmitted per degree of difference of temperature. Table IX gives the heat transmitted for each degree difference of temperature between the steam inside and the air outside the radiator per hour per square foot of surface for the two-column cast iron radiator 38 inches high.

For ordinary conditions of operation—that is, when the steam is at a pressure from atmospheric to 10 pounds and the temperature of the room is 70 degrees—there will be no necessity to consider this variation in the transmission of heat due to differences of temperature between the steam and the air. There are, however, conditions in drying rooms that are to be kept at a very high temperature, where this will make an appreciable difference in the amount of radiation to be used. In vacuum

systems also, where a very low vacuum is carried, it would be necessary to take these factors into consideration.

The following suggestions apply to the placing of radiators in the room. *The radiators should be placed in the coldest portion of the room.* In general it is best to place the radiators in front of the window, selecting a radiator of such height that the top will be an inch or two below the window sill. There

Installation of Direct Radiators.

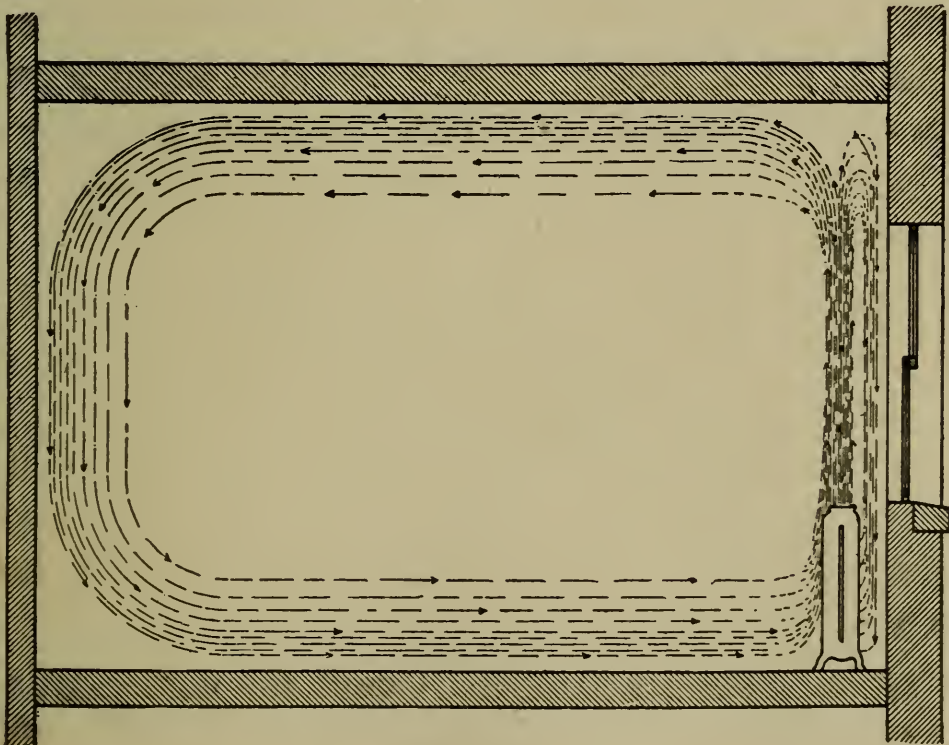


Fig. 11.

are a number of advantages in placing the radiator in front of the window. Probably the most impor-

tant is the fact that it reduces the strong cold down draft along the window surfaces.

Figure 11 shows the effect upon the circulation of the air by placing the radiator in front of the windows. In this case we get two separate currents of air. The current rising from the radiator divides, one current passing out into the room, being cooled by the wall surfaces and objects in the room, dropping down to the floor and passing back along the floor to the radiator; the other current, passing directly to the cold wall surface, is cooled, drops down along this surface and comes back to the radiator, making the circulation along the cold walls and windows close to the radiator a local one which does not affect the occupants of the room.

Carpets and rugs should not extend under the radiator. If a radiator is allowed to stand upon a carpet or rug for any great length of time, the heat from the legs of the radiator will eventually deteriorate the fabric of the rug. In a carpeted room the radiator may be placed upon a hardwood or a marble base.

When radiators are placed next the wall a space of $1\frac{1}{2}$ inches at least should be left for the circulation of air behind the radiator.

Unless otherwise specified, radiators are usually tapped as in Table X.

The best method of figuring radiating surface is to determine the actual heat loss from the room in B. T. U's, then decide upon the form of radiator which you propose to use.

Suppose, for example, that a two-column cast iron radiator is selected. The steam pres-

Rules for Direct Heating.

sure to be carried is 5 pounds. The temperature in the room is required to be 70 degrees. Referring to the table of heat losses from direct radiators

Table X—Radiator Tappings.

For one-pipe work radiators containing—

| | Inches. |
|----------------------------|---------|
| 24 sq. ft. and under..... | .1 |
| From 24 to 40 sq. ft..... | .1 1/4 |
| From 40 to 100 sq. ft..... | .1 1/2 |
| Above 100 sq. ft..... | .2 |

For two-pipe work radiators containing—

| | |
|---------------------------|----------------|
| 48 sq. ft. and under..... | .1 x 3/4 |
| From 48 to 96 sq. ft..... | .1 1/4 x 1 |
| Above 96 sq. ft..... | .1 1/2 x 1 1/4 |

(Table VII, we see that a two-column cast iron radiator loses 1.70 heat units per degree difference of temperature per square foot of rated surface per hour. The temperature corresponding to 5 pounds pressure of steam as given in Steam Table (Table VI), is 227 degrees, and the difference between this and the temperature of the room will be 157 degrees. Then the heat lost will be $1.70 \times 157 = 266$ heat units per square foot per hour. Dividing the heat loss, as given by the rule for loss of heat, by

2.66 gives the the number of square feet of radiation to be used.

This is the only method that can be used at all in rooms where conditions are exceptional. For rooms of ordinary construction, heated to 70 degrees, a large number of thumb rules are used. Some of these thumb rules are as follows:

In the following rules the expression wall surface means exposed wall surface, that is, those surfaces which have outside air temperature on one side and room temperature on the other side.

RULE 1. Divide the volume of the room by 55. Add one-fourth of the exposed wall surface; add the glass surface, and multiply the sum of these three quantities by .275. The product will be the direct radiation in square feet.

RULE 2. For ordinary rooms. Divide the exterior wall surface by 4, add the glass surface and multiply the sum by .4.

B. For entrance halls. Divide the exterior wall surface by 4, add the glass surface and multiply the sum by .54.

C. For the wall surface in basement rooms below the ground line. Divide the wall surface by 4 and multiply the result by .17.

D. For floors having unheated space below. Divide the floor space by 4 and multiply the result by .23.

RULE 3. *Divide the volume of the room in cubic feet by the factors given below and the quotient will be the radiating surface in square feet.*

| | |
|---|------------------|
| <i>First floor rooms, one side exposed.....</i> | <i>55</i> |
| <i>First floor rooms, two sides exposed.....</i> | <i>50</i> |
| <i>First floor rooms, three sides exposed....</i> | <i>45</i> |
| <i>Sleeping rooms, second floor.....</i> | <i>60 to 70</i> |
| <i>Halls and bath rooms.....</i> | <i>50</i> |
| <i>Offices</i> | <i>50 to 75</i> |
| <i>Factories and stores.....</i> | <i>75 to 150</i> |
| <i>Assembly halls and churches.....</i> | <i>75 to 150</i> |

RULE 4. (BALDWIN'S RULE.) *Divide the differences between the temperature at which the room is to be kept and that of the coldest outside temperature by the difference between the temperature of the steam in the radiator and that at which you wish to keep the room and the quotient will be the square feet of radiating surface to be allowed for each square foot of equivalent glass surface. By equivalent glass surface is meant the wall surface divided by 4 plus the glass surface.*

In all of these rules the factors to be allowed for exposure should be applied. These factors are given under the head of "Factors for Exposure." Where the rule does not involve the contents of the room it will be necessary in very large rooms or in rooms where the wall surface is very small in proportion to the contents of the room, to add a cer-

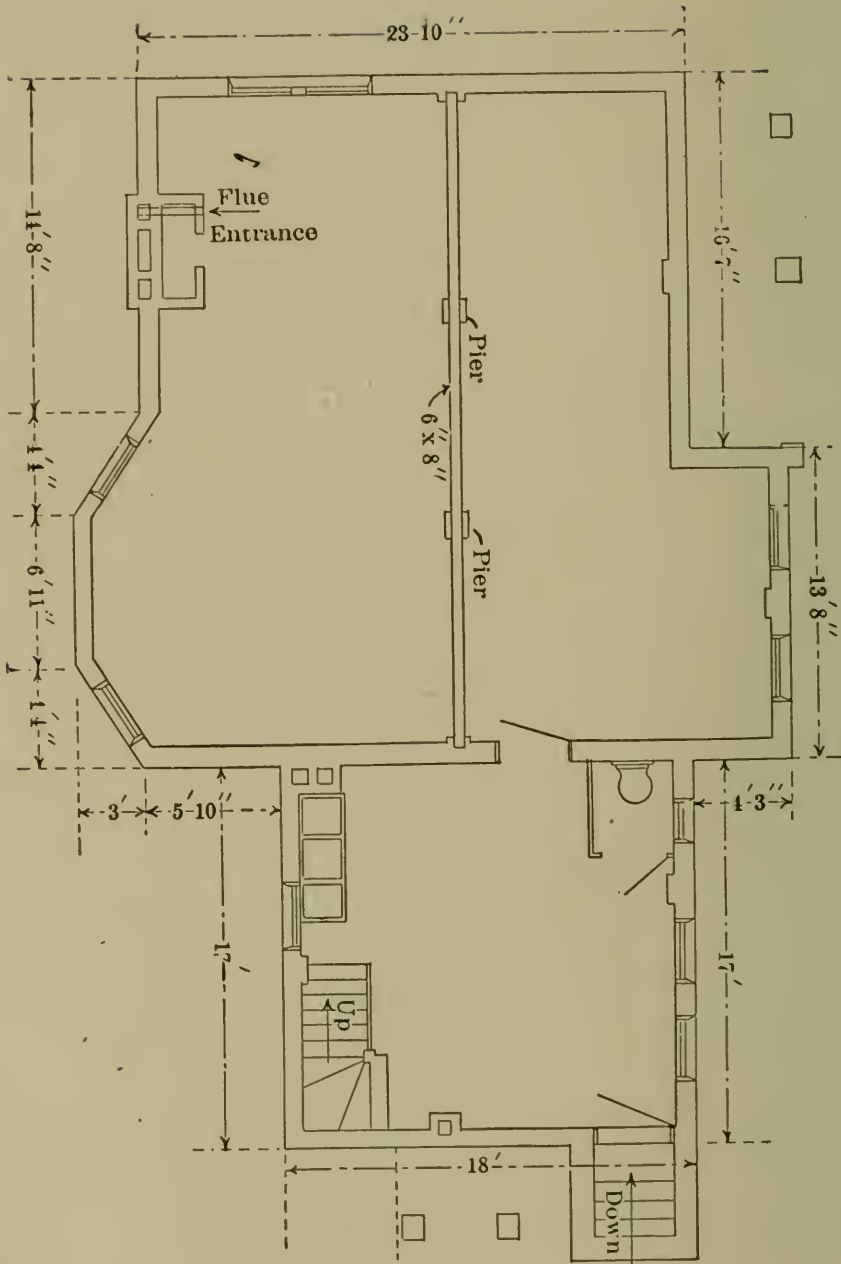


Fig. 12.
BASEMENT PLAN.

tain proportion of radiation, usually not more than 20 per cent, to allow for heating the air in the room quickly when it has once been allowed to cool.

Table XI—Dimensions and Heat Losses.

| Room. | Dimensions | Volume. | Wall surface. | Window surface. | B. T. U.'s lost per hour. |
|------------------------|---|---------|---------------|-----------------|---------------------------|
| Parlor | 13'9"x12'9"x9'6" | 1665 | 216 | 36 | 9450 |
| Sitting room | 14'3"x15'6"x9'6" | 2100 | 95 | 48 | 7035 |
| Dining room | 12'6"x13'9"x9'6" | 1640 | 145 | 36 | 7350 |
| Kitchen | 13'0"x13'0"x9'6" | 1610 | 249 | 36 | 10300 |
| Hall | 12'9"x10'0"x9'6" | 1210 | 197 | 18 | 7035 |
| SECOND FLOOR. | | | | | |
| W. Chamber | 11'6"x13'6"x8'6" | 1320 | 172 | 48 | 10050 |
| Alcove | 10'0"x 9'6"x8'6" | 810 | 130 | 40 | 7560 |
| So. chamber | 12'6"x14'9"x8'6" | 1560 | 172 | 24 | 7035 |
| N. chamber | 13' x 13' x 8'6" | 1440 | 188 | 24 | 7455 |
| Bath | 6' x 8' x 8'6" | 410 | 50 | 18 | 3150 |
| E. chamber | 13' x 8' x 8'6" | 880 | 160 | 18 | 5250 |
| Front Hall | { 14' x 4' x 8'6" } { 8' x 6' x 8'6" } | { 885 } | { 33 } | { 18 } | { 2730 } |

In order to understand better the methods of determining the heating surface required for a given house, it would be best to consider a concrete example. Figs. 12, 13 and 14 represent the basement, first and second floors of a residence. The house is constructed of wood, sheathed, papered and clap-boarded on the outside and plastered on the inside. On the first floor the rooms are 9 feet 6 inches high and on the second floor 8 feet 6 inches high.

Example. (Direct Radiation.)

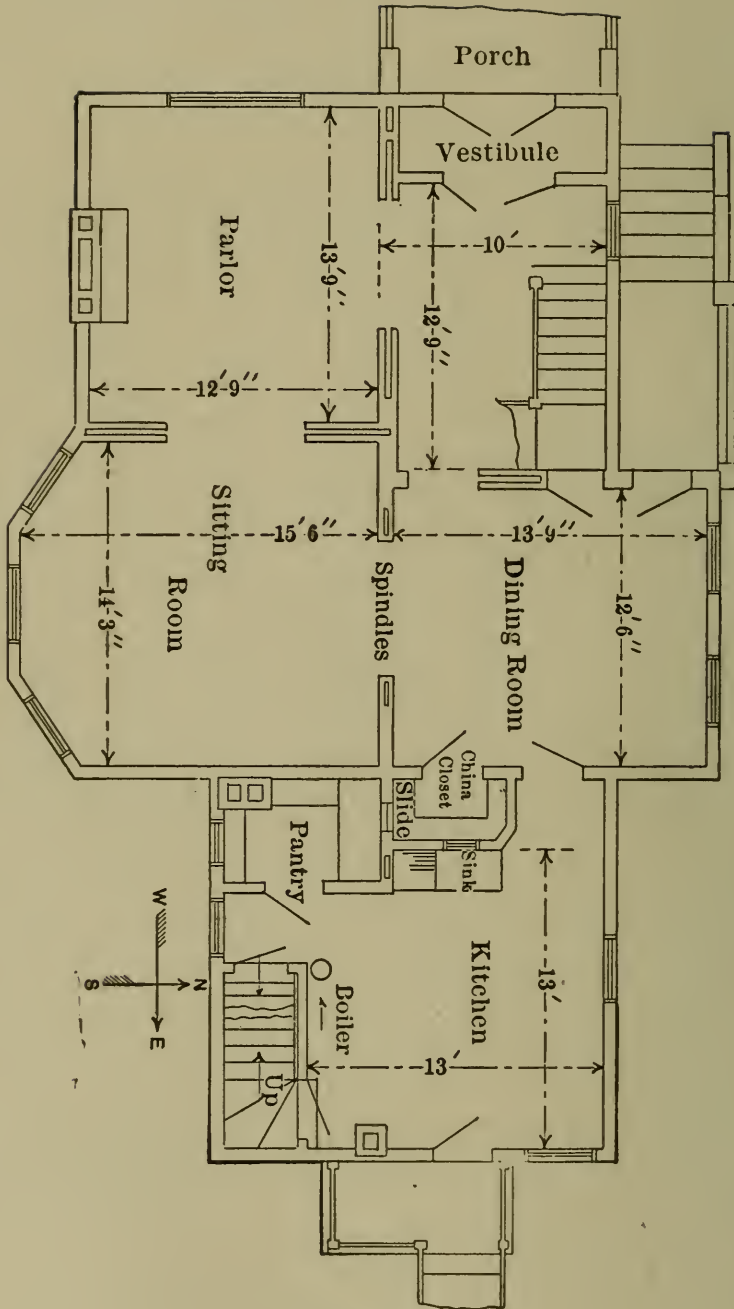


Fig. 13.
FIRST FLOOR.

The windows are 6 feet high and the standard size is 3 feet wide. Table XI gives the general dimensions of the room and the heat losses from the various rooms, assuming the temperature of the outside air to be zero and the temperature of the inside to be 70 degrees.

Table XII—Results of Computation, Direct System

| FIRST FLOOR. | B. T. U.'s from Table XI. | B. T. U.'s cor- rected for exposure. | Radiating surface. Two column cast iron sq. ft. | Radiating surface by Rule 3. |
|----------------------|---------------------------------|--|---|------------------------------------|
| Parlor | 9450 | 10395 | 39 | 33.5 |
| Sitting room | 7035 | 7035 | 27 | 38 |
| Dining room | 7350 | 8085 | 30 | 30 |
| Kitchen | 10300 | 10300 | 39 | 32 |
| Hall | 7035 | 7770 | 29 | 24 |
| SECOND FLOOR. | | | | |
| W. chamber | 10050 | 11055 | 42 | 22 |
| Alcove | 7560 | 8316 | 31 | 13 |
| S. chamber | 7035 | 7035 | 27 | 26 |
| N. chamber | 7455 | 8190 | 31 | 24 |
| Bath | 3150 | 3465 | 13 | 7 |
| E. chamber | 5250 | 5250 | 20 | 14.7 |
| Halls | 2730 | 3003 | 12 | 14.7 |

The method used in determining the British thermal units lost from the room, given in column 6, is the same as those given in the paragraph headed "Rules for Determining Loss of Heat." Take, for example, the parlor. The wall surface is

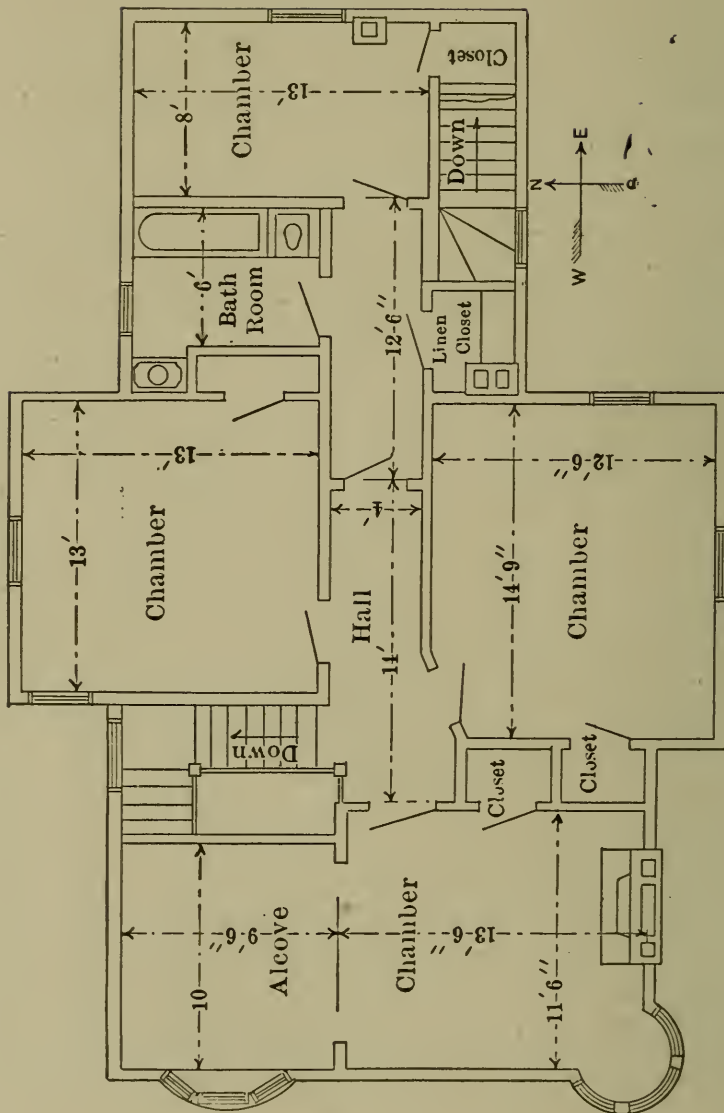


Fig. 14.
SECOND FLOOR.

216 square feet. Divide this by 4; the result, 54 square feet, is the equivalent glass surface. Add the actual glass surface, 36 square feet, which makes a total equivalent glass surface of 90 square feet. Multiply this by $1\frac{1}{2}$ times the difference between the outside and the inside temperature, which gives the heat lost, or $90 \times 105 = 9,450$ B. T. U. lost from the room per hour. The remainder of the results shown in column 6 have been computed in the same way.

In Table XII the second column gives the B. T. U.'s as determined in Table XI; the third column the B. T. U.'s corrected for exposure, 10 per cent being added to rooms having north and west exposures, as, in this case, the prevailing winds are from the west. Column 4 gives the radiating surface required to heat the rooms with a two-column cast iron radiator. Column 5 gives the radiating surface as determined by Rule 3.

The quantities in column 4 are obtained in the following manner. The steam pressure to be carried in the radiator is 5 pounds. The corresponding temperature of steam is 227 degrees. The temperature of the room is 70 degrees. The difference in temperature between the room and the steam will be 157 degrees. In the last column of Table VII the heat lost for a two-column cast iron radiator is given as 1.7 B. T. U.'s per degree difference per hour. Then the total heat lost per square foot

per hour will be $157 \times 1.7 = 267$ B. T. U.'s, that is, each square foot of radiator surface will give to the room 267 heat units per hour. Dividing the heat lost from the room, as given in column 3, by 267, will give the results shown in column 4.

In column 5 the radiating surface has been determined by Rule 3, which is sometimes called the Volume Rule; that is, the cubic contents of the rooms are divided by a certain factor, depending upon the location of the room. A careful comparison of columns 4 and 5, together with an inspection of the plans, will show the inconsistency of the volume rule. The volume rule can be used only where the room has an average amount of cubic contents, as compared with its wall surface. To get the best results it is better to employ the method that has been used in determining the results in column 4.

CHAPTER IV.

DESIGN OF INDIRECT STEAM HEATING SYSTEM.

It is seldom that indirect radiators only are installed. This is due chiefly to the increased cost of installation and operation of such a plant, as compared with a plant using both direct and indirect radiation. In a residence heated by indirect radiation alone, it will be necessary to introduce an excess of air over that required by ventilation. This materially increases the cost of operation. In designing an indirect heating plant the loss of heat from the building is figured in the same way as with the direct system. In using indirect radiation alone it will be necessary to introduce enough air so that the heat left in the room will supply the loss from the walls and windows. In order to determine the amount of surface to be placed in the room, it is necessary to know the temperature to which the radiator will heat the air and the amount of heat given off by the indirect radiator under different conditions of operation.

The amount of heat that may be obtained from a given indirect radiator will depend upon the temperature at which the air is taken in, the tempera-

**Heat Lost from
Indirect Steam
Radiators.**

ture of the radiator, and the cubic feet of air passing through the radiator. The following table gives the relation between the above quantities, assuming the temperature of the air entering the radiator to be zero, the temperature of steam in the radiator 227 degrees, the temperature corresponding to 5 pounds gauge pressure:

In school buildings and in buildings where the flues are of ample size the amount of air passing per square foot of radiating surface may be assumed to be 200 cubic feet per hour. In residences and buildings where the flues are usually small, the amount of air passing per square foot of surface per hour does not exceed 150 cubic feet.

From the results of the tests on indirect radiators given, the following points may be noted:

If the temperature of the air entering the radiator is constant, then the temperature of the air leaving the radiator will decrease as the amount of air passing through the radiator is increased.

In order to determine the amount of heat transmitted by the radiator it is necessary to assume the number of cubic feet of air that will pass through the radiator per square foot of radiation. You will also note the difference between the standard or short pin radiator (Fig. 15) and the long pin radiator (Fig. 16). As shown in Table XIII, the tem-

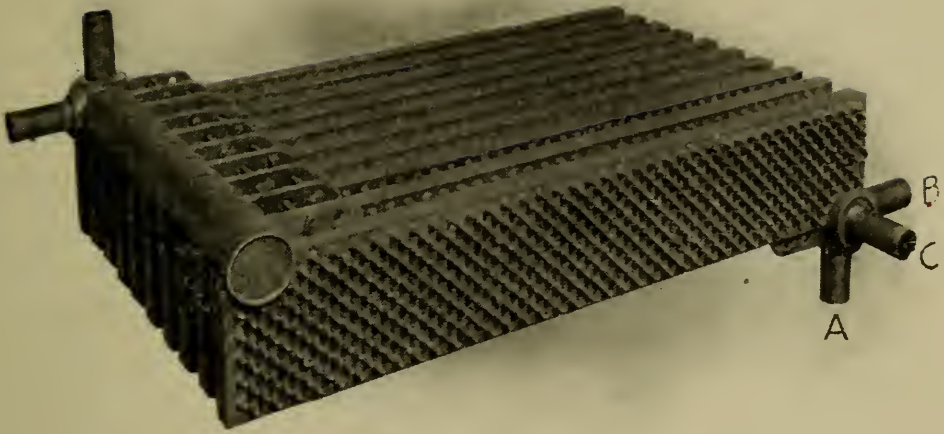


Fig. 15. Short Pin Indirect Radiator.



Fig. 16. Long Pin Indirect Radiator.

perature at which the air is heated by the long pin is less than the temperature to which the air is heated by the short pin with the same quantity of air passing. This is undoubtedly due to the fact that the pins

Table XIII—Heat Losses from Indirect Radiators

| Cubic feet of air passing per sq. ft. of radiator.. | Increase in temperature of the air passing through the radiator | | Pounds of steam condensed per sq. ft. of radiator | | B. T. U.'s transmitted per sq. ft. of radiation per degree diff. in temp. of air passing through radiator and the steam... | |
|---|---|-----------|---|-----------|--|-----------|
| | Standard pin. | Long pin. | Standard pin. | Long pin. | Standard pin. | Long pin. |
| 50 | .147 | 140 | .125 | .15 | .80 | .95 |
| 75 | .143 | 137 | .17 | .21 | 1.17 | 1.27 |
| 100 | .140 | 135 | .24 | .26 | 1.51 | 1.60 |
| 125 | .138 | 132 | .295 | .31 | 1.85 | 1.90 |
| 150 | .135 | 129 | .355 | .36 | 2.22 | 2.20 |
| 175 | .132 | 126 | .41 | .405 | 2.57 | 2.47 |
| 200 | .130 | 123 | .47 | .45 | 2.90 | 2.72 |
| 225 | .127 | 120 | .53 | .49 | 3.25 | 3.00 |
| 250 | .123 | 118 | .585 | .53 | 3.60 | 3.20 |
| 275 | .121 | 115 | .645 | .57 | 3.90 | 3.40 |
| 300 | .119 | 112 | .700 | .61 | 4.22 | 3.60 |

are so long that the ends become cooled. On the other hand, the long pin type is a very desirable type to use when one wishes to pass large quantities of air, as the radiator has ample air passage. This is primarily the work for which it is designed.


The short pin gives better results for ordinary houses where small quantities of air pass through the radiator.

Table XIV—Indirect Radiators—Temperature of Leaving Air.

| Temperature of air entering the radiator..... | | | | |
|---|---|-----------|---|-----------|
| | Temperature of air leaving the radiator with a velocity of 200 cu. ft. of air per sq. ft. surface | | Temperature of air leaving the radiator with a velocity of 150 cu. ft. of air per sq. ft. surface | |
| | Standard pin. | Long pin. | Standard pin. | Long pin. |
| 0 | 130 | 125 | 135 | 128 |
| 10 | 134 | 128 | 139 | 132 |
| 20 | 139 | 132 | 144 | 136 |
| 30 | 144 | 136 | 149 | 140 |
| 40 | 148 | 141 | 153 | 144 |
| 50 | 153 | 144 | 158 | 146 |

Indirect radiators are placed in a chamber or box, usually situated in the basement of the building, as close as possible to the vertical flue leading to the room which they are to heat. The air is admitted to the radiator by a duct or flue, connected with the outside air. This duct should be supplied with a suitable damper and, if possible, be so arranged as to close

**Installation of
Indirect Radiators.**

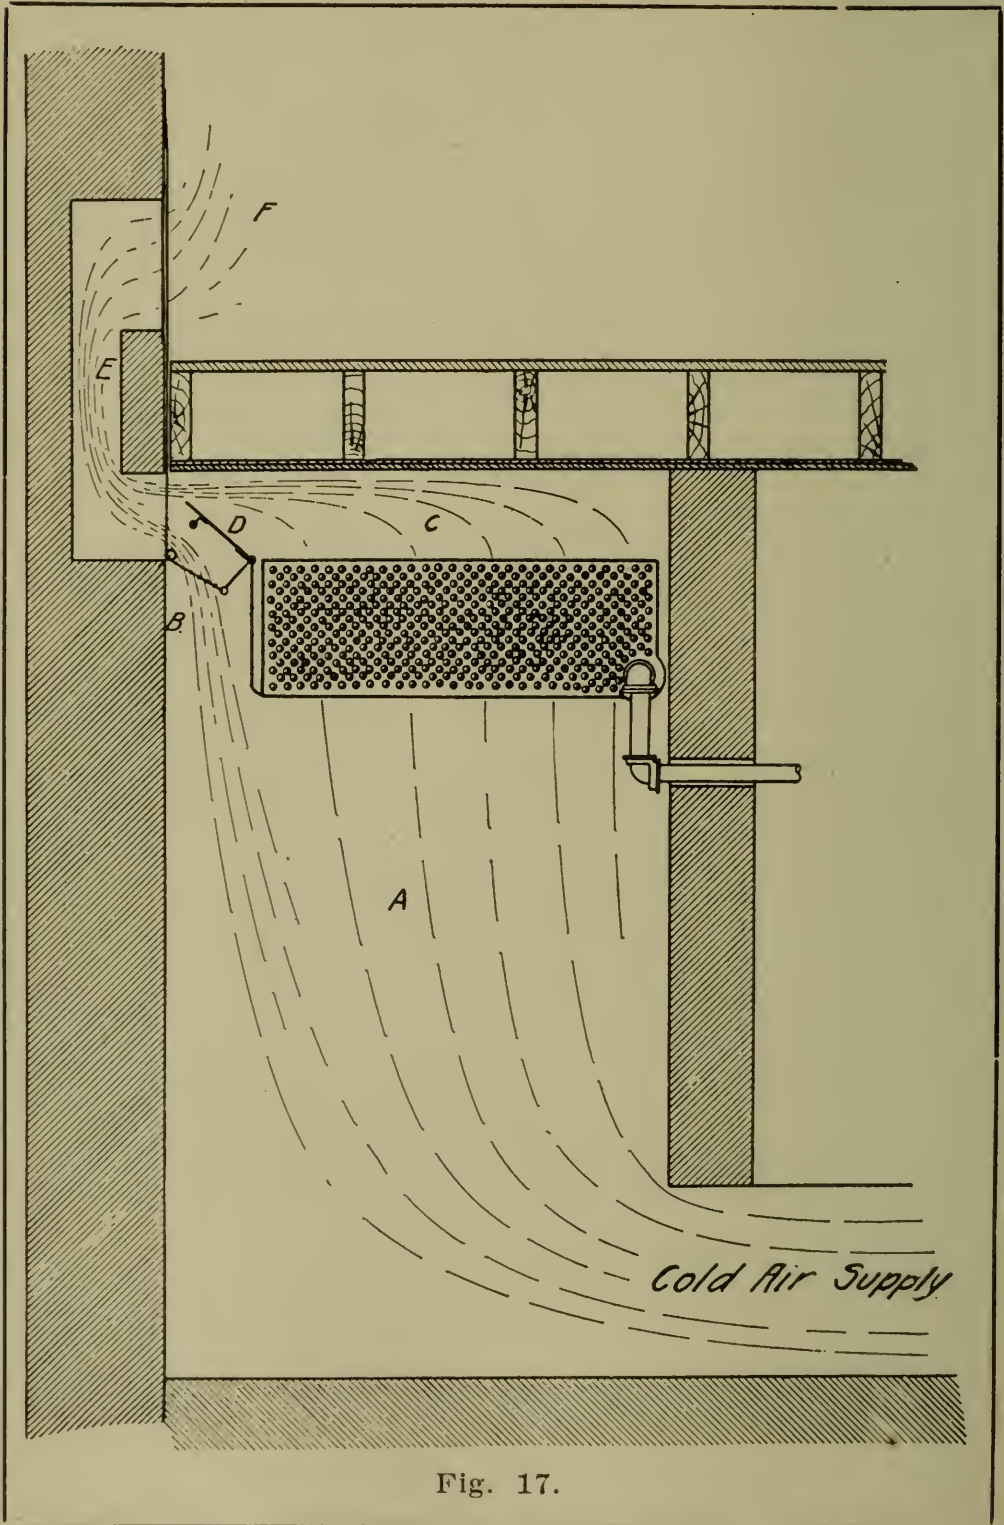

automatically when the steam pressure is taken off the radiator. The cold air is usually admitted directly beneath the radiator and the heated air on leaving the room is taken off at one side.

The casing surrounding indirect radiators is usually built of galvanized iron or of matched board, lined with tin. If of galvanized iron it should be bolted together with stove bolts, so that the casing may be easily removed. A much better method, but one which is more expensive, is to enclose the radiator in a small brick chamber with cement floor. This chamber should be large enough so that the radiator is accessible for repairs. Sometimes a duct is provided in the radiator casing so that cold air may be taken around the radiator and mixed with the heated air through a suitable damper, controlled from the room which is heated. This is a very common arrangement in school buildings. Fig. 10 shows a sketch of an arrangement of this kind.

The pipes or ducts leading from an indirect radiator should be carried to the room as directly as possible. It is better to have a long cold air pipe and a short hot air pipe. A long horizontal hot air pipe should be avoided. Where the air from the indirect radiator is to be used primarily for ventilation it is best to place the hot air register near the ceiling.

The indirect radiators are usually suspended in

the radiator chamber on iron pipes supported by rods hanging from the ceiling. There should be at least 10 inches clear space between the radiator and the bottom and top of the casing. The casing of the radiator should fit the radiator as closely as possible, so that very little air is allowed to pass around the radiator without being heated. Indirect radiators should be placed at least 2 feet above the water line of the boiler, if they are to be operated on a gravity system of circulation, and should be so arranged that the condensed water will drain from them without trapping. The tappings of these radiators are the same as for double pipe direct steam radiators. (See p 70.) The following table gives the general proportions for an indirect radiator system:

Table XV—Size of Flues for Indirect Radiator.

| Heating surface, sq. ft. | Area of cold air supply, sq. in. | Area of hot air supply, sq. in. | Size of brick flue for hot air. | Size of register. |
|--------------------------|----------------------------------|---------------------------------|---------------------------------|-------------------|
| 20 | 30 | 40 | 8x 8 | 8x 8 |
| 30 | 45 | 60 | 8x12 | 8x12 |
| 40 | 60 | 80 | 8x12 | 10x12 |
| 50 | 75 | 100 | 12x12 | 10x15 |
| 60 | 90 | 120 | 12x12 | 12x15 |
| 80 | 120 | 160 | 12x16 | 14x18 |
| 100 | 150 | 200 | 12x20 | 16x20 |
| 120 | 180 | 240 | 14x20 | 16x24 |
| 140 | 210 | 280 | 16x20 | 20x24 |

It is usual to assume that the air enters the radiator at zero degree of temperature, in which case

it will leave the radiator at about 130 degrees, the steam pressure in the radiator being 5 pounds and the velocity through the radiator being 200 cubic feet per hour per square foot of radiator. Under the above conditions an ordinary pin radiator will give off 470 B. T. U.'s per square foot, or, say approximately, 450 B. T. U.'s. Under these conditions the air entering the room will be at a temperature of 130 degrees, and if the temperature of the room is 70 degrees this air will be capable of losing to the room 60 degrees, or in other words, there is 60 degrees of temperature available in this air for heating purposes, or of 450 B. T. U.'s given out by the radiator 210 B. T. U.'s are available for heating the room.

SOME RULES FOR INDIRECT HEATING.

RULE 1. A. *For ordinary rooms. Divide the wall surface by 4, add the glass surface, and multiply the sum by .6. The quotient will be the amount of indirect radiation necessary to heat the room.*

B. *For entrance halls. Divide the exterior wall surface by 4, add the glass surface and multiply the sum by .75, the product will be the number of square feet of indirect radiation.*

RULE 2. *Figure the heating surface the same as for direct heating. Add 40 per cent.*

RULE 3. *Divide the volume of the room by 40. The quotient is the square feet of indirect surface required to heat the rooms on the first floor. For second and third floor rooms divide by 50, and in stores and large rooms divide by 60.*

Take the same house that was used in the problem for direct heating. In this case all rooms are to be heated by indirect radiation. It is in actual

practice an unusual arrange-
ment, but it is figured out in
this way as an illustration
merely.

Example of Indirect Heating.

The heat loss in this house will, of course, be the same in both direct and indirect heating and is given in Table XII (p. 77). Assume that the air enters the radiator at zero degrees and leaves at 130 degrees; that the steam in the radiator is at 5 pounds pressure and that 200 cubic feet of air is passed through the radiator per square foot of surface. From the results determined in paragraph headed "Heating Effect of the Indirect Radiator" each square foot of radiation gives off approximately 450 B. T. U.'s. If the temperature of the room is 70 degrees only 60 degrees of the heat given to the air is effective in heating the room. As the total amount of increase in temperature is 130 degrees, only approximately $60 \div 130$, or 45 per cent, is available for heating. As each square foot of indirect radiation gives off 450 B. T. U.'s, 45

per cent of 450, or 200 B. T. U's, will be available for heating the room. The heat loss as given in the table for the parlor is 10,395 B. T. U's. Dividing this by 200 gives 52, the number of square feet of radiation required for the room.

Fifty-two square feet of radiation passing 240 cubic feet of air per square foot will pass 12,480 cubic feet of air per hour; 12,480 is 3.47 cubic feet per second. Allowing a velocity of 5 feet per second, the area of the hot air pipe is $3.47 \div 5 = .69$ square feet. This equals 99 square inches, which is the proper area of the pipe. The size of the cold air pipe leading to the radiator is usually made three-quarters the size of the hot air pipe. Table XVI gives the results for the whole house computed in the same manner as given above. In the table the odd figures and decimals have been left off.

**Size of Hot Air
Pipe.**

In selecting the size of radiator for a room, it is necessary to select those that vary by 10 square feet or more, as indirect radiator sections are not made smaller than 10 square feet per section. In a house where the radiators would be less than three sections, it is necessary to put two or three rooms on the same radiator, as it is not desirable to make very small indirect stacks. There is always danger, however, in taking the heat for two separate rooms off the same radiator, that the heat will not dis-

tribute equally between the two rooms. When separate rooms are heated from the same radiator, care should be taken to see that pipes leading to the two rooms have about the same length and as nearly as possible the same resistance.

A much more common arrangement of indirect radiators is to put in just enough indirect radiation to give the proper amount of air for ventilation and supply the addi-

Table XVI—Results of Computation, Indirect System.

| | B. T. U.'s lost per hour. | Size of radiator in sq. ft. | Area hot air flue. | Area cold air flue. | Area vent flue. | Volume of room. |
|---------------------------------|------------------------------|--------------------------------|-----------------------|------------------------|--------------------|--------------------|
| FIRST FLOOR— | | | | | | |
| Parlor | 10,395 | 50 | 100 | 75 | 12x12 | 900 |
| Sitting room | 7,035 | 35 | 70 | 53 | 8x12 | 700 |
| Dining room | 8,085 | 40 | 80 | 60 | 8x12 | 720 |
| Kitchen | 10,300 | 50 | 100 | 75 | 12x12 | 1,000 |
| Hall, 2d floor | 15,800 | 73 | 145 | 110 | 12x12 | 1,500 |
| SECOND FLOOR— | | | | | | |
| W. chamber, alcove | 19,370 | 93 | 180 | 135 | 12x20 | 1,600 |
| So. chamber | 7,035 | 35 | 70 | 50 | 8x12 | 700 |
| N. chamber | 8,190 | 40 | 80 | 60 | 8x12 | 750 |
| Bath | 3,465 | 17 | 40 | 30 | 6x 8 | 300 |
| E. chamber | 5,250 | 24 | 50 | 35 | 6x 8 | 500 |

tional heat for the room with direct radiation. Each system is installed as though the two were separate,

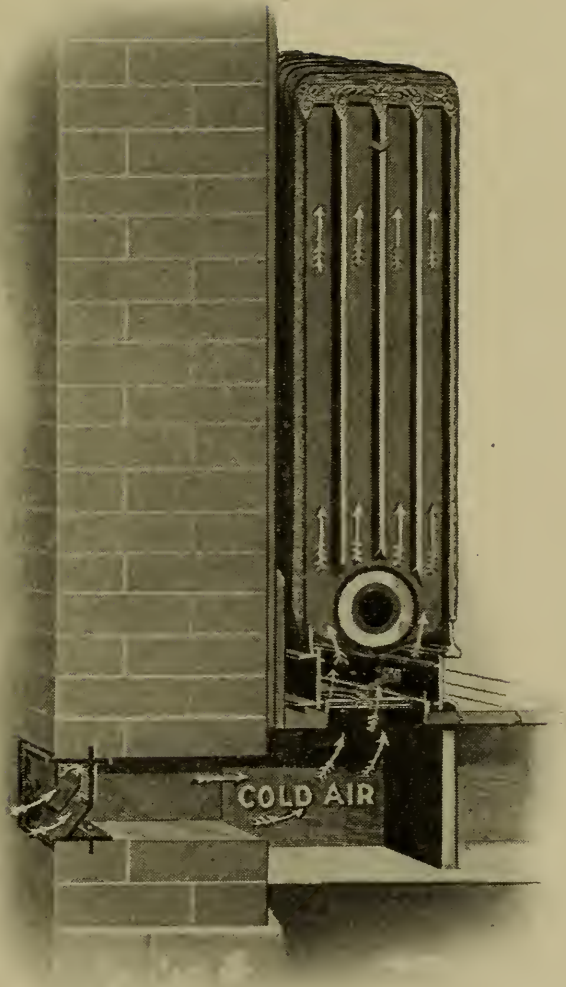


Fig. 18. Arrangement of Flue Radiator.

except that they take their steam from the same steam mains and return into the same return pipes. In this system the direct radiators can be installed on the one-pipe system, but the indirect should be installed on the two-pipe system as indirect radiation does not work well on a one-pipe system. It is not necessary to put indirect radiation into all the rooms of a residence. They are put into the principal living rooms, the hall and the large bedrooms. Where the house is small it may be necessary to put indirect radiation only in the sitting room and in the hall. An example of this kind will be taken up under the head of ventilation.

Flue Radiators.

Where only a small quantity of air is needed for ventilation flue radiators may be used in place of indirect radiators.

The damper in the outside wall regulates the amount of air passing into the room and in extremely cold weather this may be entirely closed. Table VIII on page 65 shows the heat loss from this type of radiation and the amount of air that the flues will pass. In figuring this type of radiation figure the same as for direct radiation and add 25%. Each 30 square feet of flue radiation will furnish ventilation sufficient for one person.

CHAPTER V.

STEAM BOILERS AND STEAM PIPING.

Boilers are divided into two general classes—fire tube or tubular, and water tube or tubulous boilers. The commonest form of boiler used for heating purposes in this country is what is known as the return flue fire tube boiler.

These boilers are adapted to plants of over 30 and under 150 horsepower and where the pres-

Types.

sure does not exceed 100 pounds. For pressures above 100 pounds it is customary to use water tube boilers. There is one exception, that is the Scotch marine boiler, which is a fire tube boiler and which can be made to withstand pressures of 200 pounds and over in large sizes, as in this boiler the fire does not come in contact with the outside shell.

For heating purposes there have been introduced a number of special forms of boiler, a great many of these forms being built of cast iron. Cast iron boilers are not operated at pressures exceeding 10 pounds.

Any of these forms of boilers may be used for heating and the selection of the proper form will

depend upon the conditions in each particular case. In selecting a boiler the following points should be taken into consideration: The boiler must be of sufficient strength to withstand the maximum pressure to be carried. This does not usually exceed 10 pounds. It must have sufficient heating surface in proportion to the grate surface to be economical. The stack temperature in a low pressure boiler should not exceed 450 degrees; in the best plants it does not exceed 300 degrees. The boiler must have sufficient liberating surface so that the steam formed in the water may escape from the surface of the water, without carrying a large quantity of water with it. The boiler must have large circulating areas so that the water may be circulated freely to the heating surfaces and the steam formed may pass away from the heating surfaces without restriction. The steam that forms on the heating surfaces rises in bubbles and is liberated from the surface of the water. If the boiler has insufficient liberating surfaces or the circulating areas are contracted the steam cannot rise rapidly enough and bubbles of steam remain on the heated surfaces. These bubbles prevent the water from reaching the heating surfaces and as steam is a poor conductor of heat this results in an overheating of these surfaces. This trouble may be very serious, especially in the water tube type of boiler, and results in the burning out of the tubes. In

cast iron boilers the lack of proper liberating surfaces and sufficient steam space often causes excessive priming. The question of circulating area and liberating surface is of more importance in a low pressure boiler plant than in a high pressure plant, as steam at 5 pounds pressure has about six times the volume of steam at 100 pounds pressure; so that to have relatively the same circulating area and liberating surface in a low pressure boiler, we should have five times as much as in a high pressure boiler.

In boilers for heating purposes it is desirable that they should have sufficient steam space, and a large storage of water, particularly if the plant is to be continuously operated. In boilers having large water storage it is possible to maintain a steam pressure on the boiler all night under banked fires. Where boilers are to be operated only occasionally, it may be desirable to have a small quantity of water, as each time the boiler is started it is necessary to heat all the water in the boiler before steam is formed. The ordinary fire tube return flue boiler, on account of its large water storage, liberal circulating areas and large liberating surface, is a desirable one for heating purposes.

The heating surfaces in a boiler are those surfaces which have water on one side and hot gases on the other. A boiler should be so proportioned

as to transmit as much of the heat generated by the fuel to the water as possible.

**Proportion of
Boilers.**

Experience has determined that for best results in boilers of 50 horsepower and over a square foot of heating surface should evaporate not more than three pounds of water per square foot of heating surface. For small houses, where heating boilers of but a few horsepower are used, it is not usual to allow a square foot of heating surface to evaporate more than 2 pounds of water and when a square foot of heating surface evaporates more than the amounts given above, the transmission of heat through the plate becomes so rapid that all the heat is not removed; the result is an excessively high stack temperature and a corresponding loss of heat. Surfaces that have steam on one side and hot gases on the other are called super-heating surfaces. It is not advisable to have super-heating surfaces in a boiler.

The proportion of grate surface to heating surface depends upon the kind of fuel and the intensity of the draft. In small boilers used for heating purposes it is usual to allow one square foot of grate surface to every 20 to 30 square feet of heating surface. For boilers 50 horsepower and over it is usual to allow from 30 to 40 square feet of heating surface per square foot of grate surface and in very large boilers the ratio is 50 to 60

square feet of heating surface per square foot of grate.

The rate of combustion for anthracite coal will vary from 5 to 7 pounds of coal per square foot of grate surface per hour with average draft. With bituminous coal under similar circumstances, 6 to 8 pounds will be burned in the smaller boilers and from 12 to 15 pounds in the larger sizes.

The air opening to be allowed in the grates depends upon the kind of coal, but usually does not exceed 50 per cent of the area of the grate. Anthracite and the better grades of bituminous coal do not require as large opening as do the slack coals.

The term boiler horsepower as applied to boilers has no definite value and varies with local customs, and the opinion of the manufacturer.

The rating of a boiler should be the amount of steam it can evaporate with good economy and without producing wet steam. In purchasing a boiler specify the number of square feet of heating surface the boiler should contain. This is a better criterion of the work that the boiler will do than the horsepower rating. The American Society of Mechanical Engineers has adopted the following rating for the horsepower of a boiler :

Boiler Horsepower.

),
, , ,
, , ,
, , ,

Table XVII—Cast Iron Boilers for Steam Heating.

| Name of heater. | Radiation, sq. ft. | Grate surface, sq. ft. | Heating surface, sq. ft. | Sq. ft. of heating surface per sq. ft. of grate surface. | Sq. ft. radiation per sq. ft. of grate. | Sq. ft. of radiation per sq. ft. of heating surface. |
|-----------------|--------------------|------------------------|--------------------------|--|---|--|
| A... | 750 | 5.04 | 90 | 17.8 | 149 | .42 |
| B... | 700 | 4.8 | ... | ... | 146 | ... |
| B... | 800 | 5.25 | ... | ... | 155 | ... |
| C... | 750 | 6.25 | 120 | 19.2 | 120 | 6.25 |
| C... | 3,400 | 25.00 | 540 | 21.6 | 136 | 6.3 |

A boiler horsepower is $34\frac{1}{2}$ pounds of water evaporated from feed water at 212 degrees, to steam at 212 degrees, which is called the from and at evaporation. According to this rule, if three pounds of water are evaporated per square foot of heating surface, we would allow from 10 to 12 square feet of heating surface for each boiler horsepower.

In order to give some idea of the proportions used by the various cast iron boiler manufacturers, table XVII has been compiled which embodies the practice of three makers of standard cast iron heating boilers. The different makers have been designated by the letters

**Proportions of
Cast Iron
Boiler.**

“A,” “B,” “C.”

STEAM PIPING.

In designing a system of steam piping the three following considerations are the most important: First, that the piping shall be so arranged that all condensed water shall drain from it; second, that it shall be free to expand, that is, so arranged that the joints shall not be strained when the piping is heated; third, that all points in the piping at which air would accumulate shall be provided with some means of removing the air.

In this article the different parts of the piping system referred to will have the following meaning:

MAINS.—Mains are those pipes which lead from the boiler or boiler header to the submains or risers. Usually there are no radiators tapped from these mains.

RISERS.—Risers start from the mains in the basement or attic, and extend up or down through the building. From the risers the connections to the individual radiators are taken.

RETURNS.—All piping carrying condensed water from the steam mains to the boiler is included in the return system. The terms return riser, return main, etc., have the same significance as in the steam system.

RELIEFS OR DRIPS.—A small pipe connecting the steam to the return system so as to carry condensed

water to the returns is called a relief or drip. Drips are used at all points where water would collect in the steam system. These drips are sometimes made of large pipe and called equalizing pipes, serving to equalize the pressure between steam and return mains in gravity return systems.

PITCH.—The pitch of a pipe refers to its inclination from the horizontal pipe lines. It is best that pipes should pitch with the current of the steam, so that the steam will assist in the removal of the condensation. Return pipes are usually pitched toward the boiler so that the system may be drained at that point.

WATER LINE.—The water line is the height at which the water stands in the return pipes. In a well designed gravity system it is seldom more than six inches above the water line of the boiler.

SIPHON.—When a vertical bend is made in the return main so that the return dips down and returns to its former level, it is called a siphon. All siphons should be provided with a drain (or pet cock).

DAMS.—Sometimes the water level in the boiler is lower than that desired in the piping system and an inverted siphon is placed in the return pipe. No return will then take place until the water has reached the highest point of this bend in the return. A dam should be provided with an air cock.

WATER SEAL.—Where a return pipe enters the

return main below the water line it is said to be sealed. It is customary to seal all main riser drips and returns from indirect radiators and pipe coils.

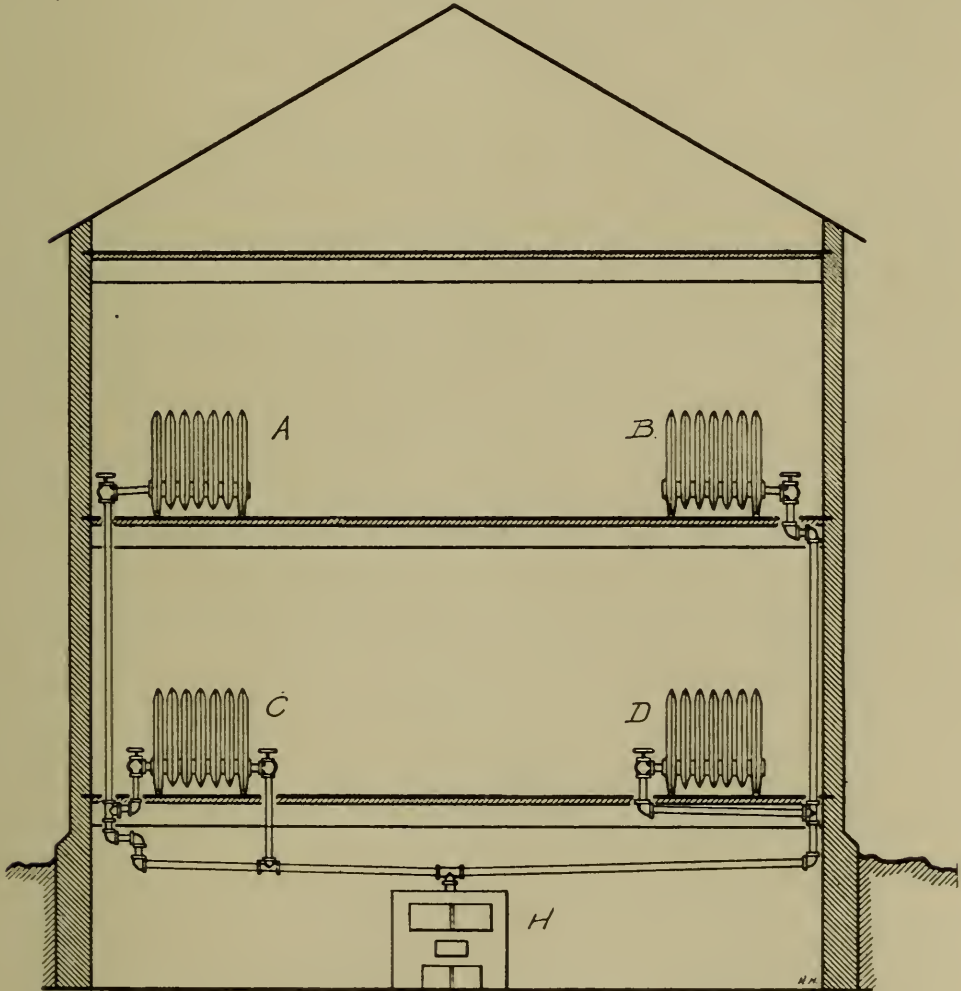


Fig. 19.

WATER HAMMER.—The rattling and the hammering often heard in pipes is called water hammer. It is caused by steam coming in contact with water or surface in the pipes which is colder than itself. A sudden condensation results and a vacuum

is produced into which the water rushes. The blow is often so severe as to crack the fittings and spring the valves. It is most apt to occur when the plant is first started. Accidents from this cause may be avoided by admitting the steam very slowly at first.

STEAM TRAPS.—Steam traps are vessels usually placed between the steam and the return system to allow the water of condensation to be carried to the return system without steam entering the returns. By the use of steam traps the steam and return mains may have a wide difference of pressure. Steam traps are objectionable as they are liable to get out of order and require frequent repairs.

The systems of piping may be grouped under three general heads. First, the one-pipe system. In this system the pipe carrying the steam to the radiator also returns the condensed water from the radiator to the boiler. Second, two-pipe system, in which one set of pipes is used to carry the steam to the radiator and an entirely separate set of pipes is used to carry the return water to the boiler. Third, a combination of these two systems. The usual arrangement in the combination system is to run the mains on a two-pipe system, but the connection between the mains and the radiators is on the single pipe system. The

Systems of Piping.

one-pipe system has certain fundamental advantages over the two-pipe system. In the one-pipe system the steam and condensed water are always at the same temperature and as a result there is

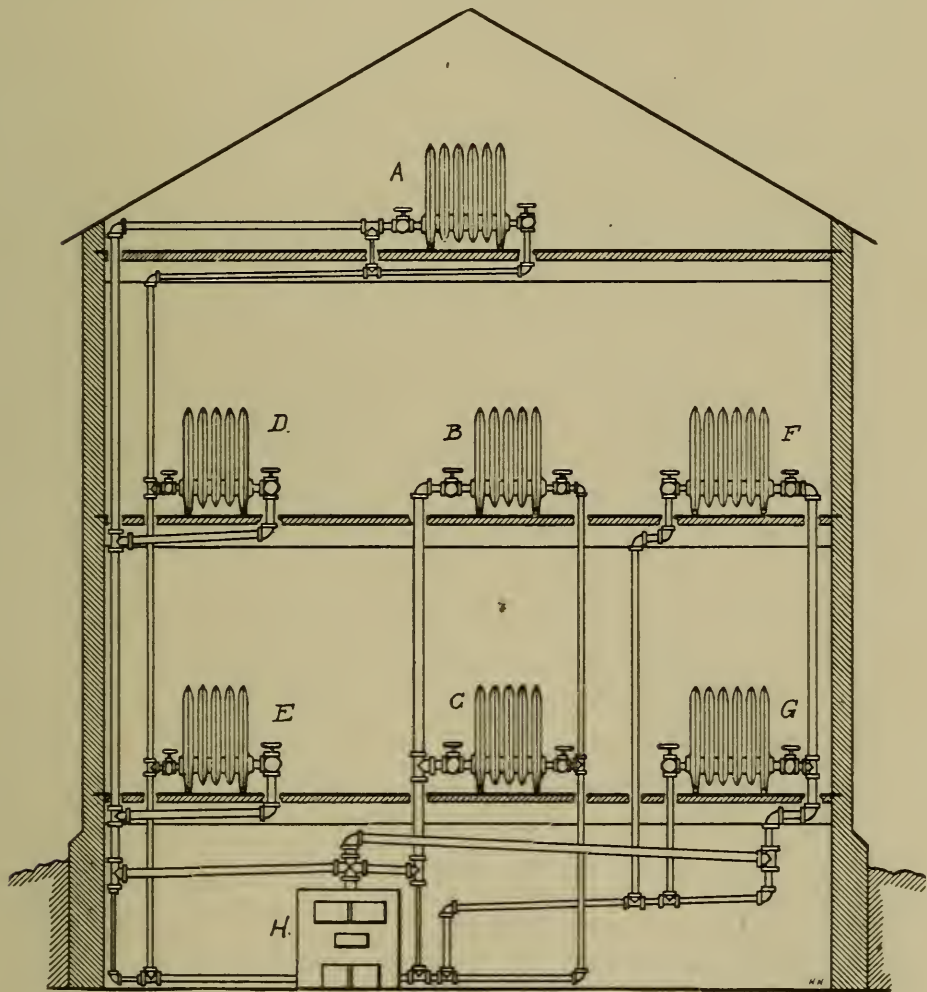


Fig. 20.

very little opportunity for water hammer. In the two-pipe system the steam and water being separate the water may become considerably cooled below the temperature of the steam, and if at any

point in the system it again comes in contact with the water we have condensation of the steam, vacuum forms, causing water hammer. In large plants, however, the one-pipe system is not desir-

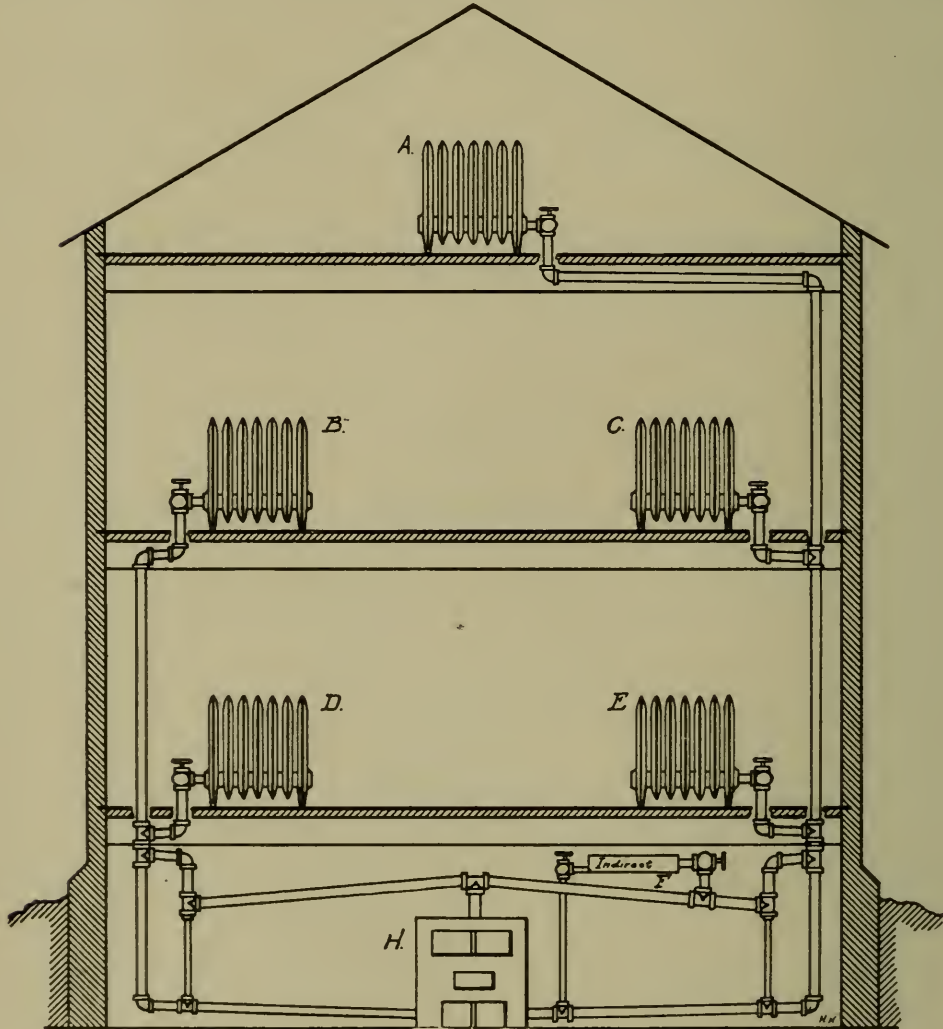


Fig. 21.

able as it necessitates carrying a very large quantity of water in the steam mains.

ONE-PIPE SYSTEM.—The simplest of all piping systems used in steam heating is what is known

as the one-pipe gravity system. In this system, the steam generated in the boiler flows through the pipes to the radiators where it is condensed. The

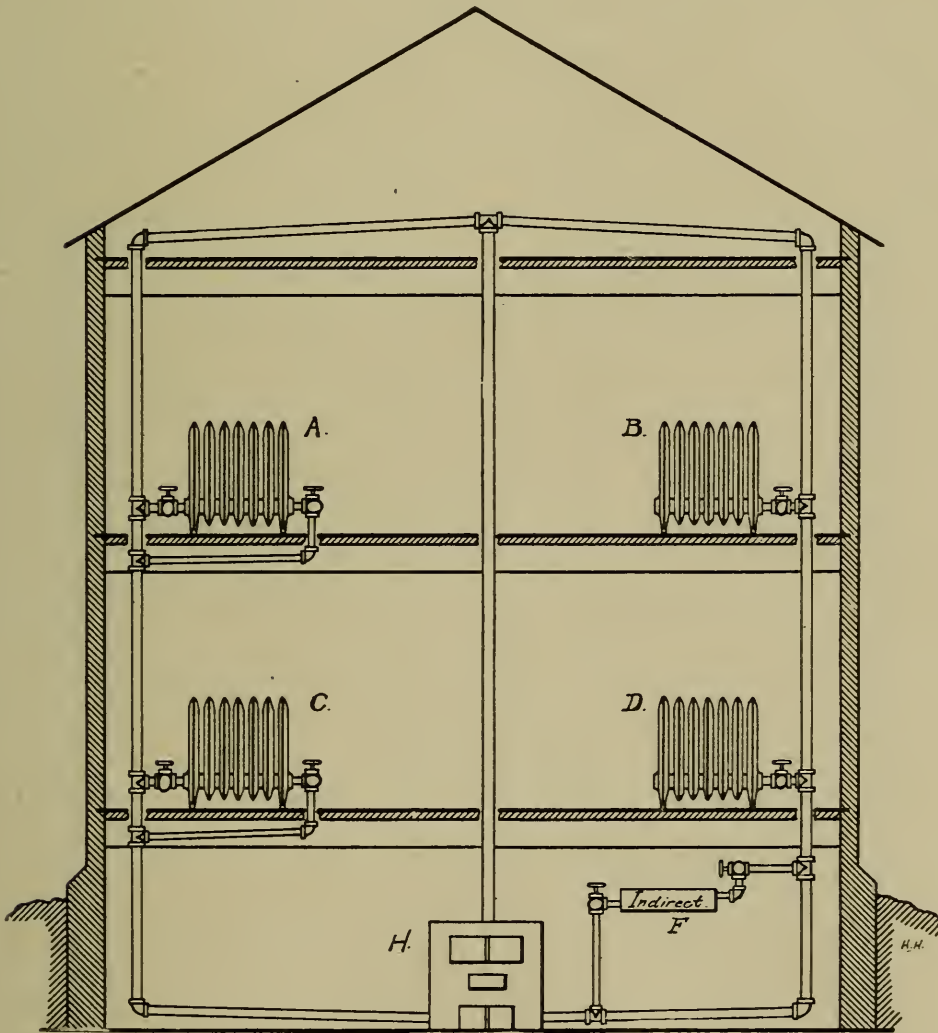


Fig. 22.

condensed steam in the radiators flows back through the same piping system to the boiler. This arrangement necessitates the condensed steam flowing back against the current of the steam. This

is objectionable as there is a tendency to trap the water. Because of this tendency it is good practice to make the pipes larger in size than would be the case if the steam and water flowed in the same direction. In the one-pipe gravity system the pipe should always be given a good pitch toward the boiler. Figure 19 shows in diagram the piping and radiator connections for a one-pipe system.

TWO-PIPE SYSTEM.—In the two-pipe system one system of pipes supplies the steam and another system carries off the water of condensation. The principal object in the two-pipe system is to avoid the accumulation of any great amount of water in the radiators or mains and in that way give a more positive circulation. Figure 20 shows the general arrangement used in the two-pipe system. The indirect radiators and pipe coils should always be connected on the two pipe system.

COMBINATION SYSTEM.—In ordinary buildings the most satisfactory method is to use a combination of the one-pipe and the two-pipe systems. In this system, as shown in diagram in Figure 21, the radiators and risers are on the one-pipe system, while the mains are installed on the two-pipe system. The system has this advantage over the one-pipe system of mains, that the mains are not obliged to carry so much water of condensation and can be freed from water from time to time. The one-pipe radiator connections of this system are

more desirable than the two-pipe radiator connections in that there is but one valve to get into trouble instead of two and the steam and the water of condensation are always in contact with each

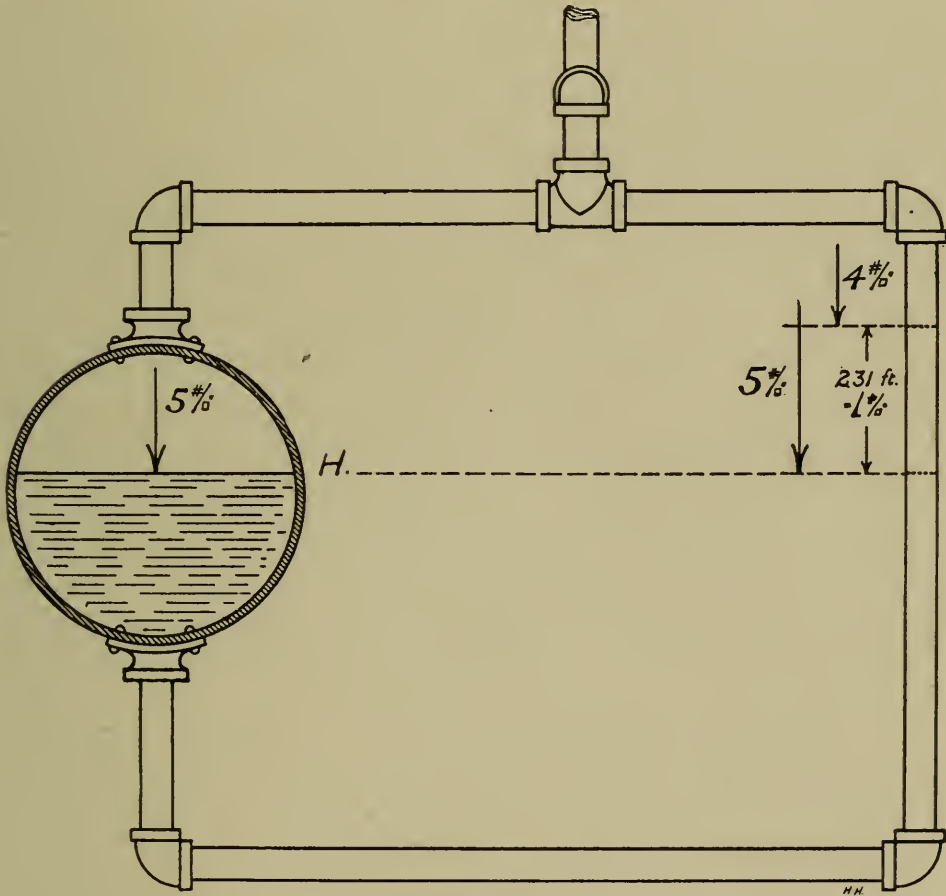


Fig. 23.

other—thus avoiding the danger of water hammer. The risers may be one-pipe, as it is very seldom that we have difficulty with the circulation in using vertical risers. In most cases the one-pipe radiator connections and two-pipe mains will be found to give the best satisfaction.

OVERHEAD DISTRIBUTION.—In office buildings and buildings where the basement space is valuable for rental purposes, it is desirable to place the steam mains where they will occupy the least desirable space. It is customary to run a vertical steam main to the attic. A set of distributing mains is run through the attic, from which vertical risers extend down through the building with drip pipes connecting to the return system at their lower ends. The radiators are connected to the risers by means of single-pipe radiator connections. This system gives very satisfactory results as in all cases the currents of steam and water are in the same direction. In buildings exceeding four stories in height it is usually necessary to provide some form of flexible connection to allow for expansion. A system of this kind is shown in Figure 22.

GRAVITY SYSTEM.—Figures 19-22, inclusive are all shown for gravity return system and this system is the one commonly used for all small buildings and for residences. In this system the steam and return mains are connected to the boiler without the introduction of pumps or traps, so that the condensed steam flows back to the boiler by gravity. Figure 23 gives a diagrammatic sketch of such a system. If the pressure at the surface of the water in the boiler is the same as the pressure of the surface of the water in the return mains, then

the water level in the return mains and in the boiler will be the same. But if, as shown in Figure 23 by the dotted lines, the pressure in the boiler is 5 pounds and the pressure is only 4 pounds when it gets to the ends of the system, then the system is no longer balanced. It is necessary for the water to rise in the return mains until the column of water in the return mains is equal in height to the pressure of 1 pound, or approximately, it must rise about 2.31 feet so that the water in the return main will be 2.31 feet higher than the water in the boiler, and this will be true for each 1 pound difference in pressure between the steam at the boiler and the steam at the extremities of the system. It is necessary, then, to be very careful to have ample sized piping in this system so that the pressure at all points of the return main will be about equal. In addition, it is necessary that the steam radiators, both direct and indirect, be at least 2 feet above the water line. For the reasons given above it is not desirable to operate large plants on the gravity return system, as this system requires larger expense for steam mains and more or less difficulty will always be experienced in starting up the system. The systems of circulation involving traps and pump circulation will be taken up under the head of Central Heating Systems.

There are a great many rules given for determining the size of steam return mains, all of which

must be more or less modified to meet the particular case in hand. In fact a very

Size of Steam careful determination of the size
Return Mains. of main is not necessary, as, no matter how carefully we calcu-

late the size of the main, it is necessary to take the nearest pipe size. In determining the size of the main two conditions must be considered. First, it must be of sufficient capacity to allow of free circulation. This is the principal consideration in smaller buildings. Second, the mains must not produce more than a certain drop of pressure. This point is of particular importance in the design of central heating systems. In the case of residences, the size is determined by rules determined by practice. In the second place, the laws governing the amount of pressure in steam pipes are fairly well known. They will be treated under the head of Central Heating Systems. The most rational method of finding the size of mains is by determining the velocity of steam passing in the main. Knowing the weight of steam passing in the main and having the pressure, the volume of steam passed through the main is known. This volume divided by the allowable velocity in feet gives the area of the pipe in square feet. The velocities allowed in various forms of mains are as follows:

In steam engine connections from 75 to 100 feet per second.

In exhaust steam mains from 75 to 150 feet per second.

For steam heating work on the one-pipe system, 2 inches and under 10 feet per second.

For two-pipe work pipes 2 inches and under 15 feet per second.

For two-pipe work pipes 2 to 4 inches 25 feet per second.

For single-pipe work low pressure pipes 2 to 4 inches 15 feet per second.

For single-pipe work low pressure pipes 4 inches and over 30 feet per second.

EXAMPLE.—Assume that a main is to supply 2,000 feet of radiation. This radiation gives off approximately 1.70 B. T. U's per square foot of radiating surface per degree difference of temperature. Let the temperature of the steam be 220° , the temperature of the room 70° . Then the total B. T. U's transmitted per hour will be $220-70 \times 1.70 \times 2,000 = 510,000$. At 220° the latent heat of steam taken from the steam tables equals 966 B. T. U's. Then the steam used per hour will be $510,000 \div 966 = 527$ pounds of steam. At 220° each pound of steam has a volume of 22.95 cubic feet. Hence we have $527 \times 22.95 = 12,000$ cubic feet per hour or 3.3 cubic feet per second. For a velocity of 25 feet per second we must have a pipe with an area of .134 square feet or 19 square inches. This is approximately the area of a 5-inch pipe.

Rule 1.—The following is a very common rule for gravity return systems: To determine the diameter of the main leading from the boiler, point

**Miscellaneous Rules
for Size of
Steam Main.**

off two places in the number expressing the radiating surface and take the square root of the remainder. To apply the above rule for indirect surfaces, multiply the indirect surface by seven-fifths and proceed as for direct surface. As an example, suppose we are to supply 2,000 square feet of direct radiation. We point off two places, which gives us 20. The square root

Table XVIII—Pipe Sizes.

| Number of sq. ft. of radiation on the main or riser. | Steam Main single pipe system. | Steam Main two pipe system | Steam River single pipe system. | Steam River two pipe system. |
|--|--------------------------------|----------------------------|---------------------------------|------------------------------|
| 50..... | 1 ½ inch | 1 ¼ inch | 1 ¼ inch | 1 ¼ inch |
| 100..... | 2 inch | 1 ½ inch | 1 ½ inch | 1 ½ inch |
| 150..... | 2 inch | 1 ½ inch | 2 inch | 1 ½ inch |
| 200..... | 2 ½ inch | 2 inch | 2 ½ inch | 2 inch |
| 250..... | 2 ½ inch | 2 inch | 2 ½ inch | 2 inch |
| 300..... | 3 inch | 2 ½ inch | 3 inch | 2 ½ inch |
| 400..... | 3 ½ inch | 3 inch | 3 inch | 2 ½ inch |
| 500..... | 3 ½ inch | 3 inch | 3 inch | 3 inch |
| 600..... | 3 ½ inch | 3 ½ inch | | |
| 800..... | 4 inch | 3 ½ inch | | |
| 1,000..... | 4 ½ inch | 4 inch | | |
| 1,500..... | 4 ½ inch | 4 inch | | |
| 2,000..... | 5 inch | 4 ½ inch | | |
| 3,000..... | 6 inch | 5 inch | | |
| 4,000..... | 7 inch | 6 inch | | |
| 6,000..... | 8 inch | 7 inch | | |

of 20 is 4.48, which would make the size of the main $4\frac{1}{2}$ inches.

Table XVIII gives the common practice in pipe sizes :

The steam supply of the radiator should never be less than 1 inch. Steam mains in one-pipe work should not be less than $1\frac{1}{2}$ inches and in two-pipe work less than $1\frac{1}{4}$ inches. The return connections to radiators should not be less than $\frac{3}{4}$ -inch and return mains should not be less than 1 inch. The drip pipe should not be less than $\frac{3}{4}$ -inch. Long horizontal pipes should be one-pipe size larger than the verticals in the same line. In the overhead system, especially where the building is over seven or eight stories, it is well to make the risers fairly large at the lower end to take care of the condensed steam. These risers, even at the lower end, should not be less than 2 inches in size.

RETURN MAINS.—Return mains cannot be figured for returning the water of condensation at a low velocity alone, but allowance must be made for the very sudden demands which occur when the plant is started and for the air carried with the water. The size of the return main is determined almost entirely by practical considerations.

Table XIX gives the relative size of steam and return main and diameter of steam main.

Return mains may be placed on a dead level, but as a rule it is desirable to give them some slight

pitch, to some point, preferably the boiler. At its lowest point there will be provided some sort of drain cock so that all condensed steam may be drained out of the system. The radiators, as well

Table XIX—Relative Size of Mains.

| Diameter Steam Pipe. | Diameter Return Pipe. |
|-------------------------|--------------------------|
| 1½ | 1 |
| 2 | 1 |
| 2½ | 1¼ |
| 3 | 1½ |
| 4 | 2 |
| 5 | 2½ |
| 6 | 3 |
| 8 | 4 |
| 10 | 5 |
| 12 | 5 or 6 |

as the pipes, should be set so that the condensed steam may drain from them easily. It is always best to drain the condensed steam with the steam, in

Pipe Drainage. which case the steam tends to free the pipes of the water of condensation. If mains are long, it is well to drain them at intervals to avoid carrying too much water of condensation with the steam. In the gravity return system where the drip pipes connect to the return system, there should be at least two feet difference in level between the steam main and the boiler water level, in order to avoid the possibility of the water from the boiler being

forced back into the steam main. Check valves will not prevent it, the water of condensation will accumulate in the steam main above the check. If it is necessary to drip the steam main at a point

below or close to the water line, then it should be drained to a separate system of piping and the condensed steam accumulating in this piping should be forced back to the boiler by some mechanical means.

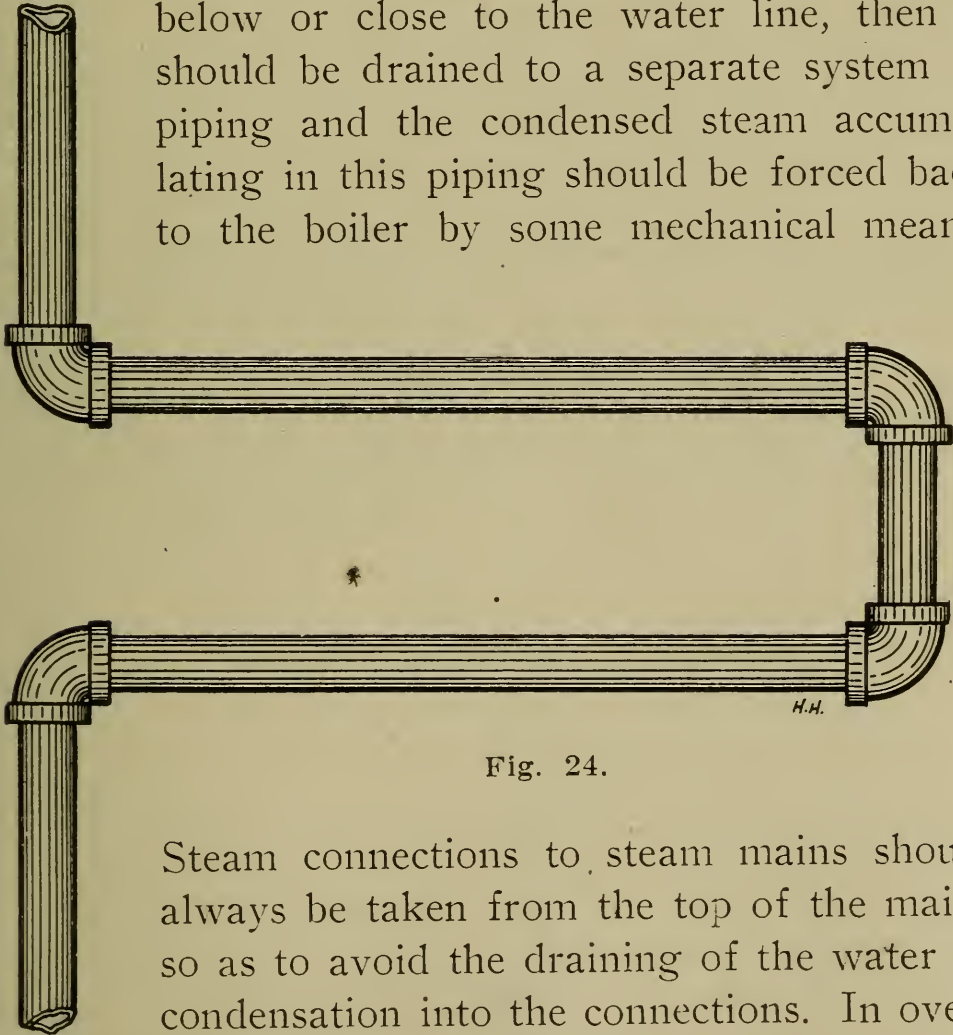


Fig. 24.

Steam connections to steam mains should always be taken from the top of the mains so as to avoid the draining of the water of condensation into the connections. In overhead systems of piping the steam mains may be drained directly through the risers as the amount of condensation is small compared to the number of drain pipes. In this case the risers may be taken from the bottom of the main. In connecting radi-

ators to the pipe system they should be set so as to have a slight pitch in the direction in which they are intended to drain. Radiators set so that they cannot be entirely drained are a very common source of water hammer.

The expansion of pipes in mains exceeding 50 feet in length becomes an important consideration. It is customary to assume that in low-pressure

Expansion of Pipes. steam piping there will be an expansion of $1\frac{1}{4}$ inches per 100 feet of pipe. In steam mains carrying a pressure of 80 pounds or over it is customary to allow for an expansion of about $1\frac{1}{2}$ inches per 100 feet of length. There

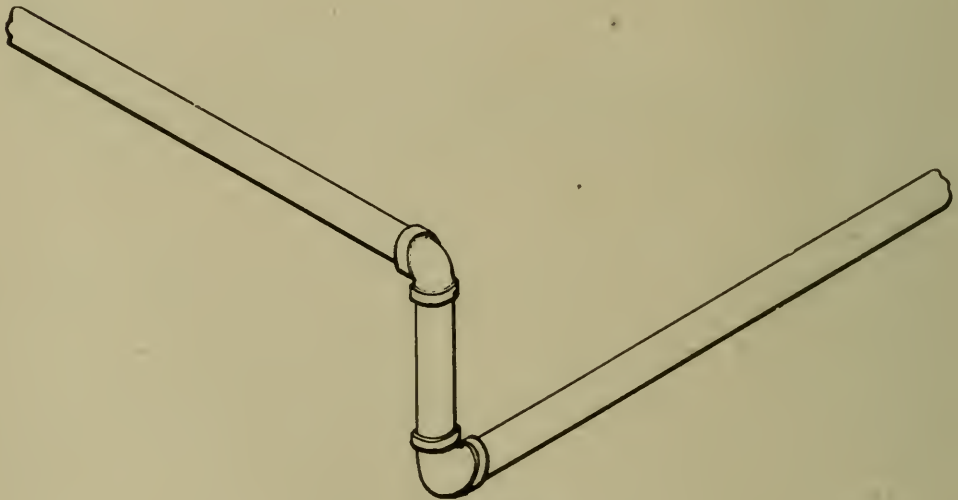


Fig. 25.

are three general methods of taking up expansion.

First, a simple means is by making offsets and turns in the pipe every 50 to 100 feet, the expansion

being taken up by the spring in the pipe. This is shown in Fig. 24. This method is seldom used except in pipes under 4 inches. Another method and the method which it is most desirable to use, is to take up the expansion at all 90° turns. In this method the pipe when it reaches the corner turns either up or down and the expansion is taken up

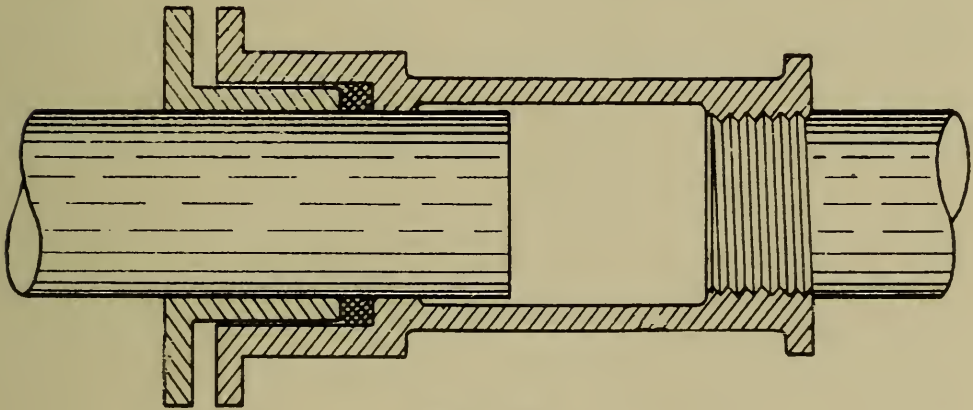


Fig. 26.

by the movement around the vertical nipple in the elbows or tees at the corner. This method of taking up expansion is shown in Fig. 25. The author has had the opportunity of observing a system installed, in which expansion amounting to as high as 4 or 5 inches has been taken up in swing joints and the joints (which have been in use for over seven years) have given no trouble whatever.

The third method is by use of expansion joints. The use of expansion joints is in general not to be recommended. Fig 26 shows a cross-section of an expansion joint. Expansion joints are quite ex-

pensive and are always liable to leak and require attention. By carefully laying out the piping most systems can be installed without the use of expansion joints. The most serious difficulty occurs in the modern high office building. In buildings of not over ten stories expansion joints may be avoided by anchoring the risers in the middle so that they expand in both directions, and allowing for a flexible connection between the risers and supply main in the attic and return main in the basement. In this case the radiators in the upper and lower stories of the building must have allowance made in the radiator connections for expansion of the main.

Another method that has been used to allow for expansion is by offsetting the pipe at about the middle story. As, for example, in a building of say 16 stories, run the riser up to the eighth story, then offset just under the ceiling of the eighth story for a considerable distance, usually not less than 20 feet, and continuing the riser up at another location. The principal objection to this method is its appearance. In some cases it is difficult to avoid the use of expansion joints. In using expansion joints, the joint should be anchored so that the expansion will go in a definite direction.

A great deal of consideration should be given to the valving of a steam heating system. Gate valves should be used on horizontal steam mains, as they do not form a water pocket. If globe valves are

used on steam mains, they should be placed horizontally, that is, in a vertical pipe to avoid forming a steam pocket. Where it is possible to use it, an angle valve makes a very desirable form of valve. In large buildings where the plant will be under the control of an engineer, it is desirable to place valves on the steam risers and valves on the corresponding return risers. In residences it is well to avoid valves, particularly on return mains. A valve on the return main is particularly dangerous as it may be closed by accident while the system is in operation, in which case the radiator will be filled with water and no water will be allowed to return to the boiler.

LOCATION OF MAINS AND RISERS.—Mains and risers should be located in as inconspicuous a place as possible, at the same time they should be accessible. The concealing of mains and risers in the building construction is always a questionable practice. If it is necessary to conceal the pipe it should be concealed under panels screwed on so that they can be removed in case of leakage or other necessary repairs. It is not wise to attempt to save in risers by making long radiator connections. The system will give much better operation by having frequent risers with shorter radiator connections. Where risers are concealed in a building of wooden construction they should be carefully protected from the woodwork.

CHAPTER VI.

CONNECTIONS TO MAINS AND TO RISERS.

In making the connections from mains to risers in a steam system there are three things to be considered—the drip, the expansion, and free circulation. The simplest form of connection is shown in Fig. 27, and for general purposes it is perhaps

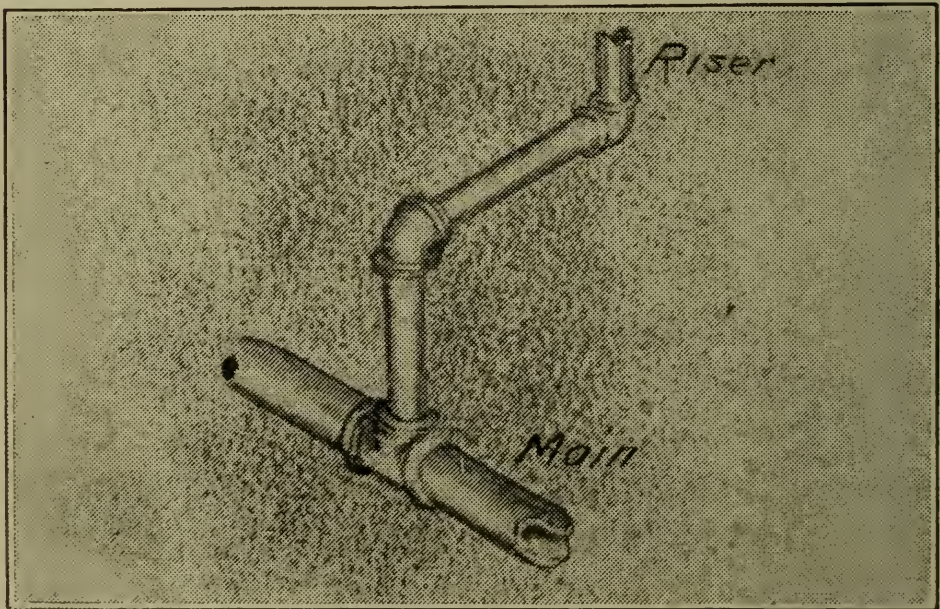


Fig. 27. The simplest form of connection. Not desirable if expansion at right angle is great.

the best form of connection. The expansion of the main in the direction of its length is taken care of by turning in the threads of the vertical pipes. The expansion at right angles to the main, which is or-

dinarily very small, is taken care of by the spring of the pipes. If the expansion occurring at right angles were very large, then some other form of connection would be desirable.

Fig. 28 shows a similar connection, but using a 45-degree elbow in place of a 90-degree elbow at the main, as shown in Fig. 27. This connection offers less resistance to the passage of steam than the connection shown in Fig. 27; on the other hand, it does not allow of as much expansion. The pipe rising from the main

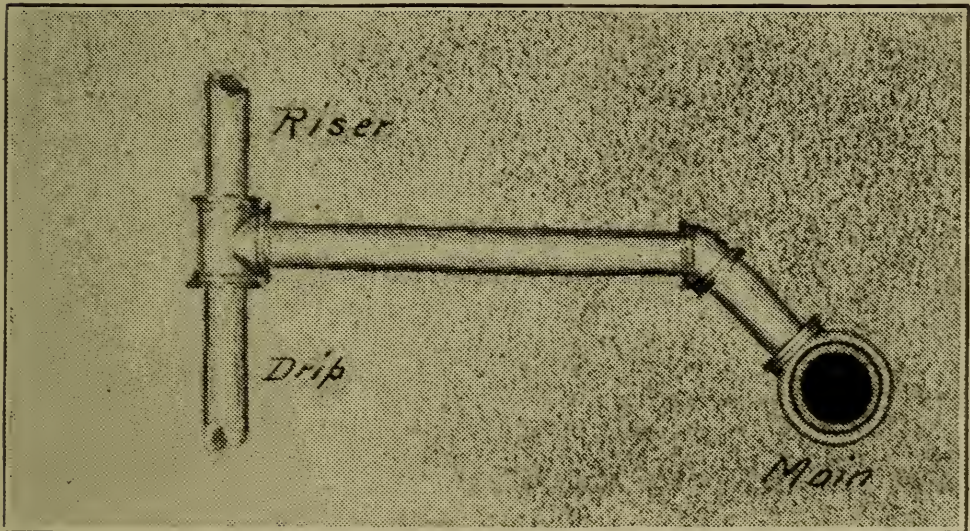


Fig. 28. Using a 45° ell instead of a 90°, as shown in Fig. 1.

being at 45 degrees, there is a limited opportunity for any turning in the threads of the pipe and expansion is taken up by the spring of the pipe. In this figure a drip is shown at the bottom of the riser. A drip is often placed at this point, particu-

larly in large buildings. In smaller plants condensation is carried back through the steam connection itself, as in Fig. 27. In larger buildings it is undesirable to carry so much condensation through the horizontal pipes and a drip is placed at the bottom of the riser, as shown in Fig. 28.

Fig. 29 shows a connection similar to that in Fig. 27. It allows free expansion of the main, the same as Fig. 27. In Fig. 29 all the condensation

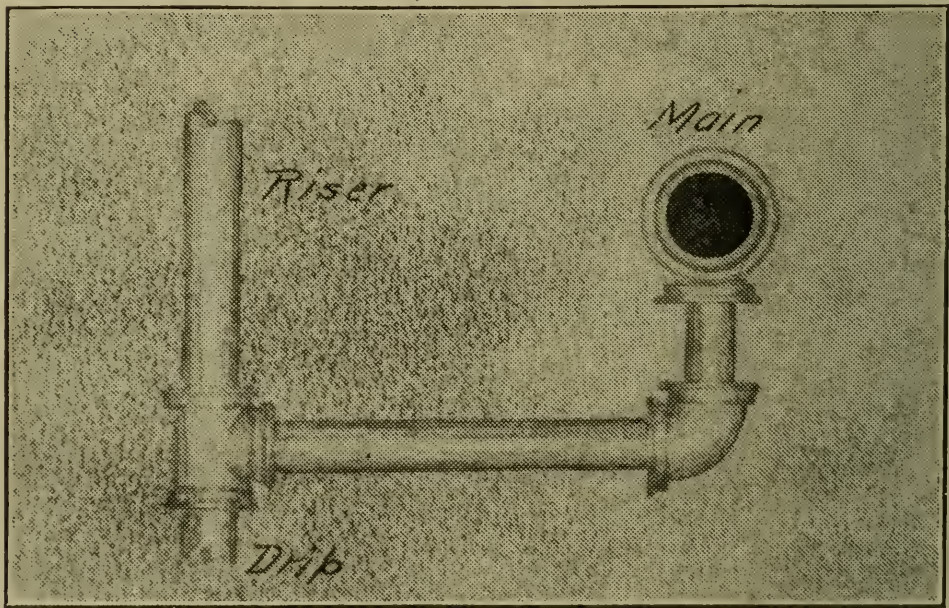


Fig. 29. Allows free expansion of the main; requires a drip at the point where riser starts.

which has occurred in the main up to this connection will drain into the connection and it is therefore necessary to place a drip at the point where the riser starts. A connection of this kind is often used where it is desired to meter different riser con-

nections for different consumers, then the condensation for each riser or each set of risers can be collected and metered with very little possibility of its coming back into the main. This is, in some respects, an undesirable form of connection. If for any reason the water level rises in the return system above the horizontal pipe connection to the riser then the riser will be entirely sealed from the main

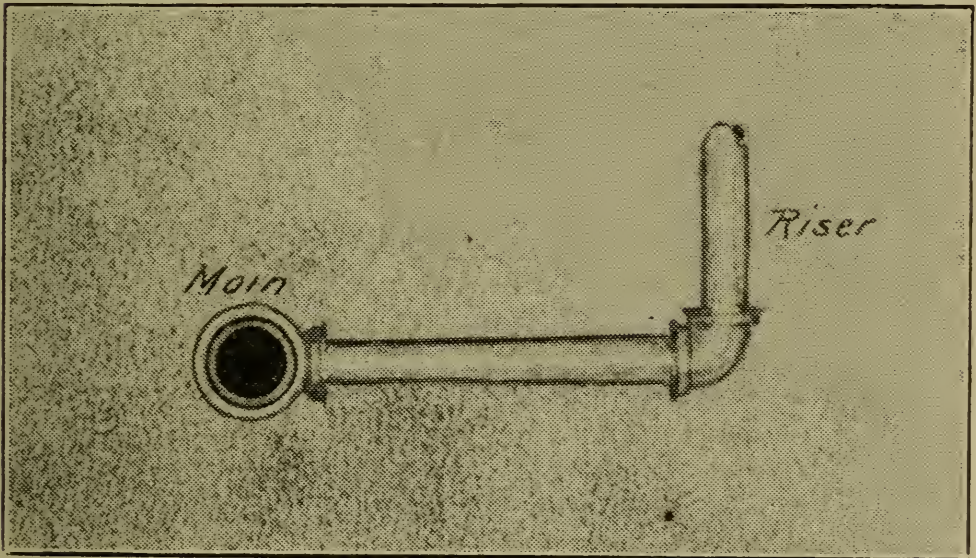


Fig. 30. Often used in limited headroom. Usually undesirable.

and it will be impossible to get steam into the riser. The writer has experienced this difficulty in places where it was necessary to use this form of connection. This happens particularly in gravity return systems.

Fig. 30 shows a form of connection often used where there is very limited head room. As a general rule this form of connection is a very unde-

sirable one. It allows almost no expansion, all expansion in such a connection must be taken up in the spring of the pipes. In addition to this, if the main happens to carry a large amount of water of condensation, part of this condensation may flow into the horizontal pipe and impede the circulation in the horizontal. Under the same conditions if a

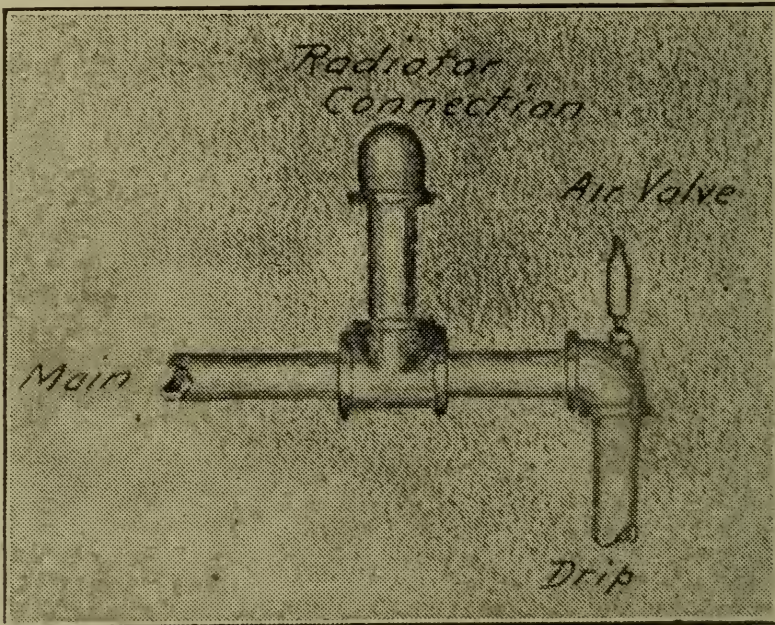


Fig. 31. A different way of carrying off the drip; used where drip is taken off at end of main.

connection such as is shown in Fig 27 or Fig. 28 were used, no difficulty would be experienced.

Fig. 31 shows another method of carrying off the drip. This arrangement is used where the drip is to be taken away at the end of the main. It is very often desirable at such points, particularly if the main is long, to remove the air from the pipe.

The figure shows an air valve placed at the end of the pipe. Locating an air valve at the end of a main near the point of the drip facilitates the rapidity of

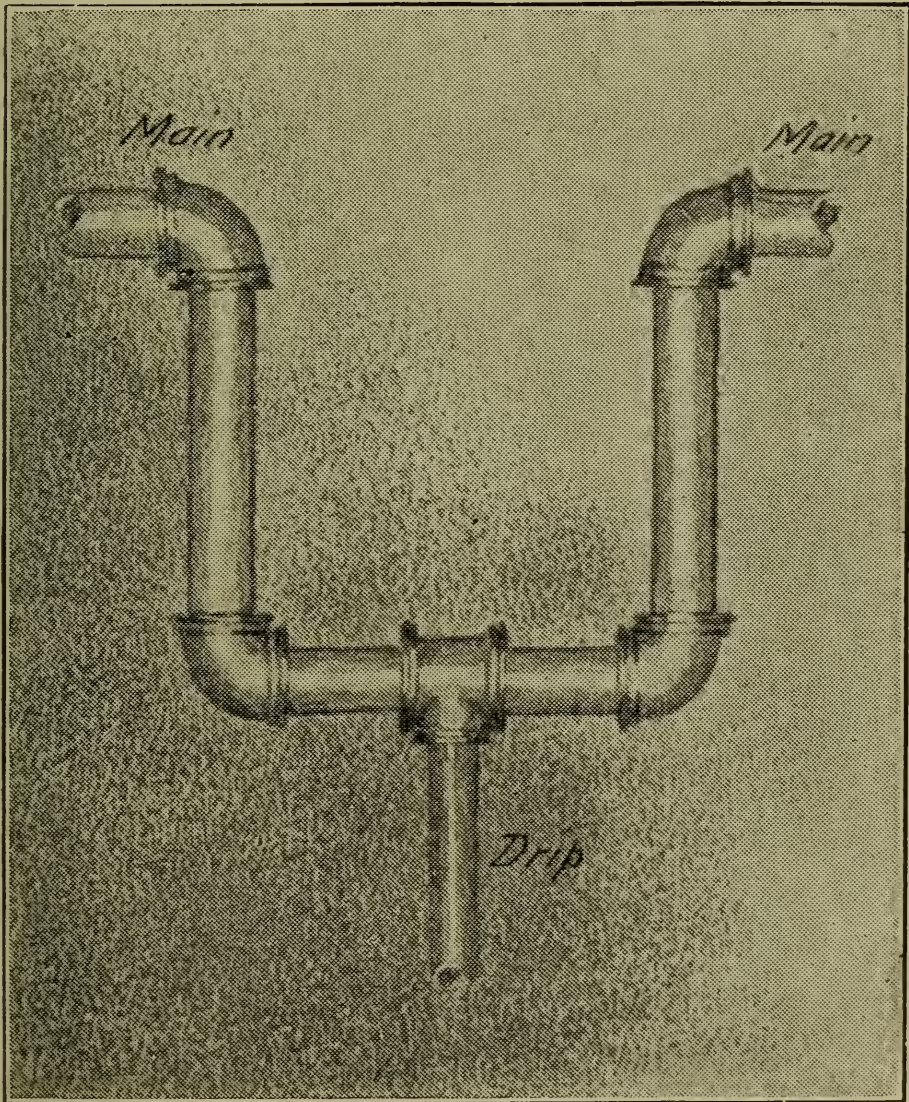


Fig. 32. Drips from two mains to a single drip pipe. Simple but undesirable.

the circulation in the main. In a great many installations all the air in the system is taken care of by

means of the radiator air valves. Such an arrangement, particularly if the house be large, always

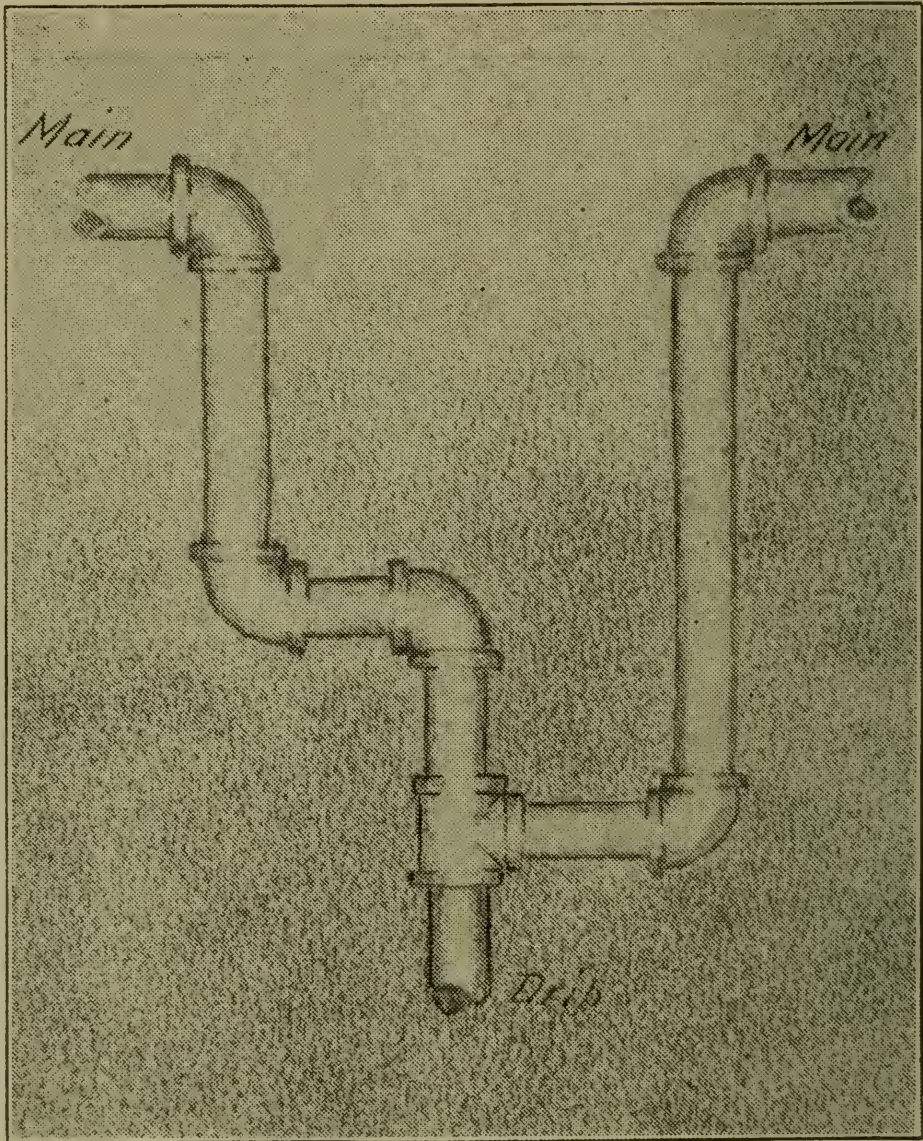


Fig. 33. A better arrangement of dripping two mains into one drip pipe.

makes the system slow in circulation. In the larger systems it is absolutely imperative that the steam

mains be properly relieved of air. In addition to making the steam slow in circulation, it causes unequal expansion of the piping. This trouble will be taken up in another chapter.

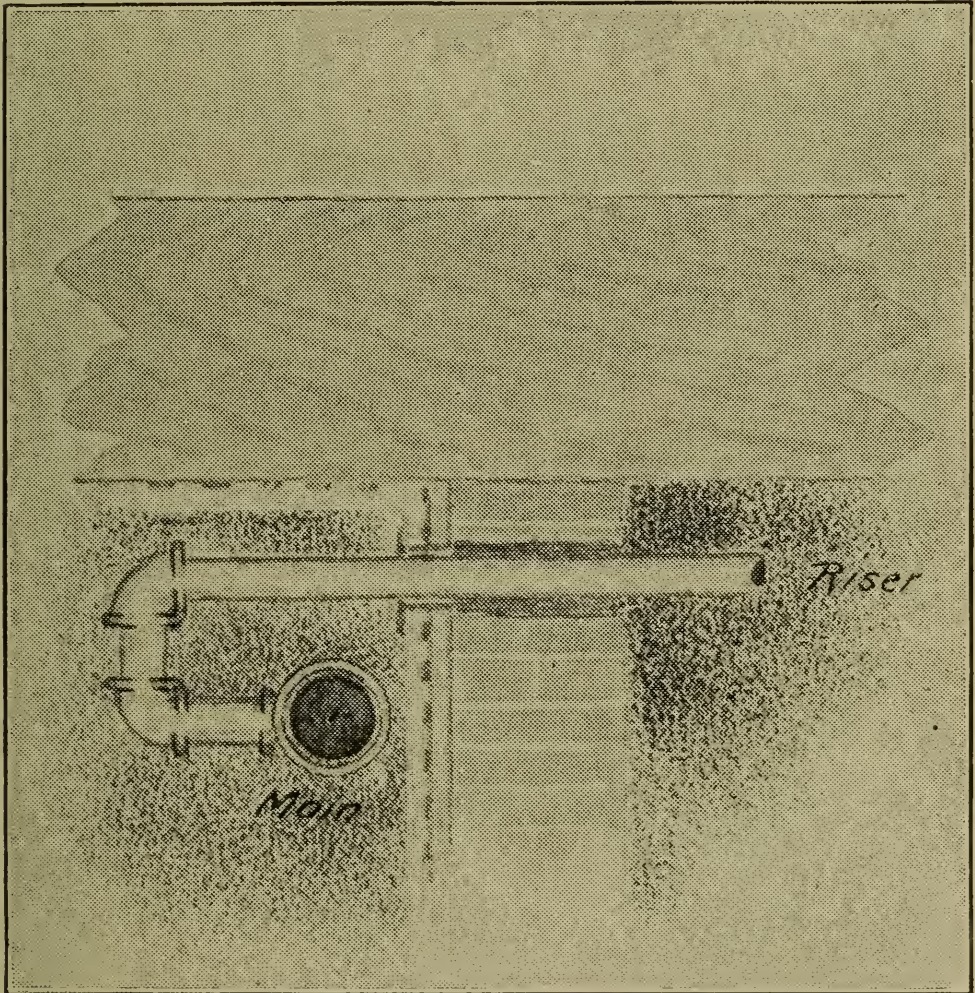


Fig. 34. Connection from main to riser where head room is very short and expansion great.

Fig. 32 shows the connection of the drips from two mains to a single drip pipe. Such an arrangement, while simple, is undesirable, as the condensa-

tion from one main often interferes with the condensation coming from the other main. This would give very little trouble if the connection were made above the water line. The objection, however, to making such connection above the water line is that if the two currents of condensation which meet at this point are not at the same temperature, hammering or a chattering noise results. If placed below the line there is an opportunity for the two streams of water to interfere with the circulation.

A better arrangement is that shown in Fig. 33, in which the two streams of water coming as drip from the steam mains would not strike each other in the same line; the one stream would flow into the other. The union of the two streams should occur below the water line of the system, if possible.

Fig. 34 shows a connection from main to riser, in which the head room is very short and it is desired to take up a large amount of expansion, the expansion being taken up by a swing on the short vertical nipple and by a swing on the riser. This connection has been used for tunnel mains where the head room in the tunnel did not permit of the other forms of connection shown.

Fig. 35 shows the connection between the main and the riser in an overhead system of distribution in which the rooms in the upper story are used and it is desired to conceal the piping connections.

As shown in Fig. 35 it will be seen that the con-

nection from the main to the riser is carried in the space between the roof and the ceiling of the room

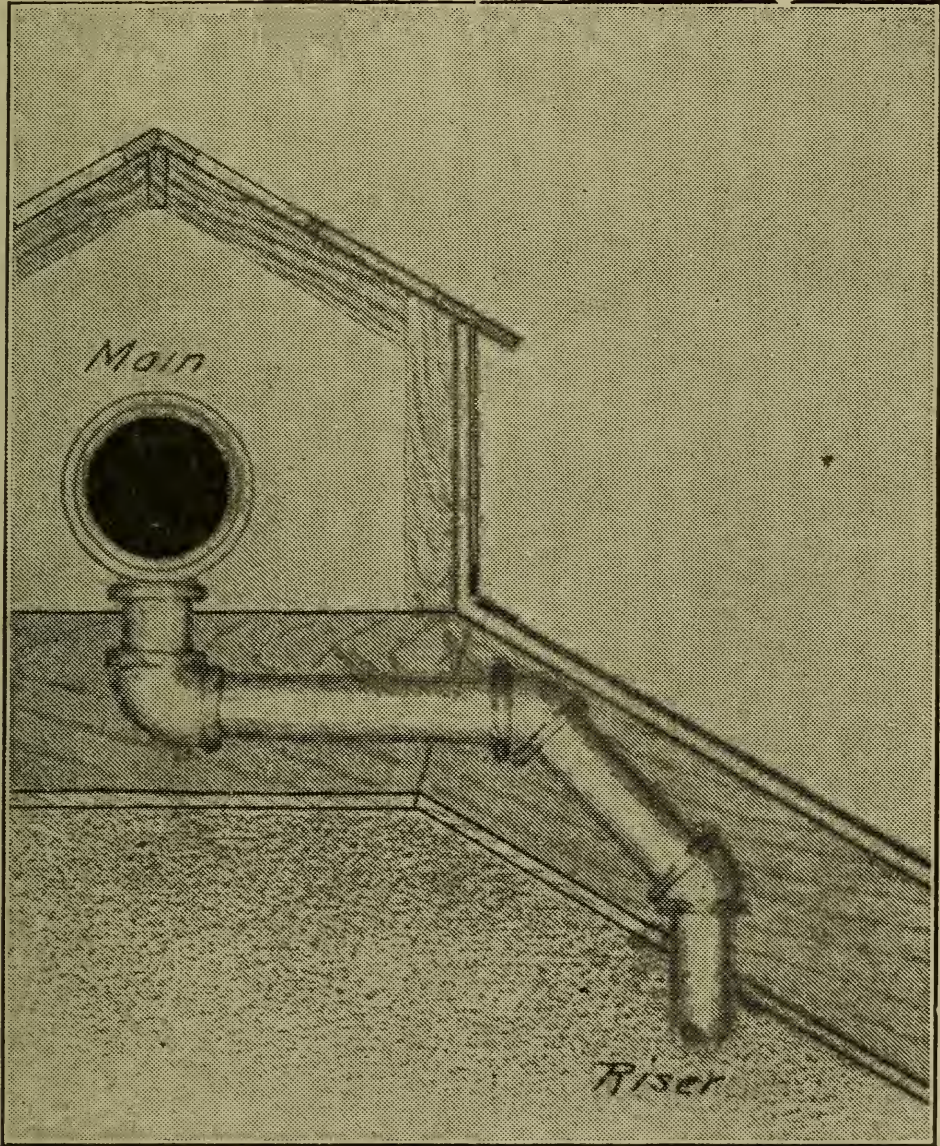


Fig. 35. Connection from main to riser in overhead system of steam distribution.

below. The connection from the main to the riser is taken from the bottom of the main. This is not

objectionable in an overhead system, as each riser has a drip at the bottom and becomes in itself a

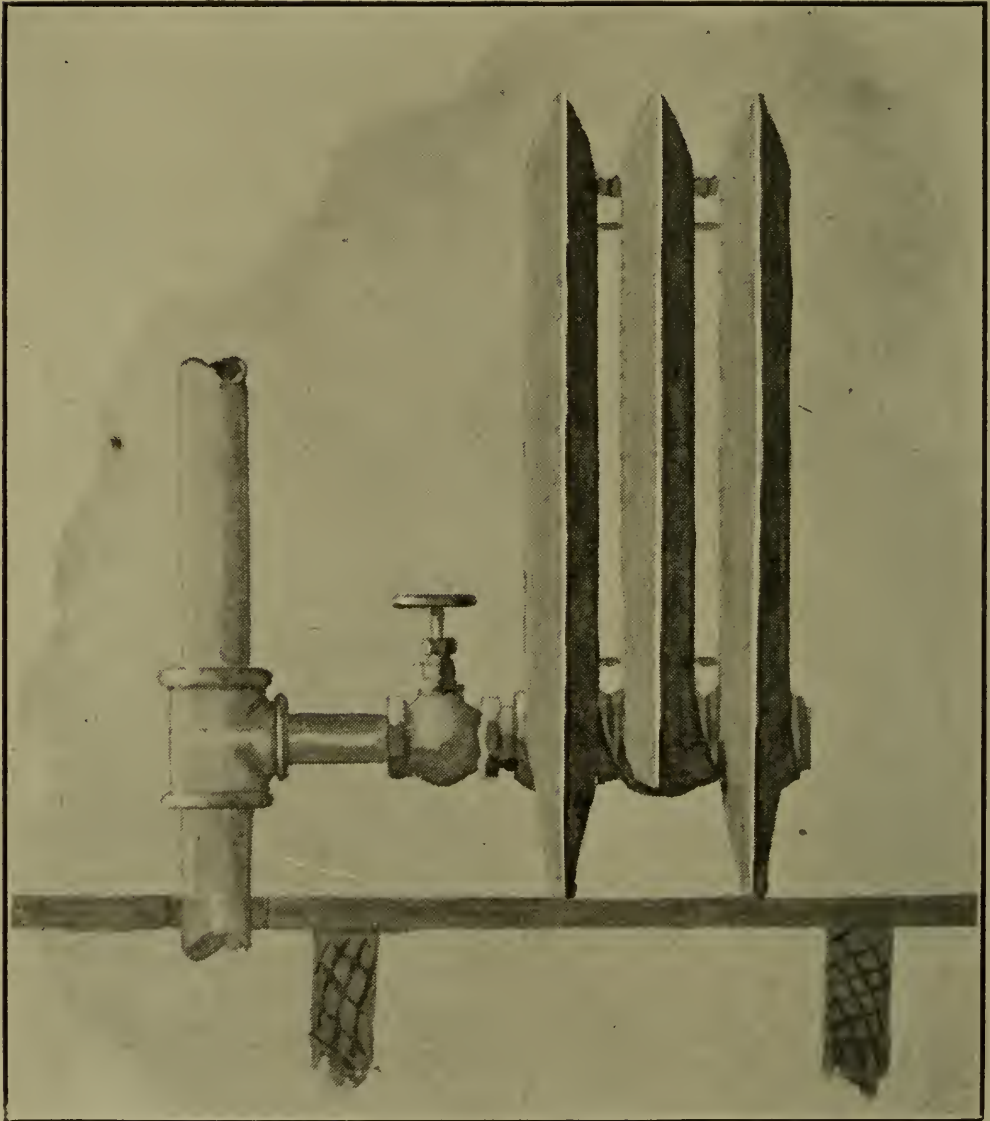


Fig. 36. Horizontal connection long enough to care for some expansion of riser by the spring of the pipe.

drip main, and in some cases this is the desirable thing to do, as it keeps the steam and

main entirely relieved of condensation at all points.

In making connections between mains and risers an endeavor should be made to locate the main so that the horizontal pipe connecting main to the riser will be as short as possible. If it is necessary to

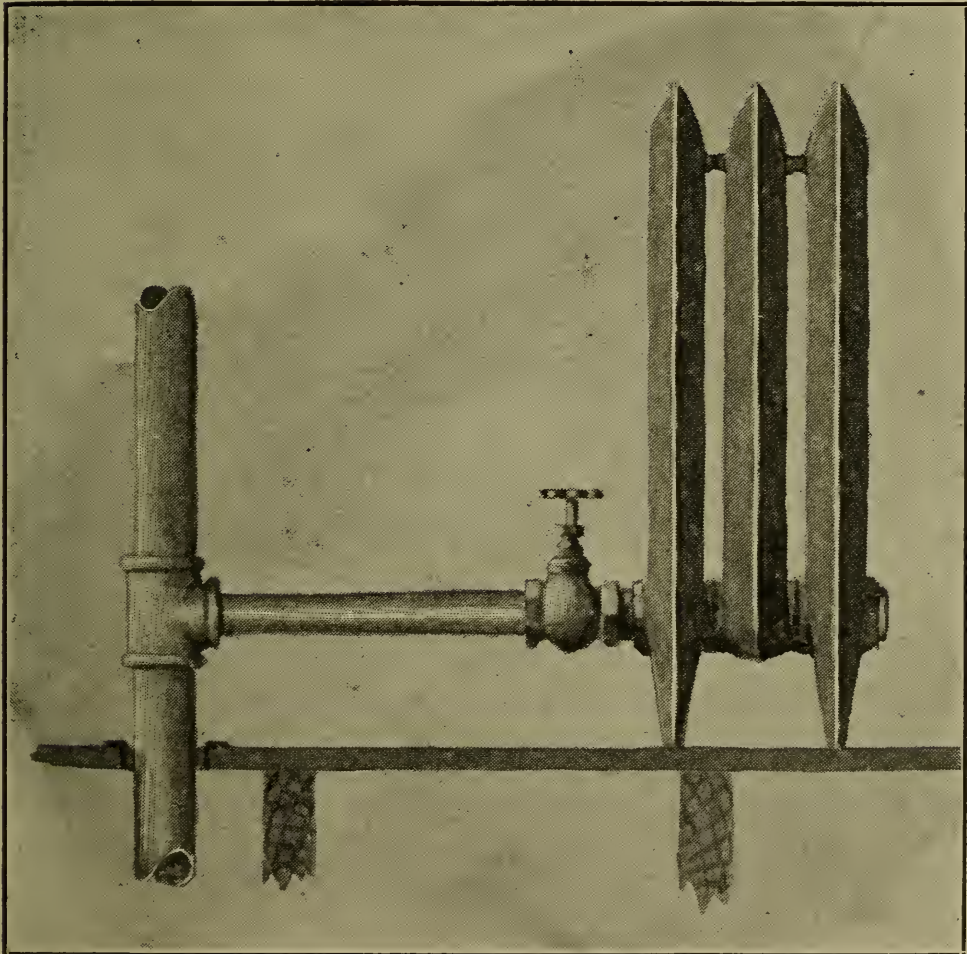


Fig. 37. Simplest form; short; drains easily, but does not allow for expansion of riser.

make this a long pipe then the pipe should be made one pipe size larger than would otherwise be used

particularly in the single pipe system. In the double pipe system long horizontals are not so objectionable, as the riser may be dripped at its lower end, as shown in Fig. 28.

In residence work it is usually found desirable to connect directly from the steam main to the radiators on the first floor instead of connecting these radiators to the risers. This direct connection from the radiator to the main insures a quicker circulation of the first floor radiators, which is usually found desirable in residence work. In building work this is not usually the case, the first floor radiators are connected to the main risers.

The connection between the radiators and the risers should always be carefully considered. There are a great many forms of connection used between the radiator and the riser to which it is connected. Each of these different forms of connection has its advantage and disadvantage, which must be considered in using any particular type of connection. Figures 36 to 42 deal with single pipe work.

**Radiator
Connections.**

Fig. 36 is the simplest form of connection. Its advantage is that it is short, simple and drains easily. The disadvantage of this form of connection is that it does not allow of any expansion.

The expansion of the riser would lift one end of

the radiator off the floor and in all probability produce a leaky joint.

Fig. 37 is a similar form of connection, but the connection between the valve and the riser is long enough so that a certain amount of expansion can

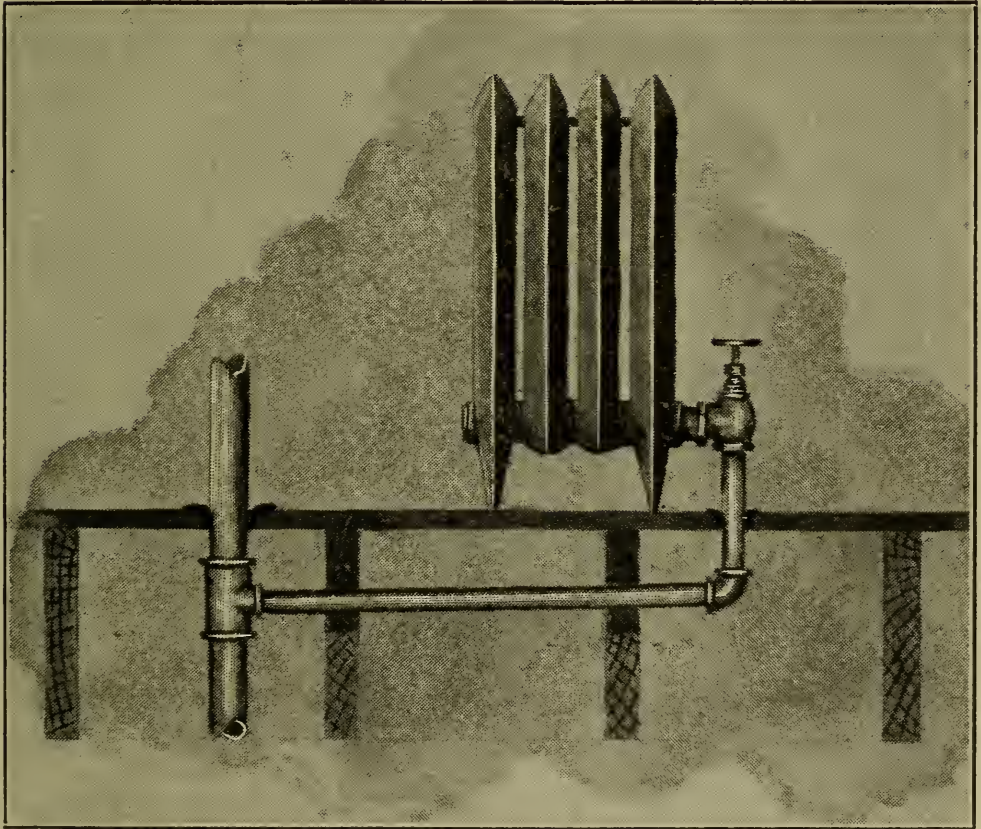


Fig. 38. Desirable, clean, but floor must come up when the trouble-man comes.

be taken care of by the spring of the pipe which connects the radiator valve and the riser.

Fig. 38 is a very common form of connection used in residence work. The advantage of this connection over the connections shown in Figs. 36 and 37

is that where the pipe passes over the floor there is always opportunity for dirt to collect around and under the pipe and it is difficult to sweep this dirt out. The connection shown places the horizontal pipe in the joist space. The long horizontal pipe

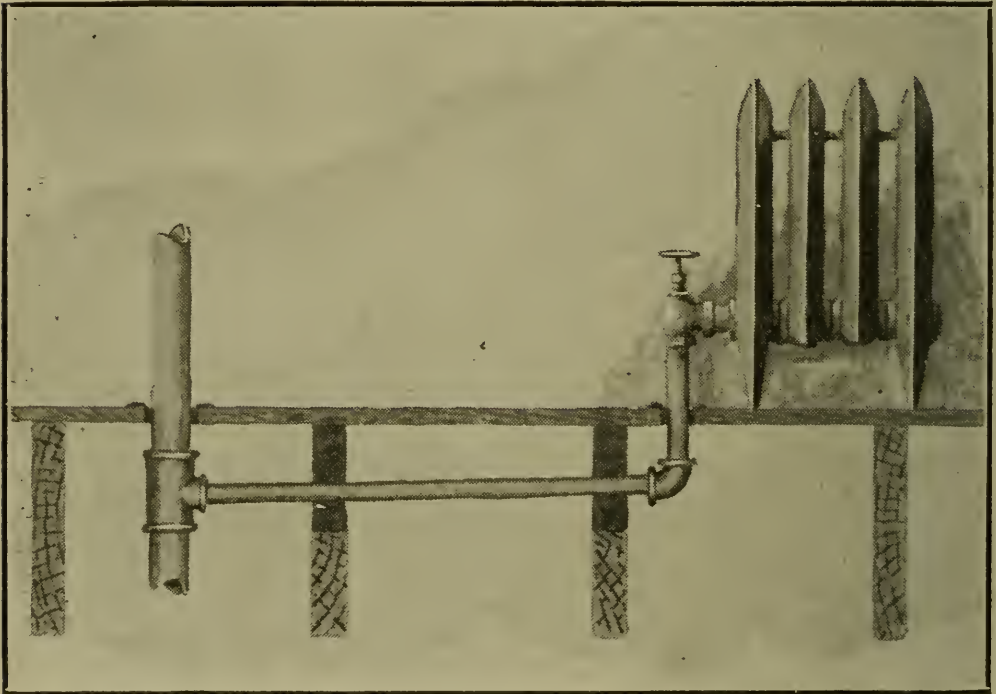


Fig. 39. Similar to Fig. 3, with position of radiator changed.

under the floor allows a certain amount of expansion due to the spring of the pipe. On the whole this is a desirable form of connection. Its principal objection is that it cannot be easily reached in case of accident and it cuts the joists. The most common trouble with such connection is to have a sand hole in the elbow. Of course to repair this it would be necessary to take up the floor.

Fig. 39 is practically the same as Fig. 38, the position of the radiator being changed.

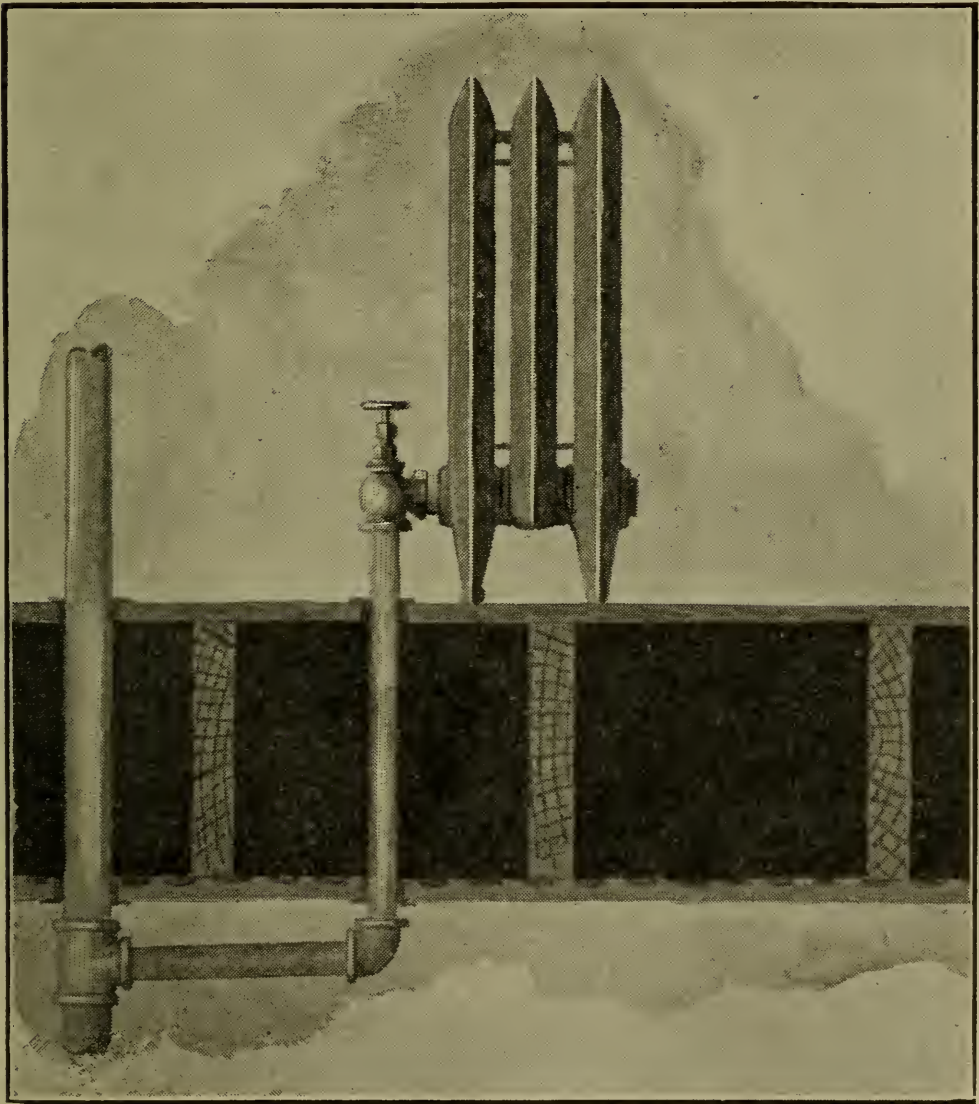


Fig. 40. Sometimes used on upper floors: horizontal pipe exposed below ceilings is an objection. Will do for store and undecorated rooms.

Fig. 40 shows the arrangement of radiator connection in which the horizontal is dropped down

under the ceiling of the room below. This connection is sometimes used on upper floors. The objection to it, however, is that the horizontal pipe coming just below the ceiling is very unsightly, and it should be used only where the horizontal pipe is exposed in store-rooms or through undecorated rooms where such pipe would not be objectionable.

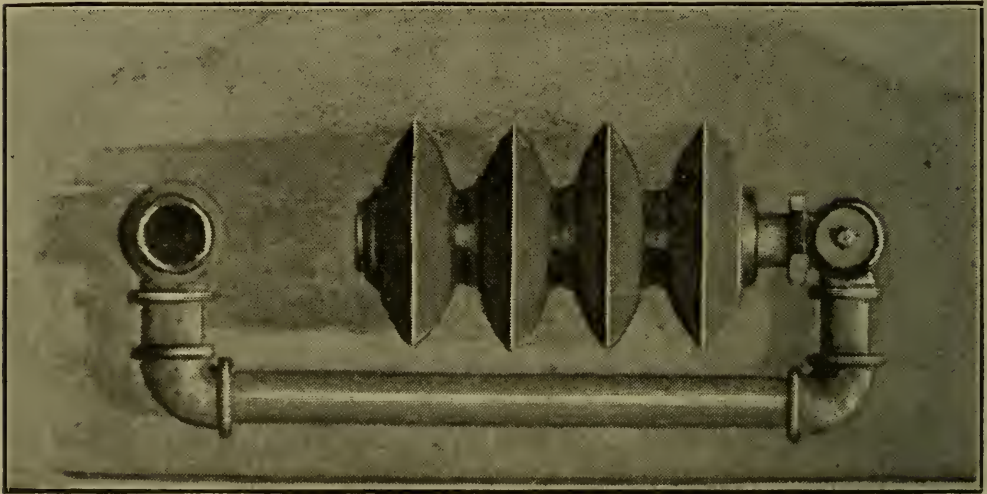


Fig. 41. Used in office buildings; good form for fireproof buildings.

Fig. 41 is the plan of a connection very commonly used in office buildings. The connection is made from the riser to the radiator, passing the pipe beyond the radiator and using a corner valve where the radiator connection attaches to the radiator. The principal objection to this arrangement is that it throws the radiator out some distance into the

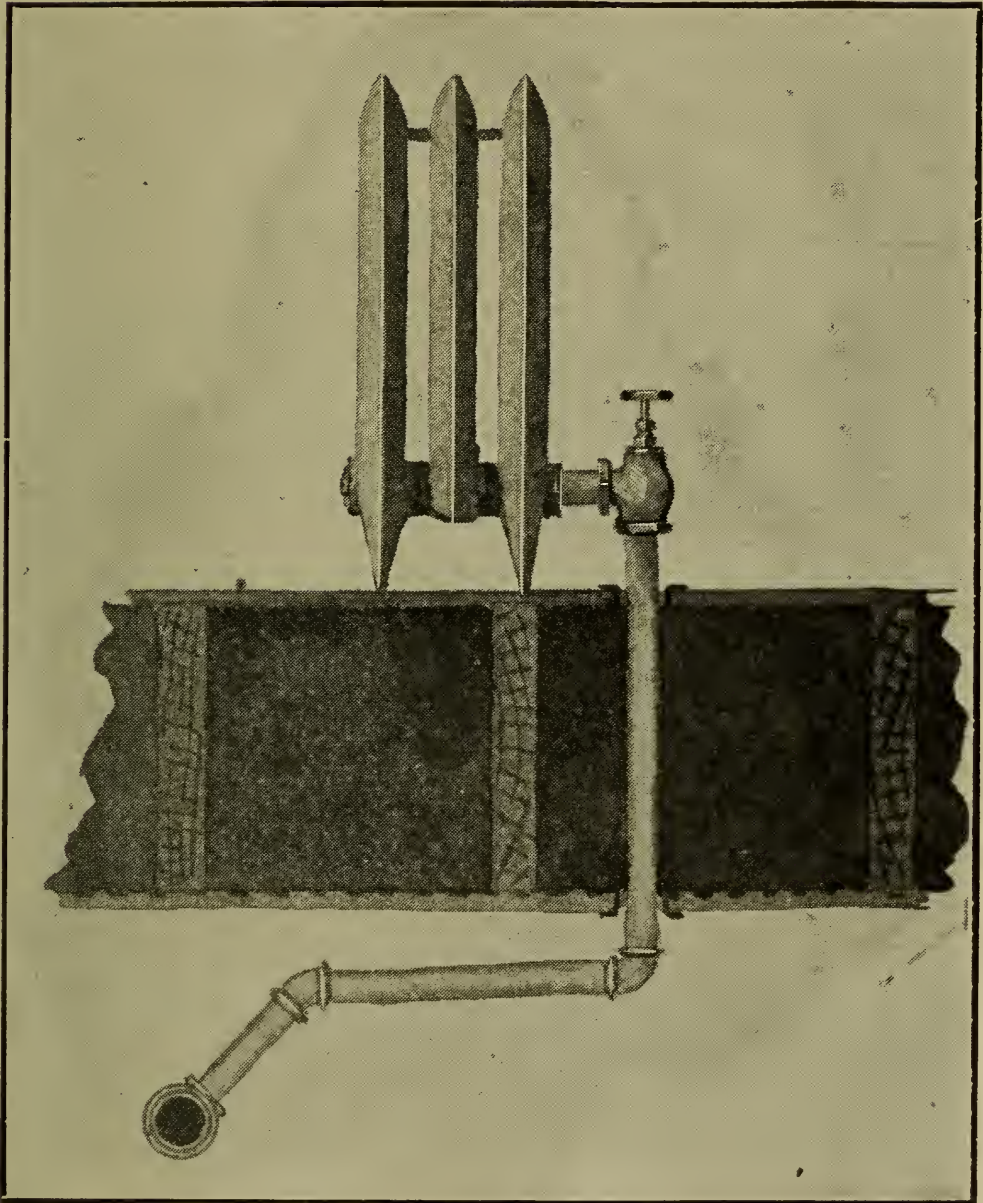


Fig. 42. Commonly used in residence work, where first floor radiators are fed from main in cellar.

room and it is very difficult to sweep around the connection so as to keep it clean. In buildings of fireproof construction and where a large amount of

expansion is to be taken care of, this is probably the best form of connection to use.

Fig. 42 shows a connection similar to Fig. 40 for first floor radiators. It is customary in most buildings to connect the first floor radiator directly to

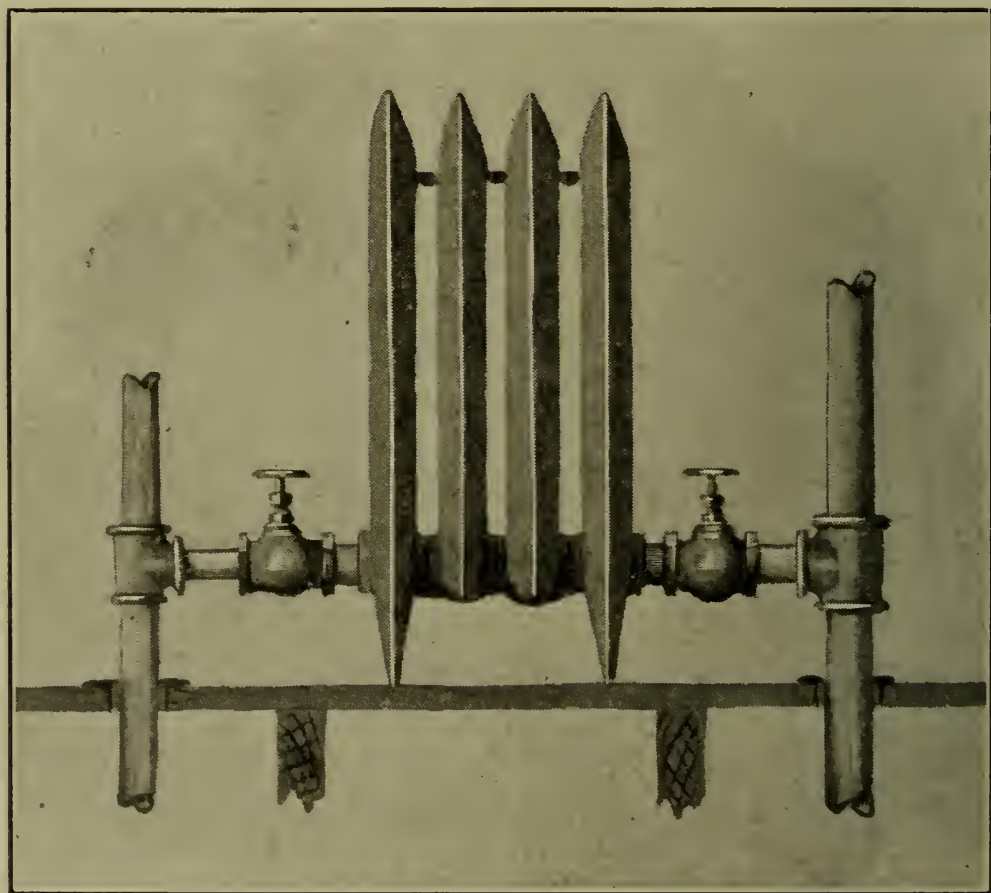


Fig. 43. The simplest connection for a two-pipe system.

the main and not to a riser. This arrangement is commonly used in residences. The connection is such that we have very easy turns and a very slight resistance for the passage of steam into the

radiator. It is particularly desirable where the system is operated at a low pressure.

All the previous figures have dealt with single pipe connections.

Fig. 43 shows the simplest form of radiator connection for the two-pipe system. The objection to this arrangement is similar to the objection made to Fig. 36. That is, it is very rigid and will permit of almost no expansion and should only be used where the radiator is located at such a point that it is not necessary to take up expansion. The connection is simple and direct, and from the standpoint of circulation, a desirable one.

Fig. 44 shows a connection in which the expansion is taken up by means of the spring in the horizontal pipes. The verticals to the radiator valves may be made shorter and these connections can all be concealed in the joist space if desired. This arrangement can be used for buildings not more than three stories in height. Where buildings are higher the two-pipe connection should be made with a series of elbows, allowing for free expansion—something like that shown in Fig. 41.

Fig. 45 shows a two-pipe radiator connection where the radiator is on the first floor and the horizontals are located in the basement. The same connection is shown with a horizontal pipe, allowing for expansion. In this case the return connection is shown entering directly into the return main

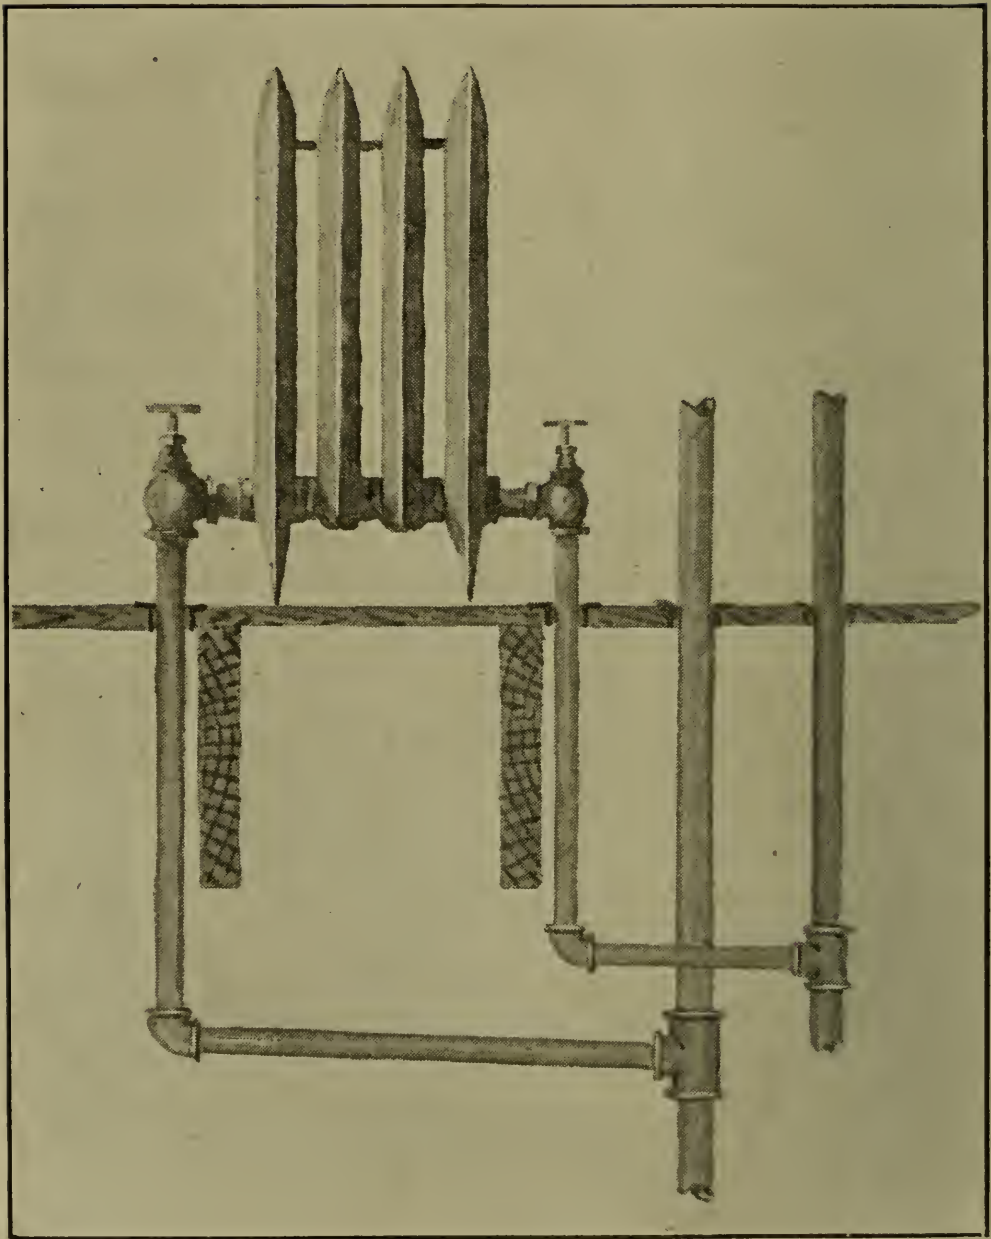


Fig. 44. Expansion taken up by spring in horizontal pipes.
Used in buildings not more than three stories in height.

without any elbow. This is always undesirable, as the connection is very rigid, not allowing for expansion, and should only be used where the con-

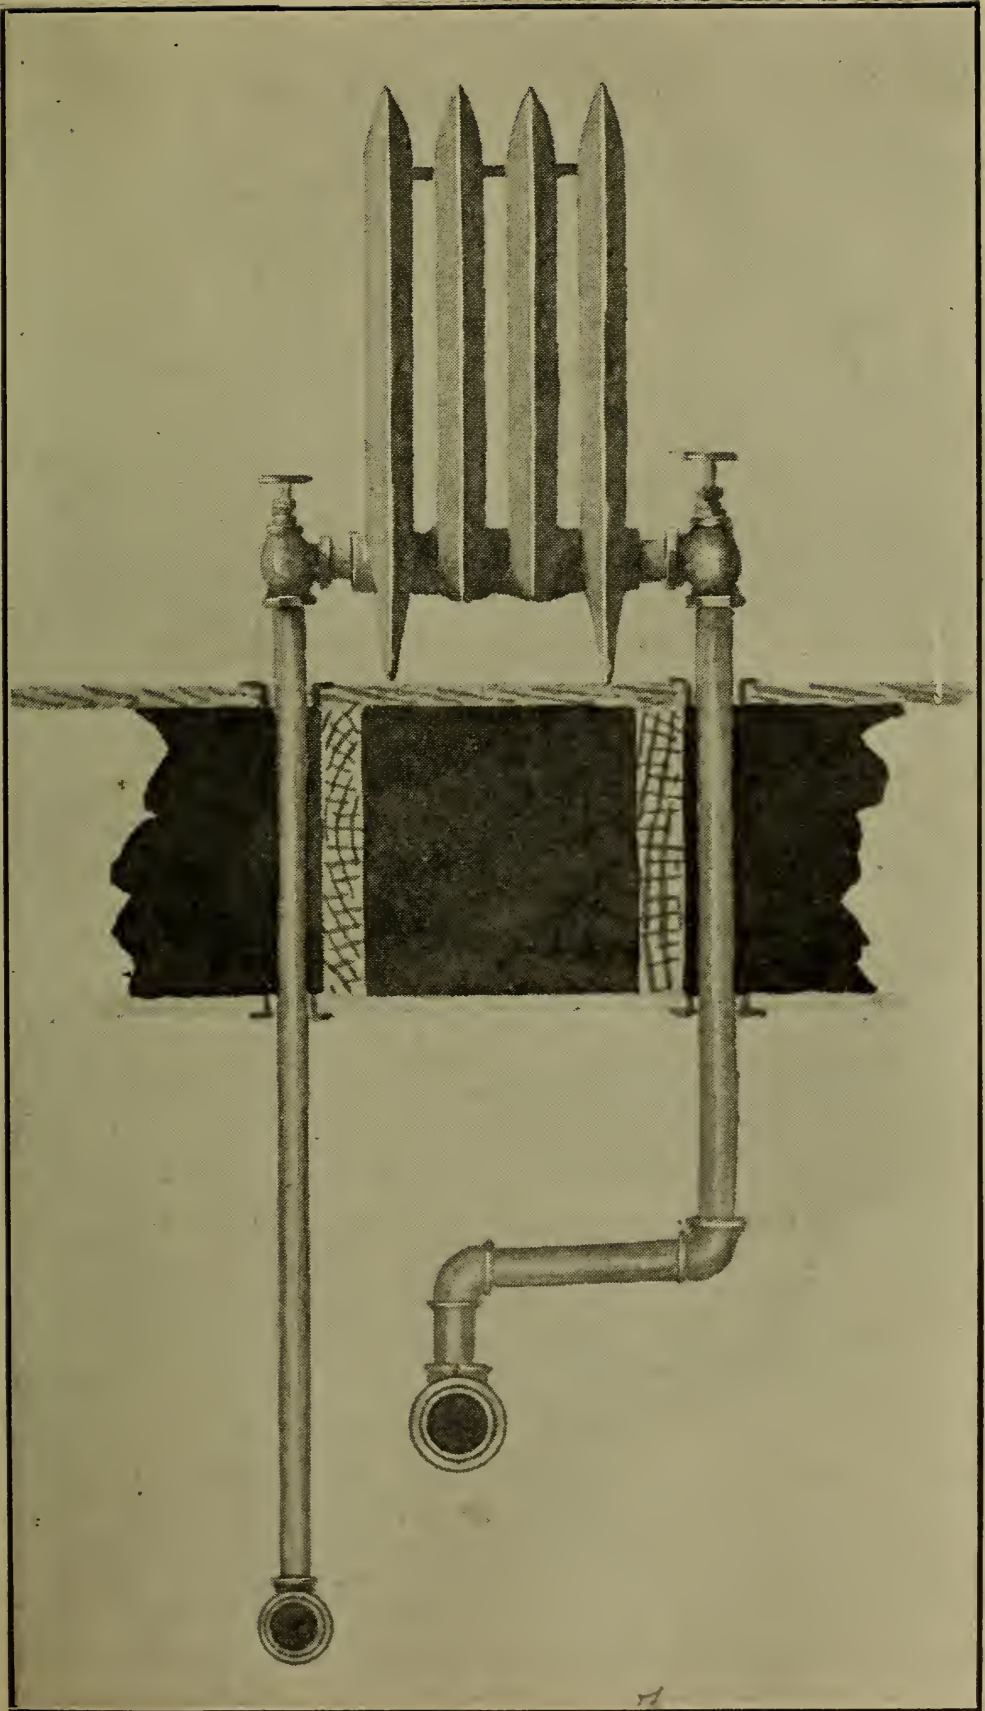


Fig. 45. Radiator on first floor and horizontals in basement.

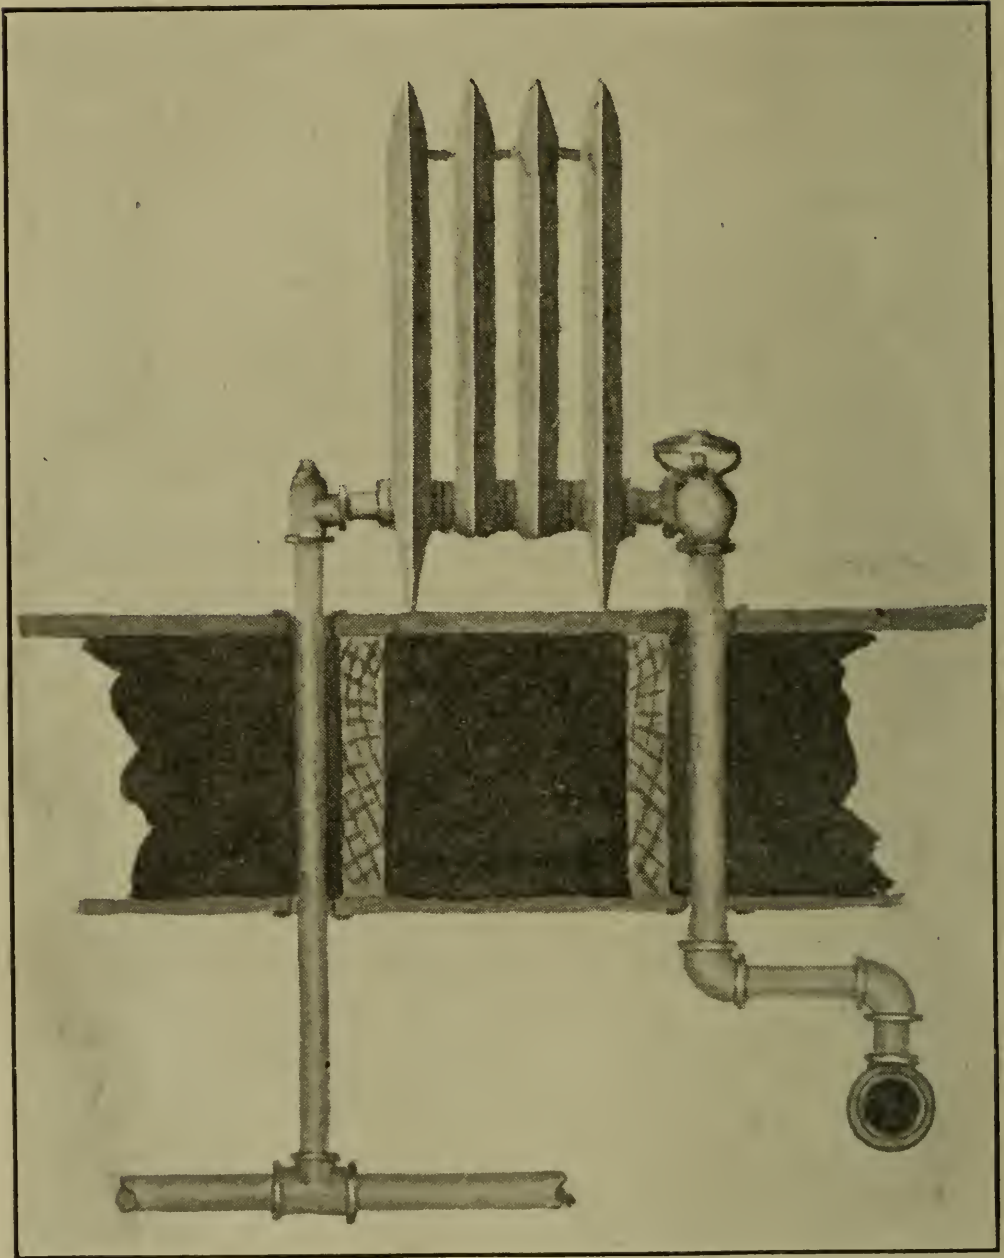


Fig. 46. Connection for automatic system of heat control on the double-pipe system.

nection will not be affected by expansion. If expansion must be allowed for in the return main

then a connection similar to that shown for the steam main should be used.

Fig. 46 shows the radiator connection for automatic system of heat control on the double-pipe system. In this case it is quite common to put the automatic on the steam supply and the check valve on the return. Then when the steam is turned off by the thermostat, the check valve automatically closes, and there is no possibility of the steam or water in the return main getting back into the radiator. If no check were placed upon the return a vacuum would be formed in the radiator, due to the condensation, and the water would be drawn back from the return main into the radiator by this vacuum; then when the steam was again turned on this water would cause a severe hammer in the radiator.

In planning radiator connections for a building a long horizontal should be avoided, the length should be only sufficient to take up expansion.

The location of the radiator should be carefully selected, so as not to occupy the best space in the room. For example, it is not uncommon to find the radiator in a bedroom occupying the only place in the room for the bed. The position of the radiators should be selected also with reference to the risers, so as to make the connections as short and direct as possible. The form of connection should be such as to allow for proper expansion.

SUPPORTING OF PIPES.—Horizontal pipes are usually supported by the ordinary form of expansion hanger. As a rule pipes should be supported every 10 feet and should be supported at points bearing the greatest weight. In placing a pipe support care should be taken to see that each support bears its proper proportion of weight. In buildings over three stories in height other methods should be taken to take the weight of the risers. An iron strap passing around the pipe and bolted to some portion of the building structure is usually the best means. Large piping is often supported by chains or on brackets with rollers. The supports of large pipes will be taken up under the subject of Central Heating.

CHAPTER VII.

DESIGN OF A HOT WATER HEATING SYSTEM.

Hot water heating plants may be divided into two classes, those using natural circulation, and those using forced circulation. In residences and small buildings the system using natural circulation is almost universally used. It is simpler in construction and cheaper to install and operate. In central hot water heating systems and in the larger buildings the forced system of circulation is employed. It is more certain in circulation, the size of the pipes may be smaller and in such buildings the system may be cared for by an expert attendant. The systems of forced circulation will be discussed in connection with central heating.

The arrangement of the hot water boiler and of the piping in a hot water heating plant is similar to that of a two-pipe steam system, the difference is only in minor changes in the piping system. The circulation in a natural hot water heating system is produced by the difference in the weight of the water in the cold and the hot leg of the system. It depends very largely upon the height of the water column in the cold leg. The

Natural System.

difference in the weight of the water in the two legs of the system is due to the fact that water weighs less per cubic foot as its temperature is increased, namely:

At 130° the weight of water per cubic foot is 61.56 pounds. At 140° the weight of water per cubic foot is 61.37 pounds. If, then, there were one cubic foot of water in both hot and cold legs of the system with a difference of 10° between the two sides, the force to produce circulation would be .19 pound. It will be seen from this that the force going to produce circulation is a small one and may be easily overcome by the resistance of the piping system. It is important, then, that in installing a hot water system considerable attention be given to the arrangement of the piping.

In designing a hot water system the losses of heat from the building would be computed by the same rules as previously given for other systems. These losses of heat having been determined, it will be necessary to replace the loss by the heat given off by the radiator. In order to determine the amount of radiation necessary we must know what the losses of heat per square foot are for hot water radiators. Table 20 gives the results obtained from hot water radiators tested under actual operating conditions with hot water.

Table XX shows that the rate of transmission, as given in the last column of the table, is almost the same as for steam radiators. It will be safe to assume that the hot water radiator would

TABLE XX.

| Kind of Radiator | Temp. in hot leg. | Temp. in cold leg. | Temp. of room | Loss in B. T. U. per sq. ft. per hour | Loss in B. T. U. per sq. ft. per hour per deg. dif. in temp. |
|-----------------------------|-------------------|--------------------|---------------|---------------------------------------|--|
| 38" 3-column cast iron..... | 187 | 182 | 72 | 180 | 1.67 |
| 38" 2-column cast iron..... | 190 | 185 | 70 | 200 | 1.70 |
| 38" flue radiator..... | 182.5 | 178.5 | 70 | 181 | 1.65 |

give off the same amount of heat per square foot whether filled with steam or hot water, the temperature inside and outside of the radiator being the same. This, however, is not the case, as it is customary to operate a hot water plant at a temperature not exceeding 180° or less. In calculating heating surfaces, the temperature of the water should never be assumed higher than 180°. The temperature being about 220° under ordinary conditions in a steam radiator and only 180° in the hot water radiator, the total transmission in the hot water radiator is only about 75 per

cent of the transmission by the steam radiator using steam.

There is another consideration in hot water heating. The lower the temperature of the radiating surface the more uniform the temperature of the room and the more agreeable the heating effect. Where it is desired to heat almost uniformly all portions of a room, regardless of initial expense, it may be accomplished by installing very large heating surfaces. The reason for this is easily explained. Where the radiating surfaces are kept at a high temperature, say 200° or over, at least 50 per cent of the heat is given off by radiation and the remaining heat is given off by contact of air. When the temperature of the radiating surface is lowered a large proportion of heat is given off by contact of air and a smaller portion by radiation. This allows the air in the room to be at nearly the same temperature as the objects in the room. It is possible, then, in a hot water system to use quite different amounts of radiation, depending upon the effect desired. This may be illustrated by an example.

Suppose a room to lose 10,000 B. T. U.'s per hour and that the heating surface has the same rate of transmission whether steam or water is used, and that this rate of transmission be 1.68 B. T. U. per square foot per degree difference of temperature. In the first case, let the room be heated by

steam. The temperature of steam in the radiator be 220° and the temperature of the room 70° . Then the heat lost per square foot of surface would be $(220-70) \times$ the rate of transmission, $1.68=250$ B. T. U. The number of feet of radiation required to heat the room will be $10,000 \div 250 = 40$ sq. feet.

In the second case, suppose the room to be heated by hot water radiator at a temperature of 180° . Then the B. T. U. given off per square foot of surface would be $(180-70) \times 1.68=185$. The number of square feet of radiation required to heat the room would be $10,000 \div 185 = 54$ square feet.

In the third case, assume a residence in which a very uniform heating condition is desired and the temperature of the heating surface is not to exceed 150° . The loss per square foot of radiation would be $(150-70) \times 1.68=135$ B. T. U. The radiation required would then be $10,000 \div 135 = 75$ square feet. The amount of radiation in hot water heating depends, then, upon the effect desired.

In a closed tank system it would be entirely possible to obtain a temperature as high as 240° or 250° . In the open tank system the temperature should never exceed 180° , as a higher temperature than this would form steam in the tank and there would be danger of the water boiling, which causes a cracking, hammering sound in the piping system.

Rule 1.—Divide the volume of the room by 55. Add $\frac{1}{4}$ of the exposed wall surface.

Rules for Hot Water Heating. Add the glass surface. Multiply the sum of these by .4, the product will be the square foot of direct hot water radiation required.

Rule 2.—For ordinary rooms divide the exterior wall surface by 4; add the glass surface and multiply the sum by .55. For entrance halls multiply the sum by .7.

Rule 3.—Divide the volume of the room in cubic feet by the factors given below and the quotient will be the radiating surface in square feet.

| | |
|---|-------|
| First floor rooms, 1 side exposed..... | 40 |
| First floor rooms, 2 sides exposed..... | 37 |
| First floor rooms, 3 sides exposed..... | 34 |
| Second floor rooms..... | 45—50 |
| Halls and bath rooms..... | 35 |
| Offices | 37—50 |

In all these rules factors of exposure are to be allowed as given on page 27.

In order to understand better the methods of determining the heating surface required for a given house, take the same house as figured for steam on page 75.

Take, for example, the parlor, assuming the outside air to be at zero degrees and the inside air at 70°. The wall surface is 216 square feet and one-quarter of this is 54. Add the glass surface, 36

square feet, and multiply the sum by $1\frac{1}{2}$ times the difference between the temperature of the room and the outside air, or $(54 + 36) \times 1\frac{1}{2} \times 70 = 9,450$ B. T. U.'s. To this add 10 per cent for exposure, which gives the loss as 10,395 B. T. U.'s per hour.

In Table XXI the second column gives the B. T. U.'s, as determined in Table XII, column 3. Column 3 gives the radiation in square feet for a two column radiator. Column 4 gives the radiation as determined by Rule 3, the volume rule, the vol-

TABLE XXI.

Results of Computations—Direct Hot Water.

| | B. T. U.'s from table XII | Radiating surface, 2-column cast iron | Radiating surface Rule 3 | Radiating surface actually installed |
|------------------------|------------------------------|---|-----------------------------|---|
| First floor— | | | | |
| Parlor | 10,395 | 68 | 45 | 68 |
| Sitting room | 7,035 | 46 | 52.5 | 50 |
| Dining room | 7,350 | 48 | 48 | 48 |
| *Kitchen | 10,300 | 67.5 | 47 | 40 |
| Hall | 7,035 | 46 | 32.5 | 48 |
| Second floor— | | | | |
| W. chamber | 10,050 | 65 | 39 | 65 |
| Alcove | 7,560 | 49 | 18 | 40 |
| S. chamber | 7,035 | 46 | 34.5 | 46 |
| N. chamber | 7,455 | 49 | 32 | 50 |
| Bath | 3,150 | 20 | 12 | 20 |
| E. chamber | 5,250 | 34 | 25 | 34 |
| Halls | 2,730 | 18 | 25 | 20 |

*Just enough radiation to keep from freezing in extremely cold weather.

umes of the rooms being taken from Table XI. Column 5 gives the radiation that would actually be used. The quantities in column 3 are obtained as follows: Assume the temperature of the water entering the radiator at 175° and that of the temperature of the water leaving the radiator 165° , then the average temperature in the radiator is 160° . The temperature in the room is 70° , the difference being 90° . The rate of transmission as given in Table XX, line 2, is 1.70 B. T. U. The total transmission per square foot per hour is, then, $1.70 \times 90 = 153$ B. T. U. Dividing the heat lost from the room, column 2, by 153, or the loss for each square foot of radiation, will give the results in column 3, the number of square feet of radiation required. In column 4 the radiating surface has been determined by the volume rule, Rule 3, and shows the inconsistency of this method of figuring though it is a method very commonly used. This method should never be used except as a check. When the volume rule shows very much larger results than the other rules it is well to add surface to the radiator to allow for the increase in volume. This has been done in column 5. In regard to proportioning of radiation one can never trust absolutely to his figures and should always carefully compare his results with the room and its exposure and use his judgment in regard to changes that seem desirable.

CHAPTER VIII.

HOT WATER BOILERS AND PIPING.

Hot water boilers are practically the same as steam boilers. Any good form of steam boiler may be changed to a hot water boiler by filling the steam **Hot Water Boilers.** space with water and allowing the water to go in at the lowest point of the boiler and go out at the highest point of the boiler. In boilers especially designed for hot water heating no space is left over the tubes, the whole boiler shell being filled with tube surfaces. This makes the hot water boiler more compact for the same amount of heating capacity than the steam boiler. The circulation in the hot water boilers is probably slower than in steam boilers and there is much less local circulation. The cold water enters from the bottom, passes over the tubes and leaves at the top of the boiler. The heat transmitted per square foot of surface is practically the same in steam and hot water boilers. The proportions of heating surface to grate surface and of grate surface to chimney area may be taken the same for hot water as for steam.

In large hot water systems the ordinary fire tube boiler is used. The principal modification of the

boiler would be to fill the steam space with tubes and make the return opening same size as the steam opening. For residence work cast iron, sectional boilers are usually used and these are suitable for all similar work, except where high pressure is used. In high pressure hot water heating, cast iron boilers are not permissible as these boilers are not usually made to withstand pressures exceeding 20 pounds. A pressure of 20 pounds corresponds to a water column 46 feet high and this is about the height of an ordinary four-story building. It is not desirable to use cast iron boilers in buildings more than three stories high, above that height wrought iron boilers should be used so as to withstand the static pressure due to the height of the water. Cast iron boilers would not be suitable for hot water systems using a closed tank and having the water under pressure. Boilers for these systems are usually made to withstand safely a pressure of 100 pounds per square inch. The proportions of cast iron boilers for hot water heating are given in Table XXII. In this table the rating of the boiler does not include the piping. In selecting the boiler the square feet of radiation equivalent to the piping must be added to the square feet of radiator surface. In the average house these boilers will carry .6 of their rating in actual radiation, exclusive of piping, provided the piping is covered with some good grade of pipe covering.

Table XXII is based on approximately the following, allowing one square foot of grate to each 30 square feet of heating surface, and one square foot of grate to each 300 square feet of radiation. (This radiation must include the radiating surface in the mains.)

In designing a hot water piping system the most important consideration is the resistance of the piping. The resistance of the piping should be almost the same for each radiator at the same level and the friction of the piping system should be kept as low as practicable.

DEFINITION OF TERMS USED.—The different parts of the piping system referred to will have the following meaning.

FLOW MAINS AND FLOW RISERS.—The flow mains and flow risers are those portions of the piping system which carry hot water from the boiler to the radiator. The word *flow* always refers to the hot side of the system.

RETURN MAINS AND RETURN RISERS.—The terms return mains and return risers refer to piping which returns the cold water from the radiator to the boiler.

EXPANSION TANK.—The expansion tank is a vessel partly filled with water and partly filled with air which allows for the variation of the volume of water in the system with the changes of the tem-

perature of the water. In the open tank system this tank is situated at the highest point of the system. In the closed tank system it may be located anywhere in the building.

TABLE XXII.
Proportion of Cast Iron Hot Water Boilers.

| Sq. ft. of radiation boiler will stand | Sq. ft. of heating surface | Sq. ft. of grate surface | Size of pipe Connections | Smoke flue |
|--|----------------------------|--------------------------|--------------------------|------------|
| 300 | 25 | 1 | 2 | 8 |
| 400 | 30 | 1.3 | 2 | 8 |
| 500 | 40 | 1.6 | 2½ | 9 |
| 750 | 60 | 2.5 | 2½ | 9 |
| 1,000 | 80 | 3.3 | 3 | 9 |
| 1,500 | 120 | 5.0 | 3½ | 10 |
| 2,000 | 160 | 6.5 | 4 | 11 |
| 2,500 | 200 | 8.5 | 5 or 2-3½ | 12 |
| 3,000 | 250 | 10.0 | 6 or 2-4 | 14 |
| 3,500 | 280 | 11.5 | 6 or 2-4 | 16 |
| 4,000 | 330 | 13.5 | 6 or 2-5 | 18 |
| 5,000 | 400 | 16.5 | 7 or 2-5 | 26 |
| 6,000 | 500 | 20 | 8 or 2-6 | 22 |
| 7,000 | 575 | 23 | 8 or 2-6 | 24 |
| 8,000 | 650 | 26.5 | 2-7 or 3-5 | 26 |
| 9,000 | 750 | 30 | 2-7 or 3-5 | 26 |
| 10,000 | 800 | 33.5 | 2-8 or 2-6 | 28 |
| 11,000 | 900 | 36.5 | 2-8 or 2-6 | 28 |

PITCH.—The pitch of the pipe refers to its inclination from the horizontal.

LEGS OF THE SYSTEM.—The flow main is often termed the hot leg of the system and the return main the cold leg of the system.

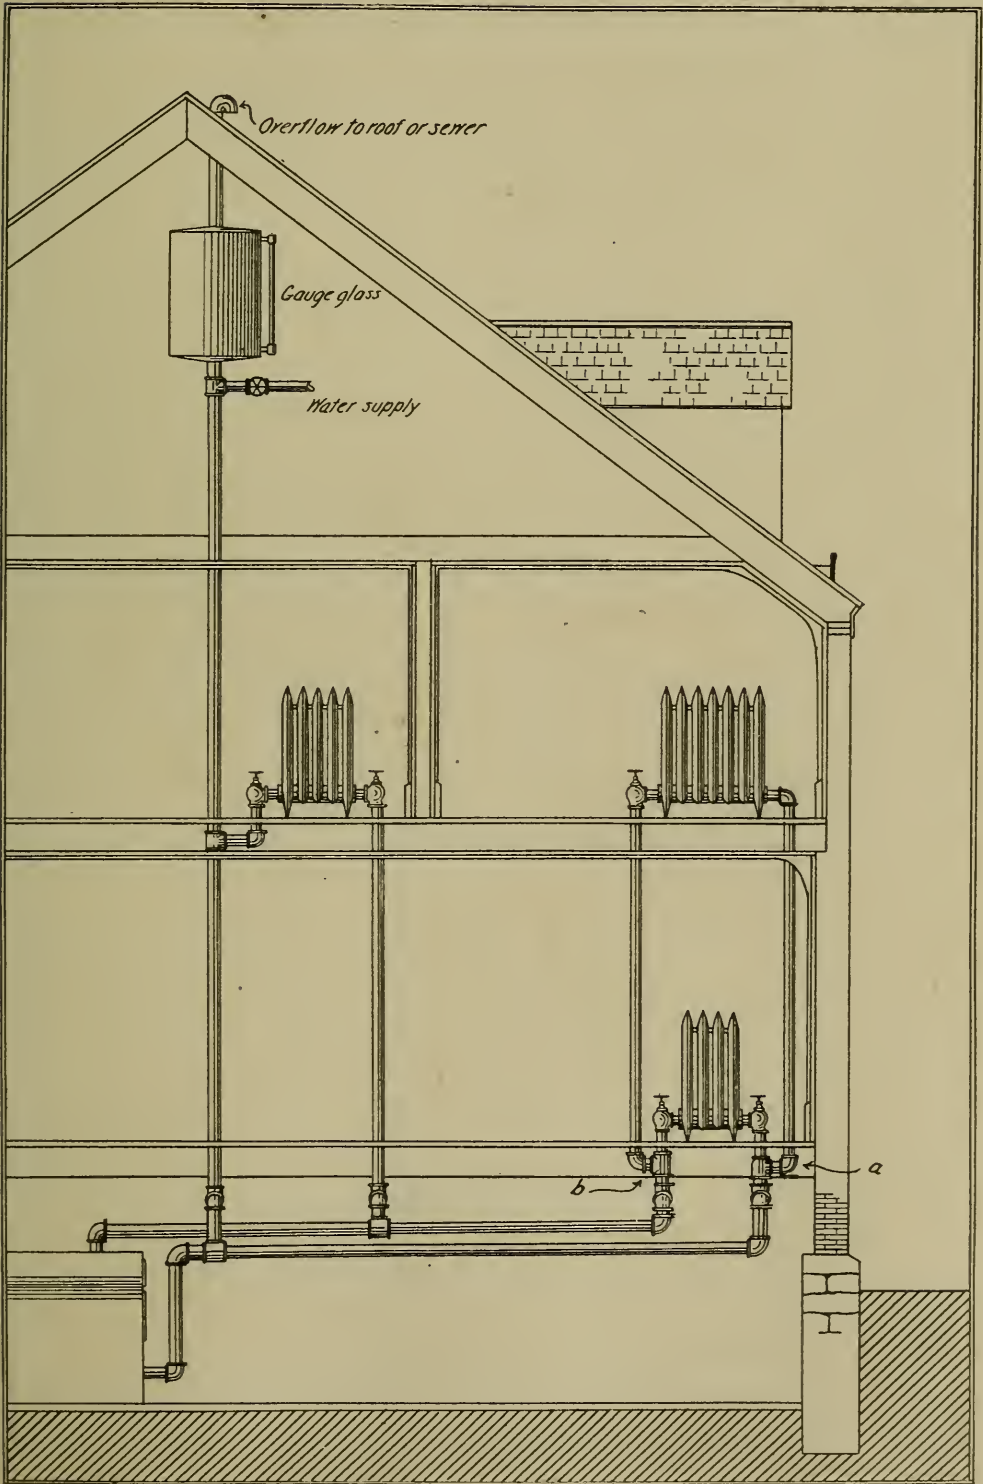


Figure 47.

Four systems of piping are used—the multiple circuit system, the single circuit system, the overhead system, and the single pipe system.

MULTIPLE CIRCUIT SYSTEM.—This system is the one most used and is sometimes called the standard system of piping. This system is shown in Fig. 47. The flow main rises from the top of the boiler to a convenient height just below the basement ceiling so as to allow for pitch towards the boiler of not less than $\frac{1}{2}$ an inch in 10 feet. This main or mains is carried around the basement so as to supply the risers. Too many risers should not be taken from one set of mains, as the radiators at the end will be too much cooled. The main return is parallel to the flow main and of the same size. The open expansion tank is placed at least 3 feet above the last radiator and should be connected to the nearest riser. The connection to the expansion tank should be at the bottom of the tank. In this system the branches from the flow main usually supply only one radiator on the first floor, a separate branch being run to the radiators on the second and third floors. At the points A and B, Fig. 47, where the riser branches to go to the second floor, the risers offset. This is done to prevent too rapid circulation in the radiators above, the tendency being for the second floor ra-

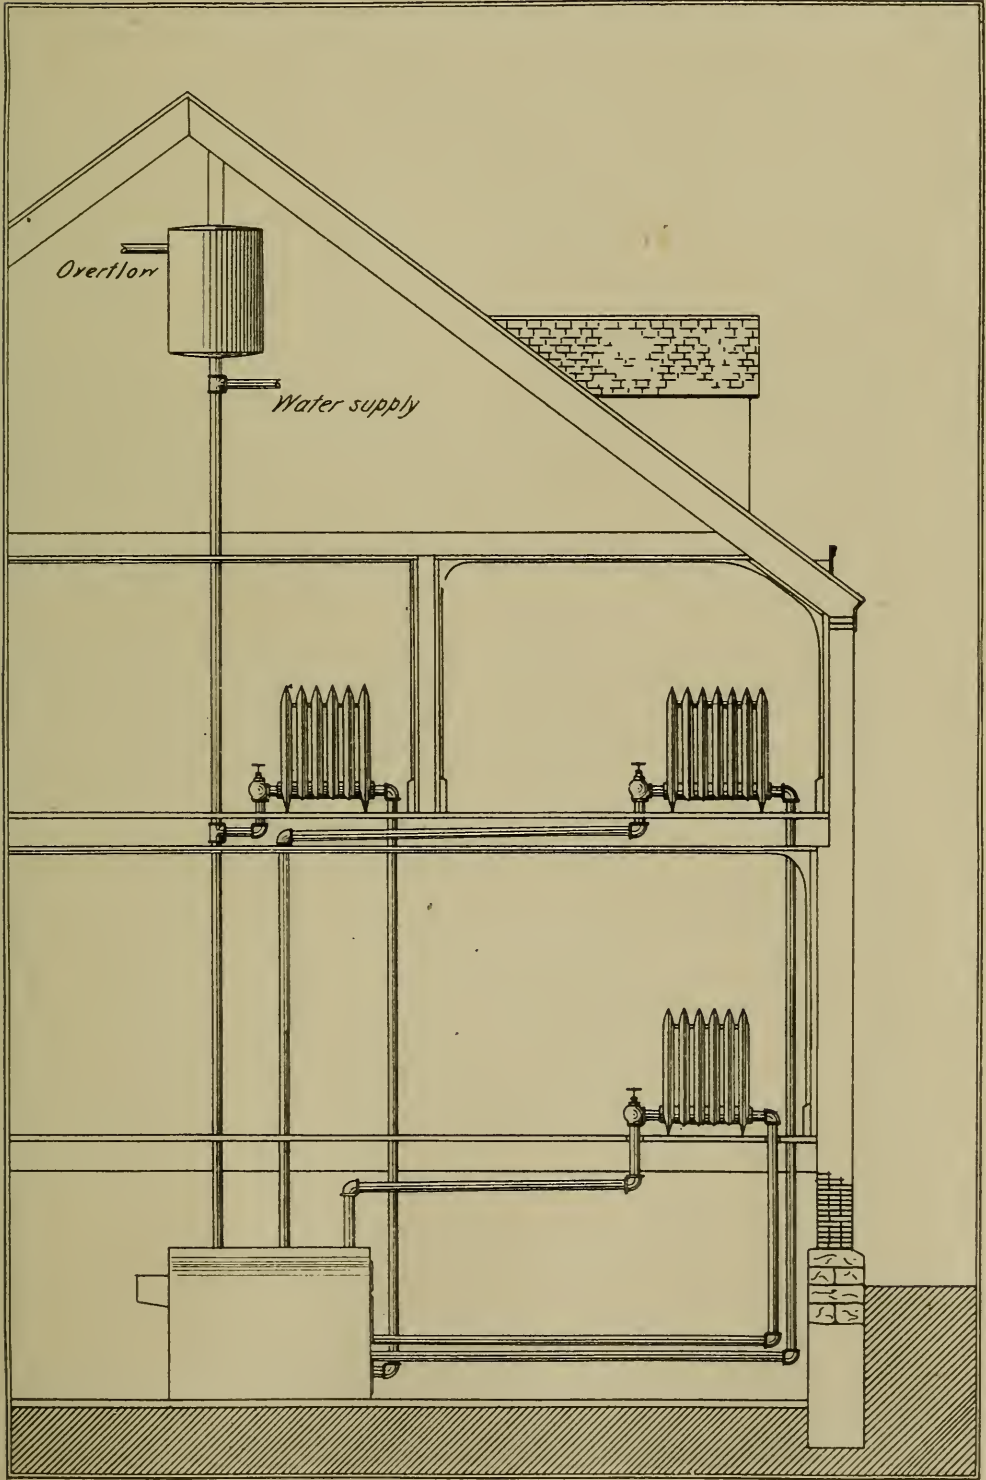


Figure 48.

diators to take all the water and prevent circulation in the first floor radiators. This is a reason why it is preferable to connect first and second floor radiators separately to the flow main. The circulation in the hot water system depends upon the vertical height of the system. The higher the main the more rapid the circulation. This makes it necessary to put additional turns in the risers going to the upper floors or add to the resistance in the piping system so as to make the resistance to each floor proportional to the effective head producing circulation at that floor.

SINGLE CIRCUIT SYSTEM.—In the single circuit system, as shown in Fig. 48, the water flows directly to the radiator from the boiler through a pipe to which no other radiator is connected and is returned to the boiler by a separate pipe. A large number of these circuits may be connected to one boiler, each one being entirely separate from the other. This is one of the earliest forms of piping systems used for hot water work. It gives good results but is expensive to install and makes an extremely complicated piping system.

OVERHEAD SYSTEM.—The overhead system is shown in Fig. 49. In this system the flow main is carried directly from the boiler to the highest point in the system, usually the attic. From this flow main risers extend to the basement and connect to the main return. This system is sometimes

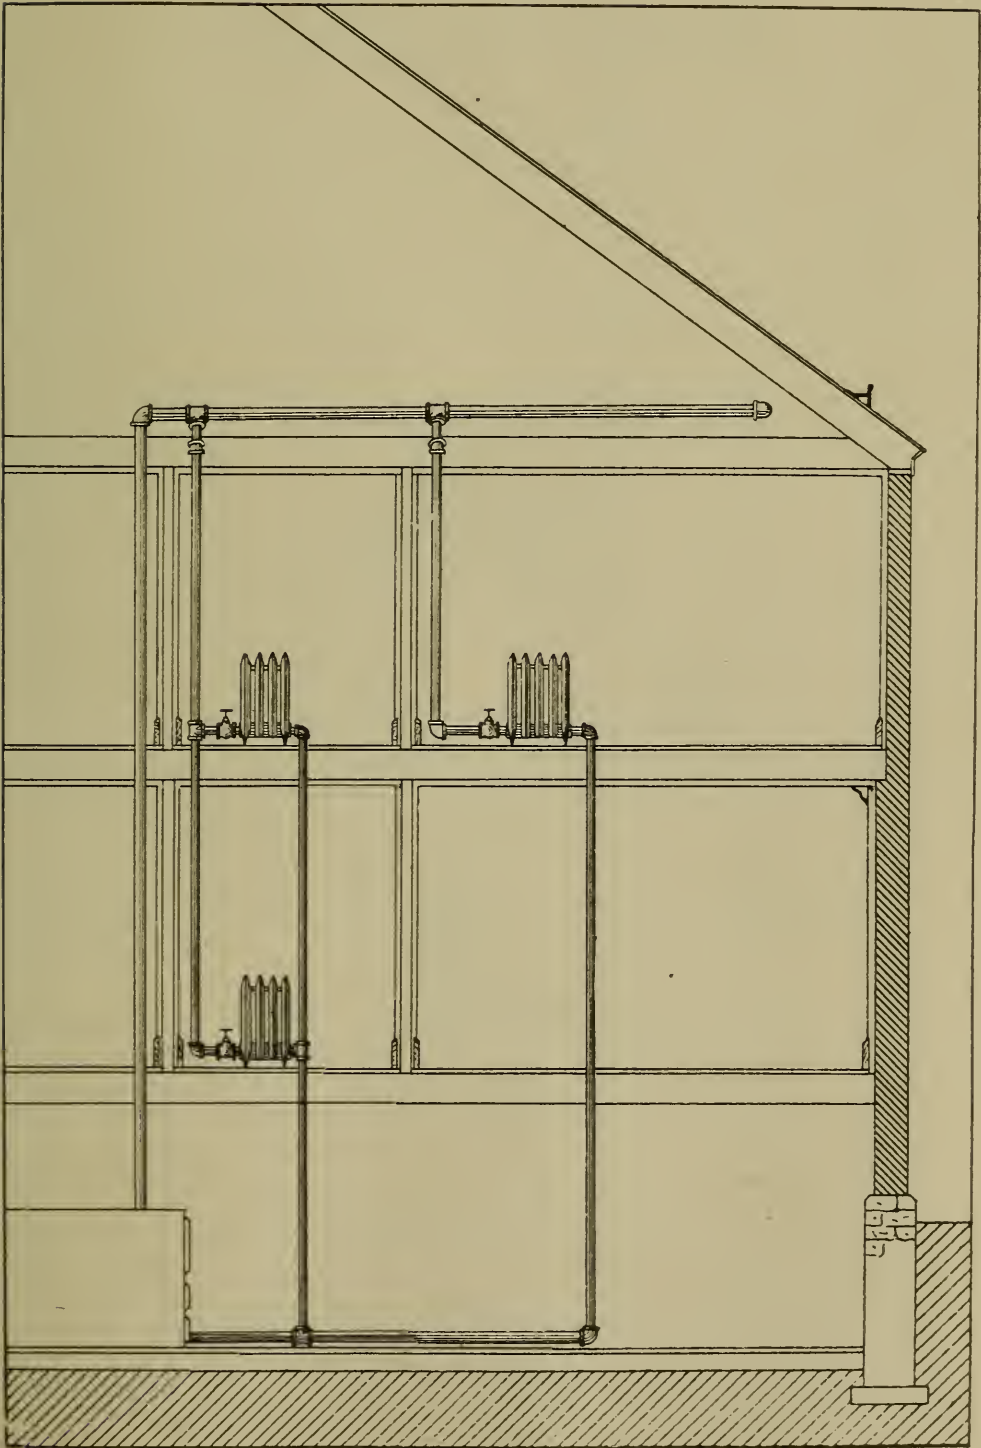


Figure 49.

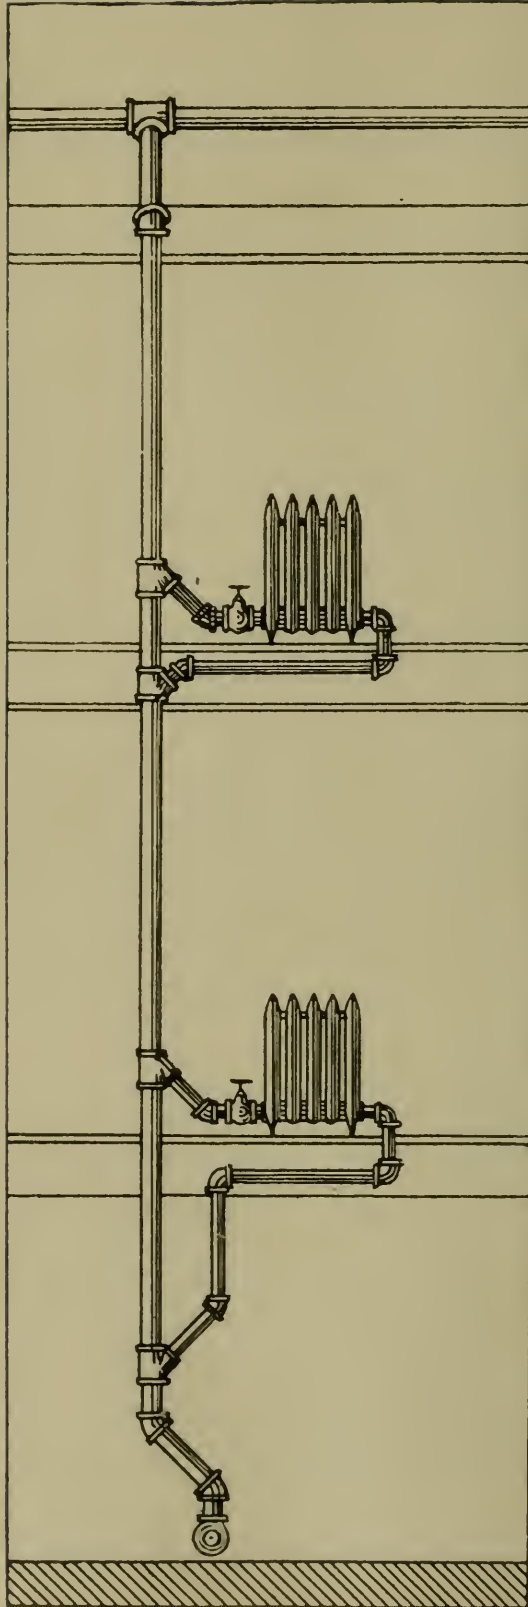


Figure 50.

modified as shown in Fig. 50. In this case the riser in both flow and return main to the radiator takes its supply at a point near the level of the radiator and delivers the water at a point below the level of the radiator in the same main. One objection to this arrangement is the fact that the radiators on the upper floor will be considerably

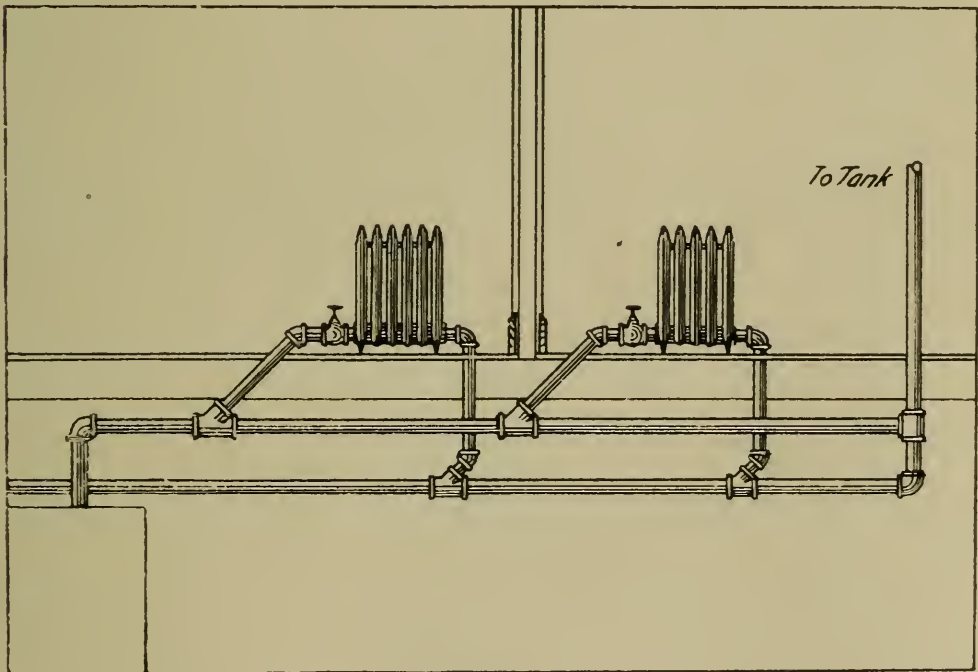


Figure 51.

warmer than the radiators on the lower floors, and where this system is installed larger radiators should be used on the lower floors. It has the advantage of simplicity.

In the systems described, with the exception of Fig. 50, the circulation from flow to return main

takes place through the radiators. This is what is termed an open circuit. In the open circuit system, where two or three radiators are closed off, the resistance to circulation is greatly increased and the system will be slow to circulate when the radiators are opened. This may be avoided by connecting up the piping system as shown in Fig. 51. The closed circuit system is particularly desirable in large buildings, especially buildings having very long horizontal mains.

In this system the hot water main acts as both flow and return main, the radiators being connected on the two-pipe systems as shown in Fig. 52.

Single Pipe System. It is necessary in the single-pipe hot water system to make the mains very large in diameter, as the current in them must be relatively slow. In this system the hot water passes along the top of the main and the cold water passes along the bottom of the main. It is necessary, then, that the flow riser going to the radiator be connected to the top of the main and the return riser coming from the radiator be connected to the bottom of the main. The main itself is usually installed on a closed circuit, as shown in Fig. 52. The single-pipe system of distribution has not been extensively used and has no great advantage over the standard system of piping.

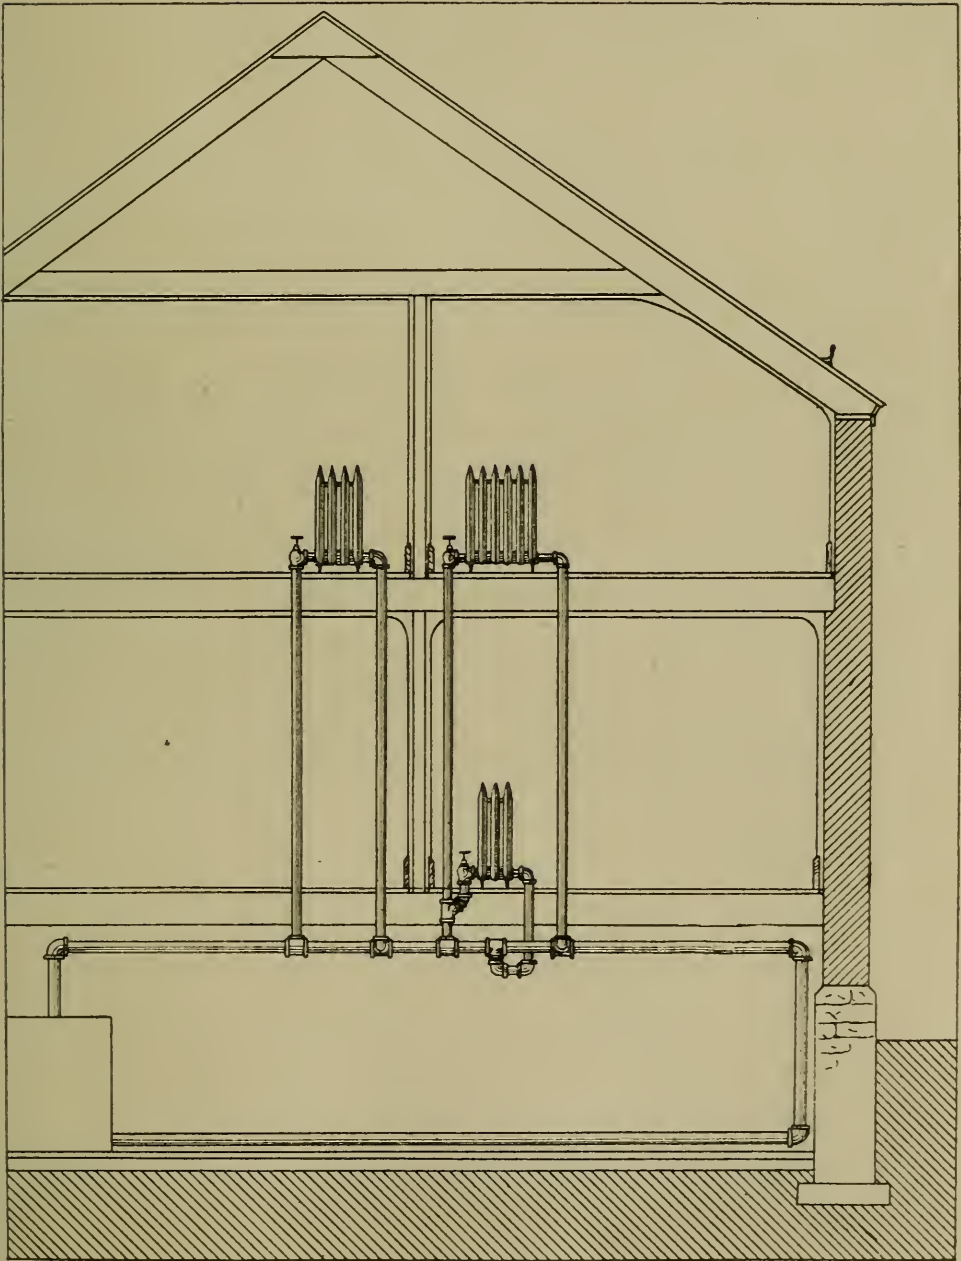


Figure 52.

As previously stated, the hot water system should be so designed that the resistance of flow to each

Velocity of Flow. radiator should be proportional to the force producing flow. The water will always seek the path of least resistance, so that the radiators having the smallest pipe resistance will receive the largest quantity of water, and radiators having the largest pipe resistance will be proportionally colder. A series of experiments have been made at the University of Michigan to determine the velocity of water in a hot water heating system under actual conditions of operation with full sized pipes and radiators.

TABLE XXIII.
Velocity of Hot Water Circulation (Feet per Second.)

| Height of circuit in feet. | —Difference in Temperature.— | | |
|----------------------------|------------------------------|------|------|
| | 10. | 15. | 20. |
| 5 | .135 | .39 | .55 |
| 10 | .19 | .56 | .78 |
| 15 | .235 | .69 | .95 |
| 20 | .27 | .79 | 1.09 |
| 25 | .30 | .88 | 1.22 |
| 30 | .31 | .96 | 1.34 |
| 40 | .38 | 1.11 | 1.53 |
| 50 | .425 | 2.25 | 1.74 |

The actual velocity was found to vary from one-quarter to one-half of the theoretical velocity, depending upon the difference in temperature between the hot and cold leg of the system. In Table XXIII the actual velocities have been computed

from the results obtained by these experiments for different heights and different conditions of temperature.

No complete set of experiments has been made to determine the resistance of pipe and fittings. The University of Michigan at the present time is making a series of experiments, but these have not yet been completed. The following are the ordinary assumptions that have been made:

**Resistance of Pipe
and Fittings.**

| Diameter of mains. | Total Length of Circuit in Feet. | | | |
|-----------------------|----------------------------------|-------|-------|-------|
| | 50. | 100. | 200. | 300. |
| 1 | 40 | 30 | .. | .. |
| 1¼ | 60 | 45 | 30 | .. |
| 1½ | 90 | 60 | 40 | 30 |
| 2 | 160 | 120 | 70 | 60 |
| 2½ | 250 | 200 | 120 | 110 |
| 3 | 350 | 300 | 200 | 190 |
| 3½ | 500 | 400 | 330 | 250 |
| 4 | 650 | 500 | 450 | 350 |
| 4½ | 900 | 700 | 650 | 500 |
| 5 | 1,200 | 1,000 | 800 | 650 |
| 6 | 1,500 | 1,200 | 1,200 | 1,000 |

Resistance of standard elbow=25 feet of pipe.

Resistance of standard tee=25 feet of pipe.

Resistance of standard return bend=35 feet of pipe.

Resistance of the ordinary radiator connection from the flow main through the radiator to the return main is equivalent to about 100 feet of pipe.

The size of pipe may be figured by assuming the actual velocity due to the head and calculating the size required to carry a

Size of Pipe. given amount of water.

This is usually done in large buildings. In smaller buildings it is customary to follow the rules used in good practice.

Table XXIV gives the pipe sizes of the mains to supply different quantities of direct radiation at different distances from the boiler. In establishing the size of the risers it is customary to start with a riser the same size as the radiator connection and carry the riser down to the floor below where the next radiator connects. If the radiator does not exceed 60 feet in size, add one pipe size to the pipe.

Table XXV gives the size of risers for various quantities of radiation on different stories.

The following are the radiator tappings for hot water radiators:

- Radiators containing 40 sq. ft. and under... 1 inch
- Radiators containing above 40 sq. ft. and not exceeding 72 sq. ft. 1 1/4 inch
- Radiators containing above 72 sq. ft. 1 1/2 inch

Hot water piping should be pitched away from the boiler and arrangements should be made so that

Air Valves, Pitch and Support of Pipes. the piping and boiler can be drained. This is necessary on account of freezing if the plant is not kept in operation. The piping should be supported the

same as for steam pipes, with supports about every 10 feet. Care should be taken that the pipes are straight, as any sudden elevation in the pipe will

TABLE XXV.
Size of Hot Water Risers.

| Diameter of Riser, inches. | —Height of Radiator above Boiler in Feet.— | | | | |
|----------------------------------|--|-----|-------|-------|-------|
| | 5. | 15. | 25. | 35. | 45. |
| 1 | 30 | 40 | 50 | 60 | ... |
| 1¼ | 40 | 60 | 70 | 80 | 90 |
| 1½ | 90 | 100 | 120 | 135 | 150 |
| 2 | 160 | 180 | 220 | 260 | 300 |
| 2½ | 250 | 290 | 350 | 400 | 500 |
| 3 | 360 | 450 | 550 | 650 | 750 |
| 3½ | 500 | 620 | 750 | 900 | 1,000 |
| 4 | 700 | 800 | 1,000 | 1,150 | 1,500 |

form a pocket in which air will collect, and this collecting of air in the pocket will prevent the flow of water. An accumulation of air in the pipe will stop the circulation almost as effectively as a valve. The expansion of pipes by heat must also be taken care of as in the steam system. All branches going from the piping system and supplying radiators below the level of the mains should come off the bottom of the main, so as to prevent air accumulating and sealing the pipe.

All radiators and high points in the mains where air will collect should be provided with air valves.

There are special air valves made for hot water work. These will be described later.

CHAPTER IX.

VENTILATION.

The necessity of ventilation, that is, of renewing the air in a closed room, is due, first to the vitiation of the air by the products of respiration from the persons in the room; second, to the products of combustion from artificial illumination; third, to the heat generated by persons and lights in the room; and, fourth, to the presence of gases from chemical processes.

In a small house or a small school building ventilation is very easily produced by methods which employ natural draft, such as hot air furnaces, steam and indirect radiators. In all systems using natural draft, the force of the draft depends upon the difference of the temperature between the air inside and that outside the flue. Where this difference amounts to only 30° or 40° the difference in the weights of the columns of air is so small that the force producing draft is very light and may be easily overcome by external conditions. In larger buildings it is not possible to use natural draft as the flues become excessive in size and are not cer-

tain enough in their operation. This has led to the use in school buildings and other public buildings of a forced system of ventilation in which the circulation is produced by a fan or system of fans.

The perfectness of the ventilation in a room is ordinarily determined by the amount of carbonic acid gas. Carbonic acid gas is not poisonous in itself. Its injurious effects are produced entirely by the reduction of the oxygen in the room. There are, however, other injurious gases given off from the body, together with the carbonic acid gas.

The lungs take in oxygen from the air, which combines with the tissues of the body, forming the products of combustion

which are given off by the **Products of Respiration.**

excretory organs — lungs,

skin, etc. The principal excretions removed by the lungs are carbonic acid gas, water vapor mixed with other gases and some animal matter. These excretions, together with excretions from the skin, produce a disagreeable odor and may be poisonous. The average man when sitting still consumes in breathing from 19 to 25 cubic feet of air per hour, and when exercising from 26 to 35 cubic feet per hour. The amount of carbon dioxide and water vapor given off per hour by human beings is given in table XXVI.

The products of combustion from the sources of heating, such as grates, stoves, etc., are drawn off

Table XXVI—Air Pollution Tests.

| Subject to Test | At Work | | | | At Rest | | | |
|----------------------|------------------|-----------------|----------------------------|----------------------------|------------------|-----------------|----------------------------|----------------------------|
| | Temp. Deg. F. | Humid. P. C. | CO ₂ cu. ft. | H ₂ O Grains | Temp. Deg. F. | Humid. P. C. | CO ₂ cu. ft. | H ₂ O Grains |
| Laborer .. | .45 | 81 | 1.515 | 2.03 | 69 | 20 | .551 | 1.12 |
| Laborer .. | .77 | 47 | 1.423 | 8.05 | 78 | 26 | .586 | 2.55 |
| Clerk | .64 | 44 | 1.331 | 1.768 | 69 | 29 | 1.141 | 1.19 |
| Draughts- man ... | .69 | 41 | 1.61 | 1.61 | .. | .. | | |
| Average man | | .. | | | 66 | 63 | .412 | 1,365 |
| Woman | | .. | .600 | | .. | .. | | |
| Boy | | .. | .48 | | .. | .. | | |
| Girl | | .. | .39 | | .. | .. | | |

by the chimney, but the Products of Combustion. products of combustion from the lights in a room pass directly into the room. Lights give off carbonic acid gas, watery vapor, and traces of sulphuric acid. Table XXVII gives the consumption of combustibles and the generation of carbonic acid

Table XXVII—Pollution of Lighting.

| SOURCE. | Consumption of com- bustible per C. P. in cu. ft. per hr. | Carbonic acid per C. P. in cu. ft. per hr. |
|-----------------------------|---|--|
| Gas—Fishtail burner | .802—.527 | .494—.304 |
| Gas—Argand burner | .0 —.445 | .254 |
| Gas—Welsbach burner ... | .053—.024 | .030—.057 |
| Petroleum, round burner.. | Gals. .00050 | .112 |
| Petroleum, small flat bnr.. | Gals. .00198 | .335 |
| Wax candles | Oz. .271 | .417 |
| Paraffine candle | Oz. .324 | .459 |

gas by ordinary forms of lighting. The table is given for each normal candle power.

The products of chemical operations should never accumulate in a room so that the odor is perceptible. In some industrial

processes it is almost impos- **Chemical Processes.**
sible to avoid a certain

amount of concentration of the gases. In such a case the chemical products should be sufficiently diluted with fresh air so as not to produce injurious effects upon the occupants of the room.

Table XXVIII gives the relative dilution required for different gases in cubic feet per 100 cubic feet of air.

The amount of heat generated by a human being varies with age, activity and temperature of the surrounding air. The

average amount of heat **Generation of Heat by**
given off by an adult is **Human Beings.**

about 400 B. T. U's per hour, and by a child about half that amount, or 200 B. T. U's per hour. Of 400 B. T. U's given off by human beings about 30 per cent is lost by contact of air and about 43 per cent by radiation, the balance is lost by exhalation and other losses. Comparing this with the average steam radiator, we see that a child is equal to about eight-tenths of a square foot of radiation and an adult man is equal to about one and eight-tenths

of a square foot of radiation. This becomes a very important point in the heating of large halls, particularly if they are very crowded and have very little external wall space, as the heat given off by

| | Detrimental effect occurs in several hrs. in ½-1 hr. | |
|---------------------------------|---|----------|
| Iodine vapors | .00005 | .0003 |
| Chlorine or bromide vapors..... | .0001 | .0004 |
| Muriatic acid | .001 | .005 |
| Sulphuric acid | | .005 |
| Sulphureted hydrogen | | .02 |
| Ammonia | .01 | .03 |
| Carbonic oxide | .02 | .05 |
| Carbonic acid | 1.00 | 8.00 |
| Carbureted hydrogen | | 6.56 gr. |

the persons in the room may be more than sufficient to warm the room, which will necessitate providing for the removal of this heat from the room.

Table XXIX gives the heat generated by different sources of illumination per candle power per hour.

**Generation of Heat by
Illumination.**

Ordinarily the heat given off by electric lights is so small as to be incalculable, but where oil lamps, candles, or gas lights are used, the heat given off is appreciable, except in the case of the Welsbach burner, which gives off relatively a small amount of heat. The ordinary fish-tail burner is equal to about one and four-tenths square feet of radiation.

In order that the air in a room occupied by human beings may be reasonably pure it should be diluted with fresh air. The amount of the dilution, except where chemical processes are to be considered, is usually determined by the per cent of carbon dioxide present, which is assumed to be proportional to the products

Changes of Air Necessary.

Table XXIX—Heat Given Off by Illuminants.

| SOURCE. | Total B. T. U.'s given off. | Heat radiated, B. T. U.'s. |
|---------------------------|--------------------------------|-------------------------------|
| Gas—Fishtail burner | 313 | 32 |
| Gas—Argand burner | 198 | 28 |
| Gas—Welsbach burner | 32 | 6 |
| Petroleum | 158 | 42 |
| Incandescent lamp | 14 | 10 |
| Arc lamp | 2.5 | .. |

of respiration. The carbon dioxide itself is not injurious, but it serves as an indication of the presence of other injurious substances. It is usually assumed that carbon dioxide is uniformly distributed throughout the room. This, however, is not strictly true, as carbon dioxide is a very heavy gas and naturally accumulates at the floor. Air that contains more than ten parts of carbon dioxide to each 10,000 parts of air produced by exhalation is of an unhealthful quality. Seven parts in 10,000 is ordinarily considered the minimum limit of ventilation. The effects of poor ventilation are usually shown when the carbon dioxide exceeds six parts in

10,000 parts. The following rule may be used to determine the necessary amount of air that should be supplied to a room: Multiply the number of sources of carbon dioxide by the amount of carbon dioxide given off from each source. Multiply the result by 10,000 and divide by 4. This will give the minimum amount of ventilation to be allowed per person. For satisfactory ventilation divide by 3. Pure air is found to contain about 3 parts of carbon dioxide in 10,000.

This may be expressed as follows:

Let S = cu. ft. carbonic acid from each source per hr.

n = number of sources.

a = allowable limit of CO_2 in cu. ft. of air.

A = the cu. ft. of air to be supplied.

$$\text{Then } A = 10,000 \frac{n S}{a - 4}$$

a should not exceed 7 and a equals 10 is the sanitary limit.

For example, take a hall containing 400 adults, giving off (from Table XXVI) .58 cu. ft. of CO_2 per hour. Then to determine the amount of air necessary substitute in the above formula

$$A = 10,000 \frac{400 \times .58}{6 - 3} \text{ solving}$$

$$A = 770,000 \text{ cu. ft. per hour.}$$

The amount of air necessary is usually determined by allowing each person in the room so

Table XXX—Change of Air Necessary.

| | |
|--------------------------------------|---------------------------|
| Hospitals | 3,600 cu. ft. per person |
| Barracks and workshops..... | 3,000 cu. ft. per person |
| Schools | 2,400 cu. ft. per person |
| Churches, theaters & audience halls. | 2,000 cu. ft. per seat |
| Office rooms | 1,800 cu. ft. |
| Toilet and bath rooms..... | 2,400 cu. ft. per fixt're |
| Dining rooms | 1,800 cu. ft. per person |

many cubic feet of air per hour. The changes of air ordinarily allowed are given in Table XXX.

These figures in the above table give sufficient air so that the air in the room will remain continuously pure, even though occupied all the time. When less than these amounts are used there is danger, if the buildings are very tight, that the rooms may become foul. The figures given above are seldom realized in practice, except where the fan system of ventilation is used. In school buildings using an indirect system the amount of air allowed per child seldom exceeds 1,000 cubic feet of air per hour.

Another method that is sometimes used in figuring ventilation, particularly for smaller buildings, is to allow so many changes of air per hour. In rooms seldom occupied allow the air to be changed about once per hour. In living rooms about one and a half to two times per hour. In toilet rooms

four to five times per hour. In restaurants, where smoking is allowed, from five to six times per hour. In extreme cases the change of air is sometimes as high as ten times per hour. It is difficult, however, to change the air in a room very rapidly without producing drafts.

The effects of poor ventilation have been frequently tested in schools where for a short time the

ventilation has been cut off.

**Effects of Poor
Ventilation.**

The pupils at first complain of being cold, and it is found necessary to raise the tem-

perature of the room from 70° to 80° before the occupants of the room are warm. This is no doubt due to the reduction in vitality owing to the impurity of the air, and a lack of oxygen in the lungs. After the ventilation has been cut off for a period of from 20 to 30 minutes, the pupils begin to complain of headache. If the ventilation is cut off much longer it is necessary to dismiss some pupils on account of headache.

For small residences and small buildings where it is not possible to go to any great expense for an

elaborate system of ventila-

Systems of Ventilation.

tion, the best form of heating giving adequate venti-

lation is the hot air furnace. In large houses where it is not possible to apply the hot air system, the best system is indirect radiators, either steam or hot

water. In still larger buildings where the flues have a large resistance and it is necessary to supply air in large quantities, the only feasible system of distributing air is by mechanical means. The usual system employed is to draw the air through a series of steam coils into a tempered air chamber. In this chamber are located the fans. The fan or fans deliver the air through heating coils into the building. Systems similar to this have been used where the coils have been replaced by hot air furnaces.

Systems of ventilation using mechanical draft give very satisfactory results if properly installed and allow of great latitude in the arrangement of the plant. Before taking up the details of the systems of ventilation it is well to consider certain fundamental facts in the science of ventilation.

The arrangement of inlet and outlet registers in a room should be given very careful consideration. They should be so placed as to avoid drafts and to insure **Air Inlets and Outlets.** uniform circulation throughout the room. Their position should be such that the air cannot pass directly from inlet to outlet flue. The creation of drafts may be avoided by bringing the air in at very low velocities, particularly where the air enters so as to strike the occupants of the room. The velocity passing through the registers should not exceed 200 feet per minute. Where the

air is brought in so that it cannot strike the occupants of the room the velocity of air through the registers may be as high as 400 feet per minute.

The most satisfactory arrangement for most rooms is shown in Fig. 53. In this figure the inlet

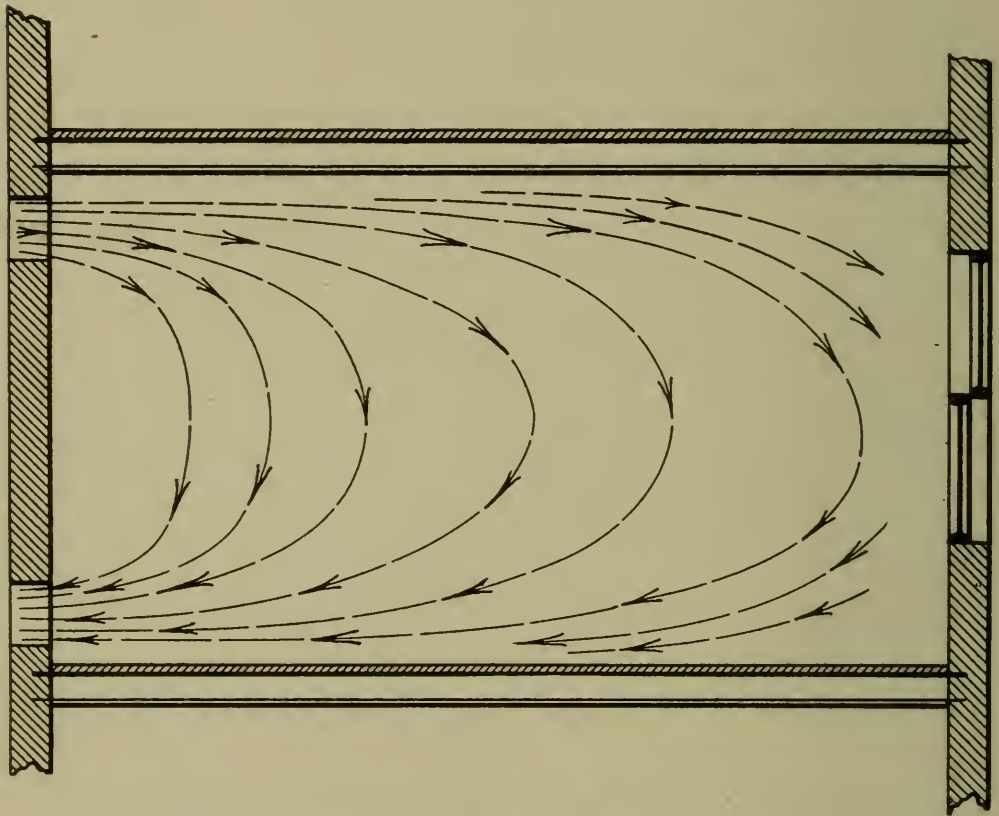


Figure 53.

register is shown near the ceiling. The hot air leaving this register rises to the ceiling, passes along the ceiling to the cold window surfaces, where it is cooled and drops to the floor; passes along the floor and out the vent flue. The inlet register is usually located about 8 feet above the floor and the outlet register from 4 to 6 inches above the floor,

just sufficient to avoid dust and dirt being swept into it. Where the current of air leaving the inlet register is liable to be centered in one point in the room it is well to put a diffusing register on the air inlet so that the air will be distributed in a num-

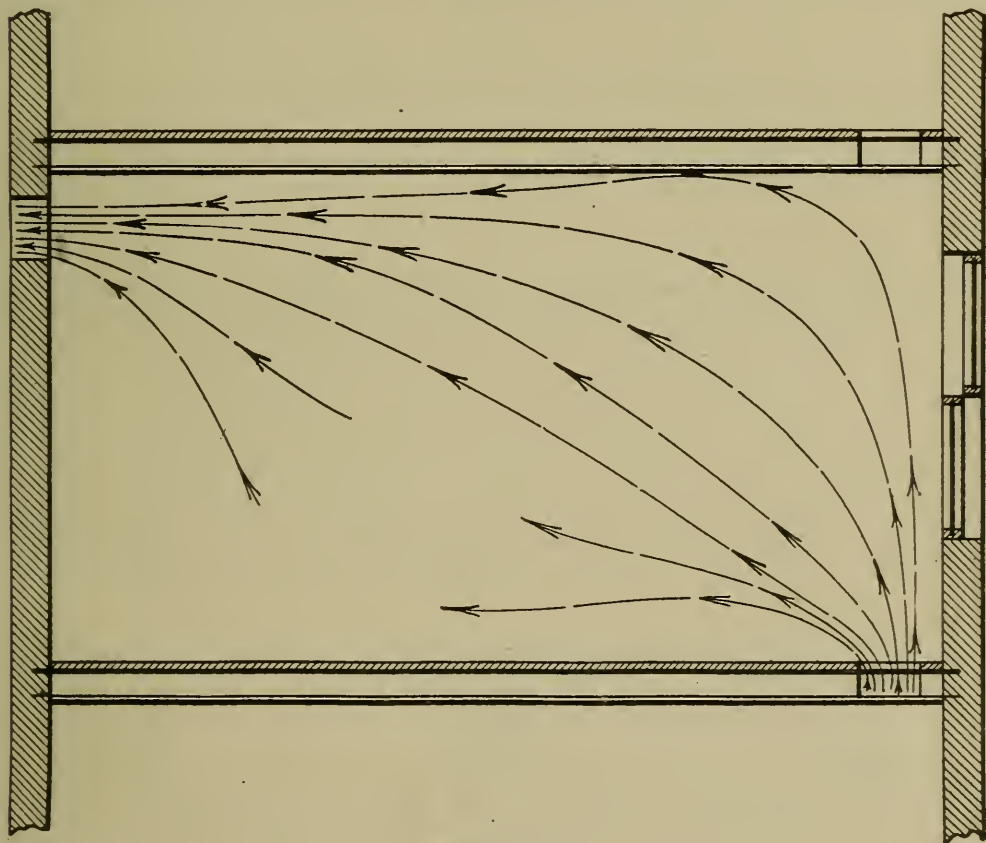


Figure 54.

ber of streams in different directions throughout the room. This arrangement of inlet and outlet registers is the usual one for school buildings. It is preferable to have the inlet and outlet register on the inside walls opposite the window surfaces and both registers on the same wall. This, however, is not absolutely necessary. The inlet and out-

let registers should never be on the outside walls. Where the inlet register is placed on the floor and the outlet register at the ceiling then the air coming from the inlet register will pass directly to the outlet register and a large proportion of the heated air be lost; in addition there will be very little circulation of air in the room, as shown in Fig. 54.

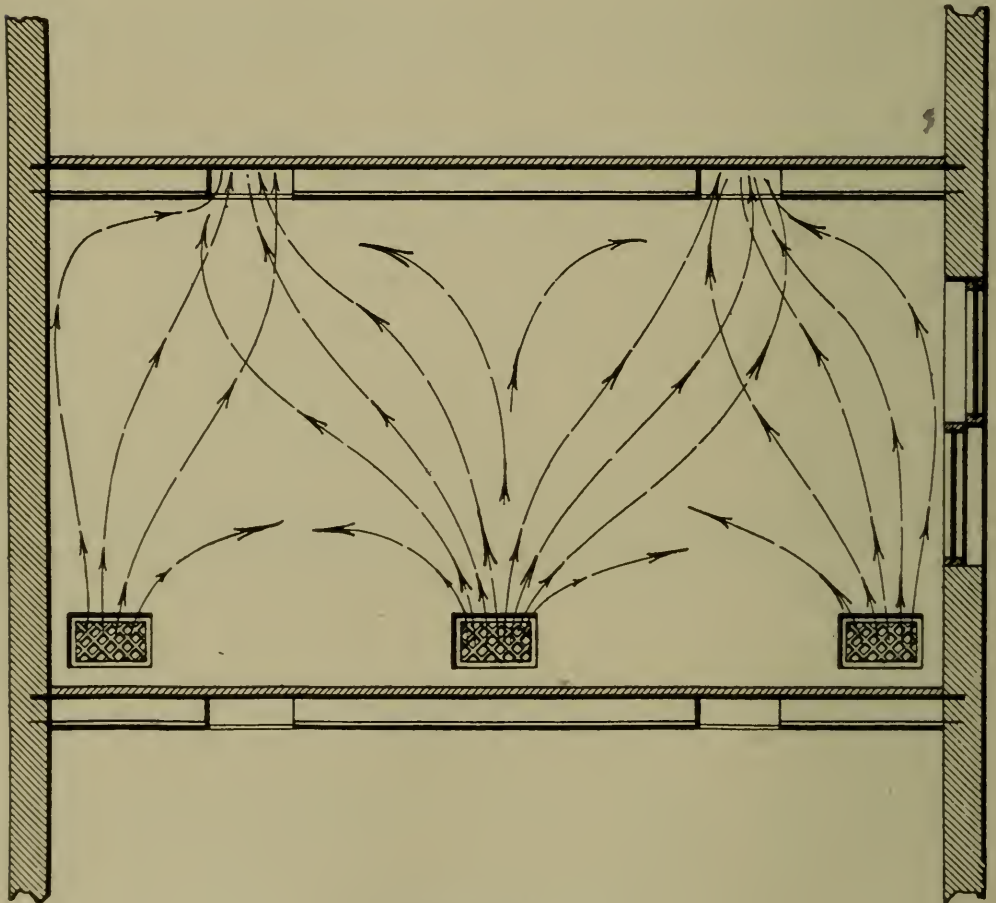


Figure 55.

In rooms for restaurant purposes, where smoking is allowed or in smoking rooms or in kitchens, the air must be taken off the ceiling, as the foul air,

being warmer, rises to the ceiling. In this case it is necessary to bring the ventilating air in at the baseboard, at a very low velocity and at a large number of places and take the air out at definite points near the ceiling, as shown in Fig. 55. In theaters and churches special means must be employed for securing ventilation. It is customary to admit the air in a large number of places. Sometimes this is done by means of a large number of small registers placed directly under the seats. Care, however, must be used in doing this to avoid drafts. Another method is to employ a large number of openings around the sides of the room. The air is usually taken off near the stage at the lowest point in the auditorium. There should be provided in all auditoriums some means of taking the air off the ceiling, as oftentimes the heat given off by the occupants of the room is more than sufficient to heat the room, and in addition we have the heat given off by the sources of illumination. This heat can be best taken care of at the ceiling line, which is naturally the warmest point in the room.

CHAPTER X.

DESIGN OF HOT AIR HEATING SYSTEM.

In a hot air furnace the cold air from the outside is passed over heated iron surfaces, usually enclosed in galvanized iron or brick walls. The space between the walls and hot surfaces of the furnace is connected to the outside air at the bottom and at the top to the flues leading to the rooms. The amount of air circulating through the furnace will depend upon the temperature of the hot air leaving the furnace and the height and resistance of the flues. In order that the air in a room may be quickly replaced by warm air it is necessary that the room be provided with a foul air flue.

A great many of the difficulties that have been experienced with the hot air system as ordinarily installed are due to the sharp competition in business, which has resulted in the erection of plants of inferior workmanship and design. One of the commonest mistakes is the installation of a furnace much too small to do the work properly. The result of putting in a small furnace is that the fire must be continually crowded so that the heating surface is at high temperature and a large amount

of the heat of the coal is wasted in excessive stack temperature.

The hot air system with natural draft should not be used in houses where the horizontal portion of the hot air flues would exceed 20 feet in length. In very large houses two or more furnaces may be used to avoid excessive pipe resistance.

Hot air furnaces are as varied in types as are steam boilers. They are made either of cast iron or steel. It is difficult to decide between the merits of **Hot Air Furnaces.** these two materials. Cast iron is less liable to be rapidly deteriorated by rust when the boiler stands in the summer, but it is more easily broken either by misuse or shrinkage strains in the castings. There is no essential difference between the metals in their conducting capacity as applied in these furnaces.

It is very important to see that the furnace is so constructed that the joints between the fire-box and hot-air chamber are tight, so that the air entering the rooms may not be mixed with gases of combustion. This is one of the most difficult things to prevent in the hot air furnace. Joints should be as few as possible and vertical joints should be avoided. The introduction of moisture into the air passing through the furnace is an important consideration and will be treated in a separate paragraph.

The builders rate their furnaces at about their maximum capacity. The rating being expressed as the number of cubic feet of building volume the furnace will heat. In selecting a furnace it is wise to have 25 to 50 per cent excess capacity in the furnace over the builder's rating.

In the hot air furnace we have the fire and hot gases on one side of the shell and air on the other side of the shell. Air being a poor medium for the conduction of heat it is essential to economy that a hot air furnace should have large heating surfaces in proportion to grate area. The best manufacturers allow from 50 to 70 square feet of heating surface per square foot of grate surface.

A furnace should be provided with some form of shaking and dumping grate which is easily cleaned. In addition to draft doors admitting air below the grates, the furnace is usually provided with a check damper in the smoke pipe. The draft door and check damper are arranged so that they may be controlled by chains situated in some convenient point in the room above.

It is very important that air after being heated by the furnace pass over the surface of a pan of water so that it can

Necessity of Supplying Moisture to Heated Air. take up moisture. One pound of air at 32° F. will hold in the form of a vapor .003 of a pound of water, and at 150 de-

degrees it will hold .22, or about 70 times as much. If then we take air saturated with moisture at an outside temperature of 32 degrees and heat it up to 150 degrees we have increased its capacity for moisture 70 times. On entering the rooms if the air has not been given opportunity to take up moisture it will take it up from the objects in the room. This drying effect of the air injures the furniture and woodwork and affects the persons occupying the room, producing a dry throat and a feeling of cold due to rapid evaporation from the skin.

The usual method of overcoming this is to have a pan filled with water situated in the furnace near the fire-box. This, however, is the wrong end of the furnace to place the pan, as the air entering is coolest at this point. The water should be added to the air as it leaves the furnace. In some hot air installations every pipe leaving the furnace has a trough in it, which is filled with water, and from this water the air takes up its moisture.

The cold air supplied to the furnace is usually taken from one of the basement windows and brought to the furnace through a tile or wooden **Cold Air Duct.** duct lined with galvanized iron; where a tile duct is used it is placed below the level of the cellar floor. The cold air should be taken from the side of the house that is subject to the prevailing winds. It is sometimes desirable to

have cold air ducts leading to different sides of the house, so that the supply of cold air may be taken from the windiest side.

It is well to provide some means of recirculation of the air in the house through the furnace. The air for recirculation is usually taken from the hall. If it is desired to recirculate partially and take the balance of the air from outside, the recirculating pipe should be brought to the furnace separately, and a deflecting plate placed in the air space under the furnace. If this is not done the air will come in from the outside and pass up the recirculating pipe instead of going to the furnace. If, however, the recirculating pipe is only to be used when the cold air pipe from outside is closed, then the recirculating pipe can be conducted into the cold air pipe directly. In this case the cold air pipe and recirculating pipe must both be provided with dampers. The cold air pipe should have at least three-fourths of the combined areas of the hot air pipes.

It is a common error to make the recirculating pipe of a furnace system too small. The recirculating pipe should be not less than three-fourths the area of the cold air pipe. It is better to have it equal in area to the cold air pipe.

The furnace should be centrally located, or if the

coldest winds come from a certain direction, it can be located more on that side of the house from which the cold winds come. The hot air flues leading from the furnace should be as short and direct as possible; long horizontal pipes should be avoided. Horizontal pipes should pitch sharply towards the furnace, three-quarter inch to the foot is good practice. All hot air pipes should have nearly equal resistance to the passage of the air. The hot air flues should have as few and as easy turns as possible. They should never be placed in the outside walls. Uptake flues of any kind in outside walls seldom draw satisfactorily. The hot air flue should enter the room in most cases opposite the largest exposed glass surface or some distance from it. The circulation of air in the room would be best if the hot air entered near the ceiling. The principal objection to this is that the register in the wall is apt to blacken the wall and it does not allow people to warm themselves over it. Floor registers are very objectionable as they always serve as receptacles for all kinds of rubbish and sweepings.

Dampers should be provided in all pipes leading to rooms above the first floor. If all the registers are provided with dampers there is danger of burning the furnace, due to shutting off all the passages for removing hot air and preventing circulation in the furnace. It is good practice to have no valve

in the hall register so one pipe will always be open.

The velocity of air for first floor pipes may be calculated as three to four feet per second, second floor four to five feet per

| | |
|--|---|
| Proportions of Hot Air Flues. | second, third floor and floors above five to six feet per second. |
|--|---|

The registers should be proportioned so as to give a velocity of two to three feet per second on the first floor and three to four feet per second on the floors above. The effective area of the ordinary register is about 50 per cent of the actual area, taking outside dimensions.

H. B. Carpenter, in a paper before the Society of Heating and Ventilating Engineers (Transactions, vol. 5, p. 77), gives the following rule for finding the cubic feet of air passing through pipes per minute:

To the first floor multiply the area in inches by 1.25.

To the second floor multiply the area in inches by 1.66.

To the third floor multiply the area in inches by 2.08.

It is good practice to figure on changing the air in the principal rooms five times per hour in hot air heating.

The foul air flues should be placed in the inside

walls and with foul air registers at the baseboard. The reason being that the hot air entering the room opposite the window surfaces rises to the ceiling, passes along the ceiling to the windows and is cooled. It then drops to the floor line, passes along the floor and out the foul air register. The hot air register should be a sufficient distance from the foul air register so that the hot air will not pass directly to the foul air flue. A cheap foul air flue can be made by having a register in the baseboard opening into the spaces between the studs, selecting a space that is open to the attic, a ventilator is placed on the attic space and discharges foul air out of doors. No two rooms should open into the same studding space. A still better draft can be produced by extending each flue separately by galvanized iron pipe to the ventilator. If no ventilating flues are provided, it is very difficult, especially if the house is tight, to get a proper circulation of hot air from the furnace; you cannot put hot air into a room if there is no provision for taking cold air out.

A fireplace makes one of the best forms of foul air flue. In a house well provided with fireplaces, it is often not necessary to provide any other foul air flues.

The size of the hot air flue, vent flue, hot air

register, heating surface and grate surface in the furnace is given in Table XXXI. This table is given for rooms of average proportion and under average conditions.

Table XXXI—Proportions of Hot Air Heating System.

| CONTENTS OF ROOM IN CU. FT. | | 500 | 1,000 | 1,500 | | | | | |
|--|-------|-------|-------|-------|-------|-------|-------|--------|--|
| FIRST FLOOR— | | | | | | | | | |
| Diameter hot air flue, in..... | | 6 | 8 | 9 | | | | | |
| Diameter foul air flue, in..... | | 6 | 8 | 9 | | | | | |
| SECOND FLOOR— | | | | | | | | | |
| Diameter hot air flue, in..... | | 6 | 7 | 8 | | | | | |
| Diameter foul air flue, in..... | | 6 | 8 | 9 | | | | | |
| Grate area in furnace, sq. in..... | | 25 | 50 | 75 | | | | | |
| Heating surface in furnace, sq. ft.... | | 10 | 20 | 30 | | | | | |
| 2,000 | 2,500 | 3,000 | 3,500 | 4,000 | 5,000 | 6,000 | 8,000 | 10,000 | |
| 10 | 11 | 12 | 13 | 14 | 16 | 17 | 20 | 24 | |
| 10 | 11 | 12 | 13 | 14 | 16 | 17 | 20 | 24 | |
| 9 | 10 | 11 | 11 | 12 | 14 | 15 | 18 | 20 | |
| 10 | 11 | 12 | 13 | 14 | 16 | 17 | 20 | 24 | |
| 100 | 125 | 150 | 175 | 200 | 250 | 300 | 350 | 400 | |
| 40 | 50 | 60 | 70 | 80 | 100 | 125 | 160 | 200 | |

The following assumptions have been made in the above table: Temperature outside air, 0 degree; temperature of air in the room, 70 degrees; changes of air in the room, three times per hour.

Velocity of air in hot air flues, 1st floor, 3 ft. per second.

Velocity of air in hot air flues, 2nd floor, 4 ft. per second.

Velocity of air in foul air flues, 1st and 2nd floors, 3 ft. per second.

Temperature of air entering the room, 160 degrees.

Proportion of grate surface to heating surface, 1 to 60.

Pounds of coal burned per square foot of grate surface per hour, 2.5.

The temperature of the rooms should be regulated by the drafts of the furnace as much as possible.

The heating surfaces of the furnace should never be brought to a red heat. **Suggestions for Operating Hot Air Furnaces.**

If it is necessary to do this to keep the rooms warm, the furnace is too small.

Ashes should be frequently removed from the furnace, as an accumulation of ashes may burn out the grate. Never shake the fire more than is necessary to expose the red coals to the ash pit. The furnace should be cleaned at least once a year. The water pan of the furnace should be kept full of water.

ROUGH RULES FOR HOT AIR SYSTEM.

1. The volume of the house divided by 50 equals square feet of heating surface in furnace radiator.
2. The volume of the house divided by 20 equals the number of square inches of grate area in the furnace.
3. Divide the volume of the room by 20 and the square root of the quotient will be the diameter of

the furnace pipe for the first floor room. For second floor rooms divide the volume by 25 and the square root of the quotient will be the diameter of the furnace pipe.

As an example of the hot air system applied to the ordinary dwelling, take the same house that was

used as an example of di-
Example of Hot Air rect steam heating. The
System. heat lost from the rooms

would be the same as in the case of direct steam. As an example of an individual room take the parlor.

From Table XII we see that the volume of the parlor is 1,665 cubic feet and the heat lost 10,395 B. T. U's per hour. In figuring the heating system for the parlor the following assumption will be made: The hot air enters the room at 160° . Cold air enters the furnace at 0° . The temperature in the room is 70° . Then the air entering the room is reduced in temperature $160-70=90^{\circ}$. Each pound of air on having its temperature reduced 90° would give up $.2375 \times 90 = 21.4$ B. T. U's. Then there will have to be introduced into the room to supply heat lost from the room $10,395 \div 21.4 = 485$ pounds of air per hour. At atmospheric pressure a pound of air occupies approximately 13 cubic feet, hence 485 pounds of air is equal to 6,300 cubic feet. This is the amount of air which must be delivered to the room per hour; 6,300 cubic feet of air per hour is

equal to 1.75 cubic feet per second. Allowing a velocity of 3 feet per second, the area of the pipe would be $1.75 \div 3 = .58$ square feet, which is equivalent to 84 square inches, or approximately the area of a pipe 10.5 inches in diameter. To warm the

Table XXXII.

| | Volume of room | B. T. U. lost from room per hour | B. T. U. given air per hour | Cu. ft. of air entering room | Diameter of hot air pipe |
|----------------------|----------------|----------------------------------|-----------------------------|------------------------------|--------------------------|
| FIRST FLOOR. | | | | | |
| Parlor | 1,665 | 10,395 | 18,500 | 6,300 | 10½ |
| Sitting room | 2,100 | 7,035 | 12,500 | 4,350 | 9 |
| Dining room | 1,640 | 7,350 | 12,800 | 4,500 | 9 |
| Kitchen | 1,610 | 10,300 | 18,000 | 6,250 | 10½ |
| Hall | 1,210 | 7,035 | 12,500 | 4,350 | 9 |
| SECOND FLOOR. | | | | | |
| W. chamber | 1,320 | 10,050 | 17,900 | 6,200 | 9 |
| Alcove | 810 | 7,560 | 13,400 | 4,750 | 8 |
| S. chamber | 1,560 | 7,035 | 12,500 | 4,400 | 8 |
| N. Chamber | 1,440 | 7,455 | 13,300 | 4,650 | 8 |
| Bath | 410 | 3,150 | 5,600 | 1,850 | 6 |
| E. chamber | 880 | 5,250 | 9,400 | 3,300 | 7 |
| Halls | 88 | 2,730 | 4,800 | 1,750 | 6 |
| | | | 151,200 | | |

air going to the parlor would require $485 \times .2375 \times 160 = 18,500$ B. T. U.'s. In a similar way the same quantities have been calculated for the other rooms. Except that for the second floor room, a velocity of 4 feet per second has been allowed.

Column 3 of Table XXXII shows the heat which is left by the air in the room. Column 4 shows the

heat used to warm the air entering the room. The difference between these two columns is the heat lost up the ventilating flues. This loss should not

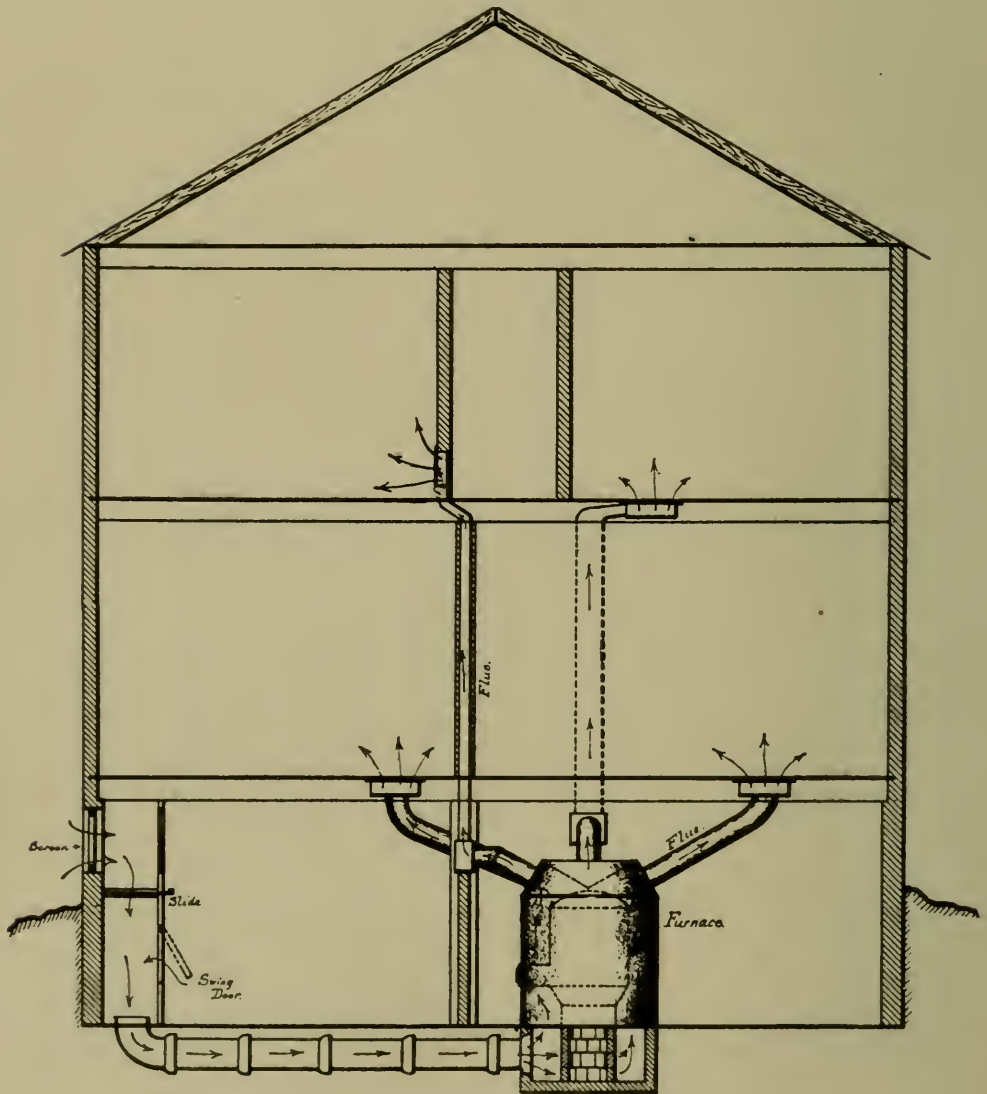


Figure 56.

be charged against the hot air furnace, but should be considered as the loss that must be charged to ventilation. The loss is about 44 per cent if the

temperature of the outside air is at 0° and the temperature of the air entering the room is 160° . As the temperature of the outside air or the incoming air is increased proportionately more heat enters the room and this loss becomes less. During the average winter weather the outside air is 35° , in which case the per cent of loss by ventilation, that is, through the ventilating flues, is about 30 per cent.

Summing up column 4 of the table gives the heat required to warm the air entering the entire house in zero weather or 151,200 B. T. U's. If we assume that 80 per cent of the coal goes into the heated air, then there will be required from the coal $151,200 \div .8 = 188,500$ B. T. U's per hour. A good anthracite coal contains about 13,500 B. T. U's; then in zero weather this house would use $188,500 \div 13,500 = 14$ pounds of coal per hour. As the average loss from a house during the heating season is approximately 50 per cent of the loss during zero weather, the average consumption of coal in this house for the heating season would be $14 \times .5 = 7.00$ pounds of coal per hour. Assuming the furnace to be operated 24 hours per day and 200 days per year, the coal consumption for this house would be $7 \times 24 \times 200 \div 2,000 = 16.8$ tons. Fig. 24 shows a cross section of a house with the hot air system installed.

CHAPTER XI.

FAN SYSTEM OF HEATING.

Where it is necessary to introduce large quantities of air into a building for the purpose of ventilation a natural system of circulation is out of the question and it is necessary to force the air into the building by some mechanical device. This is usually done by means of a steel plate blower which delivers the air with sufficient pressure to force the air into all rooms in the building. The pressure required in the average building does not usually exceed one-quarter ounce. The mechanical system of ventilation has the additional advantage that its operation is entirely independent of the heating of the building and the building may be ventilated as easily in the summer as in the winter. The natural system of ventilation depends entirely upon the air in the flues being heated, and during the summer periods the system is inoperative.

There are two general schemes of fan heating, one in which the air is heated to a temperature higher than that in the room, so that it furnishes enough heat to supply the heat lost from the walls and windows, as well as to

Systems of Fan Heating.

furnish air for ventilation. In the other system the heat loss from walls and windows is supplied by direct radiation situated in the room and the fan supplies only the necessary amount of air for ventilation. In the latter system the air for ventilation is supplied at about the temperature to be maintained in the room. The first system, in which all the heat is supplied by means of a fan, is most applicable in buildings that must be heated and ventilated both night and day. Hospitals and asylums are buildings of this class. It has certain disadvantages, however. When a room has very large glass surfaces it is almost impossible with this system to prevent strong cold drafts coming down along the window surfaces. The system is in many cases wasteful. In order to heat a building it is often necessary to admit more air than is required for the purpose of ventilation, and all the heat put into the air to raise the temperature of the outside air to the temperature of the room is lost. On the other hand, this system requires but one system of heating, which makes it less expensive to install.

The second system mentioned, where direct radiation and a fan are both used, is most applicable in buildings that require ventilation only part of the time. Schools, factories, office buildings are buildings that may be included in this class. While the buildings are filled with occupants the fan system is operated; as soon as the occupants leave the build-

ing the fan system is closed and the building kept warm by means of direct radiation. The building is thus kept warm at a minimum expenditure for fuel. There is no necessity of introducing into the building more air than is necessary for ventilation. But the system is expensive to install, as it involves installing two separate systems of heating. This system is being more and more favorably considered, however, in connection with the class of buildings mentioned.

The usual arrangement of the fan system is shown in Fig. 57. The air is drawn first through a series of tempering coils **General Arrangement of the Fan System.** shown at A. Then it enters a tempered air chamber in which is located the fan. This delivers the air through a series of heating coils B into the hot air chamber. From this hot air chamber the individual rooms in the buildings take their heat. The tempered coils are usually designed to heat the air to about 70° . The fan takes this air at 70° and passes it to the heating coils. After leaving the heating coils the temperature of the air is from 130° to 140° . Where the air is used for ventilation only the heating coils are omitted and the air is delivered by the fan from the tempered air chamber directly to the room.

The quantity of air to be supplied to each room

will depend upon the system of heating employed. If the heating is done entirely by fan enough air must be admitted so that the heat left by the air will be sufficient to heat the room. In audience and school rooms the amount of air necessary to supply proper ventilation is usually sufficient for heating. In of-

Quantity of Air to Be Supplied.

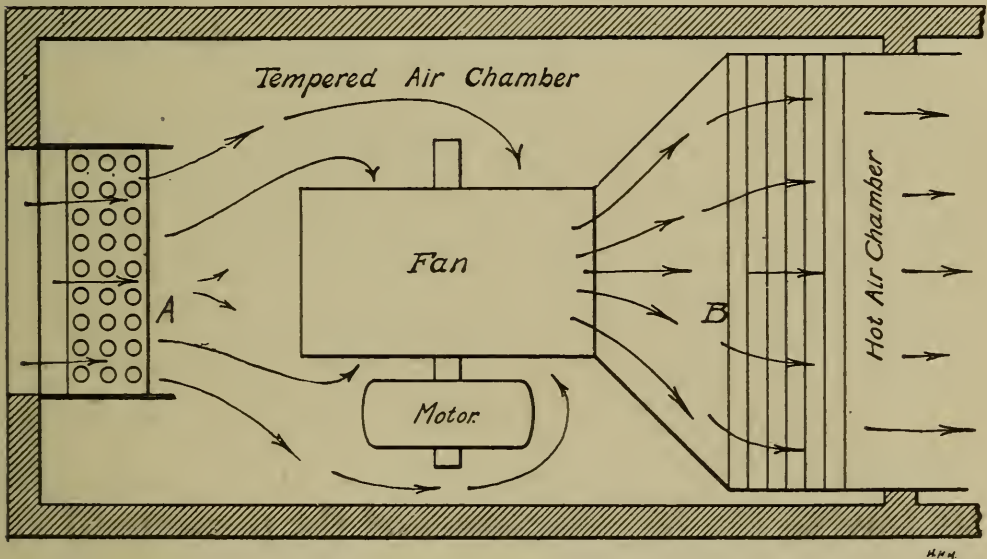


Figure 57.

fices and living rooms more air will have to be supplied in order to heat the room than would be necessary for purposes of ventilation. Roughly speaking, if the number of cubic feet of air supplied to the room per hour is four times the cubic contents of the room the room will be heated, providing the air be supplied at not less than 140°. In a system where direct radiation is used to supply losses from

walls and windows only enough air is introduced to supply the necessary ventilation. The amount of air necessary can be determined by rules previously given under the head of Ventilation.

In most cases the type of fan known as the steel plate blower is best adapted to the work of fan heating. The theory of this

Size, Speed and Horse-power of Fan. fan has been discussed by Weisbach and Lindner in

their treatises, also by various writers in the Transaction of the Society of Heating and Ventilating Engineers. The results derived are difficult of application. The following general statement may be made, however. The discharge capacity of a fan depends upon the speed of the fan tips, the size of the fan blades, and the size of the discharge openings. As the discharge opening of the fan is decreased the velocity of the air leaving the fan increases and the pressure of air in the fan case increases until we get to the maximum pressure that can be produced by a certain velocity of fan tips. This will occur when the area of the outlet equals the effective area of the fan blades. This is the point at which the fan delivers the maximum amount of air corresponding to the pressure for a given speed. If we further reduce the discharge outlet the pressure in the fan case remains constant, the quantity of air discharged is reduced and the power to drive the fan is reduced.

The theoretical relations connecting the pressure of the air, the quantity of the air delivered, power

Table XXXIII—Fan Capacities.

Speeds, Capacities and Horse Powers of "A B C" Steel Plate Fans of Varying Revolutions.

| R.P.M. | FAN | 50 | 60 | 70 | 80 | 90 | 100 | 110 | 120 | 140 | 160 | 180 | 200 | 220 | 240 |
|--------|---------|------|------|------|-------|-------|-------|-------|-------|-------|-------|-------|--------|--------|--------|
| 100 | Per V. | 785 | 942 | 1100 | 1257 | 1414 | 1571 | 1728 | 1885 | 2200 | 2513 | 2837 | 3141 | 3455 | 3769 |
| | Air V. | 885 | 820 | 957 | 1092 | 1230 | 1367 | 1503 | 1640 | 1915 | 2132 | 2459 | 2732 | 3005 | 3279 |
| | Pres. | .017 | .025 | .034 | .044 | .055 | .068 | .082 | .100 | .134 | .175 | .231 | .273 | .335 | .401 |
| | Cu. Ft. | 632 | 1121 | 1870 | 2652 | 3840 | 5475 | 6395 | 9565 | 14916 | 21750 | 30221 | 41608 | 55201 | 71941 |
| | H. P. | .150 | .222 | .370 | .476 | .672 | 1.01 | 1.37 | 2.03 | 3.46 | 5.47 | 7.7 | 12.0 | 17.1 | 25.1 |
| 125 | Per V. | 981 | 1178 | 1375 | 1571 | 1768 | 1964 | 2160 | 2356 | 2750 | 3141 | 3533 | 3926 | 4318 | 4711 |
| | Air V. | 853 | 1025 | 1196 | 1366 | 1538 | 1707 | 1879 | 2029 | 2390 | 2724 | 3073 | 3415 | 3756 | 4098 |
| | Pres. | .027 | .039 | .053 | .069 | .089 | .108 | .132 | .153 | .212 | .276 | .350 | .435 | .525 | .626 |
| | Cu. Ft. | 852 | 1402 | 2338 | 3158 | 4309 | 6844 | 7992 | 11945 | 18645 | 27170 | 37767 | 52010 | 68997 | 99910 |
| | H. P. | .175 | .284 | .439 | .588 | .934 | 1.34 | 2.06 | 2.90 | 5.00 | 8.15 | 12.5 | 19.3 | 29.2 | 43.5 |
| 150 | Per V. | 1177 | 1413 | 1650 | 1886 | 2121 | 2356 | 2592 | 2827 | 3200 | 3770 | 4240 | 4711 | 5182 | 5653 |
| | Air V. | 1025 | 1230 | 1432 | 1640 | 1845 | 2044 | 2255 | 2460 | 2870 | 3280 | 3688 | 4098 | 4500 | 4923 |
| | Pres. | .039 | .056 | .075 | .100 | .120 | .160 | .190 | .230 | .300 | .400 | .503 | .626 | .758 | .904 |
| | Cu. Ft. | 1023 | 1631 | 2305 | 3979 | 5760 | 8110 | 9580 | 14360 | 22374 | 32610 | 45325 | 62412 | 82811 | 108120 |
| | H. P. | .200 | .325 | .531 | .756 | 1.27 | 1.86 | 2.74 | 3.90 | 7.22 | 11.3 | 19.6 | 32.1 | 46.2 | 63.6 |
| 175 | Per V. | 1374 | 1649 | 1925 | 2200 | 2474 | 2749 | 3024 | 3297 | 3850 | 4380 | 4947 | 5466 | 6046 | 6596 |
| | Air V. | 1195 | 1434 | 1674 | 1914 | 2152 | 2390 | 2630 | 2868 | 3350 | 3826 | 4303 | 4781 | 5260 | 5747 |
| | Pres. | .053 | .076 | .104 | .134 | .172 | .212 | .258 | .306 | .420 | .554 | .687 | .848 | 1.02 | 1.21 |
| | Cu. Ft. | 1194 | 1962 | 3274 | 4622 | 6729 | 9594 | 11200 | 16715 | 26100 | 38043 | 52883 | 72814 | 96626 | 126089 |
| | H. P. | .225 | .393 | .647 | 1.01 | 1.74 | 2.46 | 3.55 | 5.52 | 9.91 | 17.3 | 27.9 | 44.2 | 67.1 | 103.0 |
| 200 | Per V. | 1570 | 1884 | 2200 | 2511 | 2828 | 3142 | 3456 | 3770 | 4400 | 5026 | 5654 | 6282 | 6910 | 7538 |
| | Air V. | 1366 | 1640 | 1915 | 2187 | 2460 | 2737 | 3007 | 3280 | 3820 | 4375 | 4918 | 5465 | 6011 | 6558 |
| | Pres. | .069 | .101 | .134 | .175 | .225 | .274 | .333 | .392 | .537 | .700 | .903 | 1.12 | 1.34 | 1.59 |
| | Cu. Ft. | 1364 | 2242 | 3740 | 5304 | 7690 | 10960 | 12820 | 19150 | 29850 | 43520 | 60442 | 83231 | 110422 | 143902 |
| | H. P. | .262 | .478 | .855 | 1.26 | 2.05 | 3.16 | 4.69 | 7.01 | 13.3 | 23.7 | 39.2 | 62.1 | 96.8 | 154.5 |
| 225 | Per V. | 1766 | 2120 | 2475 | 2829 | 3182 | 3534 | 3888 | 4241 | 4950 | 5654 | 6360 | 7065 | 7774 | |
| | Air V. | 1536 | 1844 | 2153 | 2459 | 2767 | 3073 | 3383 | 3688 | 4305 | 4919 | 5533 | 6148 | 6762 | |
| | Pres. | .087 | .126 | .172 | .225 | .285 | .351 | .421 | .507 | .690 | .901 | 1.14 | 1.41 | 1.69 | |
| | Cu. Ft. | 1534 | 2523 | 4207 | 5969 | 8655 | 12334 | 14385 | 21500 | 33560 | 48680 | 68000 | 93634 | 124217 | |
| | H. P. | .300 | .581 | 1.03 | 1.57 | 2.61 | 4.09 | 5.95 | 9.29 | 17.0 | 31.1 | 52.8 | 87.9 | 142.5 | |
| 250 | Per V. | 1963 | 2355 | 2750 | 3143 | 3535 | 3927 | 4320 | 4712 | 5500 | 6283 | 7067 | 7852 | | |
| | Air V. | 1708 | 2048 | 2392 | 2734 | 3070 | 3416 | 3758 | 4100 | 4780 | 5450 | 6143 | 6840 | | |
| | Pres. | .109 | .156 | .213 | .280 | .360 | .430 | .520 | .630 | .860 | 1.12 | 1.43 | 1.73 | | |
| | Cu. Ft. | 1706 | 2793 | 4675 | 6392 | 9600 | 13705 | 16000 | 23950 | 37310 | 54200 | 75558 | 104036 | | |
| | H. P. | .375 | .684 | 1.22 | 1.79 | 3.32 | 4.97 | 7.44 | 11.6 | 22.5 | 41.2 | 71.7 | 121.4 | | |
| 275 | Per V. | 2159 | 2591 | 3025 | 3457 | 3889 | 4319 | 4731 | 5183 | 6050 | 6911 | 7774 | | | |
| | Air V. | 1878 | 2258 | 2632 | 3008 | 3383 | 3755 | 4090 | 4507 | 5263 | 6013 | 6763 | | | |
| | Pres. | .131 | .189 | .258 | .337 | .426 | .526 | .623 | .756 | 1.04 | 1.35 | 1.71 | | | |
| | Cu. Ft. | 1878 | 3033 | 5142 | 7294 | 10578 | 15773 | 17394 | 26278 | 41020 | 58328 | 83104 | | | |
| | H. P. | .436 | .821 | 1.45 | 2.35 | 3.92 | 6.03 | 9.09 | 14.5 | 29.4 | 54.7 | 89.3 | | | |
| 300 | Per V. | 2355 | 2826 | 3300 | 3771 | 4242 | 4712 | 5184 | 5654 | 6600 | 7539 | | | | |
| | Air V. | 2050 | 2458 | 2875 | 3280 | 3685 | 4100 | 4510 | 4920 | 5745 | 6555 | | | | |
| | Pres. | .160 | .225 | .302 | .401 | .520 | .680 | .760 | .910 | 1.26 | 1.62 | | | | |
| | Cu. Ft. | 2016 | 3363 | 5610 | 7957 | 11520 | 16250 | 19200 | 28800 | 44750 | 63629 | | | | |
| | H. P. | .500 | .975 | 1.73 | 2.86 | 4.63 | 7.44 | 11.4 | 18.1 | 37.5 | 69.3 | | | | |
| 350 | Per V. | 2747 | 3297 | 3850 | 4399 | 4949 | 5447 | 6018 | 6597 | 7700 | | | | | |
| | Air V. | 2390 | 2863 | 3345 | 3827 | 4295 | 4770 | 5262 | 5724 | 6680 | | | | | |
| | Pres. | .216 | .306 | .418 | .550 | .693 | .850 | .970 | 1.25 | 1.68 | | | | | |
| | Cu. Ft. | 2387 | 3923 | 6545 | 9282 | 13410 | 19110 | 22395 | 33400 | 52206 | | | | | |
| | H. P. | .663 | 1.28 | 2.38 | 3.89 | 6.65 | 10.7 | 17.2 | 28.3 | 55.8 | | | | | |
| 400 | Per V. | 3140 | 3768 | 4400 | 5028 | 5656 | 6282 | 6912 | 7540 | | | | | | |
| | Air V. | 2732 | 3278 | 3830 | 4374 | 4926 | 5470 | 6013 | 6560 | | | | | | |
| | Pres. | .277 | .399 | .546 | .713 | .904 | 1.14 | 1.42 | 1.63 | | | | | | |
| | Cu. Ft. | 2729 | 4334 | 7480 | 10620 | 15400 | 21950 | 25574 | 38300 | | | | | | |
| | H. P. | .750 | 1.70 | 3.19 | 5.04 | 9.34 | 15.3 | 25.2 | 39.2 | | | | | | |

NOTE

These figures guaranteed to be correct with the resistance ordinarily found in heating work.

to drive the fan and the speed can be stated briefly as follows: The quantity of air delivered is proportional to the peripheral velocity of the fan tips and to the area of the fan tips. The pressure pro-

Table XXXIV—Fan Efficiency Under Varying Pressures.
Speeds, Capacities and Horse Powers of "A B C" Steel Plate Fans of Varying Pressures.

| PRESSURES. | | ¼ oz. | ½ oz. | ¾ oz. | 1 oz. | 1¼ oz. | 1½ oz. | 1¾ oz. | 2 oz. | 2½ oz. | 3 oz. |
|------------|----------|-------|-------|-------|--------|--------|--------|--------|--------|--------|--------|
| 50 | CU. FT. | 2740 | 3900 | 4760 | 5490 | 6090 | 6700 | 7350 | 7750 | 8650 | 9520 |
| | R. P. M. | 380 | 540 | 659 | 760 | 847 | 930 | 1004 | 1075 | 1200 | 1320 |
| | H. P. | .80 | 1.60 | 2.66 | 3.85 | 5.32 | 6.65 | 8.22 | 10.25 | 14.38 | 18.85 |
| 60 | CU. FT. | 3550 | 5040 | 5490 | 7100 | 7910 | 8700 | 9410 | 10200 | 11210 | 12390 |
| | R. P. M. | 317 | 449 | 549 | 633 | 706 | 776 | 898 | 895 | 1000 | 1100 |
| | H. P. | 1.03 | 2.05 | 3.42 | 4.95 | 6.84 | 8.54 | 10.60 | 13.2 | 18.45 | 24.3 |
| 70 | CU. FT. | 5220 | 7350 | 9050 | 10400 | 11600 | 12700 | 13750 | 14750 | 16500 | 18000 |
| | R. P. M. | 271 | 383 | 471 | 542 | 605 | 663 | 716 | 768 | 857 | 938 |
| | H. P. | 1.51 | 3.02 | 5.04 | 7.30 | 10.10 | 12.60 | 15.60 | 19.40 | 27.20 | 35.7 |
| 80 | CU. FT. | 630 | 8900 | 10940 | 12550 | 14000 | 15350 | 16600 | 17800 | 19890 | 21920 |
| | R. P. M. | 238 | 336 | 412 | 474 | 530 | 580 | 627 | 672 | 750 | 825 |
| | H. P. | 1.82 | 3.65 | 6.08 | 8.82 | 12.15 | 15.20 | 18.85 | 23.40 | 32.80 | 43.2 |
| 90 | CU. FT. | 7850 | 11050 | 13600 | 15600 | 17450 | 19100 | 20650 | 22100 | 24750 | 27300 |
| | R. P. M. | 211 | 299 | 366 | 421 | 470 | 515 | 557 | 566 | 666 | 734 |
| | H. P. | 2.27 | 4.53 | 7.56 | 11.00 | 15.10 | 18.90 | 23.40 | 29.10 | 40.70 | 53.5 |
| 100 | CU. FT. | 9540 | 13500 | 16500 | 19050 | 21300 | 23200 | 25200 | 27000 | 30500 | 33000 |
| | R. P. M. | 190 | 268 | 329 | 380 | 424 | 464 | 502 | 537 | 600 | 659 |
| | H. P. | 2.76 | 5.52 | 9.20 | 13.35 | 18.42 | 23.00 | 28.60 | 35.10 | 49.60 | 65.2 |
| 110 | CU. FT. | 11870 | 16700 | 20600 | 23600 | 26400 | 28900 | 31300 | 33500 | 37500 | 41200 |
| | R. P. M. | 173 | 244 | 300 | 345 | 385 | 422 | 456 | 488 | 546 | 600 |
| | H. P. | 3.43 | 6.85 | 11.44 | 16.60 | 22.50 | 28.60 | 35.50 | 44.00 | 61.7 | 81.2 |
| 120 | CU. FT. | 15000 | 21000 | 25840 | 29700 | 33200 | 36400 | 39400 | 42200 | 47100 | 51500 |
| | R. P. M. | 159 | 224 | 274 | 316 | 354 | 387 | 418 | 448 | 500 | 550 |
| | H. P. | 4.32 | 8.65 | 14.40 | 20.50 | 28.80 | 36.00 | 44.60 | 55.45 | 77.7 | 102.1 |
| 140 | CU. FT. | 19800 | 27900 | 34200 | 39400 | 44000 | 48200 | 51200 | 55800 | 63900 | 68400 |
| | R. P. M. | 136 | 192 | 235 | 271 | 302 | 331 | 357 | 383 | 439 | 470 |
| | H. P. | 5.72 | 11.42 | 19.00 | 27.60 | 38.10 | 47.60 | 59.00 | 73.90 | 102.7 | 135.5 |
| 160 | CU. FT. | 25050 | 35600 | 43700 | 50250 | 56150 | 61500 | 66500 | 71250 | 79200 | 87500 |
| | R. P. M. | 118 | 168 | 206 | 237 | 265 | 290 | 314 | 336 | 373 | 412 |
| | H. P. | 7.29 | 14.60 | 24.32 | 35.20 | 48.60 | 60.75 | 75.30 | 93.50 | 134.0 | 172.0 |
| 180 | CU. FT. | 31410 | 44200 | 54300 | 62700 | 69700 | 76700 | 82700 | 88400 | 99000 | 108400 |
| | R. P. M. | 106 | 149 | 183 | 211 | 235 | 259 | 279 | 298 | 334 | 368 |
| | H. P. | 9.07 | 18.13 | 30.24 | 43.80 | 60.43 | 75.5 | 93.6 | 116.20 | 161.0 | 214.0 |
| 200 | CU. FT. | 38000 | 53700 | 66000 | 75700 | 84950 | 93000 | 100500 | 107200 | 120000 | 134000 |
| | R. P. M. | 95 | 134 | 165 | 189 | 212 | 232 | 251 | 268 | 300 | 330 |
| | H. P. | 11.02 | 22.20 | 36.80 | 53.3 | 73.5 | 92.0 | 114.0 | 141.5 | 198.5 | 261.0 |
| 220 | CU. FT. | 46800 | 66300 | 80900 | 93200 | 104000 | 113500 | 123300 | 131400 | 147100 | 161500 |
| | R. P. M. | 87 | 123 | 150 | 173 | 193 | 211 | 229 | 244 | 274 | 300 |
| | H. P. | 13.48 | 27.00 | 44.90 | 65.10 | 89.6 | 112.0 | 139.0 | 173.0 | 243.0 | 313.0 |
| 240 | CU. FT. | 56400 | 79000 | 96500 | 112000 | 124800 | 136800 | 147400 | 158000 | 176100 | 194000 |
| | R. P. M. | 80 | 112 | 137 | 159 | 177 | 194 | 209 | 224 | 250 | 275 |
| | H. P. | 16.10 | 32.30 | 53.80 | 78.00 | 107.4 | 134.0 | 166.0 | 206.0 | 280.0 | 382.0 |

duced is proportional to the square of the peripheral velocity of the fan tips and the power necessary is proportional to the cube of the peripheral velocity of the fan tips and to the quantity of air delivered. Mr. M. C. Huyett gives the following approximate rule for finding the capacity of a fan: The quantity of air in cubic feet delivered per revolution is equal to one-third the diameter of the fan wheel multiplied by the width of the blades at circumference, multiplied by the circumference of the fan wheel. All dimensions expressed in feet.

Professor R. C. Carpenter gives the following rule for determining the horsepower required by the fan: The horsepower required for the fan is equal to the fifth power of the diameter of the fan wheel in feet multiplied by the number of revolutions per second, divided by 1,000,000 and multiplied by one of the following coefficients—for free delivery, 30; for delivery against 1-ounce pressure, 20; for delivery against 2 ounces pressure, 10. The best method of obtaining the horsepower to drive a fan and the capacity of the fan is by reference to the blower companies' catalogues. Some companies have published catalogues which are obviously wrong. At the present time, however, the American Blower Company, of Detroit, have published in their catalogue tables that are very satisfactory.

Table XXXIII gives the speed, capacity and horsepower required for various sized fans.

Table XXXIV gives similar results for different sized fans at varying pressure.

The table should be made use of in the following manner: Having determined the quantity of air required for the entire building, we select from the table a fan which would give the proper capacity. In doing this three things must be considered. The fan must have sufficient capacity to deliver the amount of air required. It must deliver this air with the minimum horsepower, and it must rotate with sufficient speed to produce a pressure in the fan system sufficient to overcome the resistance of the piping. It is always possible to select either a small fan driven at a high speed or a large fan driven at a low speed, both of which will deliver the same capacity of air. A large fan may be driven at so slow a speed that it will not produce sufficient pressure to overcome resistance of the air flues. Choose the largest fan that, driven at sufficient speed to overcome the resistance of the air flue, will deliver a proper quantity of air for the purpose of ventilation. As an example: Suppose we wish to deliver to a building 10,000 cubic feet of air per minute. Referring to the table, we see that we may use an 80-inch fan driven at 400 revolutions, in which case there would be required 5 horsepower to drive the fan and the pressure produced would be .713 ounce. Or we might use a 120-inch fan driven at 125 revolutions per minute,

in which case the power required to drive the fan would be 2.9 horsepowers and the pressure produced would be .153. In the first case the fan is small and being driven at high speed the pressure produced is far more than necessary to overcome the resistance requiring an excessively large horsepower to drive it. In the case of the 120-inch fan, while the horsepower is much lower the pressure is insufficient to overcome the ordinary resistance. For ordinary purposes the pressure should be about .25. Referring again to the table, we see that the 100-inch fan driven at 200 revolutions per minute would require 3.15 horsepowers and produce a pressure of .274. This would be about the proper size of fan to select. The pressure required to overcome the resistance of the building depends very largely upon the capacity and design of the flues and the resistance of these flues is largely a matter of judgment and experience.

The determination of the proper quantity of heating coil to raise the air to a given temperature will depend primarily **Heating Coils.** upon the amount of heat given off per square foot of heater coil.

Table XXXV is obtained from the results of experiments made by the American Blower Company, of Detroit, and shows the condensation and heat given off by ordinary pipe heater coils under different conditions. Knowing the heat given off

**Table XXXV—Condensation and Heat Given Off by
Heater Coils.**

| Number of pipes coil is deep | | TEMPERATURE AIR ENTERING COIL 0°-10° | | | | | | | | | |
|------------------------------|---|--|--|--|--|--|--|--|--|---|--|
| | | No. sections in coil | | Velocity of Air 1000 feet per minute. | | Velocity of Air 1250 feet per minute. | | Velocity of Air 1500 feet per minute. | | Velocity of Air 1700 feet per minute. | |
| | | Condensation per square foot in pounds | Temperature air leaving coil degrees | Condensation per square foot in pounds | Temperature air leaving coil degrees | Condensation per square foot in pounds | Temperature air leaving coil degrees | Condensation per square foot in pounds | Temperature air leaving coil degrees | | |
| 8 | 2 | 2.9 | 74 | 2.37 | 65 | 2.56 | 60 | 2.72 | 55 | | |
| 12 | 3 | 1.78 | 94 | 2.1 | 82 | 2.32 | 77 | 2.45 | 73 | | |
| 16 | 4 | 1.53 | 114 | 1.86 | 98 | 2.09 | 93 | 2.25 | 88 | | |
| 20 | 5 | 1.31 | 130 | 1.68 | 115 | 1.88 | 108 | 2.05 | 103 | | |
| 24 | 6 | 1.20 | 143 | 1.54 | 128 | 1.77 | 122 | 1.92 | 117 | | |
| 28 | 7 | 1.10 | 152 | 1.45 | 140 | 1.70 | 134 | 1.85 | 129 | | |
| 32 | 8 | 1.05 | | 1.40 | 148 | 1.65 | 140 | 1.77 | 133 | | |

| Number of pipes coil is deep | | TEMPERATURE AIR ENTERING COIL 40°-50° | | | | | | | | | |
|------------------------------|---|--|--|--|--|--|---|--|--|---|--|
| | | No. sections in coil | | Velocity of Air 1000 feet per minute. | | Velocity of Air 1250 feet per minute. | | Velocity of Air 1500 feet per minute. | | Velocity of Air 1700 feet per minute. | |
| | | Condensation per square foot in pounds | Temperature air leaving coil degrees | Condensation per square foot in pounds | Temperature air leaving coil degrees | Condensation per square foot in pounds | Temperature per square foot degrees | Condensation per square foot in pounds | Temperature air leaving coil degrees | | |
| 8 | 2 | 1.75 | 91 | 2.07 | 84 | 2.37 | 80 | 2.52 | 78 | | |
| 12 | 3 | 1.50 | 107 | 1.80 | 100 | 2.06 | 95 | 2.23 | 93 | | |
| 16 | 4 | 1.41 | 119 | 1.65 | 112 | 1.89 | 107 | 2.02 | 105 | | |
| 20 | 5 | 1.37 | 133 | 1.60 | 125 | 1.80 | 121 | 1.90 | 119 | | |
| 24 | 6 | 1.32 | 143 | 1.50 | 137 | 1.67 | 135 | 1.77 | 133 | | |
| 28 | 7 | 1.26 | 150 | 1.40 | 145 | 1.56 | 142 | 1.64 | 140 | | |
| 32 | 8 | 1.14 | 158 | 1.30 | 152 | 1.48 | 148 | 1.52 | 147 | | |

by the coil per square foot, under given conditions, the number of square feet of coil surface necessary may be obtained in the following manner: Multiply the air to be passed per hour by the difference between the temperature of the outside air and the temperature of the air after passing through the coil. Multiply this product by .2375. Divide the result obtained by 13.3, multiplied by the condensation per square foot of surface per hour, multiplied by 966. Let C = condensation per square foot of coil; V = volume of air in cubic feet passing per hour; F = square feet heating surface coil should contain; t = temperature outside air; t' = temperature of air after passing coil; then

$$F = \frac{.2375 V(t' - t)}{13.3 \times 966 C}$$

In most cases the condensation in the tempering coils can be assumed at about 2 pounds per hour and in the heating coils about $1\frac{1}{2}$ pounds. In extreme cases condensation as high as 5 pounds per square foot per hour have been reported.

After determining the number of square feet of surface in the heater the heater must be so designed as to allow sufficient air area for the passage of air through the heater coils. The coils as ordinarily arranged are shown in Fig. 58. Sufficient area should be allowed in these coils for the velocity of air passing. This should not exceed 1,200 feet per minute, except where coils are very large.

Tempering coils should not be less than 12 pipes deep. If the heater coils are made very shallow the condensation in the coil is so rapid that in cold weather they will hammer.

The heater coil consists of a cast iron base into which is screwed 1-inch steam pipes jointed at the top by nipples and elbows. The cast iron base for

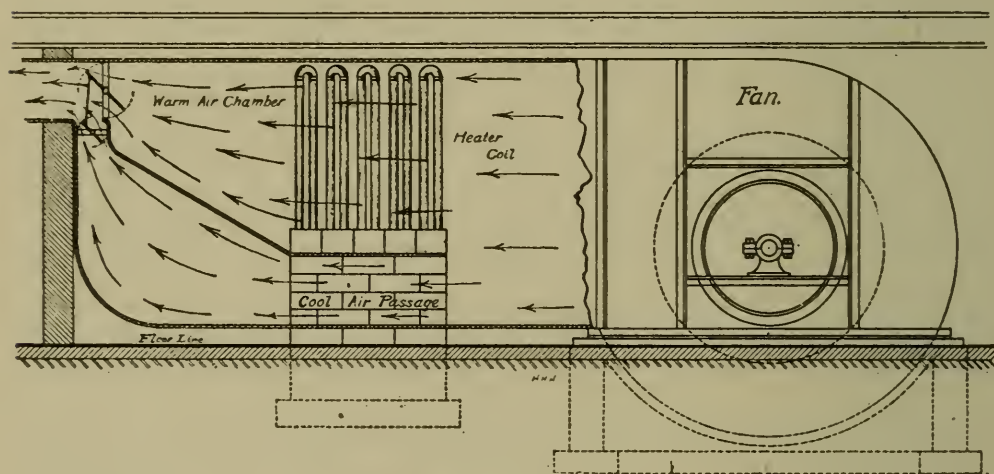


Figure 58.

each section is provided with a steam inlet and drip, both connected to the cast iron heater base. Most bases are constructed for four rows of pipes. Table XXXVI gives the principal dimensions of the American Blower Company's heaters with the size of fan regularly used.

Cast Iron Heaters. Within the last few years cast iron indirect radiators suitable for use with fans have been placed on the market. Figure 59 shows a group of ten of these sections. They are easier

to handle in erection and less liable to rust. The standard sizes on the market are 41 and 60 $\frac{5}{8}$ inches in length; both sizes are 9 $\frac{1}{4}$ inches deep and each section takes up a width of 5 inches. The 60-inch section contains 17 square feet per section and the 40-inch section 11 $\frac{1}{2}$ square feet. The sections are tapped 2 $\frac{1}{2}$ inches and may be

Table XXXVI—Heater Dimensions.

| Lineal feet Capacity of 1-inch pipe. | Connections. | | | Net air space in sq. ft. | Reg- ular Disc. | Size of fan. Steel plate. |
|---|-------------------|-------------------|-------------------|--------------------------------|-----------------------|------------------------------------|
| | Steam. | Drip. | Bleeder. | | | |
| 200 | 2" | 1" | $\frac{3}{4}$ " | 5.4 | 30 | 80 |
| 300 | 2" | 1" | $\frac{3}{4}$ " | 7.6 | 36 | 90 |
| 400 | 2" | 1 $\frac{1}{4}$ " | $\frac{3}{4}$ " | 10.7 | 42 | 100 |
| 525 | 2" | 1 $\frac{1}{4}$ " | 1" | 14.3 | 48 | 110 |
| 650 | 2" | 1 $\frac{1}{2}$ " | 1" | 17.7 | 54 | 120 |
| 825 | 2 $\frac{1}{2}$ " | 1 $\frac{1}{2}$ " | 1" | 22.2 | 60 | 140 |
| 1,175 | 2 $\frac{1}{2}$ " | 1 $\frac{1}{2}$ " | 1" | 31. | 72 | 160 |
| 1,525 | 3" | 2" | 1 $\frac{1}{4}$ " | 40. | 84 | 180 |
| 2,025 | 3" | 2" | 1 $\frac{1}{4}$ " | 52.5 | 96 | 200 |

bushed to the proper size, depending on the number of sections composing the radiator. Fig. 60 shows a curve of the steam condensation for these radiators with varying depth of coil and different velocities of air. Figure 61 shows the temperature to which the air would be heated in passing through these coils with varying depth of coil and different velocities of air. The last two cuts are from the results given by the American Radiator Co.

The success of the fan system depends very largely upon the design of the flues. The best form of flue is round, the next best form is square, or, if rectangular, as nearly square as possible. All turns and branches should

Ventilating Ducts.

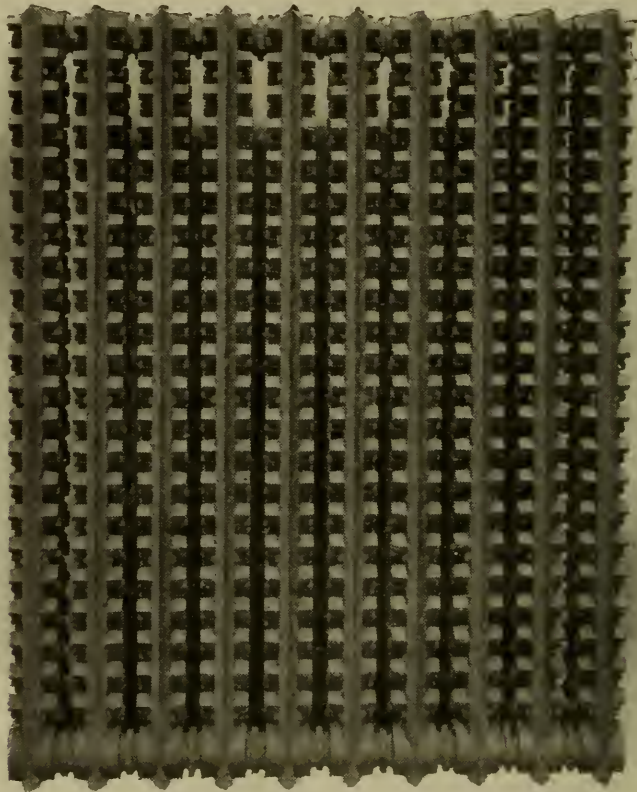


Figure 59.

be made with easy curves. The size of the flues is ordinarily determined by the velocity of the air passing in the flues. In main ducts of large size a velocity as high as 2,000 feet per minute or over may be used. In the branch ducts the velocity should not exceed 1,000 to 1,500 feet. In flues

Condensation Chart

Incoming air, ° Fahrenheit. Steam pressure, 5 pounds

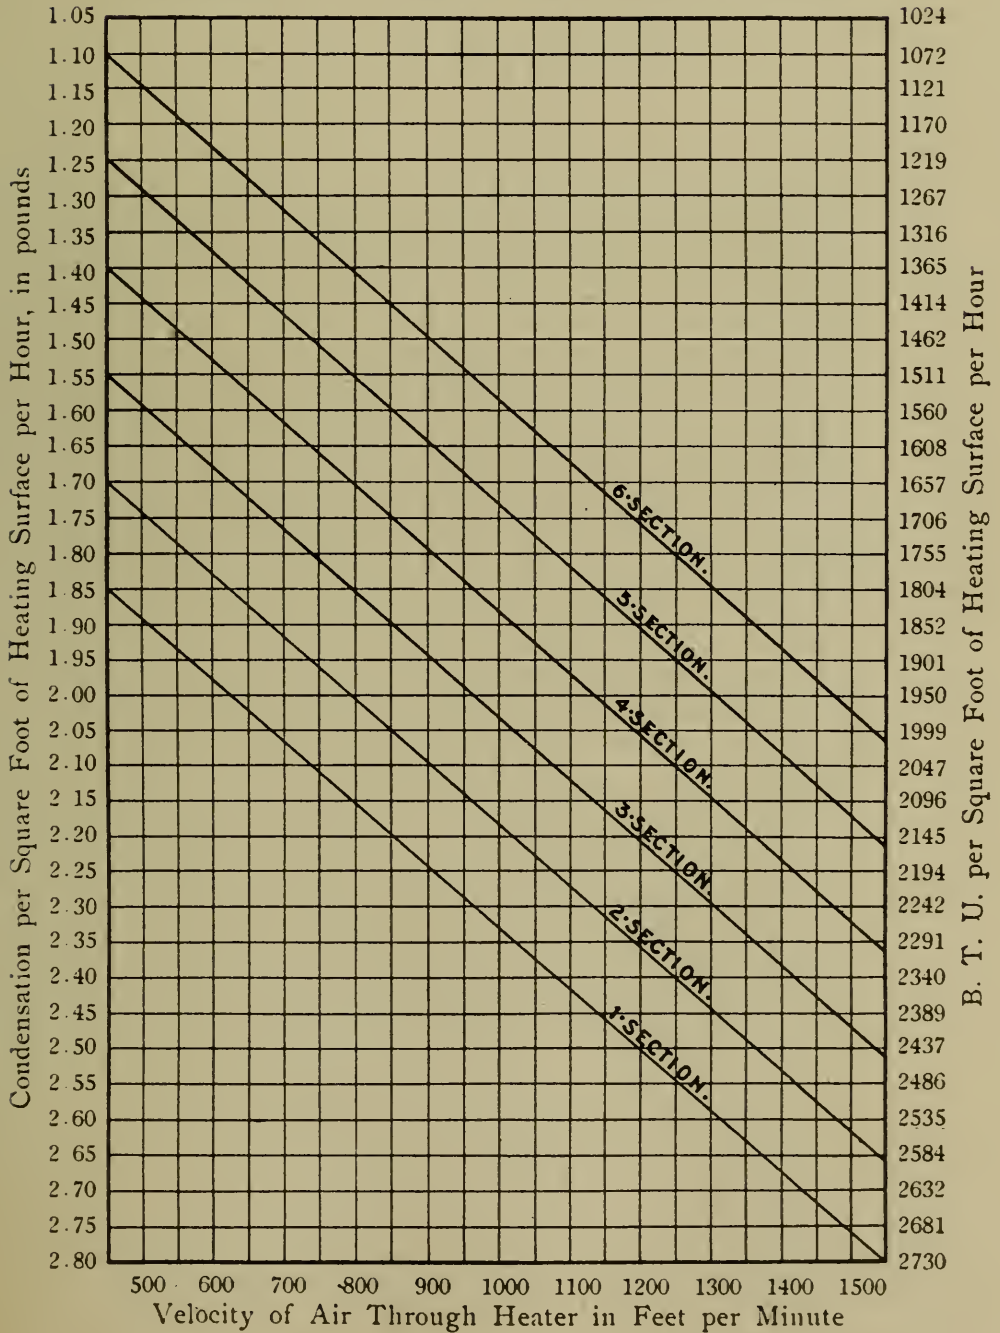


Figure 60.

leading to the individual rooms the velocity should be from 600 to 1,000 feet per minute, depending upon their size. Where the ducts are of small size

Temperature Chart

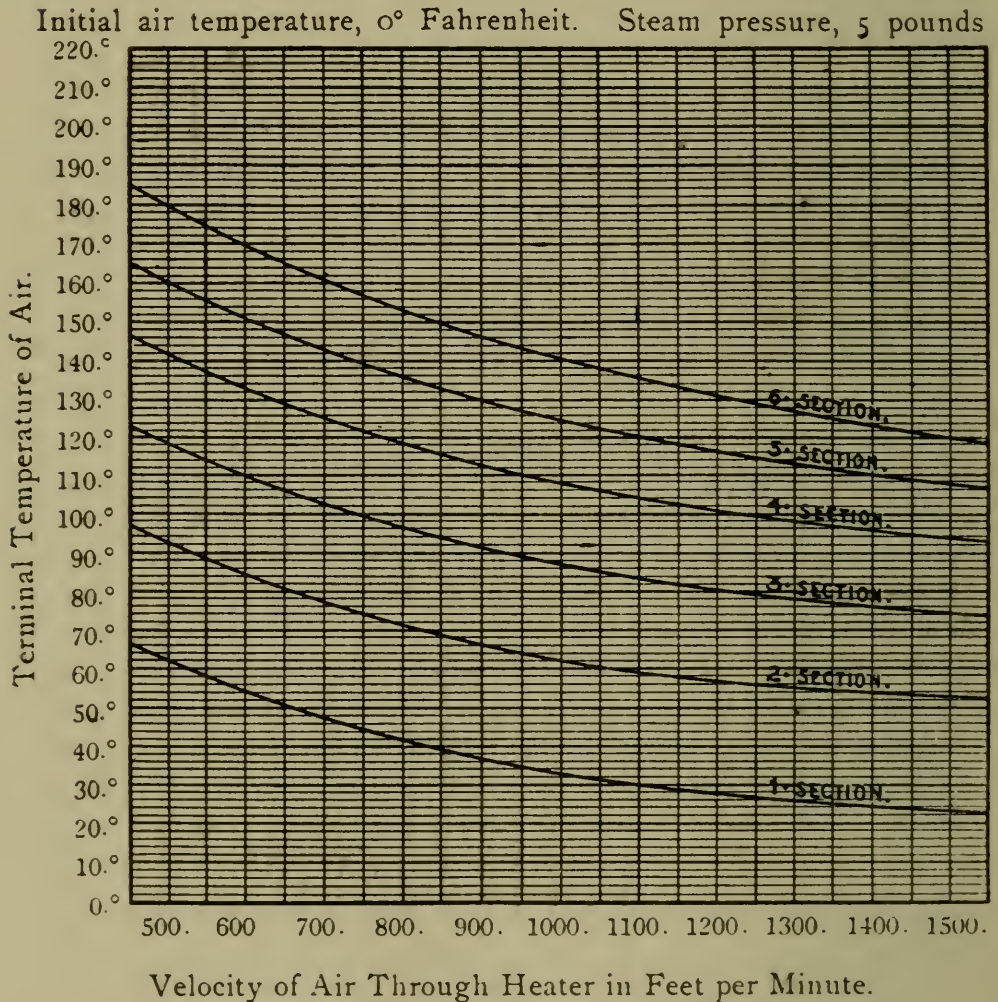


Figure 61.

this velocity is often reduced to 400 feet per minute. The velocity at the registers should not exceed 300 feet per minute except in very large registers

so located that the current of air entering the room will not strike the occupants of the room. In all ordinary buildings, if these proportions of air velocities are used the resistance of the system will be from two to three-tenths of an ounce pressure. In designing the ducts for a fan system short bends and tee branches should be avoided. The bends should be long and the branches made with Y's. The inside radius of the bend should be equal to the diameter of the pipe as a minimum and where conditions will permit, twice the diameter of the pipe. Where branches leave the main ducts it is a common practice to place a deflecting damper at the bend of the branch. This is merely a piece of galvanized iron attached to the point of the branch which may be adjusted and fastened so that each branch will take its proper supply of air. Dampers controlled by the attendants in the building should be as few as possible. The reductions in the size of a flue should be made gradually. The angle of the reduction should not exceed 30° . No round pipes less than 6 inches in diameter are used, and if rectangular, less than 6x8. A common arrangement of ducts is to let them radiate from the fan in the form of a tree, with trunk and branches. This, however, makes the duct system very expensive and a system having large feeding mains similar to a system of steam piping is the one more used as it can be designed to give satisfactory results. An-

other very satisfactory method of distribution is to force all the air from the fan into a large duct or chamber in which the air has a very low velocity.

Table XXXVII—Pressure Losses.

Air.—Loss of Pressure in Ounces per Square Inch per 100 Feet of Pipe of Varying Velocities and Varying Diameters of Pipes.

| Velocity of Air Feet per Minute. | DIAMETER OF PIPE IN INCHES. | | | | | | | |
|--|-----------------------------|--------|--------|--------|-------|-------|-------|-------|
| | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 |
| | LOSS OF PRESSURE IN OUNCES. | | | | | | | |
| 600 | .400 | .200 | .133 | .100 | .080 | .067 | .057 | .050 |
| 1,200 | 1.600 | .800 | .533 | .400 | .320 | .267 | .229 | .200 |
| 1,800 | 3.600 | 1.800 | 1.200 | .900 | .720 | .600 | .514 | .450 |
| 2,400 | 6.400 | 3.200 | 2.133 | 1.600 | 1.280 | 1.067 | .914 | .800 |
| 3,000 | 10.000 | 5.000 | 3.333 | 2.500 | 2.000 | 1.667 | 1.429 | 1.250 |
| 3,600 | 14.400 | 7.200 | 4.800 | 3.600 | 2.880 | 2.400 | 2.057 | 1.800 |
| 4,200 | | 9.800 | 6.533 | 4.900 | 3.920 | 3.267 | 2.800 | 2.450 |
| 4,800 | | 12.800 | 8.533 | 6.400 | 5.120 | 4.267 | 3.657 | 3.200 |
| 6,000 | | 20.000 | 13.333 | 10.000 | 8.000 | 6.667 | 5.714 | 5.000 |

| Velocity of Air Feet per Minute. | DIAMETER OF PIPE IN INCHES | | | | | | | |
|--|-----------------------------|-------|-------|-------|-------|-------|-------|-------|
| | 9 | 10 | 11 | 12 | 14 | 16 | 18 | 20 |
| | LOSS OF PRESSURE IN OUNCES. | | | | | | | |
| 600 | .044 | .040 | .036 | .033 | .029 | .026 | .022 | .020 |
| 1,200 | .178 | .160 | .145 | .133 | .114 | .100 | .089 | .080 |
| 1,800 | .400 | .360 | .327 | .300 | .257 | .225 | .200 | .180 |
| 2,400 | .711 | .640 | .582 | .533 | .457 | .400 | .356 | .320 |
| 3,000 | 1.111 | 1.000 | .909 | .833 | | | | |
| 3,600 | 1.600 | 1.440 | 1.309 | 1.200 | 1.029 | .900 | .800 | .720 |
| 4,200 | 2.178 | 1.960 | 1.782 | 1.633 | 1.400 | 1.225 | 1.089 | .980 |
| 4,800 | 2.844 | 2.560 | 2.327 | 2.133 | 1.829 | 1.600 | 1.422 | 1.280 |
| 6,000 | 4.444 | 4.000 | 3.636 | 3.333 | 2.857 | 2.500 | 2.222 | 2.000 |

| Velocity of Air Feet per Minute. | DIAMETER OF PIPE IN INCHES. | | | | | | | |
|--|-----------------------------|-------|-------|-------|-------|-------|------|------|
| | 22 | 24 | 28 | 32 | 36 | 40 | 44 | 48 |
| | LOSS OF PRESSURE IN OUNCES. | | | | | | | |
| 600 | .018 | .017 | .014 | .012 | .011 | .010 | .009 | .008 |
| 1,200 | .073 | .067 | .057 | .050 | .044 | .040 | .036 | .033 |
| 1,800 | .164 | .156 | .129 | .112 | .100 | .090 | .082 | .075 |
| 2,400 | .291 | .267 | .239 | .200 | .178 | .160 | .145 | .133 |
| 3,600 | .655 | .600 | .514 | .450 | .400 | .360 | .327 | .300 |
| 4,200 | .891 | .817 | .700 | .612 | .544 | .490 | .445 | .408 |
| 4,800 | 1.164 | 1.067 | .914 | .800 | .711 | .640 | .582 | .533 |
| 6,000 | 1.818 | 1.667 | 1.429 | 1.250 | 1.111 | 1.000 | .909 | .833 |

The rooms take their air from this chamber by means of vertical flues controlled by proper dampers. These large chambers are called Plenum chambers. A good example of this is shown in the construction of the new Engineering building, University of Michigan. In this building the corridor on the ground floor has a false ceiling about 3 feet below the second story floor. This leaves a space 3 feet high by 12 feet wide extending through the entire building. Into this space two separate fans

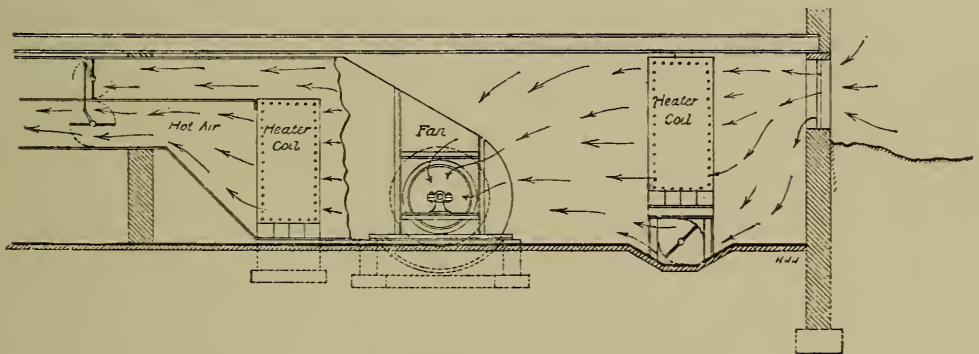


Figure 62.

deliver their air. The space acts as a Plenum chamber and the individual flues leaving the rooms take their air from this Plenum chamber through volume dampers which may be set and fastened after the proper position has once been determined.

Table XXXVII shows the loss of pressure per 100 feet of pipe for varying velocities and varying diameters of pipes. This table is quite liberal and allows for two ordinary 90° bends per 100 feet.

Where the building is heated entirely by a fan

system it is necessary to devise some arrangement by which the room may be

Air Mixing Systems. furnished with hot air or tempered air. In case the room becomes too warm, to close off the hot air register would do away entirely with ventilation and it is necessary to provide some means of introducing tempered air. The method usually used is shown in Fig. 58. Where each room is connected both to the warm air chamber and to the cold air passage, the dampers being connected so that when the warm air is turned off cold air is introduced into the room, or vice versa. In this case the mixing damper is located near the fan and preferably controlled automatically. Another system shown in Fig. 62 has entirely separate cold and hot air flues which are led to the base of vertical flues leading to the rooms, at which point there is introduced a mixing damper similar to the mixing damper shown in Fig. 58.

The flues for fan systems are ordinarily constructed of galvanized iron with double lap joints riveted and soldered. The

Materials of Flues. ducts should be made as nearly as possible air-tight. The weight of material used for ducts depends upon the size of the duct. It ordinarily varies from No. 26 to No. 16 gauge. Large ducts are also made of sheet iron with close riveting. When

ducts are made of sheet iron the ducts are painted and then asphalted. Where it is necessary to build ducts underground they are built of brick or cement. The cement, if anything, is preferable to brick, as it does not absorb odors as easily and may be plastered to make a smooth job. Where possible it is desirable to build the ducts and flues into the building itself, making them of permanent material. Brick or cement ducts built into the building and so arranged that they may be examined and cleaned easily are the most satisfactory. Wood is always a bad material to use for ducts and should be avoided. Where it is used the ducts are lined with tin, owing to the fact that wood usually shrinks, leaving open joints.

Vent ducts from closets should be carried out of the buildings separately from the other vent flues. Where these ducts are made of brick they should be lined with galvanized iron to prevent the odors from the closet being absorbed by the brick. It is very desirable that closet vents should be collected at convenient points and then exhausted from the building by means of a fan. This prevents the odors from the toilet rooms being carried back into the building.

Disc fans are used where the resistance to be overcome is very slight or in cases where the ducts

Table XXXVIII—Disc Fan Efficiency.

Disc Ventilating Fan—Capacities, Speeds and Horse Powers. (American Blower Co.)

| AIR VELOCITY IN FT. PER MIN. | | Size Fan | 18 | 21 | 24 | 30 | 36 | 42 | 48 | 54 | 60 | 72 | 84 | 96 | 108 | 120 |
|------------------------------|--------|------------------------------|---------------------|---------------------|---------------------|----------------------|----------------------|----------------------|----------------------|----------------------|----------------------|----------------------|----------------------|-----------------------|-----------------------|-----------------------|
| 600 | Free | Cu. Ft. R. P. M. H. P. | 1060 327 .016 | 1440 280 .022 | 1880 245 .028 | 2940 196 048 | 4230 165 064 | 5772 140 087 | 7536 122 113 | 9540 110 143 | 11770 98 253 | 16960 82 253 | 23090 70 345 | 30156 62 450 | 38160 55 573 | 47160 50 576 |
| | Heater | R. P. M. H. P. | 530 .053 | 453 072 | 396 094 | 317 147 | 267 212 | 227 288 | 197 377 | 178 477 | 158 590 | 132 849 | 113 1.15 | 100 1.51 | 89 1.91 | 81 2.35 |
| 700 | Free | Cu. Ft. R. P. M. H. P. | 1235 370 .025 | 1680 328 .035 | 2200 280 .045 | 3400 230 070 | 4940 164 110 | 6730 145 136 | 8800 127 178 | 11120 112 227 | 13750 96 279 | 19760 82 402 | 26950 72 548 | 35016 62 740 | 44500 58 905 | 55000 58 1.11 |
| | Heater | R. P. M. H. P. | 600 071 | 530 096 | 458 126 | 372 196 | 307 283 | 266 384 | 234 503 | 206 636 | 178 788 | 158 1.13 | 132 1.54 | 116 2.10 | 100 2.52 | 89 3.14 |
| 800 | Free | Cu. Ft. R. P. M. H. P. | 1410 435 .036 | 1920 373 048 | 2510 326 068 | 3820 262 098 | 5650 187 142 | 7700 164 192 | 10300 145 251 | 12710 127 317 | 15710 131 392 | 22600 110 562 | 30400 94 766 | 40150 83 1.00 | 50900 73 1.27 | 62800 66 1.57 |
| | Heater | R. P. M. H. P. | 705 106 | 604 149 | 527 189 | 424 194 | 353 426 | 302 579 | 265 756 | 234 957 | 212 1.18 | 178 1.71 | 152 2.32 | 134 3.20 | 118 3.83 | 107 4.73 |
| 900 | Free | Cu. Ft. R. P. M. H. P. | 1584 490 .048 | 2160 425 065 | 2826 368 085 | 4410 285 132 | 6354 246 190 | 8650 210 258 | 11304 184 338 | 14310 164 428 | 17667 146 530 | 25443 123 762 | 34642 106 1.04 | 45234 93 1.35 | 57250 82 1.72 | 70650 74 2.12 |
| | Heater | R. P. M. H. P. | 792 143 | 770 195 | 595 254 | 461 307 | 398 572 | 340 780 | 298 1.02 | 265 1.29 | 236 1.59 | 199 2.29 | 173 3.12 | 150 4.07 | 132 5.15 | 119 6.36 |
| 1000 | Free | Cu. Ft. R. P. M. H. P. | 1770 545 057 | 2400 470 080 | 3140 406 104 | 4900 328 142 | 7060 275 233 | 9610 234 317 | 12560 205 413 | 15900 181 520 | 19630 166 647 | 28270 136 933 | 38480 120 1.27 | 50265 103 1.66 | 63600 91 2.09 | 78540 82 2.56 |
| | Heater | R. P. M. H. P. | 883 204 | 760 276 | 657 362 | 530 595 | 445 814 | 378 1.11 | 332 1.45 | 293 1.83 | 268 2.26 | 220 3.26 | 194 4.44 | 167 5.77 | 147 7.33 | 132 9.05 |
| 1200 | Free | Cu. Ft. R. P. M. H. P. | 2112 654 101 | 2880 560 138 | 3768 490 180 | 5880 398 280 | 8472 330 405 | 11541 280 550 | 15072 245 716 | 19100 218 910 | 23666 196 1.13 | 33900 164 1.62 | 46176 144 2.20 | 60312 124 2.87 | 76300 110 3.63 | 94240 99 4.48 |
| | Heater | R. P. M. H. P. | 1059 300 | 912 409 | 788 534 | 636 398 | 534 832 | 453 1.20 | 396 2.14 | 351 2.70 | 322 3.32 | 264 4.85 | 234 6.60 | 200 8.20 | 176 10.6 | 160 13.3 |
| 1400 | Free | Cu. Ft. R. P. M. H. P. | 2475 767 133 | 3360 655 180 | 4400 570 235 | 6850 460 368 | 9870 330 530 | 13470 327 721 | 17600 286 942 | 22270 254 1.19 | 27500 230 1.55 | 36600 164 2.12 | 53900 144 2.89 | 70300 124 3.77 | 88950 103 4.77 | 109500 115 5.89 |
| | Heater | R. P. M. H. P. | 1235 487 | 1064 660 | 919 864 | 742 1.35 | 623 2.64 | 528 3.46 | 463 4.38 | 410 5.40 | 376 7.88 | 308 10.6 | 274 13.8 | 234 17.5 | 205 23.5 | 184 21.6 |
| 1600 | Free | Cu. Ft. R. P. M. H. P. | 2830 875 185 | 3850 750 252 | 5000 656 330 | 7810 526 515 | 11300 438 742 | 15400 375 1.01 | 20050 332 1.34 | 25400 298 1.67 | 31400 266 2.06 | 45200 220 2.97 | 61500 168 4.05 | 80000 165 5.28 | 101200 146 6.68 | 125200 131 8.25 |
| | Heater | R. P. M. H. P. | 1412 735 | 1216 1.00 | 1050 1.31 | 848 2.04 | 712 2.94 | 603 4.00 | 537 5.23 | 468 6.62 | 429 8.17 | 352 11.8 | 314 16.0 | 268 20.9 | 234 26.5 | 210 32.7 |
| 1800 | Free | Cu. Ft. R. P. M. H. P. | 3170 980 247 | 4320 840 336 | 5630 732 440 | 8850 590 686 | 12700 490 991 | 17300 420 1.35 | 22600 368 1.76 | 28600 330 2.22 | 35200 294 2.75 | 51000 245 3.97 | 69000 234 5.39 | 90200 185 7.04 | 114000 163 8.90 | 141000 148 11.0 |
| | Heater | R. P. M. H. P. | 1588 1.05 | 1368 1.43 | 1181 1.87 | 954 2.93 | 801 4.23 | 679 5.75 | 595 7.50 | 526 9.50 | 483 11.7 | 396 16.9 | 354 23.0 | 302 30.0 | 263 38.0 | 236 47.0 |
| 2000 | Free | Cu. Ft. R. P. M. H. P. | 3520 1090 336 | 4800 935 456 | 6280 815 597 | 9800 655 931 | 14120 545 1.34 | 19240 470 1.83 | 25120 410 2.39 | 31800 363 3.02 | 39260 327 3.73 | 56510 272 5.38 | 76660 234 7.31 | 100520 206 9.55 | 127200 182 12.1 | 157100 164 14.9 |
| | Heater | R. P. M. H. P. | 1764 1.30 | 1520 1.77 | 1312 2.30 | 1060 3.60 | 890 5.15 | 755 7.05 | 664 9.25 | 585 11.7 | 528 14.5 | 440 20.8 | 380 28.3 | 336 37.0 | 292 46.8 | 262 57.8 |
| 2200 | Free | Cu. Ft. R. P. M. H. P. | 3890 1200 424 | 4300 1050 576 | 6800 900 754 | 10800 720 1.18 | 15520 600 1.70 | 21130 515 2.31 | 27600 450 3.02 | 35000 400 3.82 | 43200 360 4.72 | 62200 300 6.79 | 84700 257 9.25 | 110500 228 12.1 | 139800 202 15.3 | 172500 175 18.8 |
| | Heater | R. P. M. H. P. | 1940 1.70 | 1700 2.30 | 1460 3.00 | 1163 4.70 | 971 6.80 | 830 9.25 | 727 12.1 | 645 15.3 | 582 18.8 | 485 27.0 | 415 37.0 | 368 48.2 | 323 61.0 | 284 82.0 |

are very large, with easy turns and of very short length. They are extensively used for exhausting the air from the vent flues and where the vent flues are short and large they give good satisfaction. The capacity, speed and horsepower of various sizes of disc fans is shown in Table XXXVIII.

Disc Fans.

EXAMPLE.—As an example of the fan system consider an auditorium. The dimensions of the room are 40 feet 9 inches by 79 feet 6 inches by 127 feet 9 inches. The volume of the room is 413,000 cubic feet. It has 203 square feet of glass surface and 5,441 square feet of wall surface. The heat lost from the room, figuring in the same way as we have for previous examples, will be 168,010 B. T. U's. The hall has a seating capacity of 2,500 persons. Allowing 2,000 cubic feet of air per person, the necessary air to be admitted to the room will be 5,000,000 cubic feet of air per hour. This equals 383,000 pounds. In order to heat the room with this quantity of air entering, it will be necessary to heat the air but 1.85 degrees so that the air admitted to the room for ventilating purposes will be far more than that necessary for heating purposes. It is best, then, to figure on admitting air only for purposes of ventilation. To heat this air from zero to 70° would require $383,000 \times .2375 \times 70 = 6,353,000$ B. T. U's. Referring to

Table XXXV, we see that a heater coil 12 pipes deep will heat air having a velocity of 1,250 feet per minute to a temperature of 82° , which is probably about the proper assumption to make in this case. The coil will condense 2.1 pounds of steam per square foot per hour. Each pound gives up about 970 heat units, so that each square foot of heater coil will give off about 2,000 B. T. U's. per hour. Then the number of square feet of heater coil required would be $6,350,000 \div 2,000 = 3,175$ square feet. The heater coils are usually made of 1-inch pipe and each square foot of surface is equivalent to about 3 feet of 1-inch heater pipe, hence there will be required $3,175 \times 3$ or 9,525 feet of 1-inch pipe in the heater coils. The air to be admitted to the hall is 5,000,000 cubic feet per hour or 83,300 cubic feet per minute. The usual velocity allowed for the air passing through the heater coil is 1,200 feet per minute. This will require an air area in the heater coil of $83,300 \div 1,200 = 69.5$ square feet. The area in the various heater coils will be found in the blower company's catalogues and is also given in Table XXXVI. This will determine the size of the heater coil to be used.

On account of the size of the hall and the amount of air introduced, it will be best to have two fans for delivering air into the building. Each fan would then need a capacity of 41,650 cubic feet

per minute. In order to overcome the resistance of the flues the pressure should be from .2 to .3 of an ounce at least. From the table of fan capacities we see that a 180-inch fan running at 150 revolutions would require 19.6 horsepowers and produce a pressure of .503 ounces. This, however, is a higher pressure than would be desired unless the flues were very long and had a number of curves. If the flues are short and straight we could use two 200-inch fans running at 100 revolutions. These fans would deliver 55,000 cubic feet of air each, with a pressure of .273 ounces and require 12.9 horsepower to drive them. By using a larger size of fan 6.7 horsepowers (for each one of the fans) would be saved. Assuming the air to be delivered to the hall by four ducts, these ducts being large, it would be reasonable to allow a velocity of 1,500 feet per minute in the duct. Each duct would have to carry 20,800 cubic feet of air per minute; $20,800 \div 1,500 = 13.8$ square feet in area. As the registers of these ducts will be large and situated well above the head line, it would be safe to allow a velocity of 400 feet per minute to the register. The area of each register, assuming that there are four entering the room, would be 26 square feet. The vent flues leaving the room should have an area about equal to the hot air flues.

CHAPTER XII.

A CENTRAL HEATING SYSTEM.

It is not intended in this chapter to discuss the design of heating systems, such as is used in the heating of a city, but systems that are in use for the heating of public institutions, or groups of buildings. The type of system to be used in a given installation depends very largely upon the location and character of the buildings to be heated. No two systems, even though designed by the same engineer, will be the same, and the suggestions made in this chapter can be but general.

Before starting the design of a central heating system it is first necessary to have a careful survey of the property. This survey should show the exact location of the buildings to be heated, the elevation of the basement and first floor, together with a general profile of the ground through which the tunnels or pipes are to be run. The profile of the ground will largely decide the proper location of the power house. The power house should be located as nearly as possible to the buildings to be heated or as near as possible to the largest steam load. It

should be low enough, if the profile of the land will permit, so that the condensation of the return mains may be returned to the power house by gravity. If possible, it should be so located that the floor of the boiler room may be drained to the sewer. Considerable difficulty is usually experienced to carry away the water, which results from the cleaning and blowing off of the boilers if no sewer connection can be made. The question of the soil, the location of the railroad siding, the water supply and the general appearance of the power house must also be taken into consideration.

Before designing the power house the type and general form of boilers must be determined. If the power house is to work on a low pressure system with a pressure under 100

pounds, either fire or water
tube boilers may be used.

Boilers.

In general, for this service fire tube boilers are very satisfactory, as they have large water storage, repairs are easily made, and the boiler may be crowded considerably beyond its rating. The economy of water tube and fire tube boilers is practically the same.

The principal objection to fire tube boilers, except of the Scotch marine type, is the large space which it occupies. If the power house is to be operated on high pressure, that is, over 100 or 125 pounds, then only water tube or Scotch marine boil-

ers can be used. The size of the boiler must be determined by the amount of steam which is to be used by the radiation and other devices taking steam from the boilers. The steam used by the different forms of radiation can be determined by reference to the radiator tables previously given. After having once determined the quantity of steam the plant is expected to use, it is customary to assume that each square foot of heating surface in a boiler will evaporate about three pounds of water. This determines the total amount of heating surface that the boilers should contain. The boiler units should be so selected that one boiler or one set of boilers will take care of the plant during the light load period of operation, that two boilers or sets of boilers will take care of the average operating load. In addition to this there should be a boiler or set of boilers that will take care of the maximum conditions of load. There should always be a sufficient number of boilers in the plant so that at least one boiler or set of boilers can be out of service for a considerable period of time for cleaning or repairing. In a central heating plant using the gravity return system, it is necessary that all boilers have their water line at the same level.

Systems of Distribution.

The general design of a piping system and its location will depend upon the system of distribution adopted.

If the gravity return system is used no main feed pump is necessary, the water returning by gravity to the boiler, as previously described. With this sys-

Gravity System.

tem any difference in pressure between that in the boiler and that at the extreme point in the piping system will result in a corresponding elevation of the water level in the return system at the extreme point—each one pound drop of pressure in the steam piping corresponds to an increase in the level of the water in the return piping of 2.30 feet. It is essential, then, that the gravity return system with a difference in pressure between that at the boiler and that at the extreme point of the piping system be comparatively small.

The difference of pressure assumed will determine the size of the piping. In gravity systems it is usual to allow for the drop of pressure not over two pounds between the boiler and the extreme end of the system.

In some cases the gravity return system has been used over quite an extended area, the most distant building heated being as far as 2,500 feet from the boiler, and the system has given very good satisfaction.

In a central heating plant using the gravity return system unless the steam mains are six to eight feet above the return it is necessary that the steam condensed in the mains be dripped separately from

the main returns in the building and this drip pumped back to the boilers, preferably by a pump and receiver, or some other mechanical means, such as a return trap. This pump and receiver should be of sufficient size to take care of the steam condensed in the mains when the steam is being turned on and the condensation is excessive. By returning the condensation of the mains separately, excessive hammering is avoided and the system can be started much more rapidly. Gravity return is used only where the boiler pressure does not exceed ten pounds.

The high pressure heating system is being little used for general heating purposes. It has some advantages. The pipes are smaller and radiation is

more effective per square
foot.

High Pressure System. The disadvantages, however, outweigh the advantages in most cases. In the high pressure system cast iron radiators are not safe, as they are not usually made to operate at a pressure to exceed twenty pounds. The pipe coil or other form of radiation must be used. The cost of producing steam, the chance of accident, and the cost of repairs are increased. It is not possible to use exhaust steam with a high pressure system. When pipe coil radiation is used it would be safe to carry a pressure up to 100 pounds. In determining the

size of steam mains for such a system a loss of pressure as high as ten pounds would not be considered excessive. In the high pressure system each building usually sends its condensation back to the return system through a trap so that the pressure on the return is only slightly above the atmosphere. This condensation returns to a surge tank, from which the feed pumps return it back to the boilers. The drip from the steam mains is dripped directly back into the return system.

In a very large system where it is difficult to get enough difference in elevation between steam and return mains, or where the

drop in pressure exceeds two pounds, it is usual to install some form of pump

**Low Pressure Pump
Return System.**

return. One of the most common forms of pump return is to trap the return condensation of each building into the return main, which carries the return back to a surge tank in the boiler room. From this surge tank the water is returned to the boiler by means of a pump. The drip from the steam main is trapped directly to the return main. The most objectionable feature of this system is the constant attendance and the repairs necessary to take care of the traps.

In most cases the heating system is combined with some form of power system. This makes a

very economical combination, as the exhaust from the power plant may be used in the heating system.

Where the exhaust can be entirely utilized for from six to eight months of the year it is seldom profitable to use condensing engines.

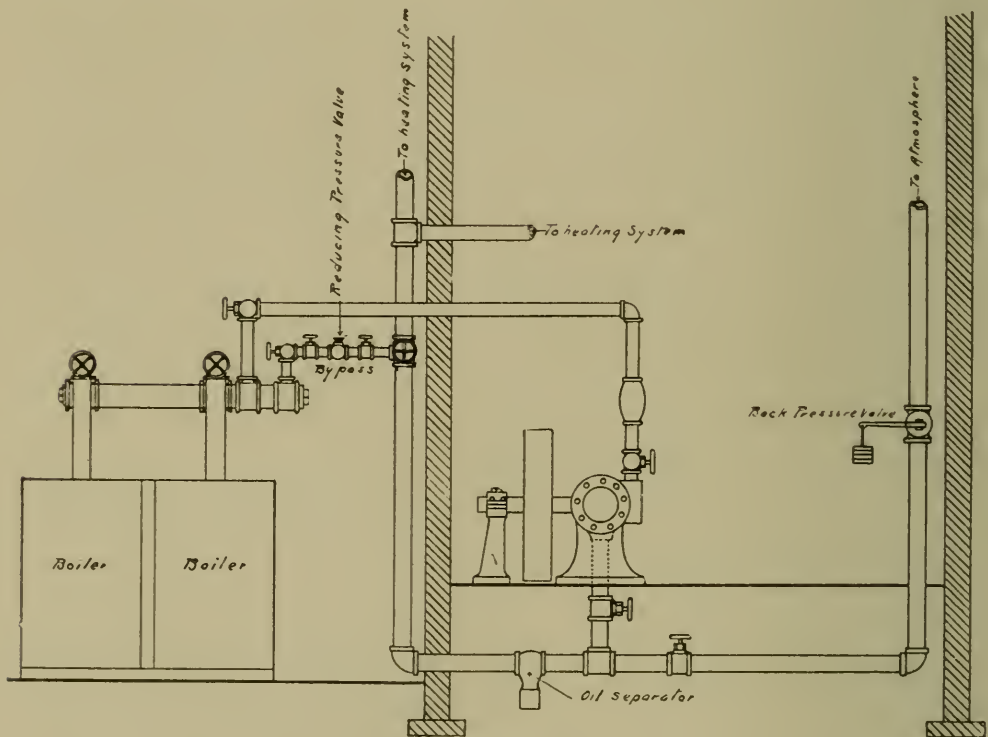


Figure 63.

There are two general schemes used for combining a power and heating system. In the simplest form the boilers are operated at a high pressure. The steam goes from the boilers to the engine, and after the steam leaves the engine it passes directly to the heating system. A by-pass pipe is carried

from the high pressure steam main to the heating main and in this by-pass is located a reducing pressure valve. If for any reason the engine does not supply sufficient steam to maintain pressure on the heating system, then the reducing valve opens and

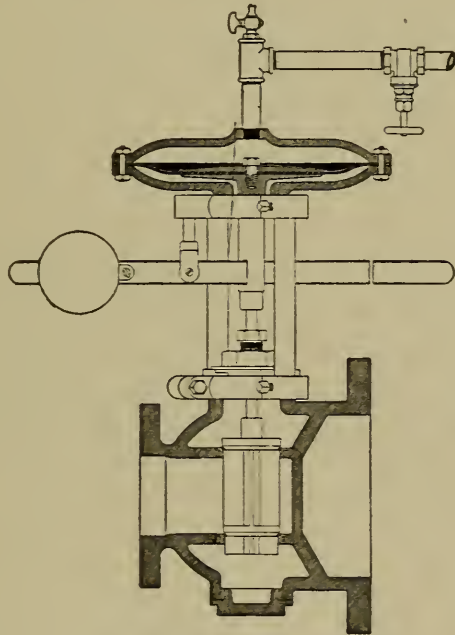


Figure 64.

introduces live steam. The returns from the heating system are carried back to the boiler by means of a pump.

Fig. 63 shows the general arrangement of systems of this kind with a by-pass for furnishing live steam to a heating system. This system depends in a measure for its success upon the action of the reducing pressure valve.

The cross-section of a reducing pressure valve is shown in Fig. 64. Such valves have been found to

be quite reliable when well designed and well made. The principal cause for trouble is when the valve becomes foul with dirt. In a system of this kind the engine exhaust is always provided with a back pressure valve connected to the atmosphere. This valve is so arranged that if for any reason excessive pressure should accumulate in the heating system

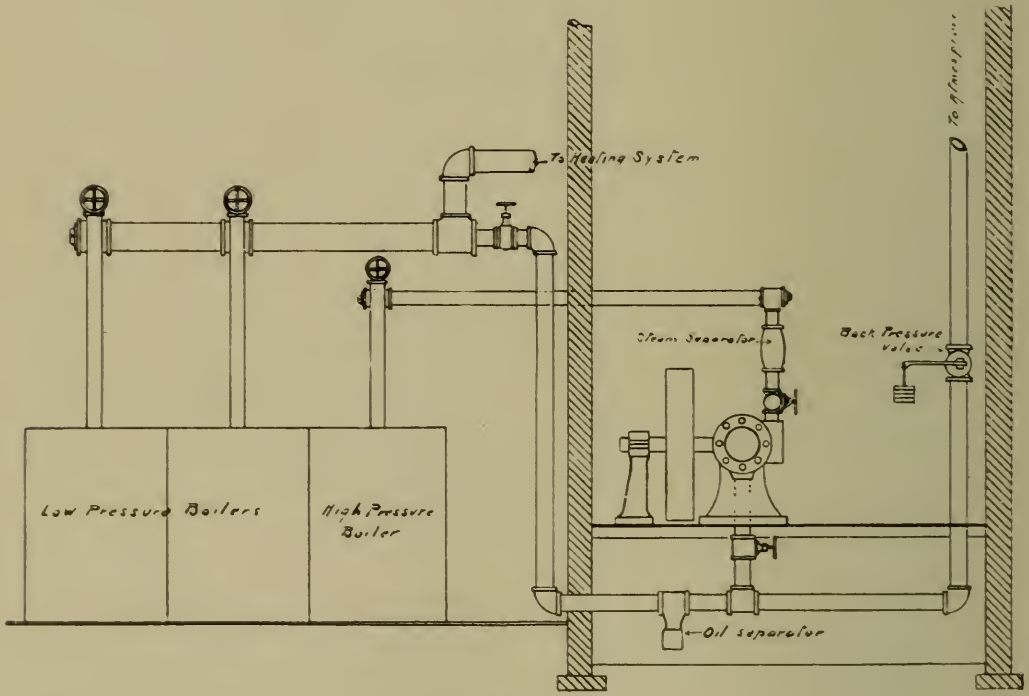


Figure 65.

the valve would open and exhaust the steam into the atmosphere. The arrangement shown in Fig. 63 is most used in small plants and both the heat and the power can be taken from one boiler. In larger plants the heating boilers are operated on the low pressure and the power boilers on the high pressure system. In the high pressure system steam goes

to the engine and pumps and is exhausted through an oil separator into the low pressure system. The pressure of the exhaust is determined by the pressure carried on the low pressure system. This system is particularly desirable where the heating load is considerably larger than the power load; and where at times the engines are entirely shut down and only the low pressure system is operated. Fig. 65 shows a sketch of this arrangement.

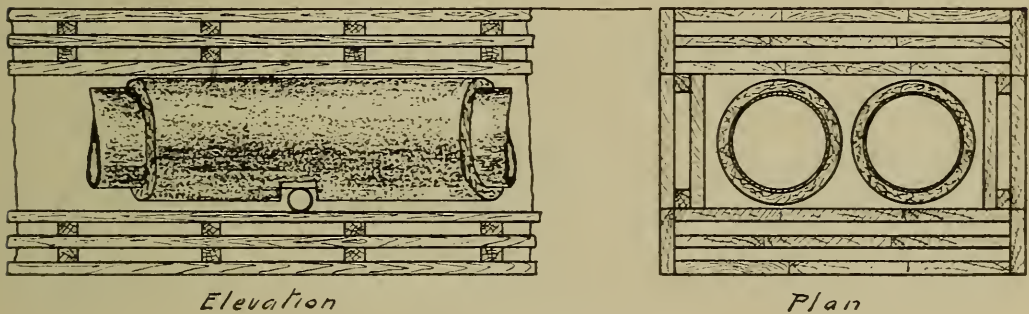


Figure 66.

In carrying pipes from one building to another it is always desirable, if possible, to carry them underground. Carrying underground affords much better heat insulation, the pipes are more easily supported and are less apt to be disturbed. The simplest method of underground distribution and the cheapest is to enclose the pipes in a pine board case, as shown in Fig. 66. This arrangement, however, is not as desirable as a tunnel system, the heat insulation is not as satisfactory and the pipes are

Method of Carrying Pipes.

more difficult to get at for repairs. Its chief recommendation is that it is cheap. In most cases it should be used for work where the expense of a tunnel system would not be warranted.

A system quite largely used is to enclose pipes in pump logs, that is, hollow wooden pipes. These pipes are creosoted and filled with an asphalt paint or some other means of preservation. They are often lined with tin or some other form of metal lining. The pipe is passed through the pump log and is usually covered with about one inch of some standard form of pipe covering. This method of running the pipes furnishes quite satisfactory heat insulation. It is much more durable than the pine board duct, it is easier to install and easier to replace in case of repairs. It has, however, the disadvantage of making the pipe quite inaccessible and in case of accident the removal of the entire system is necessary; this in many places is very expensive. The builders of one of these pipe ducts stated that the loss in the pipes enclosed in this manner is from one-fourth of one per cent to six per cent per mile of pipe delivering steam at its full capacity. The larger the pipe the smaller the proportional heat loss. Fig. 67 shows a cross section of a pipe log with covering. This pipe log construction is most used in central heating systems for building connections and where only one pipe is to be used in supplying the building.

Where it is necessary to run a number of pipes the most desirable method is to run through tunnels made of brick or cement. The size and form of tunnel used will depend upon the number of pipes to be carried, the character of the soil and the depth into the ground. Where tunnel systems have been installed the general experience has been that they more than paid for themselves in a short time, as they entirely do away with the necessity of taking up the pipe and allow for repairs and fre-

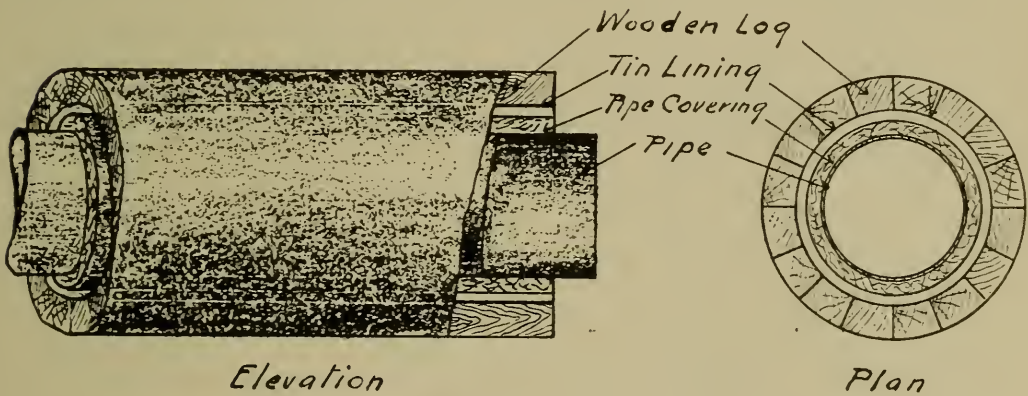


Figure 67.

quent inspection. Fig. 68 shows a small sized tunnel. This tunnel has been used for carrying pipes not over 8 inches in diameter. The tunnel is 3 feet 6 inches wide, 4 feet 6 inches high. It is made of brick 4 inches thick, with 1 inch of Portland cement outside. This cement is painted a thick coat of tar or asphalt to below the crown of the arch. Wherever the supports come the tunnel is ribbed with an 8-inch rib of brick 16 inches wide. This rib is placed about every 10 feet. A tunnel of this

kind has been in use for some time and has given good satisfaction. It is not desirable to use this sort of tunnel for large pipe or where the tunnels are to be frequently inspected.

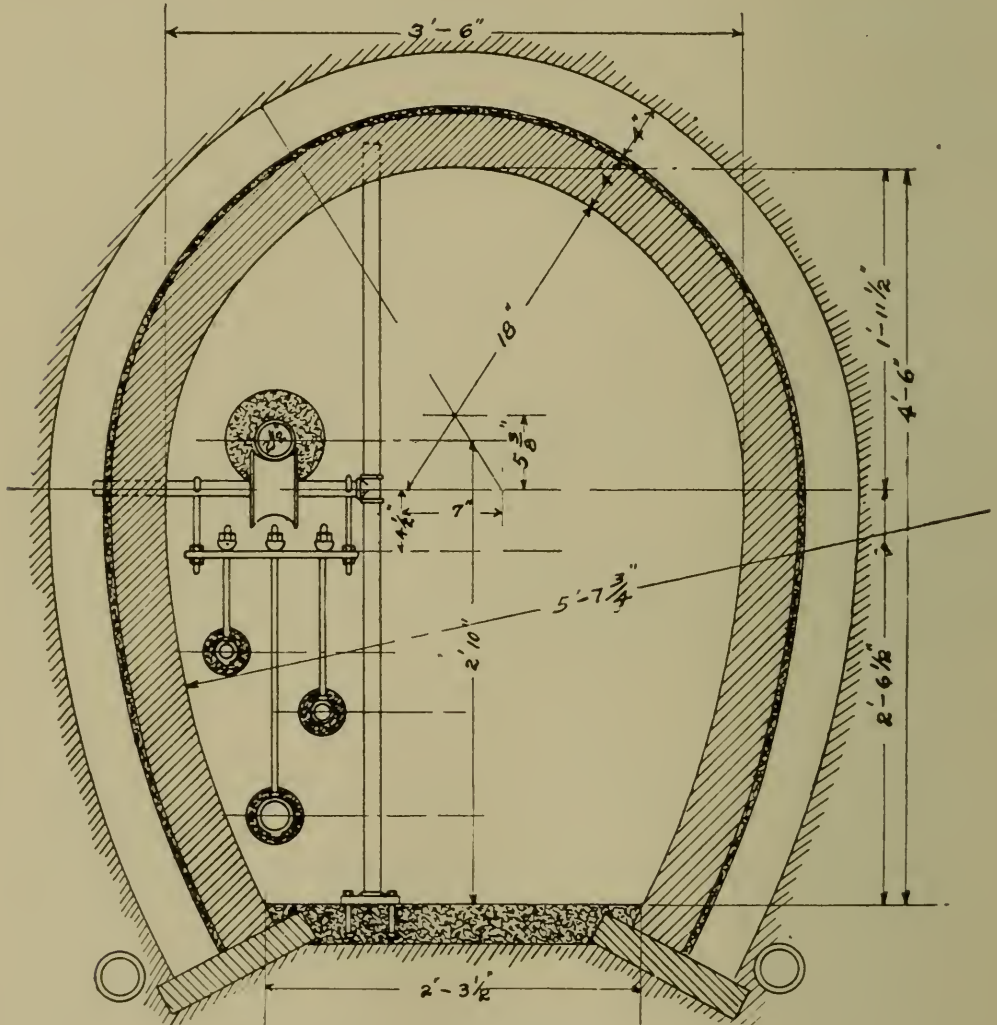


Figure 68.

For larger pipes the section shown in Fig. 69 is much more desirable. This tunnel is 5 feet by 6 feet inside dimensions. The tunnel is made of two courses of brick or about 9 inches thick. It is plas-

should be brought to some drain. In moist clay soils it is sometimes found necessary to run a tile under the middle of the tunnel connecting with the inside of the tunnel so that seepage through the tunnel walls may be carried off either to the sewer or to the pumping plant. In sand and in gravel soils this is not necessary, as almost no difficulty would be experienced from leakage. Fig 70 shows a tunnel made for carrying two large pipes. The tunnel is 5 feet 6 inches by 6 feet 6 inches and gives ample passageway between the pipe supports for easy access at all times.

The cost of tunnels depends upon the nature of the excavation and the price of materials. To give an approximate idea of what tunnels cost, the tunnel shown in Fig. 68 has been constructed, including excavation, back filling and all necessary material for \$4 per linear foot. The tunnel shown in Fig. 69 has been constructed for \$6 per linear foot, and the tunnel shown in Fig. 70 has been constructed for \$6.50 per linear foot.

The size of the pipe necessary to carry a given quantity of steam is determined by the allowable loss

of pressure that the system will permit. In a low pressure system this loss of pressure should not exceed 2 pounds. In a high pressure system it should not exceed 10

Sizes of Pipes.

pounds. The rule most commonly used is called Babcock's rule, and is as follows:

Let W = weight of steam in pounds flowing per minute.

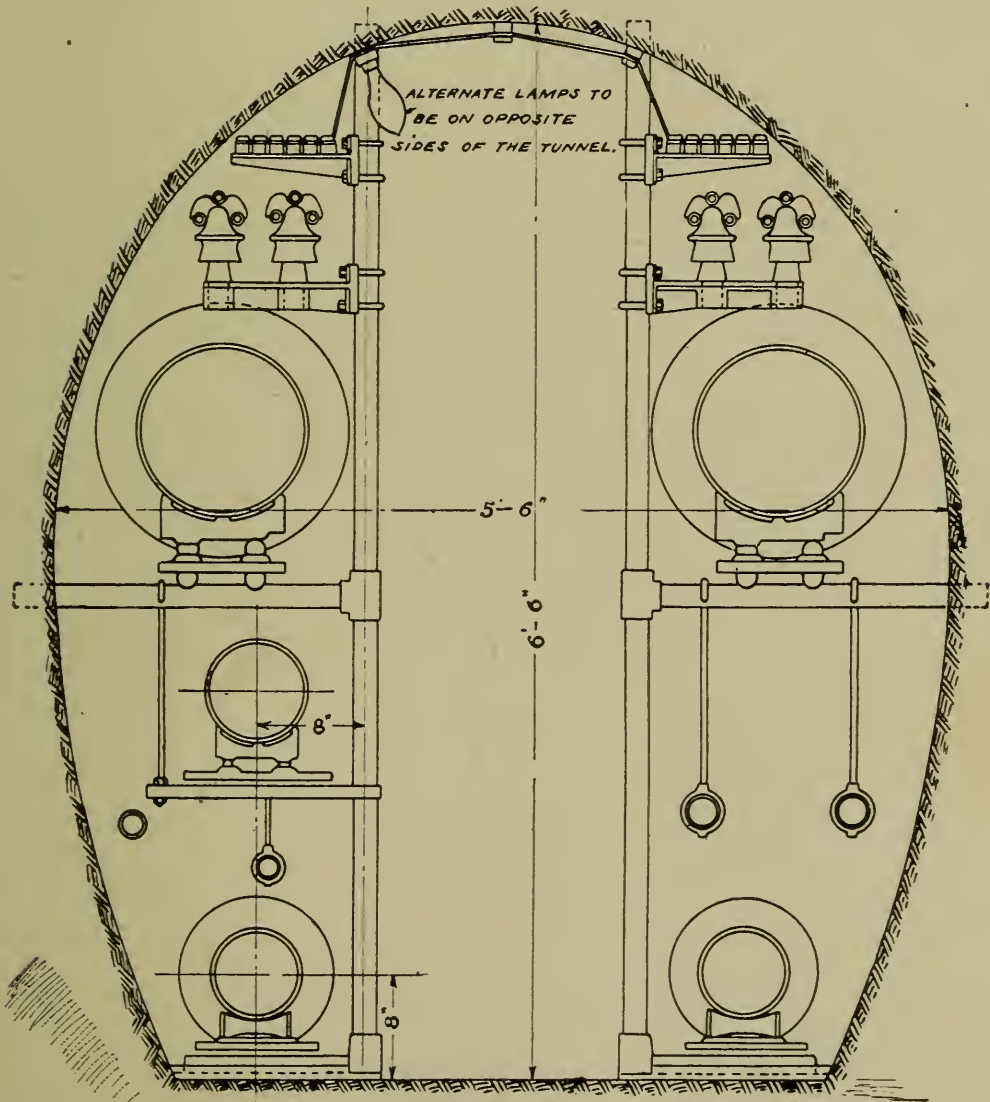


Figure 70.

w = the weight of a cubic foot of steam.

p_1 = pressure in pounds per square inch of steam entering pipe.

p_2 = pressure in pounds per square inch of steam leaving the pipe.

d = diameter in inches.

L = length of pipe in feet.

$$\text{Then } W = 87 \sqrt{\frac{w (p_1 - p_2) d^5}{L \left(1 + \frac{3.6}{d}\right)}}$$

The best way of handling this expression is to assume different diameters of pipe and then try a number of standard pipe sizes. In this way determine the pipe size which approximates most closely the weight of steam which it is desired to carry.

In low pressure gravity return systems the return is usually taken as one-half the pipe size of the steam main up to 10 inches. Above 10 inches the size is taken as one-half the size of the steam main minus one size. As, for example, a 10-inch main would require 5-inch return, a 14-inch would require a 6-inch return. The size of drip main for a given steam main depends entirely upon the length of the main. It should never be less than $\frac{3}{4}$ -inch and it is seldom necessary to make the pipe over $1\frac{1}{4}$ -inch. A $1\frac{1}{4}$ -inch drip main will take care of 2,000 feet of 12-inch pipe, providing the pipe is well covered with standard covering.

When pipes are carried through tunnels it is necessary to provide a different form of hanger than

in building work. In tunnel work the head room is **Hangers and Anchors.** so limited it is ordinarily impossible to suspend pipes from above and they must have some form of roller hanger. Fig 70 shows ball-bearing hangers for 12-inch pipe and roller hangers for the 6-inch pipe. Fig. 68 shows a very simple form of roller hanger. Fig. 69 also shows a form of ball-bearing hanger for 8-inch pipe and roller bearing for 4-inch pipe. The ball-bearing hangers shown in these figures have given very satisfactory results. They are expensive, but the expense is warranted. In tunnel work the clearance is so small that it is necessary to know exactly where the expansion is to be taken up. The only way to be certain of this is to anchor the pipe at the point desired. These anchors are usually made of heavy cast iron with wrought iron straps enclosing the pipe. The hangers should be built into the tunnel or building walls and should pass entirely through the wall, projecting 4 inches or more on the opposite side of the wall. The anchors should not be built into walls that are less than 12 inches thick, and preferably they should be 16 inches thick. In putting in hangers and supports in tunnel work it is a very important thing to see that a clear space is left through the center of the tunnel which will give easy access to the tunnel. The easier the access and the more comfortable the tunnel for passage,

the more frequent will be the inspections, and such inspections insure of the piping being kept in the best possible condition.

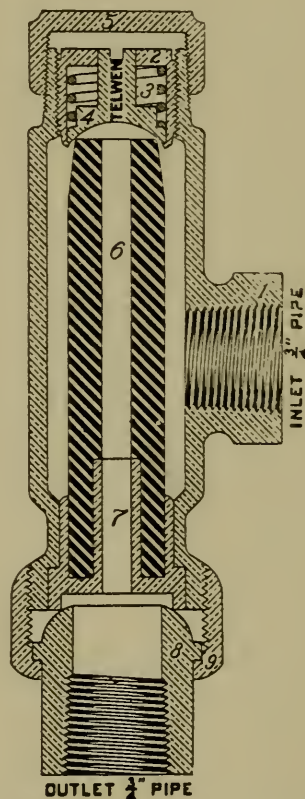


Figure 71. Air valve for use on steam mains with Paul valve.

Fig. 71 shows an air valve adapted for use on large heating systems. The outlet of this air valve is

three-quarters of an inch

Air Valves.

in diameter. It is particularly designed to take care

of the air in the building and tunnel mains. The ordinary sized valve used in radiators is entirely insufficient to take care of large mains. Piping that is 4 inches and over should have the larger valves.

With still larger piping, 10 or 12 inches in diameter, where the mains are 400 or 500 feet long, even this size is hardly sufficient to take care of the air unless a number of them are used.

The valve shown in Fig. 72 is often used. This consists of a brass pipe "A" four feet long, to which is screwed a $1\frac{1}{4}$ -inch angle valve. This pipe and angle valve are attached by a suitable elbow and nipple to the main from the point at which the air is to be removed. A yoke is fastened at elbow "B" and to this yoke two iron rods are attached. These iron rods are connected at the other end of the yoke "C." Yoke "C" is attached to the valve stem of the angle valve. The threads are removed from the stem of the valve so that the valve will pass freely through the stuffing box. By means of a lock nut on the valve stem the height of the valve disc above the seat may be adjusted. To start with, however, the brass rod "A" will be cold and the valve disc will be off the valve seat and air will be allowed to pass out pipe "D." The size used is usually $1\frac{1}{4}$ -inch pipe. As soon as steam comes the brass pipe "A" expands, bringing the valve seat up against the disc and closing the valve so that no steam can escape.

Another arrangement that may be used is shown in Fig. 73. At the point at which it is desired to remove the air a 1-inch pipe is tapped into the fitting. Into this is tapped a 1-inch nipple, an elbow and a

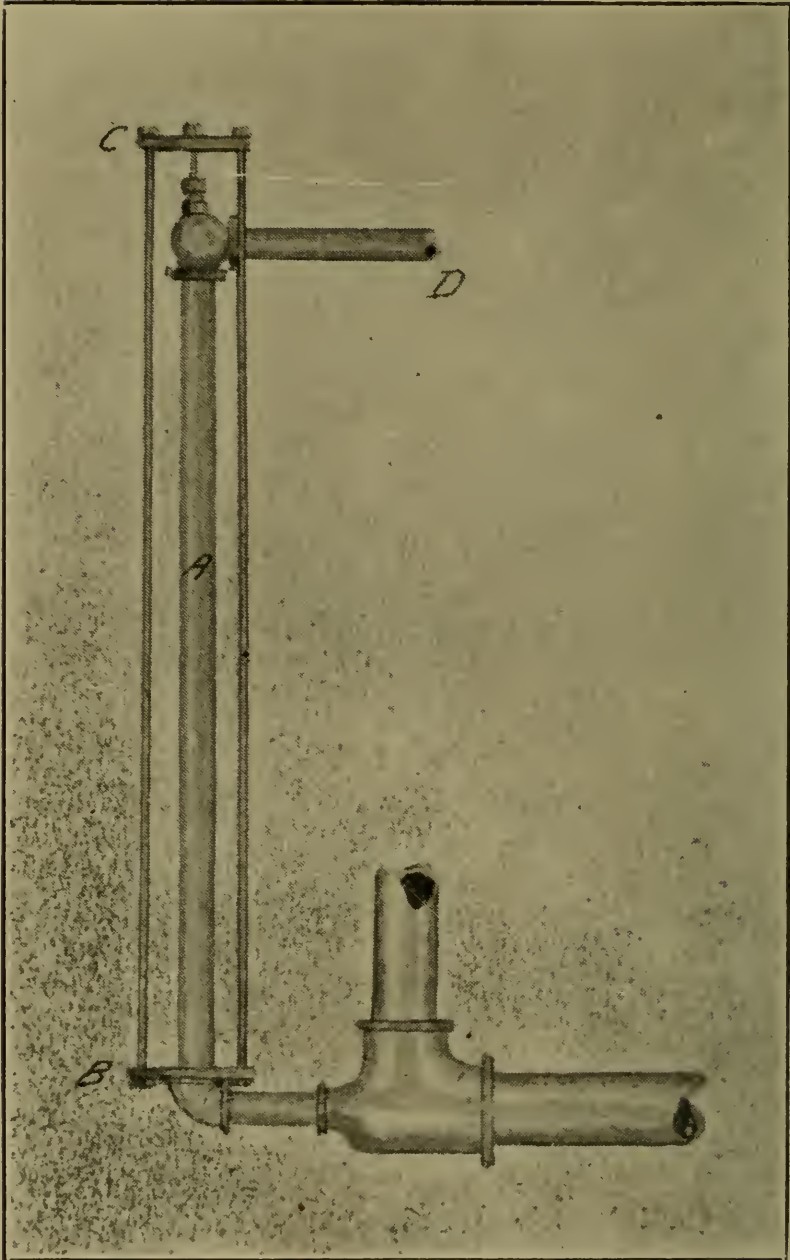


Figure 72. This form of air valve is often used.

short piece of pipe, as shown. At the end of this short piece of pipe is attached a gate valve. At intervals along the inside of the pipe are attached

large air valves, such as the one shown in Fig. 71. On starting up the system the gate valve is left wide open and remains open until steam begins to blow, then this gate valve is closed and the small air valves take care of the accumulation of air that occurs from time to time.

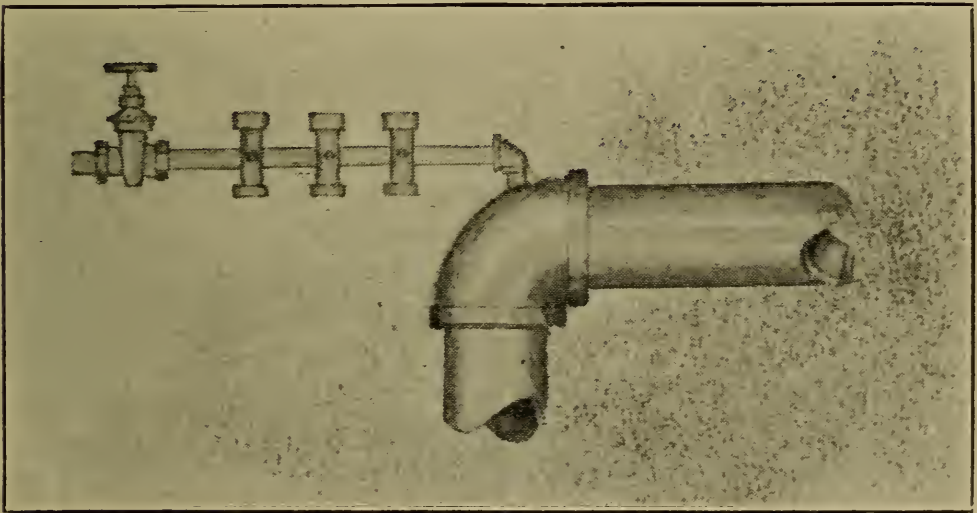


Figure 73. Air valve to relieve a fitting and line of pipe from air.

Lack of proper air valves may cause serious accidents in the pipe system. In large pipes when steam is turned on it will circulate along the top of the pipe and the cold air remains at the bottom of the pipes; the upper side of the pipe will then be hotter than the lower and hence will expand more than the under side. The tendency of the pipe is to assume a circular form, as shown in Fig. 74 by dotted lines. In case of a very large pipe this has been known to

wreck the piping system, breaking flanges and springing the valve seats. Such a condition may be prevented by running the air pipes on the mains down to the bottom of the main, as shown in the figure, so that the air is removed from the bottom of the main instead of from the top of the main. In long piping systems it is very desirable that at intervals of not more than 100 feet air valves should be placed to remove the air from the bottom of the

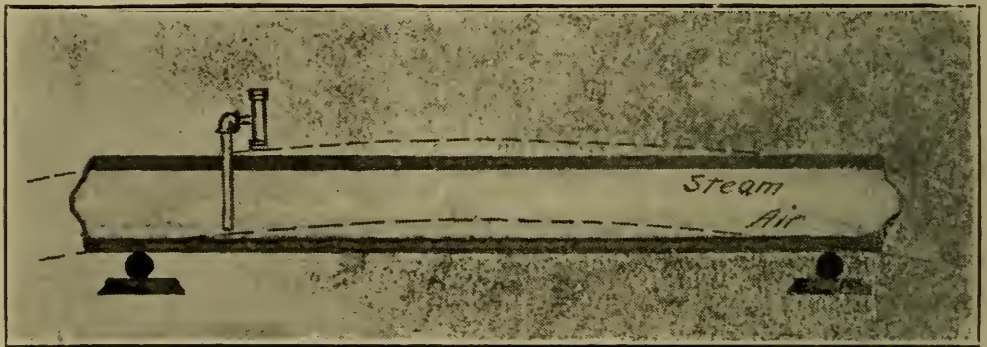


Figure 74. How air collects and sometimes breaks a piping system. How it is prevented.

main. The size of these valves will depend upon the size of the main and they should be of ample capacity. It is not always necessary to use automatic valves. Automatic valves can be replaced by $\frac{3}{8}$ -inch or $\frac{1}{4}$ -inch valves for this purpose.

Air valves should be located at all high points on the return main, particularly at points where the return main rises, passes along the horizontal, and then drops down again. At such points air valves should be located at the top of the main. If this is

not done the air will accumulate at these high points and prevent passage of water, sometimes almost as effectively as though the main were valved at these points.

Surge tanks, traps and other devices where air may accumulate should be provided with air valves. In fact, when trouble is experienced in a steam pipe system one of the first things that the builder should assure himself of is that the air is being properly removed from the parts of the system.

COMBINATION OF STEAM AND HOT WATER SYSTEM.

There are a number of systems using a combination of exhaust steam and hot water for use in connection with central heating systems. The exhaust from the engine is passed through an exhaust heater and the water heated in this heater is circulated through the heating system by means of a pump. In this way exhaust steam can be used for heating a large territory without producing any back pressure. This form of heating may be used in connection with a condensing engine. The water being circulated by a pump under pressure insures its actual circulation throughout the whole system and makes possible the use of relatively small mains for heating purposes, smaller than would be required for either low pressure steam or exhaust steam. In addition to the exhaust steam heater

there may be used either a hot water boiler or an auxiliary live steam heater, so that in case the exhaust is insufficient for heating the water, the water may be passed through this live steam heater, bringing it up to the proper temperature. In some cases a Greene economizer has been used for furnishing additional heat, thereby making use of the waste from the boiler.

Systems of this kind have been installed in a number of cities and as high as one thousand houses heated from a central heating system. In these hot water circulating systems two general forms of pump are used, either a centrifugal pump driven by a motor or engine, or a piston pump of the ordinary type. In most cases unless a high pressure is desired, a centrifugal pump is desirable. The central hot water heating system has one particularly desirable feature—the hot water leaving the system may be adjusted to correspond with the external temperature. The size of hot water mains is determined from the velocity of water circulating in the main. In small mains it should not exceed 4 feet per second; in large mains it may be as high as 8 feet per second.

Central heating by means of hot water is particularly adapted for residence districts, as the system can be installed with less expense per foot of main, making it possible to cover profitably an area having the houses scattered. Central heating with

steam is particularly adapted for close business districts where steam is the usual form of heating and where the piping system will be relatively short for the load carried.

In connection with the systems using pressure there must be used some form of expansion tank. Some of these systems use an open expansion tank, allowing the water in the return system to enter this open tank at practically atmospheric pressure, the suction of the circulating pump being connected to this open tank. Where this system is used a piston type of pump would probably be a desirable form. Where the centrifugal type of pump is used it would be desirable to use a closed tank. In this case the tank is partly filled with water and partly filled with air. The expansion and compression of the air allows for the change in the volume of water due to changes of temperature conditions. In this case the pump will then only furnish the pressure necessary to overcome the resistance of the piping system. The air side of the expansion tank should be provided with an air pump, so that pressure may be maintained by means of an air pump on the air side of the system and the proper quantity of air carried in the tank at all times.

CHAPTER XIII.

PIPING, COVERING AND OTHER APPLIANCES.

In all piping installation it is customary to cover the distributing pipes, except radiator connections.

Pipe Covering. It is good practice to cover the risers passing through buildings, together with all steam and return mains. Where the water mains pass through rooms in which any drip from the pipes would be objectionable, such pipes are also covered to prevent the condensation of moisture on the outside of pipes. In general the best form of non-conductor is dry air, which is so confined as to prevent circulation. In all successful forms of covering air is confined in the structure of the covering and the effectiveness of the covering depends largely upon the confining of this air. The effectiveness of different forms of covering was determined in a series of experiments made under the direction of Prof. M. E. Cooley, University of Michigan. Table 39 shows the relative effectiveness of some of the different forms of covering.

The results of these tests show that hair felt is the best non-conductor. It is not, however, suited for over 10 pounds pressure, as it chars and breaks

down at higher pressure owing to the higher temperature; this is also true of the wool felts. In low pressure work at such temperatures as are ordinarily used, hair felt is found to be quite sat-

Table XXXIX.

Relative Value of Different Pipe Coverings.

| Material of coverings Moulding coverings | Lbs. of steam condensed per sq. ft. covered pipe per hr. | Ratio of condensation of covered pipe to bare pipe, | Thickness of covering, inches. | B.T.U.'s transmitted per sq. ft. per hr. | Relative insulating value compared to 1 in. hair felt. |
|---|--|---|--------------------------------|--|--|
| 1. Asbestos | .145 | .319 | 1.23 | 136. | .803 |
| 2. Magnesia | .119 | .224 | .94 | 166. | .915 |
| 3. Magnesia and asbestos. | .125 | .500 | 1.12 | 118. | .879 |
| 4. Asbestos and wool felt | .190 | .228 | 1.12 | 102. | .910 |
| 5. Wool felt | .117 | .234 | 1.16 | 110. | .904 |
| 6. Wool felt and iron with air space | .134 | .269 | | 125. | .828 |
| Sectional Coverings. | | | | | |
| 7. Mineral wool | .097 | .193 | .94 | 91. | .952 |
| 8. Asbestos sponge | .105 | .220 | 1.12 | 102. | .920 |
| 9. Asbestos felt | .100 | .217 | 1.35 | 94. | .923 |
| 10. Hair felt | .080 | .186 | 1.45 | 75. | .960 |
| Non-Sectional Coverings. | | | | | |
| Two layers asbestos paper | .388 | .777 | | 364. | .263 |
| Two layers asbestos paper, one inch hair felt and one thickness canvas | .070 | .150 | | 68. | 1,000 |

isfactory. It is expensive, but its expense is warranted in the saving from condensation in the piping.

Table 40 shows the relative effectiveness of different thicknesses of covering. Column 3 of this table

shows the relative effectiveness of the various thicknesses of covering compared with the bare pipe. From this table it is not a difficult matter to figure the amount of saving that may be made by using various thicknesses of covering. Knowing the amount of steam carried per year and the cost to produce 1,000 pounds of steam, and having the results shown in this table, we can easily compute the financial saving to be made in the various thick-

Table XL.

Heat Transmission for Varying Thicknesses of Covering.

| Thickness of covering. | Condensation per sq. ft. per hour in pounds. | Ratio of of condensation covered to bare pipe. | B. T. U.'s transmitted per sq. ft. per hour. |
|------------------------|--|--|--|
| $\frac{1}{2}$ | .120 | .281 | 167. |
| $\frac{3}{4}$ | .117 | .255 | 163. |
| 1 | .107 | .231 | 149. |
| $1\frac{1}{2}$ | .099 | .219 | 138. |
| $1\frac{3}{4}$ | .087 | .191 | 121. |
| 2 | .078 | .19 | 108. |

The covering used in obtaining the above results was a wool felt.

nesses of covering. In doing this it is usually found that for building work an inch covering is sufficiently heavy; but for tunnel work and all work where the heat loss from the pipe is entirely lost and does not enter the building it is economy to use covering 2 inches thick. Table 41 shows the heat lost through a 1-inch wool covering with various steam pressures. In covering a piping system the

fittings and valves should be covered the same thickness as the pipe. This also applies to flanges and steam traps. Where flanges and other parts which require removal are covered they should be covered so that the covering can be taken off easily. A satisfactory method of doing this is to form a covering composed of one layer of asbestos paper, 1 inch of hair felt and one thickness of 8-ounce duck. These are quilted together with cord so that the

Table XLI.

Heat Transmission for Varying Pressures.

| Gauge pressure. | Condensation per sq. ft. per hour. | Ratio of condensation of covered to bare pipe. | B. T. U.'s transmission per sq. ft. per hour. |
|-----------------|------------------------------------|--|---|
| 5.3 | .108 | .239 | 100. |
| 9.6 | .111 | .233 | 104. |
| 15.5 | .126 | .227 | 110. |
| 20.5 | .134 | .223 | 119. |

jacket is firmly held in one piece. This covering is then fastened over the pipe to be covered by means of hooks and laces. The advantage of covering may be shown from the following computation:

EXAMPLE.—In a given steam plant it was found that the heat lost from bare pipes per hour was 3,355,000 B. T. U.'s. In the particular plant in question the number of heat units required to make a pound of steam was 990, and this loss of heat would represent a condensation of 3,390 pounds of

steam per hour. Assuming an evaporation of 9 pounds of steam per pound of coal this would be equivalent to 376 pounds of coal per hour. If the plant were operated 365 days in the year and 20 hours a day, and the coal cost \$3.25 per ton, the yearly loss would be \$2,069. By covering the pipe 1 inch thick with hair felt the loss which would result from the bare pipe would be reduced 15 per cent, which equals \$314, making a saving of \$1,755 by putting on covering. This amount capitalized at 10 per cent would represent an investment of \$17,550. In the particular case in question the actual cost of the covering was but \$3,500.

In steam piping work it is very important that the piping system be provided with sufficient number of properly located air valves. Pri-

Air Valves. marily, air valves should be located at the points in the piping at which air accumulates in quantity. We are familiar with the fact that when a radiator is not provided with an air valve steam will not circulate into it and it does not become warm. This is true of both steam mains and the return system. The writer has seen the entire return system of a building plugged with air on account of there being no air valve on a high point in the return main.

For radiators an air valve similar to that shown in Fig. 75 is usually used. You will notice that this air valve allows air entering from the connection

to the radiator to pass directly to the top of the air valve body and out through a small hole or opening, which may be adjusted by means of a screw plug. If water enters the air valve, the water will rise in the valve body until the copper float, having a pin on its upper end, rises so as to close the exit



Figure 75. Type of air valves commonly used on radiators.

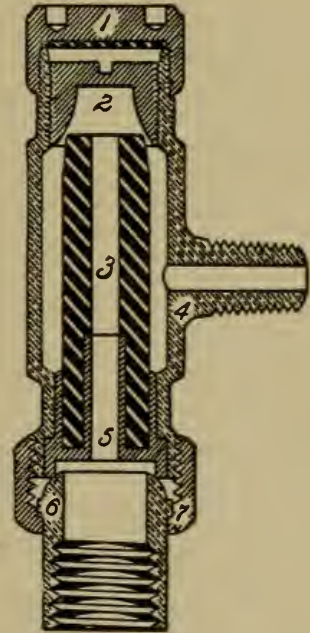


Figure 76. Air valve used on radiators in connection with Paul valve.

from the air valve, and no water is allowed to escape. When steam enters the air valve the expansion plug shown at the center of the air valve expands, raising the copper float, again closing the outlet from the air valve.

Fig 76 shows an air valve which is used for radiators in connection with a system of air piping from the air valves. (1) is a cap screw screwed

down on the valve with a lead washer, making a tight seat. (2) is a hollow screw upon which the expansion post (3) sets, closing the valve. The adjustment of the valve is done with screw (2), and this may be done without disturbing the valve. (3) is a hollow part fastened at (5) and held in place by the union (6). This should never be disturbed. (4) is the nipple of the valve body, by which it is attached to the radiator. This is the union for attaching to the piping of the Paul system or other air piping system. (7) is a nut which forms the union for attaching this piping. The operation of the valve is as follows: The air is drawn in from the radiator through nipple (4) into the valve between the adjusting screw (2) and the composition part (3) passing down through (3) into the pipe. When steam enters the composition part becomes heated and expands, thereby closing the opening between (3) and (2). When air again accumulates and cools this composition part contracts, permitting air to be drawn through the tube.

There are two typical forms of air valve, one closing off the air by the action of the float, the other closing off the air by the action of heat expanding a plug. Fig. 75 shows a combination of these two principles, which prevents the throwing of water or the discharging of steam.

Fig. 76 exemplifies the simple expansion opera-

tion. The valve shown in Fig. 76 would allow cold water to pass.

Fig. 77 shows an air valve particularly adapted to hot water work. In this air valve the float principle alone is used. Air enters in through the con-



Figure 77. Air valve adapted to hot water work.

nection to the radiator, as shown by the arrow in the cut, passes under the float and escapes through a small tube which reaches to a point near the top of the air valve. As soon as the water enters the float lifts, due to the air compressed by the water under the float, and the rubber valve held by the rim closes the opening through which the air escapes. The valve as shown here is made for connection to an air valve piping system. A similar valve is made without this connection. In the air

valve shown for connection to a piping system there is a three-way plug cock in the air valve, which allows of air and water being drawn directly to the air pipe system and of being entirely closed off.

The pipe used in steam heating work is usually of standard weight, except for boiler blow-offs and boiler feed pipes, which are

Pipe, Valves and Fittings. made of extra heavy pipe. Steam pipe is made of steel or wrought iron. Wrought iron is more expensive than steel, but gives better results. Steel pipe can be made which is very satisfactory, but care should be used in selecting a good grade of pipe. Cast iron elbows and tees are more satisfactory than malleable iron and they should be full weight. There are on the market light-weight cast iron fittings. The advantage of cast iron for fittings is that the fittings can be broken with a sledge if at any time it is desired to open the pipe. If malleable iron fittings are used it is necessary to cut them out with a cold chisel, which is expensive. In putting up piping bushings are to be avoided as much as possible and reduction in size made in the fittings.

Valves 2 inches and under are usually made of brass composition and should be of full weight. Over 2 inches it is customary to use iron body brass mounted. Valves over 4 inches should be provided with yokes. Valves 6 inches and over should be provided with by-passes.

CHAPTER XIV.

AUXILIARY DEVICES FOR HEATING SYSTEM.

A temperature regulator is an automatic device which will open and close the valve of the radiator so as to keep the room at a constant temperature. The temperature regulator in general consists of three parts. *First*, a thermostat which is so constructed that its parts will move with a change of temperature in the surrounding air and the motion of these parts will directly or indirectly open the dampers or valves which control the heat supply. *Second*, there must be some means of transmitting the motion from the parts of the thermostat to the valves or dampers controlling the heat supply. *Third*, some form of mechanism for opening the valves or dampers. In most temperature regulating systems the thermostat merely furnishes power enough to close or open an air valve or electric switch and thus start or stop the operation of the valves or dampers.

The form most used at the present time uses compressed air to operate the valves and dampers. In the Johnson thermostat a small air valve is opened by the expansion of a curved strip composed of two

materials having different rates of expansion. The bending of this strip due to change of temperature allows the air to escape and a small diaphragm to move back, thus opening a second valve allowing the air to come from the compressor or source of air supply and close the valve or damper on the radiator. When the room becomes cool the contraction of this strip closes the first small valve forcing out the diaphragm and closing off the compressed air supply to the valve or damper and releasing the air already in the valve or damper. Another form of thermostat extensively used is operated by means of a liquid confined in a thin metal vessel, the liquid having a very high degree of expansion. As the liquid expands or contracts it controls the system of valves controlling the heat supply to the room.

Temperature regulation is a desirable thing in all large heating systems, particularly for public buildings. The systems are quite expensive, but the expense of construction is more than offset by the saving in fuel bills. The saving in fuel bills in most cases is not less than 20 per cent and often as high as 30 per cent. In general the operation of these systems has been entirely satisfactory even after they have been in use some time without any attendance. The control of the temperature of the room should be regulated within 3 degrees. With proper care these systems should control the temperature

of the room within 2 degrees. Temperature regulating apparatus is particularly desirable in school rooms; this places the temperature of the room outside the control of the instructor and it is then free from his own personal ideas in the matter, thus adding much to the health and comfort of the occupants of the room.

The discharge of air from the air valves and radiators often produces a

Air Piping System.

very disagreeable odor and in addition it is very difficult to obtain an air valve which will not at times discharge a certain amount of steam or water. This difficulty may be overcome by using an air valve so designed that the discharge connection to the valve can be fastened to a piping system. The pipes and air valves are carried to the basement, collected into a larger pipe and discharged to a sewer or suitable vessel. A system of air piping is very desirable, particularly in large buildings, such as hotels and office buildings, where it saves materially in the attendance necessary to keep the plant in operation. It is also desirable in nice residences where any discharge of water or steam might injure the furnishings. In case it is desirable to install a vacuum system of heating this system could be connected directly to a vacuum pump insuring more rapid circulation in the radiation.

It is always desirable in a steam or hot water

heating plant, particularly steam, to install some form of damper regulator

Damper Regulators. on the boiler. In some heating plants it consists of an ordinary rubber diaphragm enclosed in a metal case. The steam is allowed to come in contact with one side of the diaphragm, pushes a lever attached to the other side of the diaphragm. This lever operates a damper controlling the air supply to the fire and sometimes also operates the check valve in the breeching. This is a very desirable arrangement as it reduces the attendance necessary to keep the pressure in the boiler at the point desired.

The humidity of the atmosphere is a very important consideration in any heating system. When the air is very dry it is

Humidity Regulation. necessary for a room to have a much higher temperature in order that it may feel comfortable than when the air is moist. It is, therefore, important that we keep the humidity at a point as high as consistent with satisfactory operation. Cold air contains proportionately less moisture than warm air and therefore when cold air is heated and brought into a building, it should be moistened in order to keep a proper per cent of humidity. The average humidity is about 70 per cent; in the most arid regions humidity is as low as 30 per cent. Humidity as low as 30 per cent produces irritation of

the lungs and smarting of the eyes. In cold weather, if the humidity of the outside air is 70 per cent and this air is heated and brought into the room without moistening, its humidity may be reduced as low as 30 or 35 per cent, making the air as dry as in the most arid regions. This produces a serious effect upon the inhabitants and also the furniture of the room. The decrease of humidity due to the action of the heating system occurs particularly in the indirect heating system. There has been placed on the market what is called a humidostat. This is similar to a thermostat except that it is arranged so that as the moisture decreases in the room the humidostat opens up a series of steam or water jets in the air supply so that the air in passing through the steam or water jet takes up moisture. When the moisture gets to a certain percentage, determined by the setting of the humidostat, the apparatus closes off automatically the steam or water jets. Such devices are particularly desirable in connection with school and hospital heating plants.

In the large cities the smoke and dust in the air makes it undesirable to introduce this air directly into the room for ventilating purposes. A great many schemes have been tried to remove the dust from the air. The earliest form was to use burlap screens through which the

Air Washers.

Plan of Air-Purifier.

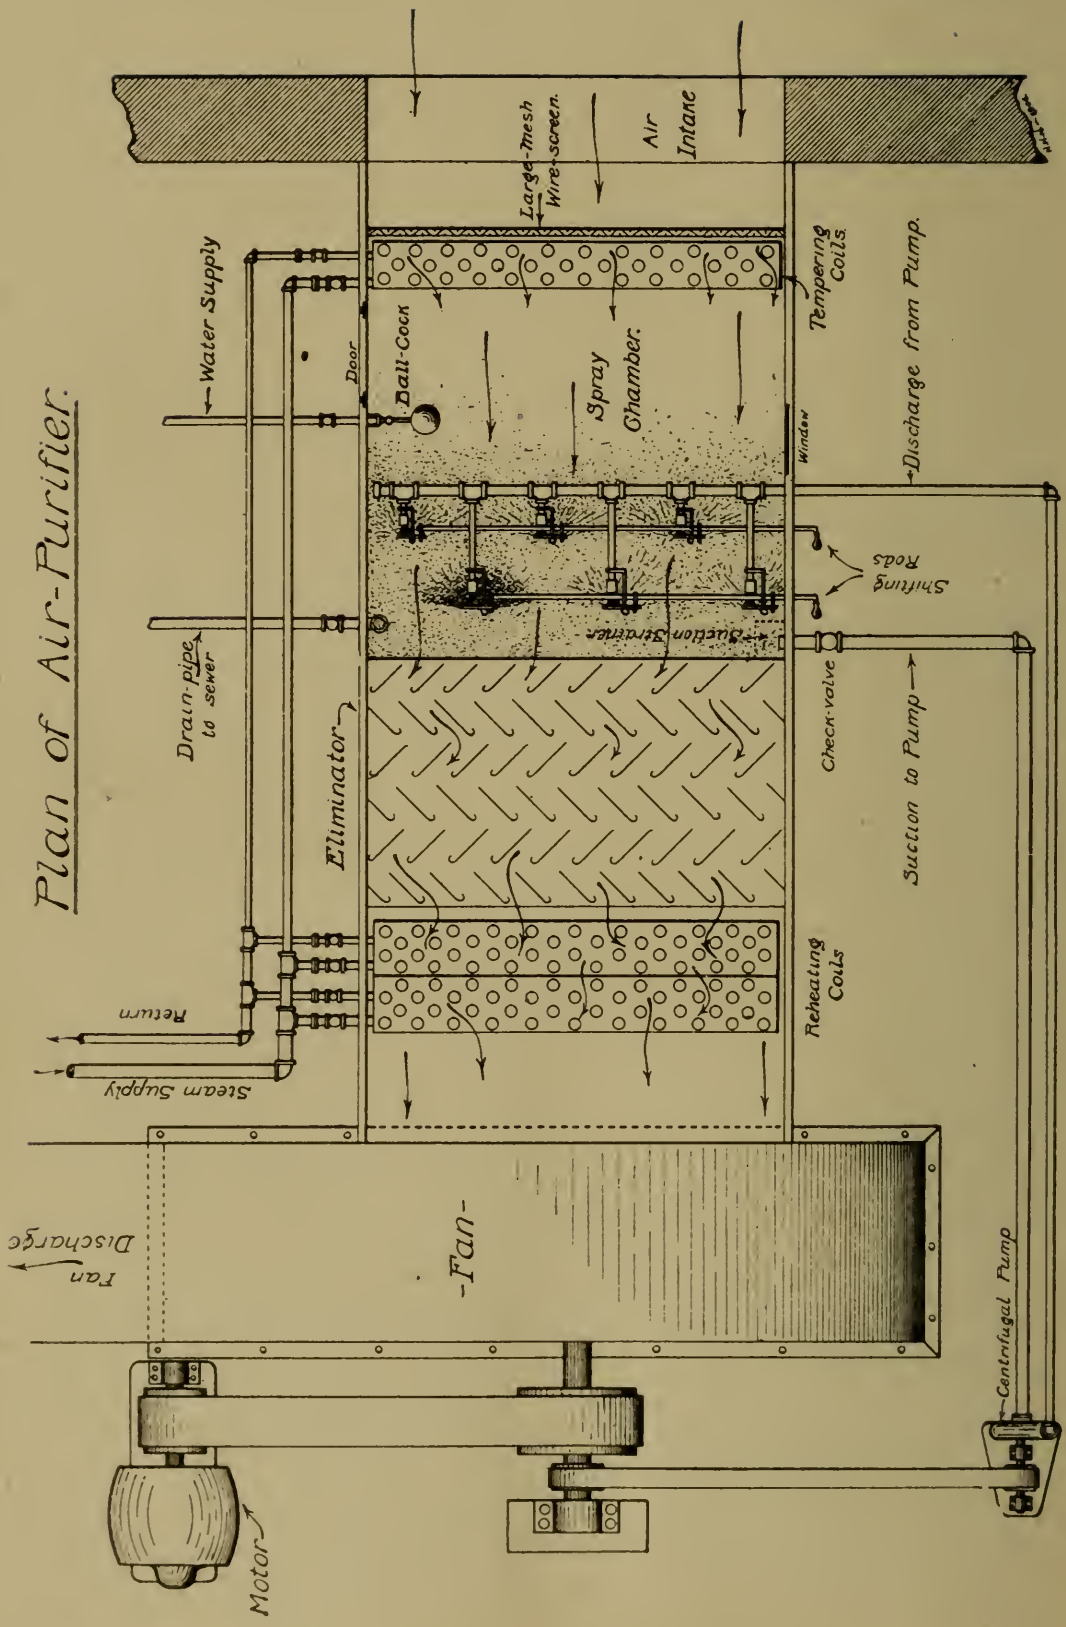


Figure 78.

air passes. These screens work fairly well but the finer dust will always be carried through them. A better plan is to pass the air through a sheet or series of sheets of water. After passing through these sheets of water the air is passed through an apparatus which removes the excess of water. Fig. 78 shows the general arrangement of an air washing system. As you will notice from the figure, the air first passes through a tempering coil which raises the temperature from 60 to 70 degrees, then passes through the sprays or sheets of water, then through the eliminator where the excess of water is removed and then it passes to the heating coils to be heated. The water used for washing the air is circulated over and over again by means of a small centrifugal pump driven by a motor. In some cases it is desirable that the air should be cooled. This may be done by placing cooling coils in the tank where the water collects after having washed the air, and reducing the temperature of this water to the desired point. The washing of the air with water also increases the humidity of the air. In a plant installed by the author the humidity of the air has been kept at a point not lower than 60 per cent by means of the air washer. Air washing devices are very effective in removing dirt; the amount of dirt removed in some cases is very large.

There is very frequently installed in connection


with the heating system what is known as a vacuum heating system. There are

Vacuum Systems. two principal forms of vacuum heating systems, one in which the air is drawn from the radiator by means of an air pump through an air valve, as shown in Fig. 76, and the other in which the radiator is fitted with a special form of return valve and vacuum is maintained on the return system by means of a pump or aspirator. The vacuum systems of heating lowers the temperature of the radiator and the radiators do not condense so much steam as they would under full pressure. They do not make any material saving in the amount of coal burned. The principal advantages of the vacuum systems are certainty of circulation and the reduction of pressure in the piping system. They are particularly well adapted for use in connection with exhaust steam heating systems where the reduction of pressure in the heating system lowers the back pressure on the engine, increasing the horse power output of the engine.

The vacuum system of heating in which the air is drawn from the air valves is particularly desirable in hospitals and school buildings as it does away with the objectionable odor from the air valves. The vacuum system of heating does away very largely with the attendance required by air

valves. It also permits of the radiator being placed lower than the level of the boiler and the condensation is raised from the lower level by means of the vacuum in the system. Oftentimes this enables the engineer to overcome serious difficulties in the design of a heating plant. These systems can be profitably installed in old plants where the steam mains are overtaxed, owing to frequent additions to the plant. By additions of the vacuum system these old mains can be made to carry a larger weight of steam, the vacuum system permitting a higher velocity of steam in the system without increasing the back pressure.

Sizes of Flow and Return Steam Mains

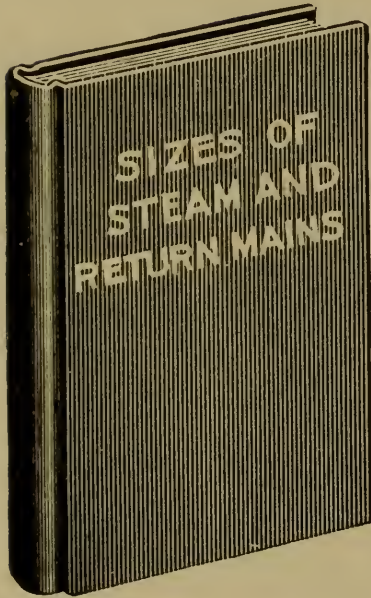

Being an apprentice's query as to correct sizes of pipes in heating plants, and answers thereto by twenty-five leading American heating engineers. These replies, giving the practice in some of the leading shops in many different cities of the country, with tables and diagrams, are by the following engineers :


- Prof. R. C. Carpenter, Cornell University
Prof. J. H. Kinealy, St. Louis
John Gormly, Philadelphia
Ralph Collamore, Detroit
Gerard W. Stanton, New York
- Wm. G. Snow, Boston
Thomas Barwick, New York
Ed. K. Munroe, Baltimore
W. R. Stockwell, Irvington-on-Hudson
Clarence M. Lyman, Utica, N. Y.
- R. R. M. Carpenter, Wilmington, Del.
E. F. Capron, Chicago
J. R. Shanklin, Charleston, W. Va.
John S. Brennan, Milwaukee
H. A. Smith, New York
- R. S. Thompson, Springfield, O.
Bernard Gause, Jacksonville, Ill.
J. J. Wilson, Philadelphia
Henry S. Kries, Baltimore
Reginald Pelham Bolton, New York
- F. R. Still, Detroit
Thomas Morrin, San Francisco
James A. Donnelly, New York, and others.

Bound in Boards, Price 50 cents, delivered
 $6\frac{3}{4}$ x $4\frac{1}{4}$ inches

Domestic Engineering, 58-64 N. Jefferson St., Chicago

Plumbing Catechism

THEORY AND PRACTICE OF
PLUMBING DESIGN

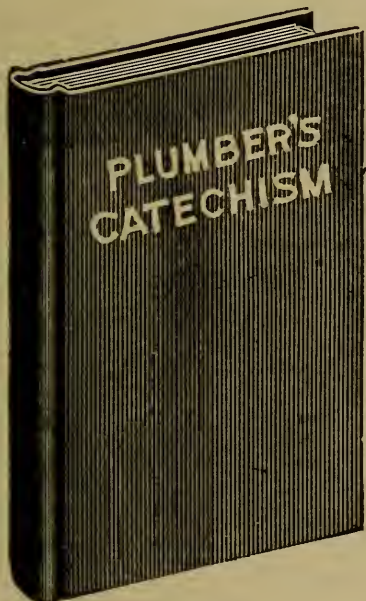

By *Charles B. Ball*, M. Am. Soc. C. E., and M. Am. Soc. Inspectors of Plumbing and Sanitary Engineers, and *Herbert T. Sherriff, A. B.*, some-time Editor of "Domestic Engineering", M. Am. Soc. Inspectors of Plumbing and Sanitary Engineers.

Bound in cloth; $6\frac{3}{4}$ x $4\frac{3}{4}$; 100 pp; elaborately indexed.


This book formulates, in question and answer form, the basic principles of plumbing design and practice, crystallizing the knowledge of the skilled plumber, and providing the non-technical reader a source of information as free as possible from puzzling set phrases. It is specially commended to students in engineering and trade schools, and to master and journeymen plumbers, preparing for examinations. It does not discuss matters of handicraft such as joint wiping, lead burning, etc.

CONTENTS: PLUMBING FIXTURES: Lavatories, kitchen sinks, bath tubs, laundry tubs, slop sinks, urinals, water closets, water closet flushing apparatus, local ventilation, floor slabs, refrigerators. WATER SERVICE PIPES: Fixture supply pipes, storage tanks, hot water supply systems. THE DESIGN OF PIPE SYSTEMS: The main drain, the main trap, the air inlet, traps, ventilation pipes. PUMPS. EFFECTS OF FREEZING.

Price \$1.00, delivered

Domestic Engineering, 58-64 N. Jefferson St., Chicago

FIFTY Plumbing Charts

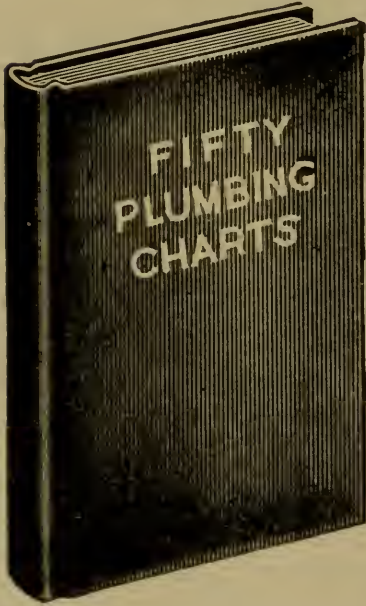

Showing how modern, up-to-date, sanitary plumbing should be done. Paper bound, 9x5 $\frac{3}{4}$ inches; 50 pp. A lay-out of each of the following jobs is shown, giving sizes of all pipes, heights of all fixtures; every joint, every piece of material and every fixture:


| | | | |
|---------|-------------------------|----------|----------------------------------|
| Plate 1 | Kitchen Sink Connection | Plate 27 | Anti-Freezing W. C. |
| " 2 | Lavatory | " 28 | Roof Connections |
| " 3 | Water Closet | " 29 | Roof Connections |
| " 4 | Bath Tub | " 30 | Fresh Air Inlet |
| " 5 | Wash Tray | " 31 | Fresh Air Inlet |
| " 6 | Pantry Sink | " 32 | Traps |
| " 7 | Urinal | " 33 | Traps |
| " 8 | Slop Sink | " 34 | Traps |
| " 9 | Hotel Sink | " 35 | Grease Traps |
| " 10 | Sitz Bath | " 36 | Soil Pipe on Side Wall |
| " 11 | Foot Bath | " 37 | Plumbing for Residence |
| " 12 | Bath Room | " 38 | Cellar Work, Residence |
| " 13 | Refrigerator | " 39 | Plumbing for Double House |
| " 14 | Refrigerator Line | | Under Test |
| " 15 | Ferrule Connections | " 40 | Plumbing for 3 Tenement houses |
| " 16 | Preparing Lead Works | " 41 | Plumbing for Six Flats |
| " 17 | Ferrule Connections | " 42 | Cellar Work for Stores and Flats |
| " 18 | Cleanouts | " 43 | Plumbing for Horse Stall |
| " 19 | Water Closets | " 44 | Plumbing for Stables |
| " 20 | Water Closets | " 45 | Plumbing for Eng. House |
| " 21 | Back Venting | " 46 | Cellar Work, Eng. House |
| " 22 | Back Venting | " 47 | Plumbing for Hotel |
| " 23 | Floor Con. for W. C. | " 48 | Plumbing for R. R. Sta. |
| " 24 | Floor Con. for W. C. | " 49 | Plumbing for Y.M. C. A. Bldg. |
| " 25 | Local Venting | " 50 | Plumbing, High School |
| " 26 | Local Venting | | |

Price 25 cents, delivered

Domestic Engineering, 58-64 N. Jefferson St., Chicago

JUL 3 1908

LIBRARY OF CONGRESS



0 020 237 569 8