



DUDLEY  
NAVAL ~  
MONTEREY, C. L. 33943





# NAVAL POSTGRADUATE SCHOOL

## Monterey, California



# THESIS

AN ANALYTIC MODEL OF GAS TURBINE  
ENGINE INSTALLATIONS

by

Stephen M. Ezzell

September 1984

Thesis Advisor:

P. F. Pucci

Approved for public release; distribution unlimited.

T217400



Unclassified

DUDLEY KNOWLTON, JR.  
NAVAL POSTGRADUATE SCHOOL  
MONTEREY, CALIFORNIA

SECURITY CLASSIFICATION OF THIS PAGE (When Data Entered)

REPORT DOCUMENTATION PAGE		READ INSTRUCTIONS BEFORE COMPLETING FORM
1. REPORT NUMBER	2. GOVT ACCESSION NO.	3. RECIPIENT'S CATALOG NUMBER
4. TITLE (and Subtitle)  An Analytic Model of Gas Turbine Engine Installations		5. TYPE OF REPORT & PERIOD COVERED  Master's Thesis; September 1984
7. AUTHOR(s)  Stephen M. Ezzell		6. PERFORMING ORG. REPORT NUMBER
9. PERFORMING ORGANIZATION NAME AND ADDRESS  Naval Postgraduate School Monterey, California 93943		10. PROGRAM ELEMENT, PROJECT, TASK AREA & WORK UNIT NUMBERS
11. CONTROLLING OFFICE NAME AND ADDRESS  Naval Postgraduate School Monterey, California 93943		12. REPORT DATE  September 1984
14. MONITORING AGENCY NAME & ADDRESS (if different from Controlling Office)		13. NUMBER OF PAGES 224
		15. SECURITY CLASS. (of this report)  Unclassified
		15a. DECLASSIFICATION/DOWNGRADING SCHEDULE
16. DISTRIBUTION STATEMENT (of this Report)  Approved for public release; distribution unlimited.		
17. DISTRIBUTION STATEMENT (of the abstract entered in Block 20, if different from Report)		
18. SUPPLEMENTARY NOTES		
19. KEY WORDS (Continue on reverse side if necessary and identify by block number)  Gas turbine, ducting		
20. ABSTRACT (Continue on reverse side if necessary and identify by block number)  An interactive computer simulation of marine gas turbine installations including intake and exhaust ducting for the engine and module cooling has been developed. A one-dimensional analysis		

Unclassified

SECURITY CLASSIFICATION OF THIS PAGE (When Data Entered)

was used in determining the pressure losses of the ducting. The pressure losses along with the ambient conditions and desired power setting define a unique operating point for the system. The computer model predicts operating parameters for this point by an iterative matching technique.

S N 0102-LF-014-6601

Approved for public release; distribution unlimited.

An Analytic Model  
of  
Gas Turbine Engine Installations

by

Stephen M. Ezzell  
Lieutenant Commander, United States Navy  
B.S., North Carolina State University, 1971

Submitted in partial fulfillment of the  
requirements for the degree of

MASTER OF SCIENCE IN MECHANICAL ENGINEERING

from the

NAVAL POSTGRADUATE SCHOOL  
September 1984

ABSTRACT

An interactive computer simulation of marine gas turbine installations including intake and exhaust ducting for the engine and module cooling has been developed. A one-dimensional analysis was used in determining the pressure losses of the ducting. The pressure losses along with the ambient conditions and desired power setting define a unique operating point for the system. The computer model predicts operating parameters for this point by an iterative matching technique.

## TABLE OF CONTENTS

I.	INTRODUCTION . . . . .	10
II.	THEORY AND ANALYSIS . . . . .	15
A.	GENERAL . . . . .	15
B.	THE BERNOULLI EQUATION . . . . .	15
C.	MODIFIED BERNOULLI EQUATION . . . . .	16
D.	PRESSURE LOSSES . . . . .	18
E.	GAS TURBINE/SYSTEM INTERFACE . . . . .	21
F.	FAN/SYSTEM INTERFACE . . . . .	23
G.	JUNCTIONS OR WYES . . . . .	24
H.	EDUCTOR/SYSTEM INTERFACE . . . . .	26
I.	SYSTEM ANALYSIS . . . . .	27
J.	TOTAL PRESSURE GRADIENT . . . . .	33
III.	PROGRAM PROCEDURES . . . . .	36
A.	GENERAL . . . . .	36
B.	INTERACTIVE CODE . . . . .	37
C.	OTHER PROGRAM FEATURES . . . . .	38
IV.	RESULTS AND RECOMMENDATIONS . . . . .	40
A.	GENERAL . . . . .	40
B.	LIMITATIONS . . . . .	41
C.	RECOMMENDATIONS . . . . .	42
APPENDIX A:	PROGRAM LISTING . . . . .	44
APPENDIX B:	FLOW CHARTS . . . . .	139
APPENDIX C:	USER'S MANUAL . . . . .	173
A.	GENERAL . . . . .	173
B.	PRELIMINARY . . . . .	174

C. EXECUTING THE PROGRAM . . . . .	204
1. IBM 3033 at NPS . . . . .	204
2. VAX-11 at NPS . . . . .	204
D. BUILDING A DUCT DATA FILE . . . . .	205
E. EDITING THE DUCT DATA FILE . . . . .	214
F. COMPUTING SYSTEM PERFORMANCE . . . . .	217
G. EXAMINING THE OUTPUT . . . . .	219
LIST OF REFERENCES . . . . .	223
INITIAL DISTRIBUTION LIST . . . . .	224

## LIST OF TABLES

I.	Fittings Available From Program Menu . . . . .	22
II.	Node Designations . . . . . . . . . . . . . . .	175

## LIST OF FIGURES

1.1	Typical Shipboard Inlet and Exhaust Ducting . . .	11
2.1	Typical K Values for Fittings . . . . .	20
2.2	Fan/System Interface . . . . .	25
2.3	Module Cooling Eductor Schematic . . . . .	28
2.4	Module Eductor Performance . . . . .	29
2.5	Eductor/System Interface . . . . .	30
2.6	System Arrangements and Their Classification . .	32
2.7	Typical Duct Pressure Changes . . . . .	35

## LIST OF SYMBOLS

A	Area, ft <sup>2</sup>
AC	Area, cooling flow passage
AM	Area, mixed flow passage
AP	Area, primary flow passage (exhaust)
a }	Duct cross section dimensions, ft
b }	
D	Diameter, ft
$\epsilon$	Absolute roughness factor, ft
f	Friction factor, dimensionless
g	Acceleration due to gravity, ft/sec <sup>2</sup>
$g_c$	Gravitational constant, 32.174 ft-lbm/lbf-sec <sup>2</sup>
L	Length, ft
P	Pressure, lbf/ft <sup>2</sup>
P <sub>t</sub>	Total pressure, lbf/ft <sup>2</sup>
$\Delta p_t$	Change in total pressure, lbf/ft <sup>2</sup>
P <sub>S</sub>	Static pressure, lbf/ft <sup>2</sup>
P <sub>T</sub>	Total pressure, lbf/ft <sup>2</sup>
P <sub>V</sub>	Velocity pressure, lbf/ft <sup>2</sup>
P <sub>0</sub>	Ambient pressure, lbf/ft <sup>2</sup> or PSIA
P <sub>8</sub>	Engine back pressure, lbf/ft <sup>2</sup> or PSIA
Q	Volumetric flow rate, ft <sup>3</sup> /sec
Re	Reynolds Number, dimensionless
V, v	Velocity, ft/sec
W <sub>C</sub>	Cooling mass flow rate, lbm/sec
W <sub>8</sub>	Exhaust mass flow rate, lbm/sec
z	Potential height, ft
$\rho$	Density, lbm/ft <sup>3</sup>



## I. INTRODUCTION

The installation of gas turbine engines in a ship raises several problem areas in the design of the intake and exhaust ducting. The problems relate mainly with the large volume of combustion air required and the properties of the exhaust gases rejected to the atmosphere at high temperatures and velocity. For comparison, a boiler's combustion air requirement is nearly stoichiometric but the gas turbine operates at about 400 percent of stoichiometric. The boiler's exhaust is about 400 degrees F after leaving the last rows of the economizer, but gas turbine exhaust temperatures are frequently as high as 950 degrees F.

In addition to the air that passes through the gas turbine engine there is also a requirement to ventilate the engine enclosure. An adequate and uniformly distributed cooling airflow is required around the engine to maintain engine-mounted components at their proper operating temperatures and to minimize the heat rejected to the engine room thereby reducing the heat exposure of operating personnel. Many current designs branch the engine cooling airflow off the main intakes and/or join heated enclosure cooling air into the engine exhaust ducting. Figure 1.1 shows a typical layout of inlet and exhaust ducting. Since the enclosure cooling airflow is on the order of 20 percent of the engine's full power airflow rate, it is an important part of the ducting design.

The fundamental requirement of an intake design is to provide air to the engine compressor with the minimum total pressure loss and with a minimum of total pressure distortion. The loss of total pressure in the intakes leads to a loss of engine power and an increase in specific fuel

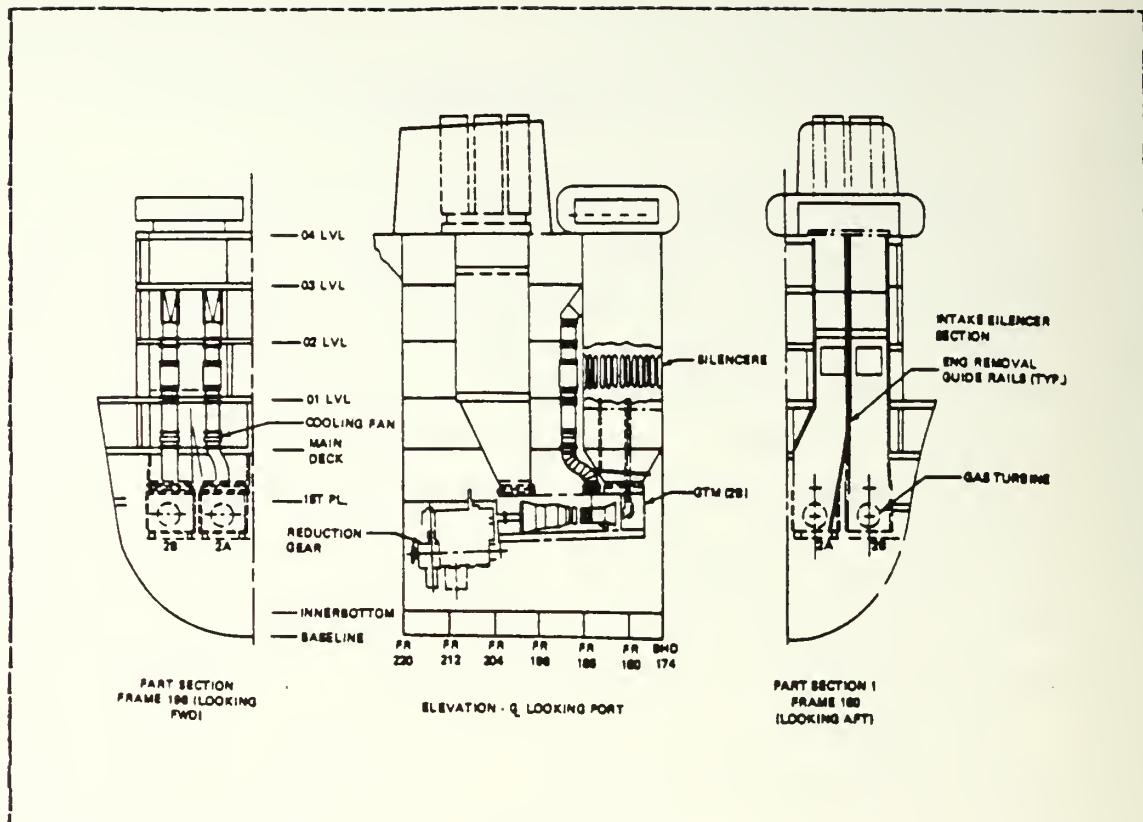


Figure 1.1 Typical Shipboard Inlet and Exhaust Ducting.

consumption. Schwieger reports "Typical exchange rates are that a one percent loss in intake pressure is equivalent to a 2.2 percent loss in power and a 1.2 percent increase in specific fuel consumption" [Ref. 1]. Additionally, total pressure distortion at the compressor face can lead to a risk of compressor blade failure.

Exhaust ducts must also operate with a minimum pressure loss. "The exchange rate is 1.1 percent loss in power and 1.1 percent increase in specific fuel consumption for the one percent increase in total pressure at the power turbine exit" [Ref. 1].

Conflicting with the design objective to reduce losses in the ducting system are several possible requirements to

install components in the ducting system which contribute to the losses but not directly to engine performance. Filters are installed to increase engine life. Silencers are installed to reduce noise. Machinery arrangements dictate the use of certain elbows, contractions, and transitions. The infrared signature of the ship's exhaust plume can be reduced by the installation of an eductor system at the exhaust exit. The eductor also improves the environment of mast mounted equipment and may contribute to flight safety when operating helicopters. Some systems use an eductor arrangement installed at the exhaust plane of the engine to pump cooling air through the engine enclosure. A waste heat recovery boiler may be installed in the exhaust to improve overall efficiency. To reduce pressure losses every attempt should be made to reduce the velocity in the duct. Lower velocities requires larger ducts. Part of the design compromise must balance the large volume of the ship occupied with inlet and exhaust ducts and the volume for other uses such as weapons and habitability. In summary there are many different components that can be utilized within the ducting system and have various effects on the system performance. The effects also vary with the operating point of the system.

It is not a straight forward problem to predict how components in the ducting system will perform. It is an interacting or matching type of problem. Furthermore, it is a dynamic problem as parameters affecting performance can vary over a wide range. For example, one power setting of the gas turbine requires a different mass flow rate of air than another. The variable mass flow rate through the ducting system creates a variable inlet and exhaust duct pressure loss. The variation in exhaust temperature affects the losses in the exhaust duct. Ultimately all losses affect the performance of the gas turbine engine.

One approach to the analysis of ducting system performance is to separate the problem into two areas of concern. The first area should deal with a one-dimensional analysis of the ducting system to determine how pressure losses affect engine performance and how the various components of the system contribute to the sum total of these losses. The second area should deal with the distortion of total pressure across any section of the duct. This area becomes a three-dimensional problem where interest is directed to performance not just at any section of the duct but to within that section to the variation of velocity across the cutting plane. The one-dimensional and three-dimensional areas of the analysis are of course related.

The relationship between the one-dimensional and the three-dimensional aspect of the problem is understood and is dealt with in an empirical manner. The method is to apply a correction factor to the loss developed in the one-dimensional analysis of a particular system component, based on the distortion of the flow assumed to be presented to the component. If the assumptions about flow distortion are made and are accurate much valuable information results from the one-dimensional analysis.

The three-dimensional analysis of a duct system is possible only for a very simple system and requires very large computer assets. It is current practice to deal with three-dimensional analysis of complex systems through model studies. One-dimensional analysis on the other hand is well suited for analysis on a computer.

It is the intent of this study to develop the methodology for a one-dimensional analysis of a gas turbine engine's inlet and exhaust ducting as might be installed on a ship. Then to implement the method in an interactive computer program which allows rapid input of the duct geometry, desired operating point and ambient conditions to

obtain an accurate estimate of performance. The designer can then decide to make changes to components to achieve design objectives and make those changes to the duct geometry through an editing routine and rerun the problem. Once the designer is satisfied with the one dimensional analysis a firm basis exists to provide a design for model studies.



## III. THEORY AND ANALYSIS

### A. GENERAL

A one dimensional analysis of the flow in duct sections utilizes the Bernoulli Equation modified to account for losses. The term one-dimensional is an adjective often applied to flow situations. The whole flow is considered to be one large streamtube with average velocity  $V$  at each cross section. Thus the one dimension is the location down the duct. Losses refers to the pressure loss caused by frictional stresses in the airflow boundary layer and by turbulence. A thorough understanding of these terms and concepts is required to convey the meaning of the results of the duct system analysis.

### B. THE BERNOULLI EQUATION

The Bernoulli Equation is discussed in any basic text on fluid mechanics. It was developed to describe the flow work of an ideal incompressible fluid in steady flow through a streamtube. In words it states that the mechanical energy per unit mass along a streamline is conserved. The Bernoulli Equation is:

$$v^2/2g_c + p/\rho + (g/g_c)z = \text{constant.} \quad (\text{eqn 2.1})$$

It relates velocity, pressure, and potential height. The constant may have a different value for each streamline, but for the purposes of duct flow certain simplifying assumptions are valid which make the constant valid for any streamline. The assumptions are that the static pressure is constant at any point in a cross section of the duct. The

next assumption is that because the system uses gases, the effect of variation in potential height at a duct section is so small relative to the other terms that its effect is neglected. This assumption is extended further to include the change in elevation effect at any section relative to any other section.

Alternate forms of the Bernoulli Equation are obtained by multiplying through by either  $g_c/g$  or  $\rho$ . Of interest to gas flow and duct design is the form obtained by multiplying through by  $\rho$ . Applying the above assumptions the resulting equation is:

$$\rho v^2/2g_c + p = \text{constant} \quad (\text{eqn 2.2})$$

In this form the constant has units of foot-pound force/feet<sup>3</sup> and expresses the energy per unit volume flow rate. It reduces to pound force/feet<sup>2</sup> or pressure. Each term in the expression is given a name. The velocity term is the velocity pressure,  $p$  is the static pressure, and the constant is the total pressure. In words, the total pressure at a point is the sum of the velocity pressure and the static pressure.

### C. MODIFIED BERNOULLI EQUATION

Although equation 2.2 was derived for flow along a streamtube of an ideal frictionless flow it can be extended to analyze flow through ducts in real systems by applying the First Law of Thermodynamics. A good development of the application of the First Law of Thermodynamics to pipe flow is found in [Ref. 2]. It results in the modified Bernoulli Equation (2.3). Equation (2.3) incorporates all the assumptions so far and includes the term  $\Delta p_t$ . The flow resistance in a system with a real fluid between stations 1 and 2 is represented by the total pressure loss,  $\Delta p_t$ .

$$\rho v_1^2/2g_c + p_1 = \rho v_2^2/2g_c + p_2 + \Delta p_t \quad (\text{eqn 2.3})$$

The velocity used in the modified Bernoulli Equation will be taken as the mean velocity and then this equation will be assumed valid for any streamline in the duct. Analytically this is not correct because there is a variation of velocity at a duct section from the walls to the center of the duct. The error introduced by this assumption is offset by two circumstances. First, with turbulent flow the velocity profile is nearly uniform which makes the mean velocity a good approximation of the velocity at any point in the cross section. Second, experimentally determined loss coefficients are utilized in computations and this coefficient is applied using the mean velocity. Then if the velocity profile in the system matches the profile of the experiment, the loss will be correctly computed using the mean velocity.

The computer program uses the mean velocity and computes it based on mass flow rates. The mean velocity is computed from the mass flow through a sectional area and the density of the fluid at the section using equation 2.4. Density is computed by the perfect gas law equation (2.5) and is a function of the absolute temperature of the gas and the static pressure of the gas.

$$v_{\text{mean}} = \frac{W}{\rho A} \quad (\text{eqn 2.4})$$

$$\rho = P/RT \quad (\text{eqn 2.5})$$

where       $P$  = static pressure  
               $R$  = gas constant  
               $T$  = absolute temperature

## D. PRESSURE LOSSES

There are two types of fluid losses in the ducting system, frictional and dynamic losses. Frictional losses occur along the walls of the entire duct length and are due to fluid viscosity. Dynamic losses result from disturbing the flow such as a change of direction, contraction, or expansion.

The Darcy-Weisbach equation (2.6) calculates the friction loss for straight ducts.

$$\text{Darcy-Weisbach equation } \Delta p_t = f (L/D) \frac{\rho V^2}{2 g_c} \quad (\text{eqn 2.6})$$

where  $\Delta p_t$  = friction loss  
in terms of total pressure

$f$  = friction factor

$L$  = duct length

$D$  = duct diameter or  
equivalent hydraulic diameter

$\frac{\rho V^2}{2 g_c}$  = velocity pressure

The friction factor,  $f$ , used in computing duct losses is taken from a correlation by Swamee and Jain presented in [Ref. 2].

$$10^{-6} \leq \frac{e}{D} \leq 10^{-2}$$

$$f = \frac{0.25}{\left[ \log \left( \frac{e}{3.7 D} + \frac{5.74}{R_e^{0.9}} \right)^2 \right]} \quad 5000 \leq R_e \leq 10^8 \quad (\text{eqn 2.7})$$

The absolute roughness factor,  $e$ , is taken to be 0.00015 feet for all air duct components. For rectangular straight duct sections the equivalent hydraulic diameter,  $D_e$ , is calculated by equation (2.8) presented in [Ref. 3]. Equations 2.6, 2.7, and 2.8 are utilized in the program for computing friction losses in the straight sections of the duct.

$$D_e = 1.30 \frac{(ab)^{0.625}}{(a+b)^{0.250}} \quad (\text{eqn 2.8})$$

Friction losses occur in all fittings not just in straight duct. There are two techniques to arrive at the friction losses in these other fittings. The decision about which technique to use depends on the whether the fitting is short or long. In short fittings friction is accounted for by measuring the connecting sections of straight duct to the center of the fitting. No attempt is made to include friction in the calculation of fluid resistance for a short fitting. Elbows are short fittings. For long fittings such as diffusers and contractions, friction is included in the computation of the flow resistance coefficient. Therefore, a connecting straight duct length should be measured to the center of an elbow or to the start or end of a diffuser or contraction.

Dynamic losses are sometimes called local or minor losses. In piping systems, losses due to the local disturbances of the flow are often called minor losses. In very long piping systems these losses are usually insignificant in comparison with the friction in the length considered. In the duct used for a gas turbine installation these so-called minor losses actually become major losses because of the short lengths usually encountered. Experimental results are almost always used to account for pressure losses through the duct fittings. Such information is usually given in the form of equation 2.9.

$$\Delta p_t = K \rho v^2 / 2 g_c \quad (\text{eqn 2.9})$$

The coefficient  $K$  is given for the fitting in numerous handbooks. Figure 2.1 shows some typical representations of the information available.

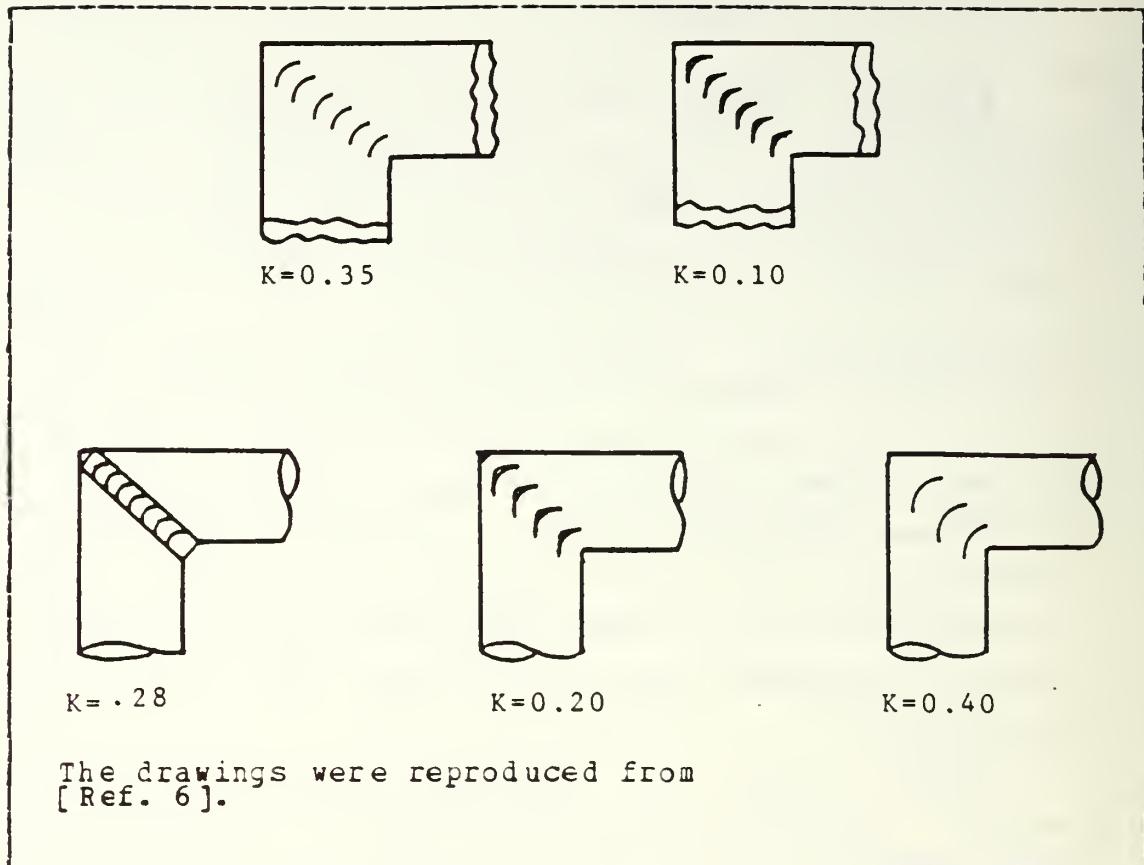


Figure 2.1 Typical K Values for Fittings.

One of the purposes of the program is to provide K coefficients for various fittings selected to represent duct components. K values can vary with the geometry of a fitting. For example, a long smooth radius rectangular elbow has a lower K value than a short smooth radius rectangular elbow. The program takes this into account and is the reason for the various questions about a fitting's geometry in the area of the program where the user is inputting the duct system.

Two fittings in the program's menu do not require geometry inputs to obtain resistance information. The two fittings are filters and the gas turbine module. The reason

for the lack of questions is that the losses are based on manufacturer's data. Filter manufacturers provide pressure loss data based on face velocity and the module is based on the mass flow rate of cooling air. A power curve fits the data and the program uses the curve to model pressure losses for these fittings.

Table I summarizes the fittings available from the program's menu. The fluid resistance coefficients are computed by the program upon input of the required geometry factors for the fitting. Input of the duct fittings is accomplished interactively. The source of the model for each fitting is noted in the program listing in the title block of the fitting subroutine. The program subroutines FIT01 through FIT29 correspond to the fittings listed in table I . A sketch of each fitting is provided in the user's manual for the program. The user's manual is Appendix C.

#### E. GAS TURBINE/SYSTEM INTERFACE

General Electric Company, the manufacturer of the LM2500 marine gas turbine, publishes performance data for its engine under variable operating conditions. [Ref. 4]. It is important to understand how the shipboard engine is operated under variable operating conditions such as duct losses and ambient temperature , pressure and humidity so that the proper corrections may be applied to the engine performance parameters for these variables.

TABLE I  
Fittings Available From Program Menu

<u>Fitting Number</u>	<u>Description</u>
01	Intake shaft, rectangular cross section, side orifices, with or without louvers
02	Straight duct, round or rectangular
03	Smooth radius round elbow
04	Round 90 degree segmented elbow with 3,4, or 5 pieces
05	Mitered round elbow with or without concentric vanes
06	Mitered rectangular elbow
07	Smooth radius rectangular elbow
08	Smooth radius rectangular elbow with splitters
09	Mitered rectangular elbow with vanes
10	Rectangular elbow with converging or diverging flow
11	90 degree rectangular elbows in a Z-shaped configuration
12	90 degree rectangular elbows in different planes
13	Branch section of a diverging wye
14	Main section of a diverging wye
15	Branch section of a convergent wye
16	Main section of a convergent wye
17	Conical round diffuser
18	Plane in-line diffuser
19	Pyramidal in-line diffuser
20	Transitional diffuser
21	Round contraction
22	Rectangular contraction
23	Screen obstruction in duct
24	Louver entrance

continued next page

25	Filter element
26	Multi-baffle type silencer
27	Gas turbine module enclosure
28	Waste heat recovery boiler
29	Abrupt exit
30	Fitting not listed

From the shipboard operator's point of view the engine should drive the ship at the desired speed whether it is a hot day or a cold day, or if the inlet duct losses are four inches of water or eight. The engine is operating differently under such conditions to produce the same horsepower and speed. The proper correction factor set to be applied to the tabulated data is the set for constant speed and horsepower. The corrections are applied in the program with each iteration of the duct system performance calculations using the current values of the inlet and exhaust duct losses and ambient conditions. The corrections are very small (less than two percent) and the convergence of the correct engine operating point and duct losses created by the mass flow of air required at the operating point is quite stable.

#### F. FAN/SYSTEM INTERFACE

The operating point of the fan installed in a duct system is the point where the fan characteristic curve intersects the system characteristic curve. The fan curve shows pressure rise vs. flow rate. With increasing flow the pressure rise across the fan is reduced. The system curve is the opposite, increasing flow in the system increases the resistance to flow. Figure 2.2 represents this situation graphically.

In the iteration process the system curve is estimated as a quadratic fitted to the origin as a minimum point and the other point at the assumed flow and the resulting pressure loss. Similarly the fan curve is also represented as a quadratic with a maximum at maximum pressure attainable and the corresponding flow and another point at zero pressure and maximum flow. The representation of the fan performance for the default condition, the Spruance class destroyer module cooling fan, is excellent. With an equation for both curves the point of intersection can be obtained. The resulting flow is used in the next iteration until the resistance of the system and the pressure rise across the fan is the same for the assumed flow.

#### G. JUNCTIONS OR WYES

An excellent discussion of the mixing of two streams moving at different velocities was written by Idel'chik and is presented here to develop the background for the eductor/system interface discussion.

The junction of two parallel streams moving at different velocities is characterized by turbulent mixing of the streams, accompanied by pressure losses. In the course of this mixing an exchange of the momentum takes place between the particles moving at different velocities, finally resulting in the equilibration of the velocity distributions in the common stream. The jet with higher velocity loses a part of its kinetic energy by transmitting it to the slower jet.

The loss in total pressure before and after mixing is always large and positive for the higher-velocity jet, and increases with an increase in the amount of energy transmitted to the lower velocity jet. Consequently, the resistance coefficient, which is defined as the ratio of the difference of total pressure to the mean dynamic pressure in the given section, will likewise always be positive. As to the lower-velocity jet, the energy stored in it increases as a result of mixing. The loss in total pressure and the resistance coefficient can, therefore, also have negative values for the lower-velocity jet [Ref. 5].

The program incorporates this concept at the junction of the module cooling air and the engine exhaust (if the system is so configured). The program assumes the lower velocity jet

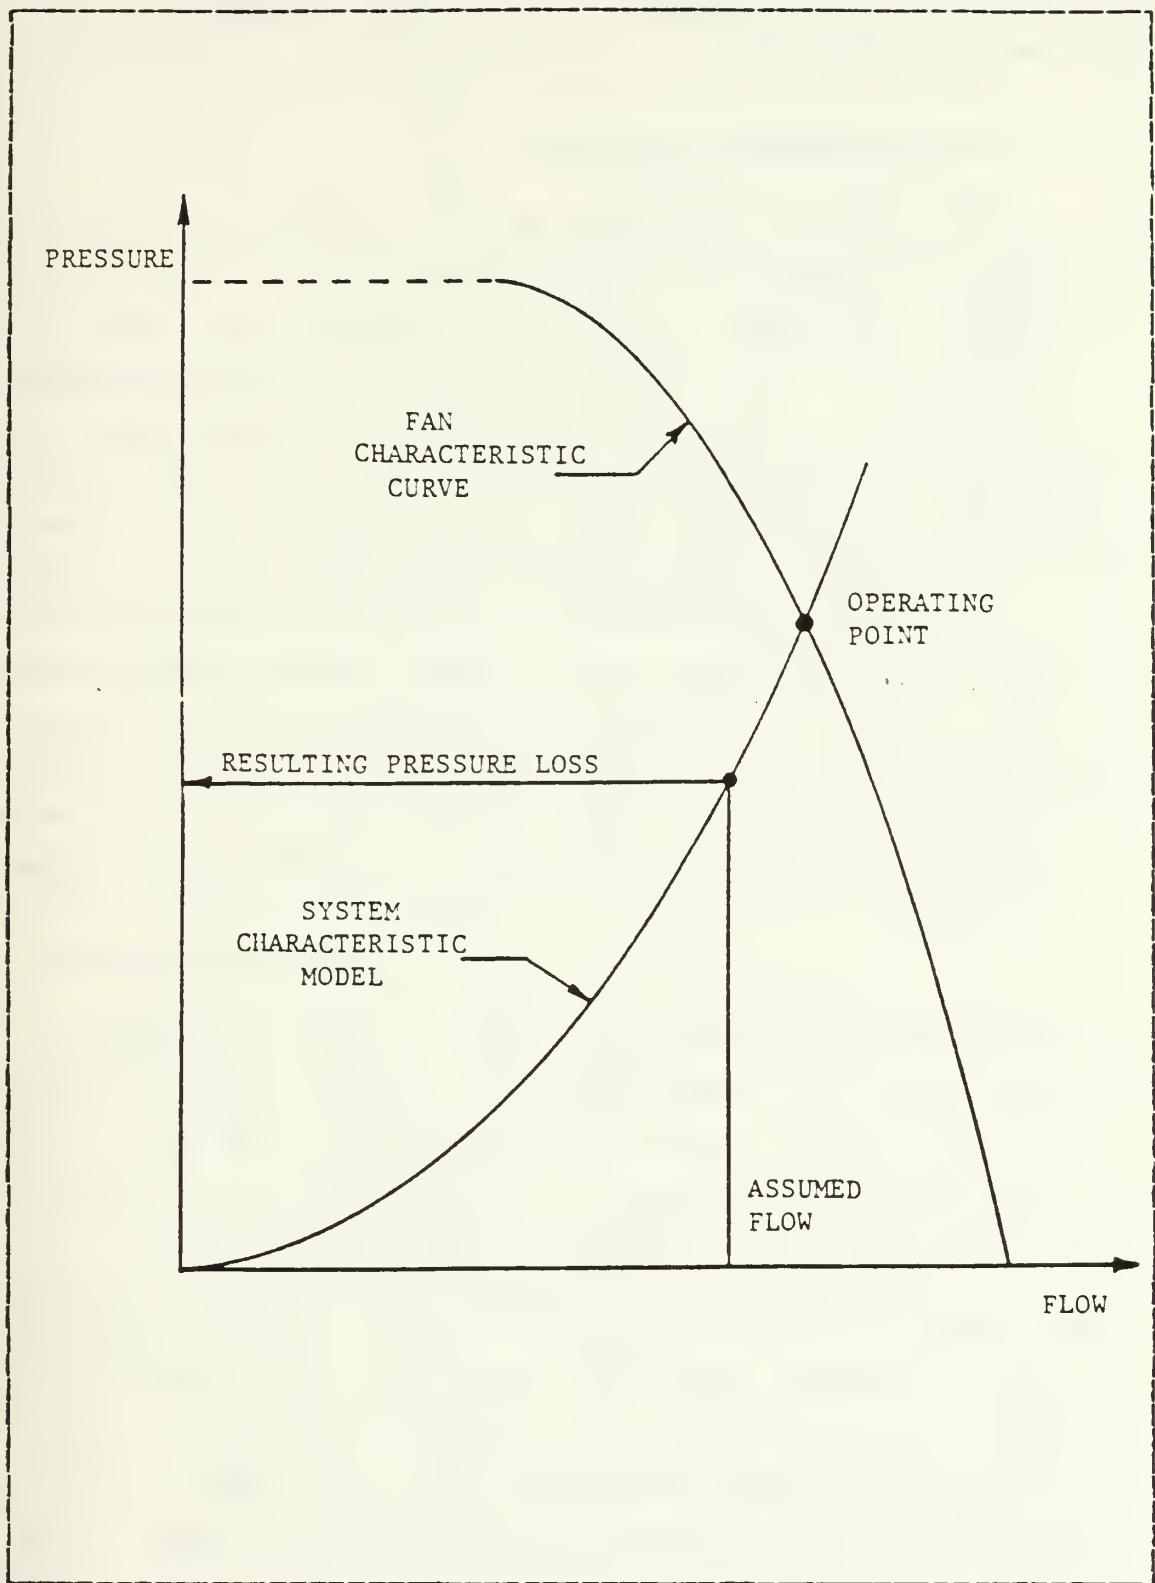


Figure 2.2 Fan/System Interface.

to be the cooling flow and the higher velocity jet to be the exhaust flow.

#### H. EDUCTOR/SYSTEM INTERFACE

The eductor discussed in this section is used in the engine's exhaust to move cooling air through the cooling ducting and engine enclosure. There is a mixing of the cooling flow and exhaust before it is discharged to the atmosphere. This section does not discuss the eductor installed at the exhaust duct exit. The only component of interest there is the nozzle as a dynamic loss. The effect of the external mixing tube is small and can be neglected.

The module cooling eductor is used on the Oliver Hazard Perry class frigate. It is shown schematically in figure 2.3. The eductor system is illustrated in figure 2.4. This figure shows the geometry and pressure distribution during the mixing of primary flow, engine exhaust, and the secondary flow, module cooling flow. A match point concept can be developed for the eductor much like the fan and system interface concept shown in figure 2.2. One curve is called the gain required and the other the gain available. These curves are shown in figure 2.5. Given the geometry of the mixing area the gain available can be computed by varying the cooling flow while the primary flow, the engine exhaust, remains nearly constant for the desired power setting. The gain available is a maximum at zero cooling flow.

The gain required is computed by dividing the system at the eductor and is analogous to the system characteristic model in figure 2.2. On the downstream side cooling and engine exhaust flows move through the exhaust duct. The cooling flow moves through the upstream duct. Total pressure losses can be computed for both and the sum is the gain required. Since these computations are taking place at

nearly constant primary flow, engine exhaust, the gain required at an operating point is a function of the cooling flow. The gain required at zero cooling flow is the exhaust duct pressure loss under the flow condition represented by the engine exhaust alone. Increasing the cooling flow increases the losses in the exhaust duct and also brings to bear losses in the cooling duct. Therefore the required gain is a minimum at zero cooling flow and increases with increasing cooling flow.

There must be an intersection of the gain required curve and the gain available curve if the system is to operate. This condition occurs if the gain available at zero cooling flow is greater than the gain required at zero cooling flow. The intersection must also be far enough to the right to provide the minimum cooling requirement for the load on the engine. The matching technique is to begin with some minimum cooling flow as specified by the engine manufacturer and march to the right adding a small increment to the cooling flow until gain required equals gain available.

## I. SYSTEM ANALYSIS

Sections of the intake and exhaust ductwork will be analyzed from node to node resulting in the pressure loss for the section. The sections will be called branches. A node is the starting or ending point of a branch. The fittings of a branch will be entered into the program in the sequence encountered by the flow along a branch. A node is an entry, diverging wye, fan, the gas turbine engine (not to be confused with the engine enclosure), convergent wye, or an exit. Figure 2.6 shows the six resulting schematic representations of a gas turbine installation and the variations of cooling flow available. The numbered dots are the nodes. Node 1 is always the main inlet entrance. Node 3 is

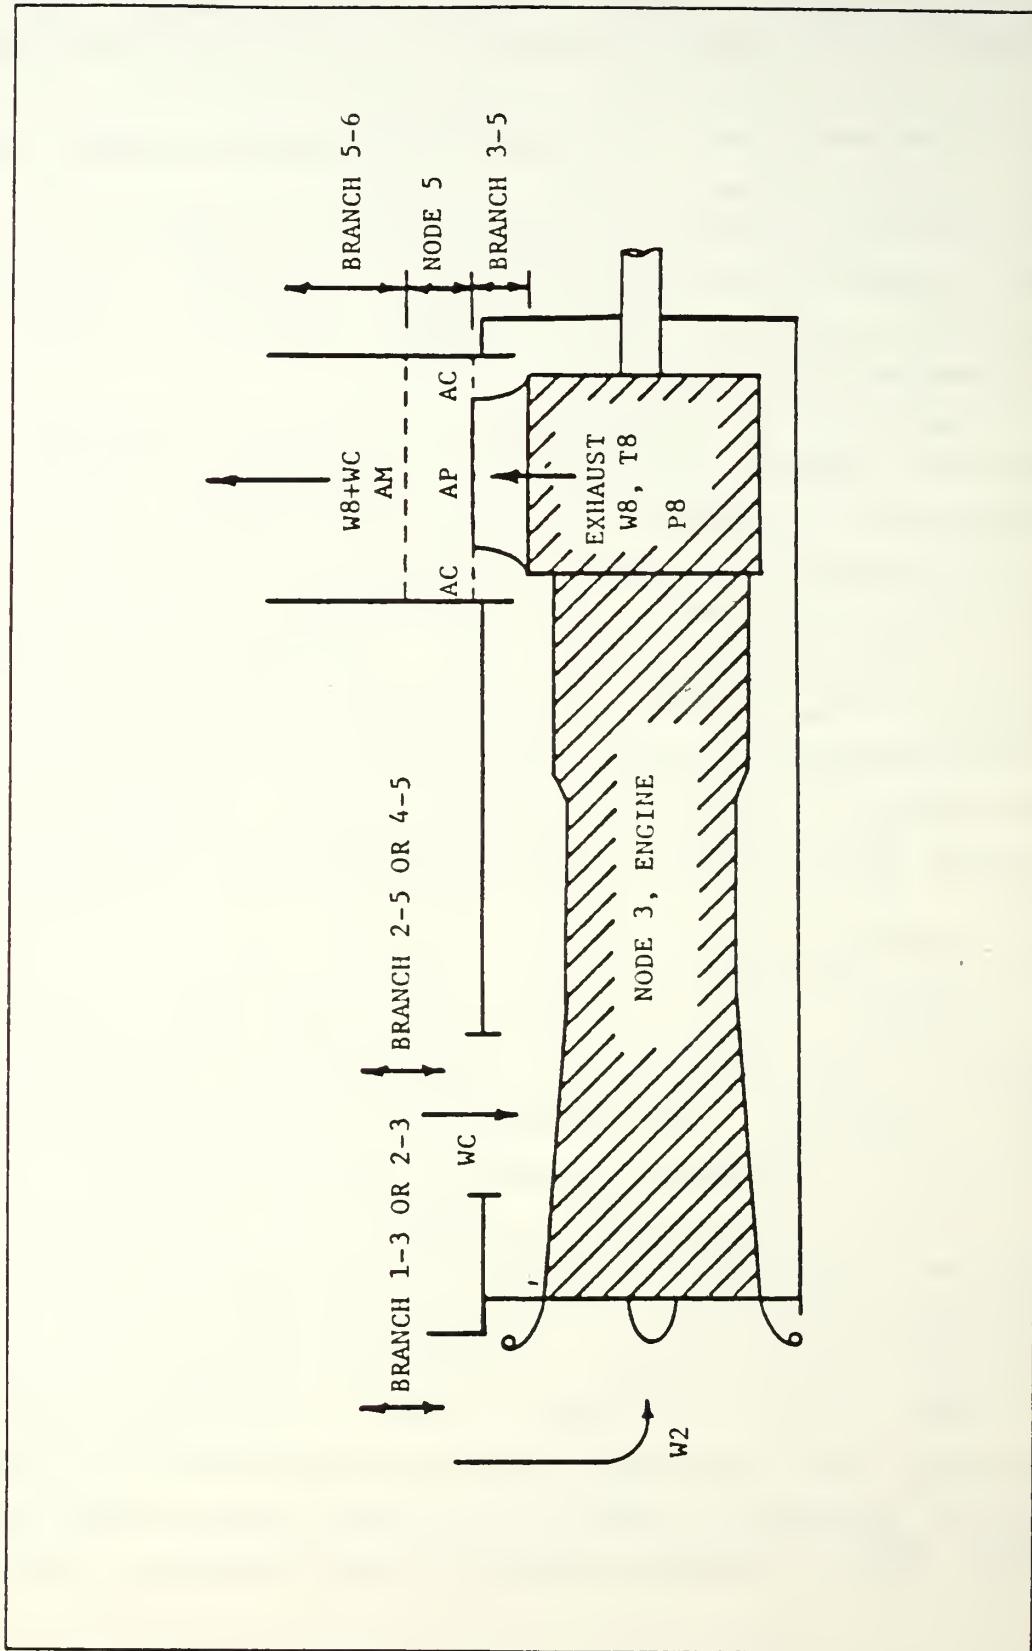


Figure 2.3 Module Cooling Eductor Schematic.

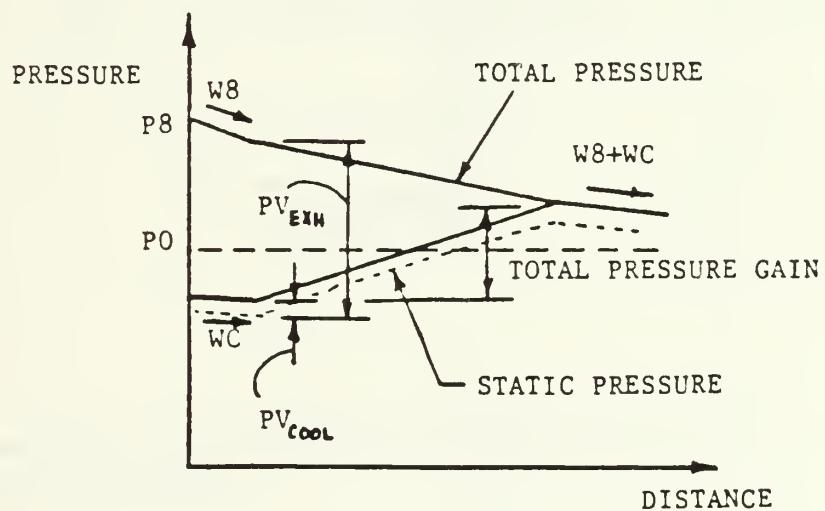
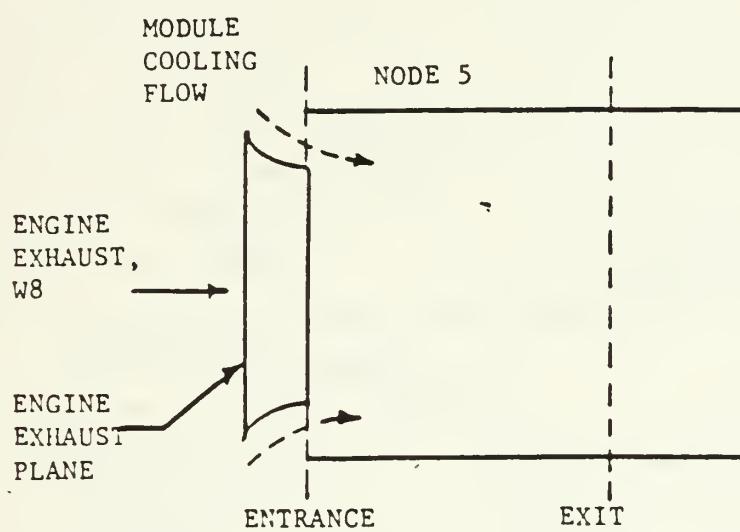


Figure 2.4 Module Eductor Performance.

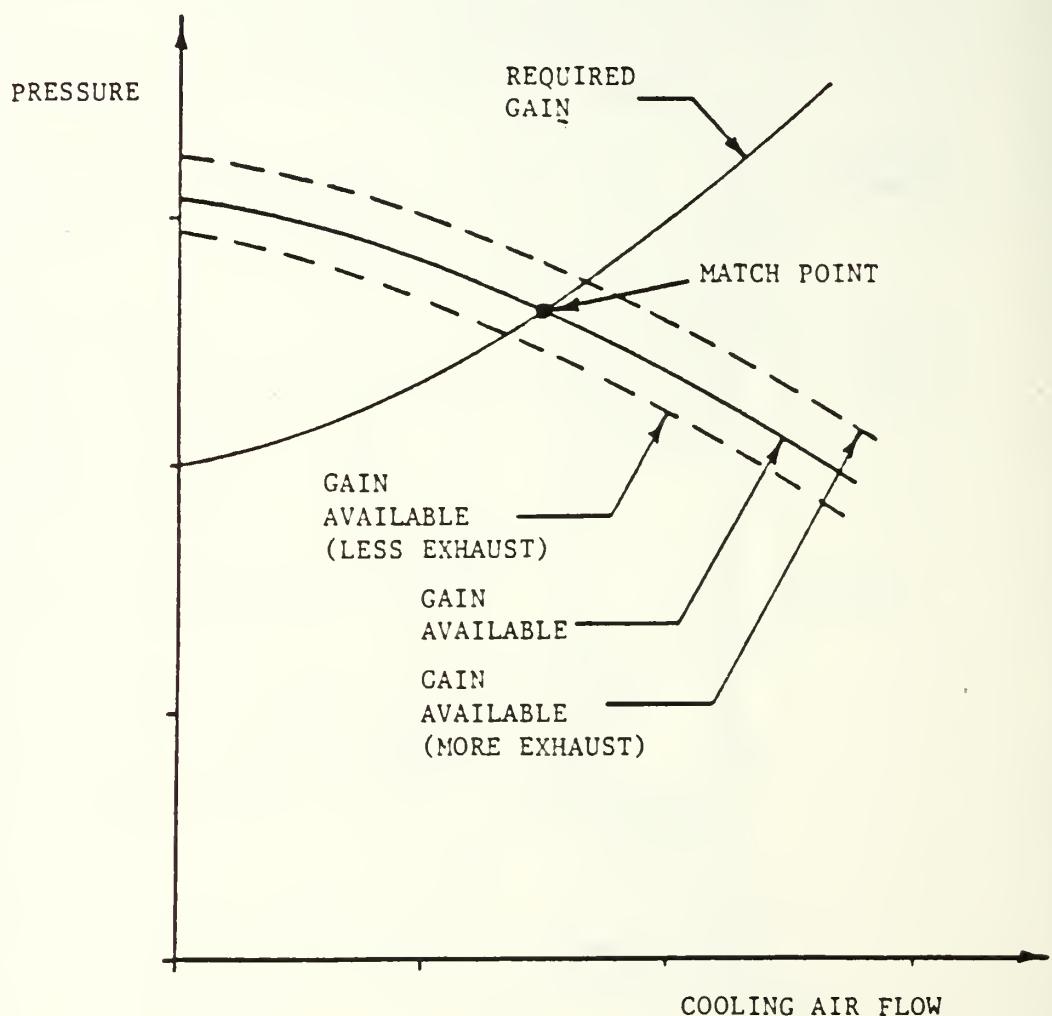


Figure 2.5 Eductor/System Interface.

always the engine. Node 4 is always the cooling fan. Node 6 is always the main exhaust exit. Node 2 may be either an independent entry for the cooling flow or the branch location where the cooling flow diverges from the combined inlet. Node 5 may be either an independent exit for the cooling flow or the junction of cooling flow with the engine exhaust. The hashed area is the engine and the larger rectangle represents the engine module which surrounds the engine and is a fitting in the cooling flow branch. The branches are designated by the node number at the beginning and end of the branch. The reader should refer to the user's manual for a complete description of entry of the fittings into the program.

The system in figure 1.1 would be a class three system. It has the cooling flow branching off the main inlet (divergent wye) and joining the main exhaust near the exhaust exit plane of the engine (convergent wye). It also has a fan installed which differentiates it from the class five system.

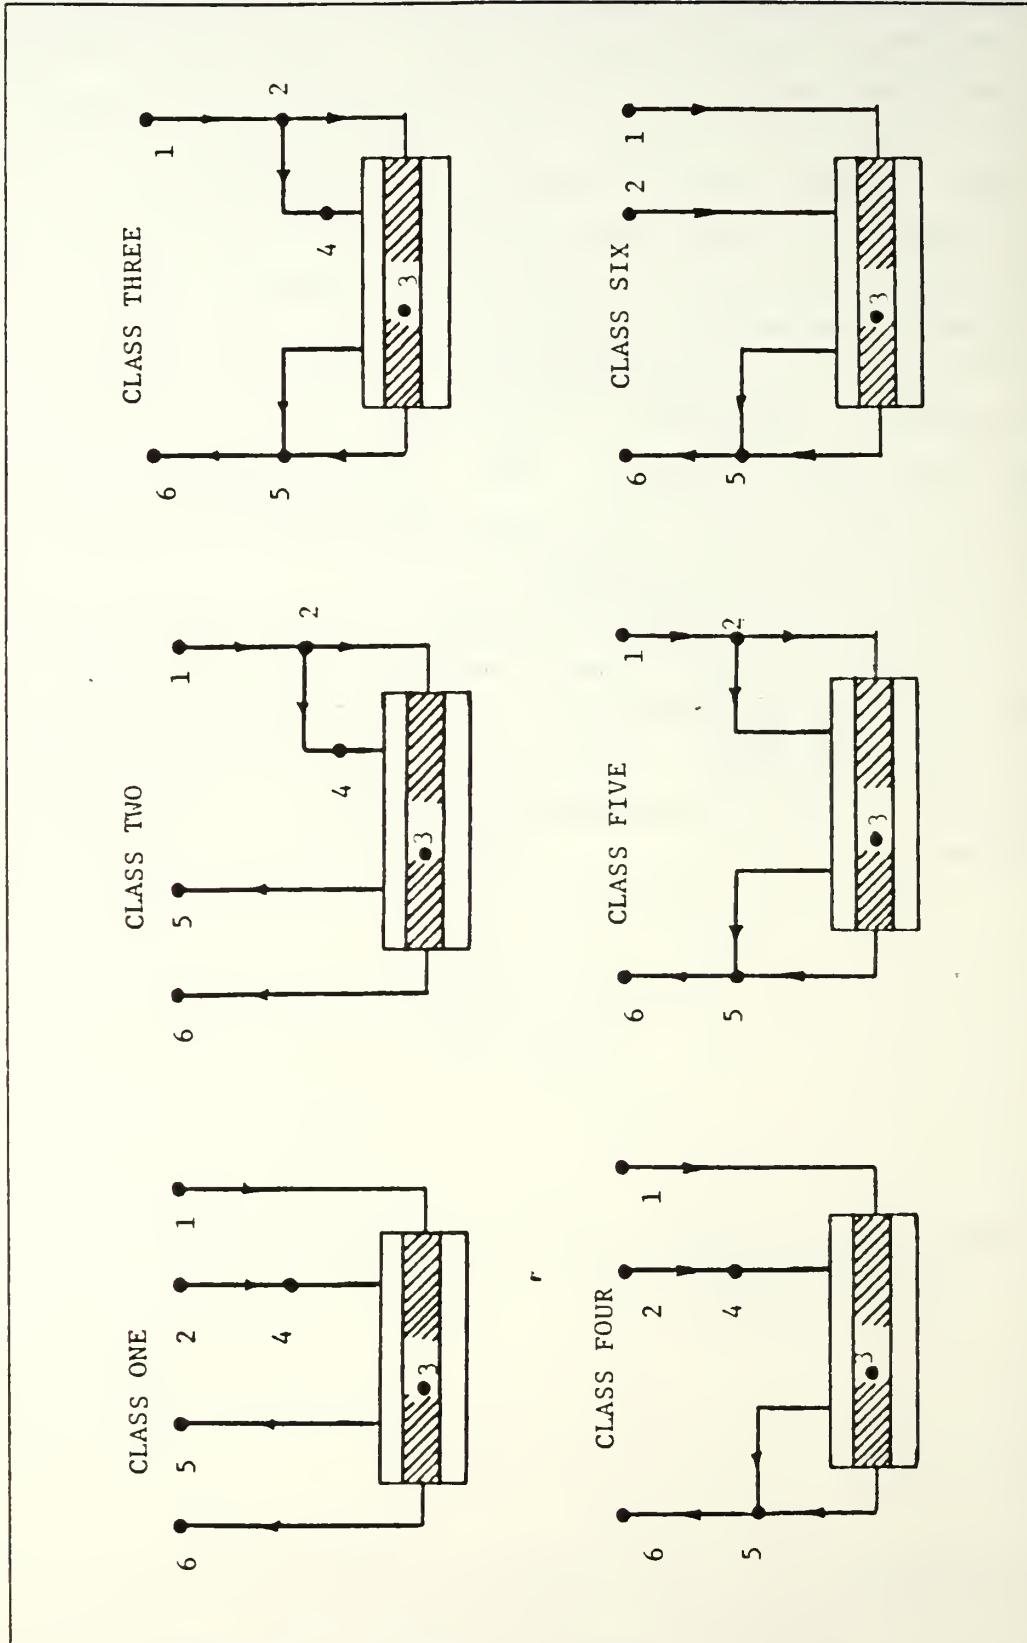


Figure 2.6 System Arrangements and Their Classification.

The basic procedure for system analysis is to assume enough flow and loss information to proceed with the analysis and check the assumptions with continuity of pressure at the nodes with each iteration. If the pressures do not match, new assumptions are made based on the current performance and the iteration is continued until convergence is achieved.

With six different types of systems to match, six different schemes must be implemented in the computer code to handle overall system matching. Each scheme must be tailored to handle the expected components that make it different from any other system. For example, system six has no cooling fan and system one does. System one needs to consider the fan and system interface but system six does not. Appendix A is the complete program listing. Appendix B contains a flow chart of the most complex system in the program, system three, and incorporates all possible component/system interfaces.

#### J. TOTAL PRESSURE GRADIENT

The total pressure changes represent the energy requirements of the system. Total pressure losses in the intake and exhaust ducts are inputs to the engine performance subroutine in the program and are used to determine the operating parameters of the engine. Fan and system matching is accomplished with the total pressure requirement. Therefore total pressure gradients in the ductwork are most important to analysis. Measurement on the other hand usually produces the static pressure gradient. The static pressure at a point is less than the total pressure at the point. Figure 2.7 shows a typical representation of the pressure changes during flow in a simple duct. Losses in a duct are due to the irreversible transformations of

mechanical energy into heat and the losses are used to plot the total pressure grade line. Note that some fittings such as diffusers and contractions cause a change in the static pressure quite different from the change in total pressure. This is a result of a change in the velocity pressure through a variable area fitting. The sample program output presented in the user's manual, appendix C, can be used to produce similar plots of the pressure grade line.

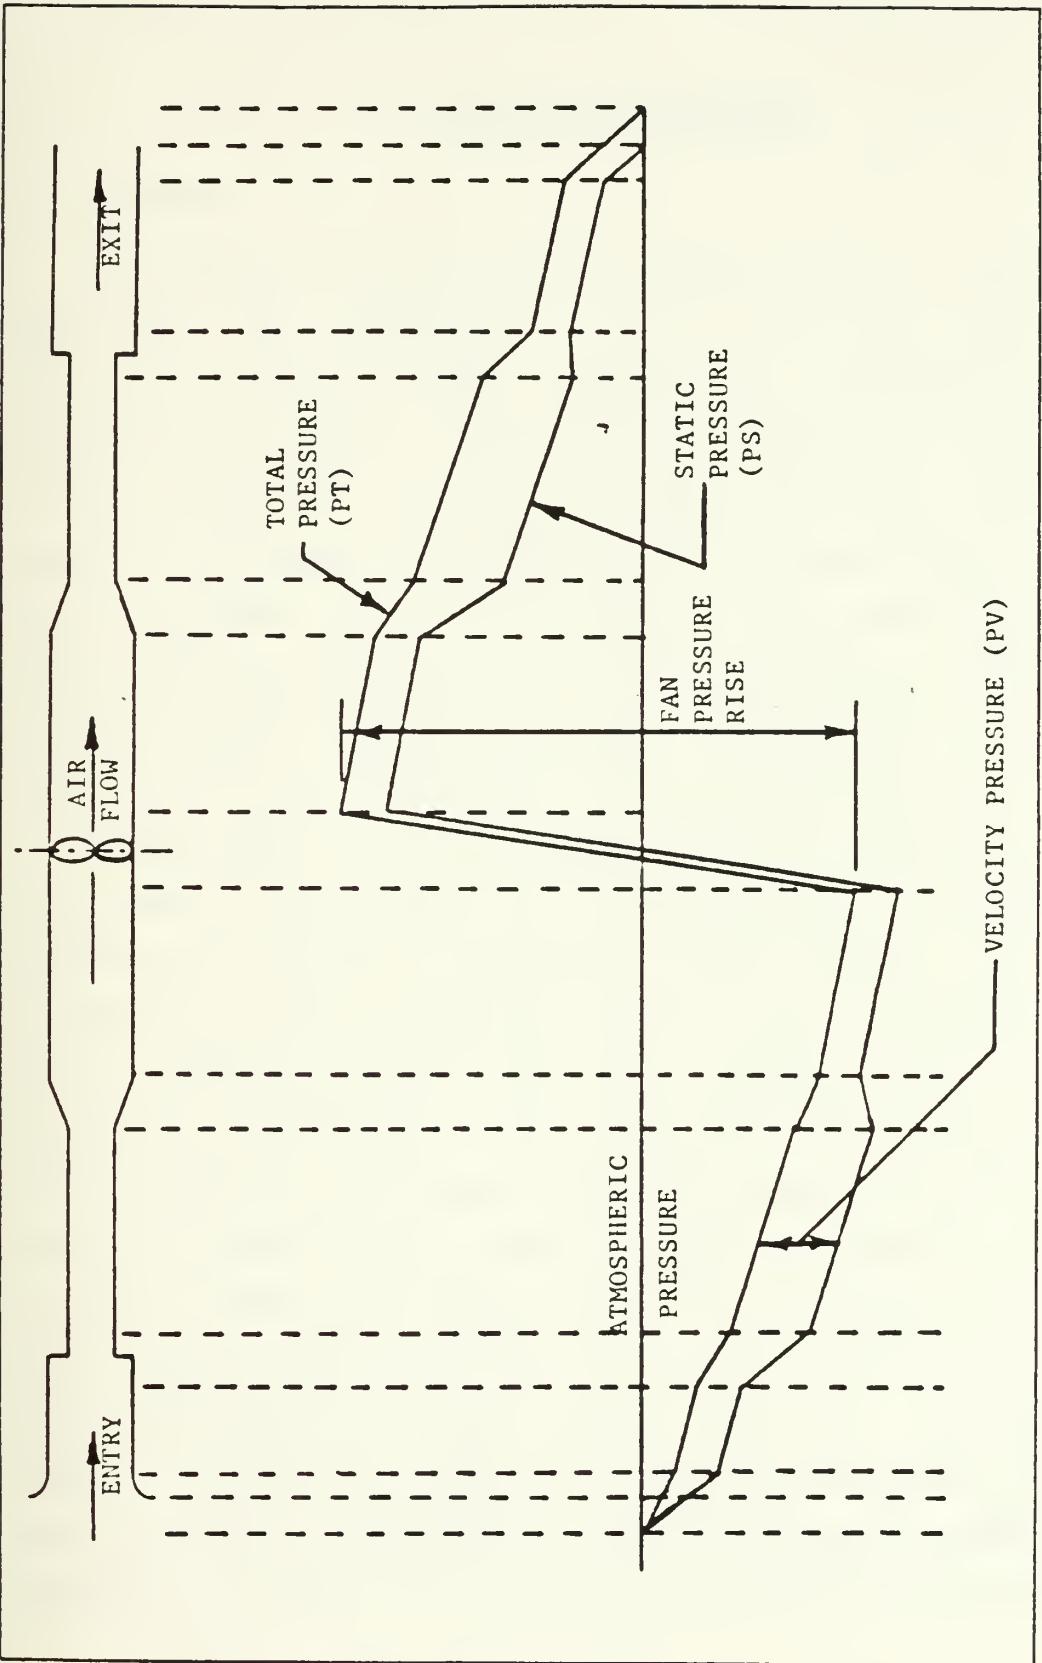


Figure 2.7 TYPICAL DUCT PRESSURE CHANGES.



### III. PROGRAM PROCEDURES

#### A. GENERAL

The purpose of the program prepared for this study is to translate the geometry of a gas turbine installation including inlet, exhaust, and cooling ducting into a one-dimensional problem to calculate the system's frictional and dynamic resistance to air flow and solve the problem for various operating conditions. The solution will include engine performance parameters such as specific fuel consumption, turbine inlet temperature, and mass flow rates. Additionally a summary of the duct system performance is given by pressure losses for each component and a summary of branch losses. Cooling air flow is predicted by matching the system and the installed fan or module eductor.

Interactive code is utilized for all program inputs. Any number of fittings and combinations of fittings may be selected to represent the user's current design. The system in figure 1.1 can be represented by fittings chosen from the menu. About 30 selections from the menu would be required to model the system. The type and number of selections depends on the system's configuration and complexity. Each fitting may have from one to seven questions posed interactively to establish the required geometry inputs. With the geometry known the program computes areas and coefficients necessary to perform the analysis. This data is stored in a file called duct data and may be saved for future program runs where geometry input is not required. The operating point is defined upon input of ambient temperature and pressure, humidity, horsepower, and power turbine speed. When combined with the duct data file the problem may be solved.

## B. INTERACTIVE CODE

Interactive code allows the user to sit at a computer terminal, access a desired program, specify inputs by typing at the terminal keyboard, and execute the program. All inputs are requested by statements appearing on the terminal screen. Resulting output is written to the user's files which may be viewed at the terminal or sent to the printer. The interactive mode of operation is especially valuable because it allows the user, by modifying selected input values, to quickly evaluate the effects of changes to an existing or contemplated design. Modification of a system is accomplished interactively within the editor portion of the program. The editor offers the ability to change a fitting. For example, a mitered round elbow could be modified to add cascaded turning vanes or a different elbow substituted entirely. Also offered is the ability to add or delete a fitting. The addition option does not allow the user to add a new first fitting to a branch, however one may be added anywhere else.

The most important consideration in writing an interactive computer program is what appears on the screen and how it appears. Requests for inputs are in English rather than engineering jargon. Units are all in the English system. All lengths are in feet, etc. All logical choices are accomplished by entry of one letter, the first letter of the choice. For example, "Y" is the reply for yes. All logical choice replies are indicated within parenthesis at the end of the question. Should the user not use one of the choices indicated, the question will be repeated until a proper response is given. Default values are available for many circumstances to minimize the input effort. A default is not available by simply depressing the return key. The user must elect default values by a logical choice. For example

the Hamilton Standard filter system installed on the Spruance class destroyer is available as a default for the filter fitting. The user selects this by answering affirmatively to a question asking if the user would like to use the default filter system.

### C. OTHER PROGRAM FEATURES

Another consideration in interactive computer programs is the practice of "user proofing" the inputs. In other words, an interactive computer program should not terminate execution (i.e., "crash") if an improper input value is inadvertently defined by the user. On numerical and logical input two features are incorporated to protect input to the program. First, read statements are protected with error and end of file detection. A problem with input here is handled by asking the user to re-enter the value. On numerical input if it happens again on the same question the program stops execution. Secondly, if an incorrect number is properly defined to the program in the geometry input phase, the user is offered one last chance to re-enter correct fitting data if the user realizes his mistake before he is asked if he wants to load the data for the fitting. The user is assisted here by a check for area continuity from one fitting to the next. A warning is provided if continuity is not maintained. Electing not to load a fitting brings the user back to the menu with the program ready to accept a choice of fittings for use instead of the erroneously entered fitting.

The program is modularized by the extensive use of subroutines. Modularization facilitates program improvements by allowing the upgrade and replacement of individual subroutines. This is a difficult procedure to do if common blocks are used. Therefore common blocks have been

eliminated from the program. The user may decide to change the fittings available in the menu, for example. Internal code documentation shows the areas that must be changed to accomplish this task.

Appendix C is a user's manual and completes the external program documentation. The manual explains how to execute the program as installed on the Naval Postgraduate School's IBM 3033 main frame computer and a smaller VAX computer. A sample case is described and sample output provided. A terminal session is also recorded to show typical screen displays.

## IV. RESULTS AND RECOMMENDATIONS

### A. GENERAL

It is now possible to analyze system performance of an ordinary marine gas turbine installation. Prior to the development of this program subsections of the system were analyzed and their interaction was neglected. This did not provide serious errors in the estimation of engine performance but it did not provide complete information on system performance. In particular, the prediction of cooling flow was not accurate. This was particularly acute when the system utilized a module eductor.

The process of manually assigning a resistance coefficient to a fitting has been eliminated. Now it is possible for the computer program to analyze the geometry of most fittings rapidly and apply the correct resistance coefficients for the one-dimensional analysis without the user looking up any correlations.

The program flexibility is demonstrated by the ability to quickly change input parameters and analyze a system at any operating point. Previous methods analyzed components at full power and then used a proportionality model where losses were proportional to the square of the engine air mass flow rate. This method consistently under-estimates duct losses at low power because it does not take into account the variation of cooling flow provided with an installed fan or module eductor. At low power the cooling flow can be a significant contributor to duct losses and the previous method can not predict this contribution.

## B. LIMITATIONS

It should be emphasized that any one-dimensional analysis does not handle flow distortion well. Suspected problems in this area are still best dealt with by the use of model studies. The limitation of a one-dimensional model is that a fitting's pressure loss may be known for uniform flow distribution, but it is difficult to predict the loss with distorted flow. It is known however that the distorted flow situation will have a larger pressure loss, but how much is not easily determined. A one-dimensional analysis may point to problems with flow distortion. The program recognizes the potential for flow distortion on certain fittings such as diffusers and points out this potential. If a fitting's pressure loss can vary significantly with distortion of flow and the one-dimensional analysis has computed a large pressure loss, the user should flag the fitting for further study by model testing as the pressure loss has probably been underestimated.

Not all possible duct designs can have their fittings modeled by the program. Some fittings will be available from the program menu and others will be similar to fittings listed, but not exactly. Then there are some which may not be listed at all. If the fitting is close, it may be used and expected to give reasonable results. If the fitting is not listed then the user must provide the resistance coefficient by using the "fitting not listed" choice. The data for this entry may come from a published correlation or from tests performed on similar installations. It is in the area of correlations where most benefit can be gained by program modification.

### C. RECOMMENDATIONS

The program currently runs as a stand alone program, but some increased utility may be realized by incorporating some of the subroutines in other programs which would then input a ship's horsepower and RPM requirements for an operating profile instead of point by point user input.

The General Electric LM2500 engine is currently the engine within the program. The engine performance in the program is built by table interpolation of the published performance data. General Electric also offers a program which provides performance data and it is recommended that this program be substituted for the engine subroutine currently in the program. This will eliminate any doubts about engine performance predictions and make the parameters more official. Also the General Electric program covers the complete performance map of the engine whereas the engine subroutine used in this analysis was limited to 22,500 horsepower maximum. There is still a little power left beyond this value and the program can not currently operate there. Another modification concerning the engine is improving the module temperature out model used in the FIIDP subroutine. The model used produces reasonable results but is not based on test data but on operator experience.

The biggest improvement in program performance and utility can be made by the incorporation of improved fitting flow resistance correlations of test data. Models and full scale systems should be instrumented to provide duct pressure loss data to check the program's analysis. Where the program prediction is not accurate new fitting correlations should be developed. Potential fittings for improved models are louvers, silencers, diffusers with distorted flow, junctions and wyes (especially where eductor action is desired), and boiler tube bundles. With sufficient data these

fittings could be modeled better and more simply. The overall objective is to increase both the utility and accuracy of the program analysis.

## APPENDIX A PROGRAM LISTING

```
***** ANALYTIC MODEL OF A GAS TURBINE INSTALLATION ON BOARD A SHIP ****
PROGRAM WRITTEN BY STEPHEN M. EZZELL, LCDR, USN
VERSION 1.0 DATE MARCH 30 1984
PURPOSE: TO ANALYZE THE DUCTING AND GAS TURBINE INSTALLATION
          AS MIGHT BE INSTALLED ON A SHIP. INPUT DUCT GEOMETRY,
          AMBIENT CONDITIONS, AND POWER SETTING TO GET PERFORMANCE
          PARAMETERS.

THIS IS THE MAIN CONTROL PROGRAM. ITS SOLE PURPOSE IS TO BRANCH
TO THE AREA OF THE PROGRAM YOU NEED. IF YOU ARE ANALYZING A NEW
SYSTEM YOU WILL NEED TO BUILD A DATA FILE FOR THE SYSTEM. YOU
WILL BE DIRECTED TO THE BUILD SUBROUTINE. IF YOU WANT TO MAKE
SOME CHANGES TO A SYSTEM YOU WILL GO TO THE EDIT SUBROUTINE.
WHEN YOU HAVE A DATA FILE YOU LIKE YOU WILL NEED TO GO TO
THE COMPUTE SUBROUTINE. IN THE COMPUTE SUBROUTINE YOUR DATA FILE
WILL BE READ AND THEN YOU WILL BE ASKED QUESTIONS TO ESTABLISH
THE OPERATING POINT. THEN THE PROGRAM WILL COMPUTE THE OPERATING
PARAMETERS YOU NEED AND OUTPUT THEM TO THE OUTPUT FILE.

NO COMPUTATIONS ARE DONE IN THE MAIN CONTROL PROGRAM.

SUBROUTINES CALLED: BUILD, EDIT, COMPUT, AND FRTCMS

A NOTE ABOUT FRTCMS. YOU WILL NOT FIND IT IN THE LISTING. IT IS
LIBRARY SUBROUTINE AVAILABLE AT NPS AND IS USED TO CALL THE
OPERATING SYSTEM FROM WITHIN THE FORTRAN PROGRAM. I USE IT FOR
TWO PURPOSES. FIRST TO DEFINE MY FILES. SECOND TO CLEAR THE
SCREEN AT YOUR TERMINAL SO THE WRITE FORMATS DON'T GET CHOPPED
UP. IF YOUR SYSTEM DOES NOT HAVE THIS CAPABILITY YOU WILL HAVE
TO SUBSTITUTE AN APPROPRIATE CODE TO ACCOMPLISH THE SAME THINGS.
THIS NOTE APPLIES TO THE IBM 3033 COMPUTER.

*****
```

INTEGER ANS,YES,NO,COMPUT,EDIT,QUIT  
DATA YES/'Y'/,NO/'N'/,COMPUT/'C'/,EDIT/'E'/,QUIT/'Q'/

NPS IBM 3033 MAIN FRAME COMPUTER PROGRAM REQUIREMENTS

HERE IS WHERE I SET UP THE FILE DEFINITIONS USING THE LIBRARY  
SUBROUTINE "FRTCMS". THERE ARE NO OTHER FILEDEF'S REQUIRED.

READING TERMINAL INPUT  
CALL FRTCMS ('FILEDEF ','05 ','TERMINAL')  
WRITING TO THE TERMINAL  
CALL FRTCMS ('FILEDEF ','06 ','TERMINAL')  
STORAGE FILE FOR THE DUCT GEOMETRY DEPENDENT VARIABLES  
CALL FRTCMS ('FILEDEF ','08 ','DISK ','DUCT ',  
+ 'DATA ')  
+ STCPAGE FILE FOR THE PERFORMANCE DATA OUTPUT  
CALL FRTCMS ('FILEDEF ','04 ','DISK ','OUTPUT ',  
+ 'DATA ')  
+ CALL FRTCMS ('CLRSRN ')  
10 INTRODUCTION. IS THERE A DUCT DATA FILE ???  
 WRITE (6,600)  
  
EVERY READ IS PROTECTED AGAINST A NULL ENTRY AND AN ERROR IN  
INPUT. THIS IS ACCOMPLISHED WITH "END=XX,ERR=XX". YOUR SYSTEM  
MAY NOT HAVE THIS CAPABILITY. IN WHICH CASE DELETE IT OR  
SUBSTITUTE AND EQUIVALENT CODE.  
  
READ (5,601,END=12,ERR=12) ANS  
CALL FRTCMS ('CLRSRN ')

```

C      EVERY QUESTION REPLY IS CHECKED TO MAKE SURE ONE OF THE ALLOWED
C      RESPONSES WAS USED, IF NOT THE USER IS WARNED AND ASKED TO
C      ANSWER WITH ONE OF THE CORRECT RESPONSES.
C
12     IF ((ANS.EQ.YES).OR.(ANS.EQ.NO)) GO TO 20
      REWIND 5
      WRITE (6,602)
      GO TO 10
20     CONTINUE
      IF (ANS.EQ.YES) GO TO 30
      IF (ANS.EQ.NO) GO TO 50
C
C      DO YOU WANT TO COMPUTE OR EDIT THE DATA FILE ??????
C
30     WRITE (6,603)
      READ (5,601,END=32,ERR=32) ANS
      IF ((ANS.EQ.COMPUT).OR.(ANS.EQ.EDIT)) GO TO 40
32     REWIND 5
      WRITE (6,602)
      GO TO 30
40     CONTINUE
      IF (ANS.EQ.COMPUT) GO TO 80
      IF (ANS.EQ.EDIT) GO TO 110
C
50     CALL BUILD
C
60     WRITE (6,604)
      READ (5,601,END=62,ERR=62) ANS
      CALL PR1CMS ('CLRSCRN ')
      IF ((ANS.EQ.COMPUT).OR.(ANS.EQ.QUIT)) GO TO 70
62     REWIND 5
      WRITE (6,602)
      GO TO 60
70     CONTINUE
      IF (ANS.EQ.COMPUT) GO TO 30
      IF (ANS.EQ.QUIT) GO TO 999
C
80     CALL COMP
C
90     WRITE (6,605)
      READ (5,601,END=92,ERR=92) ANS
      IF ((ANS.EQ.EDIT).OR.(ANS.EQ.QUIT)) GO TO 100
92     REWIND 5
      WRITE (6,602)
      GO TO 90
100    CONTINUE
      IF (ANS.EQ.EDIT) GO TO 110
      IF (ANS.EQ.QUIT) GO TO 999
C
110    CALL ED
C
      GO TO 60
999    CONTINUE
600    FORMAT ('', A ONE-DIMENSIONAL MODEL FOR THE SYSTEM PERFORMANCE//'
           +'          OF A MARINE GAS TURBINE INSTALLATION//'
           +'          BY LCDR. STEPHEN J. EZZELL//'
           +'          VERSION 1.0 MARCH 30 1984//'
           +'          OPTIONS: BUILD A DATA FILE REPRESENTING THE DUCT SYSTEM//'
           +'          EDIT OR CHANGE THE DUCT DATA FILE//'
           +'          COMPUTE SYSTEM PERFORMANCE//'
           +'          METHOD: INTERACTIVE INPUT OF DATA, BRANCHING TO DESIRED//'
           +'          OPTION BY ANSWERING QUESTIONS//'
           +'          *** WARNING, TWO NULL ENTRIES ON NUMERICAL INPUT WILL ***//'
           +'          *** KILL THE PROGRAM. ***//'
           +'          FIRST QUESTION://'
           +'          DO YOU HAVE A DATA FILE OF DUCT FITTINGS (Y/N)?')
601    FORMAT (A1)
602    FORMAT (' YOU MUST ENTER THE LETTER INDICATED IN THE BRACKETS//'

```

```
603  * FORMAT(//,*) FOR A PROPER ANSWER !!!!!!!)
604  * {E/C?})
605  FORMAT (: DO YOU WANT TO COMPUTE WITH THE FILE OR QUIT (C/Q)?:)
      STOP
      END
```

```

***** BUILD SUBROUTINE: INPUTS GEOMETRY OF DUCT & OUTPUTS DUCT DATA *****
***** GO GET THIS GOING THE DUCT SYSTEM YOU ARE WORKING WITH NEEDS TO *****
***** BE CLASSIFIED. SYSTEM SUBROUTINE DOES THIS. WITH THE CLASS OF *****
***** THE SYSTEM KNOWN, IDENTIFICATION NUMBERS ARE ASSIGNED. THE MENU *****
***** IS CALLED UP AND FITTINGS ARE ENTERED FOR THE SYSTEM TO A FILE *****
***** NAMED DUCT DATA. THE DUCT DATA FILE WILL BE SERIALIZED BY THE *****
***** USER WITH A SIX DIGIT NUMBER OF THE USER'S CHOICE. *****
*****
VARIABLES: WKI AND WKR ARE TRANSPORT ARRAYS USED TO FILL THE
SYSTEM ARRAYS WORKI AND WORKR. WORKI(NNN,1) IS THE
ID NUMBER, AND WORKI(NNN,2) IS THE FITTING TYPE.
WORKR STORES FITTING DATA SUCH AS LENGTHS, AREAS, AND
RATIOS.

***** SUBROUTINE BUILD *****
REAL WKI,WKR
INTEGER SORL,WKI,WORKI,TERM,TYPE,BRANCH,FITID,GEOM,DUMMY,M,CLASS
DIMENSION GEOM(6),WKI(2),WKR(4),WORKI(200,2),WORKR(200,4)

C INST FINDS OUT IF YOU WANT LONG OR SHORT INSTRUCTIONS
CALL INST(SORL,TERM)

C SYSTEM CLASSIFIES THE SYSTEM TO ONE OF SIX POSSIBLE SYSTEMS
CALL SYSTEM(SCSI,CLASS)
GO TO (1,2,3,4,5,6),CLASS

C GEOM IS THE IDENTIFICATION NUMBER TO BE USED WITH THE FITTING.
C IT IS BROKEN UP INTO FOUR PARTS. THE FIRST DIGIT IS THE SYSTEM
C CLASSIFICATION, 1,2,3,4,5 OR 6. THE NEXT TWO DIGITS ARE THE
C STARTING NODE AND THE FINISHING NODE OF THE BRANCH. THE NEXT
C DIGIT IS THE FLOW IN THE BRANCH, ZERO IS COOLING FLOW, ONE IS
C ENGINE FLOW, TWO IS COMBINED COOLING AND ENGINE FLOW. THE LAST
C TWO DIGITS ARE FOR THE ORDER NUMBER OF THE FITTING IN THE BRANCH.

EXAMPLE: 113101 SYSTEM ONE, NODE ONE TO THREE, ENGINE FLOW,
FIRST FITTING IN BRANCH

1
GEOM(1)=113101
GEOM(2)=124001
GEOM(3)=136101
GEOM(4)=145001
BRANCH=4
CALL FRICMS ('CLRSCRN ')
WRITE(6,600)
GO TO 15
2
GEOM(1)=212201
GEOM(2)=223101
GEOM(3)=224001
GEOM(4)=236101
GEOM(5)=245001
BRANCH=5
CALL FRICMS ('CLRSCRN ')
WRITE(6,601)
GO TO 15
3
GEOM(1)=312201
GEOM(2)=323101
GEOM(3)=324001
GEOM(4)=335101
GEOM(5)=345001
GEOM(6)=356201
BRANCH=6
CALL FRICMS ('CLRSCRN ')
WRITE(6,602)
GO TO 16

```

```

4      GECM(1)=413101
GECM(2)=424001
GECM(3)=435101
GECM(4)=4445001
GECM(5)=456201
BRANCH=5
CALL FRTCMS ('CLRSCRN ')
WRITE(6,603)
GO TO 10
5      GECM(1)=512201
GECM(2)=523101
GECM(3)=525031
GECM(4)=535101
GECM(5)=556201
BRANCH=5
CALL FRTCMS ('CLRSCRN ')
WRITE(6,604)
GO TO 15
6      GECM(1)=613101
GECM(2)=625001
GECM(3)=635101
GECM(4)=656201
BRANCH=4
CALL FRTCMS ('CLRSCRN ')
WRITE(6,605)
CONTINUE
M=0
WRITE(6,606)

C      READI IS AN INTEGER READ SUBROUTINE TO PROTECT THE PROGRAM FROM
C      CRASHING ON NULL INPUT OR ERROR INPUT. IT ALSO ALLOWS FREE
C      FORMAT INPUT.
C
C      CALL READI(DUMMY,5)
CALL FRTCMS('CLRSCRN ')

C      NOW EACH BRANCH WILL BE FILLED UP WITH THE FITTINGS. BRANCHES
C      ARE TAKEN IN NUMERICALLY ASCENDING ORDER.

20     DO 40 I=1,ERANCH
      CALL MENU(1,TERM,TYPE,GEOM(I))
      THE MENU CHOICES ARE 0 THRU 30. CHANGE THE NUMBER OF FITTINGS
      AND YOU MUST CHANGE THE FOLLOWING IF CONDITION ACCORDINGLY
      IF ((TYPE.EQ.0).AND.(TYPE.LT.31)) GO TO 30
      CALL FRTCMS('CLRSCRN ')
      WRITE(6,607)
      GO TO 20
C      ZERO MEANS NO MORE FITTINGS THIS BRANCH
30     IF (TYPE.EQ.0) GO TO 40
      M=M+1

C      A FITTING HAS BEEN SELECTED, NOW GO TO THE BRANCHING SUBROUTINE
C      TO ENTER THE FITTING.
C
      CALL SELECT (M,SORL,GEOM(I),TYPE,WORKI,WORKR)
      CALL FRTCMS ('CLRSCRN ')
      GEOM(I)=GEOM(I)+1
      GO TO 20
40     CONTINUE

C      ALL THE FITTINGS HAVE BEEN ENTERED AND THE DATA FILE IS ABOUT
C      TO BE WRITTEN.
C      CALL SUMOUT(WORKI,WORKR,M)
600     FORMAT(' SYSTEM IS CLASS ONE, SEPARATE ENGINE/COOLING FLOWS. ')
      +' YOU WILL BE ENTERING FITTINGS FOR FOUR BRANCHES.'
      +' 1. ENGINE INLET TO THE ENGINE.'
      +' 2. COOLING INLET TO THE COOLING FAN.'
      +' 3. ENGINE EXHAUST TO THE ATMOSPHERE.'
      +' 4. COOLING FAN EXHAUST TO THE ATMOSPHERE, VIA GT MODULE.')

```

```

601 FORMAT(' SYSTEM IS CLASS TWO; COMBINED INLET FCR ENGINE AND '
+ COOLING FLOW AND SEPARATE FLOWS FOR ENGINE EXHAUST AND MODULE '
+ COOLING HOT EXHAUST. YOU WILL BE ENTERING FITTINGS FOR FIVE '
+ BRANCHES.')
+   1. COMBINED INLET TO THE COMBINED SECTION OF A DIVERGENT WYE
+   2. MAIN SECTION OF A DIVERGENT WYE TO THE ENGINE.
+   3. BRANCH SECTION OF THE DIVERGENT WYE TO THE COOLING PAN.
+   4. ENGINE EXHAUST TO ATMOSPHERE.
+   5. COOLING FAN EXHAUST TO THE ATMOSPHERE VIA GT MODULE.')
602 FORMAT(' SYSTEM IS CLASS THREE; COMBINED INLETS AND EXHAUST '
+ FLOWS FOR THE ENGINE AND MODULE COOLING. A COOLING FAN IS '
+ INSTALLED. YOU WILL BE ENTERING FITTINGS FOR SIX BRANCHES.')
+   1. COMBINED INLET TO THE COMBINED SECTION OF A DIVERGENT WYE
+   2. MAIN SECTION OF THE DIVERGENT WYE TO THE ENGINE.
+   3. BRANCH SECTION OF THE DIVERGENT WYE TO THE COOLING PAN.
+   4. ENGINE EXHAUST TO MAIN SECTION OF A CONVERGING WYE.
+     AN EDUCTOR IS INSTALLED AT THE EXHAUST PLANE OF THE ENGINE.
+     IS CONSIDERED TO BE A CONTRACTION FOLLOWED BY THE MAIN
+     SECTION OF A CONVERGING WYE FOR THE PURPOSES OF THIS
+     PROGRAM.
+   5. COOLING FAN EXHAUST TO THE BRANCH SECTION OF A CONVERGENT
+     WYE.
+   6. COMBINED SECTION OF A CONVERGENT WYE TO THE ATMOSPHERE.')
603 FORMAT(' SYSTEM IS CLASS FOUR; SEPARATE INLETS FOR THE ENGINE '
+ AND COOLING FLOWS, COMBINED FLOWS FOR THE ENGINE EXHAUST AND '
+ HOT MODULE COOLING. A COOLING PAN IS INSTALLED.')
+ ENTER FITTINGS FOR FIVE BRANCHES.'
+   1. ENGINE INLET TO THE ENGINE.
+   2. COOLING INLET TO THE COOLING FAN.
+   3. ENGINE EXHAUST TO MAIN SECTION OF A CONVERGENT WYE.
+     AN EDUCTOR IS INSTALLED AT THE EXHAUST PLANE OF THE ENGINE.
+     IS CONSIDERED TO BE A CONTRACTION FOLLOWED BY THE MAIN
+     SECTION OF A CONVERGENT WYE FOR THE PURPOSES OF THIS
+     PROGRAM.
+   4. COOLING FAN EXHAUST TO THE BRANCH SECTION OF A CONVERGENT
+     WYE.
+   5. COMBINED SECTION OF A CONVERGENT WYE TO THE ATMOSPHERE.')
604 FORMAT(' SYSTEM IS CLASS FIVE; COMBINED INLET AND EXHAUST FLOW.')
+ AN EDUCTOR SYSTEM IS USED TO PUMP COOLING AIR.')
+ ENTER FITTINGS FOR FIVE BRANCHES.'
+   1. COMBINED INLET TO THE COMBINED SECTION OF A DIVERGENT WYE
+   2. MAIN SECTION OF THE DIVERGENT WYE TO THE ENGINE.
+   3. THE EDUCTOR ONLY. THIS PROGRAM CONSIDERS THIS BRANCH TO
+     CONSIST OF ONLY TWO COMPONENTS, A CONTRACTION AND THE
+     MAIN SECTION OF A CONVERGENT WYE INSTALLED AT THE EXHAUST
+     PLANE OF THE ENGINE.
+   4. BRANCH SECTION OF A DIVERGENT WYE VIA THE GT MODULE TO
+     THE EDUCTOR. THE PROGRAM CONSIDERS THIS PART OF THE
+     EDUCTOR TO BE THE BRANCH SECTION OF A CONVERGENT WYE.
+   5. COMBINED SECTION OF A CONVERGING WYE TO THE ATMOSPHERE.')
+ INSTALLATION OF A WASTE HEAT BOILER IS NOT RECOMMENDED.')
605 FORMAT(' SYSTEM IS CLASS SIX; SEPARATE INLETS FOR THE ENGINE '
+ AND COOLING FLOWS, COMBINED FLOWS FOR THE ENGINE EXHAUST AND '
+ HOT MODULE COOLING. AN EDUCTOR IS INSTALLED.')
+ ENTER FITTINGS FOR FOUR BRANCHES.'
+   1. ENGINE INLET TO THE ENGINE.
+   2. COOLING INLET TO THE EDUCTOR VIA THE GT MODULE.
+     THE PROGRAM CONSIDERS THIS PART OF THE EDUCTOR TO BE
+     THE BRANCH SECTION OF A CONVERGENT WYE.
+   3. THE EDUCTOR ONLY. THIS PROGRAM CONSIDERS THIS BRANCH TO
+     CONSIST OF ONLY TWO COMPONENTS, A CONTRACTION AND THE
+     MAIN SECTION OF A CONVERGENT WYE INSTALLED AT THE EXHAUST
+     PLANE OF THE ENGINE.
+   4. THE COMBINED SECTION OF A CONVERGENT WYE TO THE ATMOSPHERE
+     .')
606 FORMAT('ENTER ZERO TO CONTINUE')
607 FORMAT('YOU DID NOT ENTER A CORRECT FITTING ID NUMBER.')
      RETURN
      END

```

```

C***** **** * ***** * ***** * ***** * ***** * ***** * ***** * ***** * C
C EDITING SUBROUTINE: USED TO ALTER THE DUCT DATA FILE C
C***** **** * ***** * ***** * ***** * ***** * ***** * ***** * ***** * C
C WITH THIS PART OF THE PROGRAM YOU CAN CHANGE, DELETE, OR ADD A C
C FITTING TO THE DATA FILE. IT WOULD BE HANDY TO HAVE A COPY OF C
C IT WITH YOU WHEN YOU MAKE THE CHANGES. ALSO THE DATA FILE IS C
C IS PERMANENTLY CHANGED. TO SAVE A COPY, MAKE A COPY OF IT UNDER C
C A DIFFERENT FILE NAME. YOU STILL MUST HAVE A FILE NAMED "DUCT C
C DATA" TO EDIT. EACH DUCT DATA FILE IS SERIALIZED BY THE USER C
C AND A NEW SERIAL NUMBER CAN BE ASSIGNED TO THE CHANGED FILE. C
C THE SERIAL NUMBER APPEARS OF THE COMPUTED OUTPUT FILE OF SYSTEM C
C PERFORMANCE. CHANGES ARE MADE BY THE INDEX NUMBER OF THE FITTING C
C IN THE DUCT DATA FILE. THE INDEX NUMBER IS THE NUMBER IN THE C
C FIRST COLUMN. C
C
C THIS SUBROUTINE DOES NOT CHANGE THE SYSTEM CLASSIFICATION. C
C TO GET A DIFFERENT SYSTEM YOU MUST BUILD IT WITH THE BUILD C
C PART OF THE PROGRAM. C
C***** **** * ***** * ***** * ***** * ***** * ***** * ***** * ***** * C
C
C SUBROUTINE ED
C REAL A,WORKR
C INTEGER N,INDEX,ANS,CHANGE,DELETE,ADD,L,M,S,YES,NC,WORKI,P,Z,
C + FfTID
C DIMENSION INDEX(200),WORKR(200,4),WORKI(200,2)
C DATA CHANGE/'C'/,DELETE/'D'/,ADD/'A'/,YES/'Y'/,NO/'N'/
C READ (8,600) SERIAL,N
C DO 10 I=1,N
C     READ (8,601) INDEX(I),WORKI(I,1),WORKI(I,2),WORKR(I,1),
C + WORKR(I,2),WORKR(I,3),WORKR(I,4)
C 10 CONTINUE
C REWIND 3
C WRITE (6,602)
C READ (5,603,END=22,ERR=22) ANS
C IF ((ANS.EQ.CHANGE).OR.(ANS.EQ.DELETE).OR.(ANS.EQ.ADD)) GO TO 30
C 22     REWIND 5
C         WRITE (6,604)
C         GO TO 20
C 30     IF (ANS.EQ.CHANGE) GO TO 40
C     IF (ANS.EQ.DELETE) GO TO 80
C     IF (ANS.EQ.ADD) GO TO 150
C
C     FITTING IS TO BE CHANGED, A NEW FITTING SUBSTITUTED FOR THE OLD
C     WHAT INDEX NUMBER, M ???
C
C 40     WRITE (6,605)
C     CALL READI(M,5)
C     DO YOU NEED A MENU ???
C 50     WRITE (6,606)
C     READ (5,603,END=52,ERR=52) ANS
C     CALL FRICMS ('CIRSCRN ')
C     IF ((ANS.EQ.YES).OR.(ANS.EQ.NO)) GO TO 60
C 52     REWIND 5
C         WRITE (6,604)
C         GO TO 50
C 60     CONTINUE
C     IF (ANS.EQ.YES) GO TO 62
C     WRITE (6,607)
C     CALL READI(TYPE,5)
C     GO TO 64
C
C     CALL THE MENU AND MAKE THE CHANGE
C
C 62     CALL MENU (0,0,TYPE,WORKI(M,1))
C 64     CALL SELECT (4,1,WORKI(M,1),TYPE,WORKI,WORKR)
C     ANY MORE CHANGES ???
C 66     WRITE (6,608)
C     READ (5,603,END=68,ERR=68) ANS

```

```

68   IF ((ANS.EQ.YES).OR.(ANS.EQ.NO)) GO TO 70
      REWIND 5
      WRITE (6,604)
      GO TO 66
70   CONTINUE
    IF (ANS.EQ.YES) GO TO 40
    GO TO 250
C
C   A FITTING IS TO BE DELETED
C
80   WRITE (6,605)
      CALL READI(M,5)
      IF (M.EQ.N) GO TO 120
      N=N-1
      Z=0
C   REWORK THE ID NUMBERS AND RELOAD THE FILE
      DO 110 I=M,N
        TEST=WORKI(I+1,1)-WORKI(I,1)
        IF (TEST.GT.1) Z=Z+1
        IF ((TEST.EQ.1).AND.(Z.EQ.0)) GO TO 90
          WORKI(I,1)=WORKI(I+1,1)
          GO TO 150
90   CONTINUE
100  WORKI(I,2)=WORKI(I+1,2)
    WORKR(I,1)=WORKR(I+1,1)
    WORKR(I,2)=WORKR(I+1,2)
    WORKR(I,3)=WORKR(I+1,3)
    WORKR(I,4)=WORKR(I+1,4)
110  CONTINUE
120  CONTINUE
      WRITE (6,609)
C   ANY MORE DELETIONS ???
130  WRITE (6,610)
      READ (5,603,END=132,ERR=132) ANS
      IF ((ANS.EQ.YES).OR.(ANS.EQ.NO)) GO TO 140
132  REWIND 5
      WRITE (6,604)
      GO TO 130
140  CONTINUE
    IF (ANS.EQ.YES) GO TO 80
    GO TO 250
C
C   A FITTING IS TO BE ADDED
C
150  WRITE (6,611)
      CALL READI(M,5)
      FITID=WORKI(4,1)+1
      S=N-M
      N=N+1
      P=M+1
C   OPEN UP THE DATA FILE TO ADD THE NEW FITTING
      DO 160 I=1,S
        WORKI(N+1-I,1)=WORKI(N-I,1)
        WORKI(N+1-I,2)=WORKI(N-I,2)
        WORKR(N+1-I,1)=WORKR(N-I,1)
        WORKR(N+1-I,2)=WORKR(N-I,2)
        WORKR(N+1-I,3)=WORKR(N-I,3)
        WORKR(N+1-I,4)=WORKR(N-I,4)
160  CONTINUE
      Z=0
C   REWORK THE ID NUMBERS
      DC 180 I=P,N
        TEST=WORKI(I,1)-WORKI(I-1,1)
        IF ((TEST.LT.100).AND.(Z.EQ.0)) GO TO 170
          Z=Z+1
          GO TO 180
        WORKI(I,1)=WORKI(I,1)+1
170  CONTINUE
180  CONTINUE
    DO YOU NEED A MENU ???

```

```

190  WRITE (6,606)
      READ (5,603,END=192,ERR=192) ANS
      CALL PRICMS ('CIRSCAN')
      IF ((ANS.EQ.YES).OR.(ANS.EQ.NO)) GO TO 200
192  REWIND 5
      WRITE (6,604)
      GO TO 190
200  CONTINUE
      IF (ANS.EQ.YES) GO TO 210
      WRITE (6,607)
      CALL READI (TYPE,5)
      GO TO 220
C     GET THE NEW FITTING
210  CALL MENU (0,0,TYPE,FITID)
220  CALL SELECT (P,0,FITID,TYPE,WORKI,WORKR)
      DO YOU WANT TO ADD ANOTHER FITTING ???
230  WRITE (6,612)
      READ (5,603,END=232,ERR=232) ANS
      IF ((ANS.EQ.YES).OR.(ANS.EQ.NO)) GO TO 240
232  REWIND 5
      WRITE (6,604)
      GO TO 230
240  CONTINUE
      IF (ANS.EQ.YES) GO TO 150
C     DO YOU WANT TO MAKE ANY OTHER CHANGES ???
250  WRITE (6,613)
      READ (5,603,END=252,ERR=252) ANS
      IF ((ANS.EQ.YES).OR.(ANS.EQ.NO)) GO TO 260
252  REWIND 5
      WRITE (6,609)
      GO TO 250
260  CONTINUE
      IF (ANS.EQ.YES) GO TO 20
      CALL SUMOUT (WORKI,WORKR,N)
      REWIND 8
      FORMAT (I6,/,I3)
600  FORMAT (I3,3X,I6,3X,I2,3X,F10.4,3X,F10.4,3X,F10.4,3X,F10.4)
601  FORMAT ('DO YOU WANT TO CHANGE, DELETE, OR ADD (C/D/A)?')
602  +   'YOUR OLD FILE WILL BE PERMANENTLY CHANGED, DID YOU?'
+   'COPY THE OLD FILE UNDER A NEW NAME IF YOU WANTED TO?'
+   'SAVE IT? IF NOT, ENTER TWO NULL STRINGS TO KILL THE'
+   'PROGRAM.')
603  FORMAT (A11)
604  FORMAT ('YOU MUST ENTER A LETTER INDICATED IN THE BRACKETS.')
605  FORMAT ('WHAT LINE DO YOU WANT TO EDIT?')
606  FORMAT ('DO YOU NEED A MENU (Y/N)?')
607  FORMAT ('WHAT IS THE FITTING TYPE NUMBER?')
608  FORMAT ('WANT TO CHANGE ANOTHER FITTING (Y/N)?')
609  FORMAT ('DELETION COMPLETE.')
610  FORMAT ('WANT TO DELETE ANOTHER FITTING (Y/N)?')
611  FORMAT ('AFTER WHAT LINE DO YOU WANT TO ADD ANOTHER FITTING?')
612  FORMAT ('WANT TO ADD ANOTHER FITTING (Y/N)?')
613  FORMAT ('WANT TO MAKE ANY OTHER CHANGES (Y/N)?')
      RETURN
END

```

```

***** COMPUTE SUBROUTINE: PRODUCES PERFORMANCE DATA OF SYSTEM *****
***** THE DUCT DATA FILE IS READ AND THEN THE USER MUST INPUT THE *****
***** DESIRED OPERATING POINT. INPUT THE AMBIENT TEMPERATURE *****
***** (DEGREES F), THE AMBIENT PRESSURE (PSIA) AND HUMIDITY (GRAINS). *****
***** HORSEPOWER, AND POWER TURBINE SPEED. OUTPUT IS THE ENGINE *****
***** PERFORMANCE AND DUCT RESISTANCES. THE OUTPUT GOES TO YOUR DISK *****
***** UNDER FILE OUTPUT DATA. *****
***** SJEROUTINE COME *****
REAL WORKR(100,4),PO,HUMID,HP,NFT,ACWB,ACWM,ACWC,ADWB,ADWC,
+ ADWM,ALFAD,ALFAC,RHOSTD,CMFD,CFMMAX,DPMAX,K
INTEGER N,INDEX,WORKI(100,2),CLASS,BRANCH,FIT1ST,M,TEST,NBR,OFF,SERIAL,
+ ANS,YES,NC
DIMENSION INDEX(200),WORKI(200,2),WORKR(200,4),FIT1ST(7),NBR(6)
DATA YES/1,0/ NC/N/
CALL FRTCMS ('CIRSCRN ')
C READ FILE SERIAL NUMBER AND HOW MANY FITTINGS ARE IN THE FILE
READ (8,600) SERIAL,N
C READ INDEX ID NUMBER, FITTING TYPE, AND FOUR ELEMENTS OF DATA
C FOR EACH FITTING
DO 10 I=1,N
  READ (8,601) INDEX(I),WORKI(I,1),WORKR(I,2),WORKR(I,3),WORKR(I,4)
10  CONTINUE
REWIND 8
C FIND OUT WHAT CLASS SYSTEM IS IN THE DUCT DATA FILE
CLASS=WORKI(1,1)/100000
C SET UP FOR THE CORRECT NUMBER OF BRANCHES FOR THE SYSTEM
IF(CLASS.EQ.1) BRANCH=4
IF(CLASS.EQ.2) BRANCH=5
IF(CLASS.EQ.3) BRANCH=6
IF(CLASS.EQ.4) BRANCH=5
IF(CLASS.EQ.5) BRANCH=5
IF(CLASS.EQ.6) BRANCH=4
IF(CLASS.EQ.1) GO TO 80
C SEARCH FOR WYE AREAS. MUST BE KNOWN FOR MATCHING. SEARCH IS
C DONE BY LOOKING FOR THE "WYE" FITTING TYPES, 13,14,15,16.
20  DO 70 I=1,N
    IF(WORKI(I,2).EQ.13) GO TO 30
    IF(WORKI(I,2).EQ.14) GO TO 40
    IF(WORKI(I,2).EQ.15) GO TO 50
    IF(WORKI(I,2).EQ.16) GO TO 60
    GO TO 70
30  ADEC=WORKR(I,1)
    ADWB=WORKR(I,2)
    ALFAD=WORKR(I,3)
    GO TO 70
40  ADWM=WORKR(I,1)
    GO TO 70
50  ACWC=WORKR(I,1)
    ACWB=WORKR(I,2)
    ALFAC=WORKR(I,3)
    GO TO 70
60  ACWM=WORKR(I,1)
70  CONTINUE
80  CONTINUE
C THE INDEX NUMBER OF THE FIRST FITTING OF THE BRANCH MUST BE KNOWN.
C IT IS USED IN THE DO LOOPS OF THE SYSTEM ANALYSIS TO FIND BRANCH
C PRESSURE DROPS. NEXT LOOP SEARCHES FOR THESE INDEXES. LOOP WILL
C FIND THE INDEX WHEN ID NUMBERS DIFFER BY MORE THAN ONE.
FIT1ST(1)=1
DO 90 I=1,N
  TEST=WORKI(I+1,1)-WORKI(I,1)
  IF(TEST.EQ.1) GO TO 90
  FIT1ST(M)=INDEX(I+1)
  M=M+1
90  CONTINUE

```

```

C 90    CONTINUE
C      GET THE OPERATING CONDITIONS AND POWER REQUIREMENTS.
C      CALL OPCOND(TO,PO,HUMID)
C      IF A FAN IS INSTALLED GET FAN CHARACTERISTICS
C      IF (CLASS.GT.4) GO TO 98
C      CALL FAN (RHOSTD,CFMO,CFMMAX,DPMAX,K)
C 95    CALL PWRPT (HP,NPT,TO,PO)
C      GO TO THE SYSTEM SUBROUTINE TAILORED FOR THE SYSTEM
C 98    GO TO (100,150,200,250,300,350) CLASS
C 100   CALL SYS1(SERIAL,N,WORKI,WORKR,HP,NPT,FIT1ST,TO,PO,HUMID,
+             RHOSTD,CFMO,CFMMAX,DPMAX,K)
C      GO TO 400
C 150   CALL SYS2(SERIAL,N,WORKI,WORKR,HP,NPT,FIT1ST,TO,PO,HUMID,
+             ALFAC,ADWB,ADWC,ADWM,
+             RHOSTD,CFMO,CFMMAX,DPMAX,K)
C      GO TO 400
C 200   CALL SYS3(SERIAL,N,WORKI,WORKR,HP,NPT,FIT1ST,TO,PO,HUMID,
+             ALFAC,ADWB,ADWC,ADWM,ALFAC,ACAB,ACAC,ACWM,
+             RHOSTD,CFMO,CFMMAX,DPMAX,K)
C      GO TO 400
C 250   CALL SYS4(SERIAL,N,WORKI,WORKR,HP,NPT,FIT1ST,TO,PO,HUMID,
+             ALFAC,ACAB,ACAC,ACWM,
+             RHOSTD,CFMO,CFMMAX,DPMAX,K)
C      GO TO 400
C 300   CALL SYS5(SERIAL,N,WORKI,WORKR,HP,NPT,FIT1ST,TO,PO,HUMID,
+             ALFAC,ADWB,ADWC,ADWM,ALFAC,ACAB,ACAC,ACWM)
C      GO TO 400
C 350   CALL SYS6(SERIAL,N,WORKI,WORKR,HP,NPT,FIT1ST,TO,PO,HUMID,
+             ALFAC,ACAB,ACAC,ACWM)
C      CONTINUE
C      DO YOU WANT TO COMPUTE WITH DIFFERENT OPERATING CONDITIONS ???
C 410   WRITE (6,602)
C      READ (5,603,END=420,ERR=420) ANS
C      IF ((ANS.EQ.YES).OR.(ANS.EQ.NO)) GO TO 430
C 420   REWIND 5
C      WRITE (6,604)
C      GO TO 410
C 430   CONTINUE
C      IF (ANS.EQ.YES) GO TO 95
C 600   FORMAT(I6,I3)
C 601   FORMAT(I3,3X,I6,3X,I2,3X,F10.4,3X,F10.4,3X,F10.4)
C 602   FORMAT('DO YOU WANT TO COMPUTE WITH DIFFERENT OPERATING CONDITION')
+NS ('Y/N?')
C 603   FORMAT(A1)
C 604   FORMAT(" YOU MUST ENTER A LETTER INDICATED IN THE BRACKETS.')
C      RETURN
C      END

```

```

***** C
C   INSTRUCTIONS SUBROUTINE: LONG OR SHORT, CRT OR TYPEWRITER C
C***** C
C   THIS SUBROUTINE IS CALLED IN THE BUILD SUBROUTINE. IT DOES NOT C
C   COMPUTE ANYTHING. IT IS AN ADMINISTRATIVE PART OF THE PROGRAM C
C   TO SEE IF THE USER WANTS LONG OR SHORT INSTRUCTIONS, AND IF C
C   THE USER IS USING A CRT TERMINAL OR TYPEWRITER TERMINAL. C
C   TYPEWRITER TERMINALS DO NOT GET THE MENUS OVER AND OVER. C
C***** C
C   SUBROUTINE INST(SORL, TERM)
      INTEGER SORL, TERM, ANS, LONG, SHORT, CRT, TYPE
      DATA LONG, SHORT, CRT, TYPE /'L', 'S', 'C', 'T'/
  5   WRITE(6, 600)
      READ(5, 601, END=7, ERR=7) ANS
      IF ((ANS.EQ.LONG).OR.(ANS.EQ.SHORT)) GO TO 10
  7   REWIND 5
      WRITE(6, 602)
      GO TO 5
 10  IF (ANS.EQ.SHORT) GO TO 20
      SORL=1
      WRITE(6, 603)
      GO TO 30
 20  SORL=0
 30  CONTINUE
 40  WRITE(6, 604)
      READ(5, 601, END=42, ERR=42) ANS
      IF ((ANS.EQ.CRT).OR.(ANS.EQ.TYPE)) GO TO 50
 42  REWIND 5
      WRITE(6, 602)
      GO TO 40
 50  IF (ANS.EQ.CRT) GO TO 60
      TERM=0
      WRITE(6, 605)
      GO TO 70
 60  TERM=1
      WRITE(6, 606)
 70  CONTINUE
 600 FORMAT('1 DO YOU WANT LCNG OR SHORT INSTRUCTIONS (L/S) ?')
 601 FORMAT('A1)
 602 FORMAT(' YOU MUST ENTER THE LETTER INCIDATED IN THE BRACKETS.')
 603 FORMAT(' YOU HAVE SELECTED THE LONG INSTRUCTIONS.')
 604 FORMAT(' ARE YOU WORKING ON A CRT OR TYPEWRITER TERMINAL (C/T) ?')
 605 FORMAT(' YOU ARE WORKING ON A TYPEWRITER TERMINAL.')
 606 FORMAT(' YOU ARE WORKING ON A CRT TERMINAL.')
      RETURN
END

```

```

C***** SYSTEM SUBROUTINE: DETERMINES WHICH SYSTEM, 1,2,3,4,5,OR 6 C
C***** CALLED BY THE BUILD SUBROUTINE. USED TO SET UP THE PROGRAM FOR C
C THE VARIATIONS IN DUCT SYSTEMS AVAILABLE. THE EDITING SUBROUTINE C
C CAN NOT CHANGE THE SYSTEM TYPE. ONCE SET JP HERE, ANOTHER RUN OF C
C THE BUILD SUBROUTINE IS REQUIRED TO GET A DIFFERENT SYSTEM. C
C***** SUEROUTINE SYSTEM(SORL,CLASS)
C      INTEGER SORL,CLASS,ANS1,ANS2,ANS3,YES,NO,SHORT
C      DATA YES/'Y'/,NO/'N'/,SHORT/0/
C      IF(SORL.EQ.SHORT) GO TO 30
C      DOES THE COOLING AIR BRANCH OFF THE MAIN INLET ????
C      5      WRITE(6,600)
C      READ(5,601,END=7,ERR=7)ANS1
C      IF((ANS1.EQ.YES).OR.(ANS1.EQ.NO)) GO TO 10
C      7      REWIND 5
C              WRITE(6,602)
C              GO TO 5
C      DOES THE COOLING AIR JOIN THE MAIN EXHAUST ????
C      10     WRITE(6,603)
C      READ(5,601,END=12,ERR=12)ANS2
C      IF((ANS2.EQ.YES).OR.(ANS2.EQ.NO)) GO TO 15
C      12     WRITE(6,602)
C              GO TO 15
C      15     IF(ANS2.EQ.YES) GO TO 20
C              ANS3=YES
C              GO TO 25
C      IS THERE A COOLING FAN INSTALLED ????
C      20      WRITE(6,604)
C      READ(5,601,END=22,ERR=22)ANS3
C      IF((ANS3.EQ.YES).OR.(ANS3.EQ.NO)) GO TO 25
C      22     REWIND 5
C              WRITE(6,602)
C              GO TO 20
C      SYSTEM CLASSIFICATION DEPENDS ON THE CONFIGURATION OF THE SYSTEM
C      AND IF A COOLING FAN IS INSTALLED. CONFIGURATION MEANS HOW THE
C      DUCT ARE JOINED TOGETHER IN THE SYSTEM.
C      25     IF((ANS1.EQ.NO).AND.(ANS2.EQ.NO))CLASS=1
C              IF((ANS1.EQ.YES).AND.(ANS2.EQ.NO))CLASS=2
C              IF((ANS1.EQ.YES).AND.(ANS2.EQ.YES).AND.(ANS3.EQ.YES))CLASS=3
C              IF((ANS1.EQ.NO).AND.(ANS2.EQ.YES).AND.(ANS3.EQ.YES))CLASS=4
C              IF((ANS1.EQ.YES).AND.(ANS2.EQ.YES).AND.(ANS3.EQ.NO))CLASS=5
C              IF((ANS1.EQ.NO).AND.(ANS2.EQ.YES).AND.(ANS3.EQ.NO))CLASS=6
C              GO TO 40
C      SHORT INSTRUCTIONS...JUST ENTER THE SYSTEM CLASSIFICATION NUMBER
C      30      WRITE(6,605)
C      CALL READI(CLASS,5)
C      IF((CLASS.GT.0).AND.(CLASS.LT.7)) GO TO 40
C              WRITE(6,606)
C              GO TO 30
C      CONTINUE
C      40     FORMAT(' DOES THE MODULE COOLING AIR BRANCH OFF THE MAIN INLET?'
C              +(Y,N))
C      601    FORMAT(A1)
C      602    FORMAT(' YOU MUST ENTER A LETTER IN THE BRACKETS.')
C      603    FORMAT(' DOES THE MODULE COOLING AIR JOIN THE MAIN ENGINE EXHAUST'
C              +(Y,N))
C      604    FORMAT(' IS THERE A COOLING FAN INSTALLED?')
C      605    FORMAT(' ENTER THE SYSTEM CLASSIFICATION: 1, 2, 3, 4, 5, OR 6')
C      606    FORMAT(' YOU MUST ENTER A 1, 2, 3, 4, 5, OR 6')
C      RETURN
C      END

```

```

C***** MENU SUBROUTINE: PRINTS MENU AND FINDS OUT WHICH FITTING TO USE C
C***** CALLED BY BUILD AND EDIT SUBROUTINES. C
C***** CHANGING THE NUMBER OF FITTINGS REQUIRES CHANGING THE MENU. C
C***** JUST REVISE THE FORMAT STATEMENTS, WATCH THAT IT DOES NOT C
C***** OVERFLOW THE SCREEN. C
C***** ***** ***** ***** ***** ***** ***** ***** ***** ***** ***** ***** C
C***** SUBROUTINE: MENU(M,TERM,TYPE,FITID) C
C***** INTEGER FITID,M,TERM,TYPE,CRT,IYPWRT C
C***** DATA TYPWRT/0/ C
C IF USER IS ON A TYPEWRITER TERMINAL, THE MENU IS PRINTED ONLY ONCE C
C IF ((M.GT.0).AND.(TERM.EQ.IYPWRT)) GO TO 10 C
C
C      WRITE(6,600)
C      WRITE(6,601)
C      WRITE(6,602)
C      WRITE(6,603)
C      WRITE(6,604)
C      WRITE(6,605) FITID
C      CALL READI(TYPE,5)
C      GO TO 20
10     WRITE(6,606)
C      CALL READI(TYPE,5)
20     CONTINUE
C      CALL ERICMS('CLRESCRN ')
600    FORMAT('00 NO MORE FITTINGS THIS BRANCH',6X,'* 14 DIVERGI
+NG WYE, MAIN SECTION',/,'01 INTAKE SHAFT, RECT SECTION, SIDE *
+15 CONVERGENT WYE, BRANCH SECTION',/,'ORIFACES WITH(OUT) LO
+UVERS',* 16 CONVERGENT WYE, MAIN SECTION',/,'02 STRAIGHT DUCT,
+21X,* 17 DIFFUSER, CONICAL ROUND SECTION',/,'03 ELBOW SMOOTH RAD
+IUS RCUND',8X,* 18 DIFFUSER, PLANE IN-LINE',/,'04 ELBOW; 90 DEG
+3,4,5 PCS, ROUND',* 19 DIFFUSER PYRAMIDAL, IN-LINE',/,'05 ELBO
+H MITERED, ROUND, &W/O VANES* 20 DIFFUSER, TRANSITIONAL (ROUND T
+O',* 06 ELBOW, MITERED, RECTANGULAR *          RECT OR RECT TO RO
+UND),')
601    FORMAT('07 ELBOW, SMOOTH RADIUS, RECTANGULAR * 21 CONTRACTION RO
+UND',/,'08 ELCR, SMOOTH RADIUS, WITH * 22 CONTRACTION RECT
+ANGULAR,/,'SPLITTERS, RECTANGULAR * 23 OBSTRUCTION
+SCREEN IN DUCT',/,'09 ELBOW, MITERED WITH VANES, RECT * 24 LOUVE
+R ENTRANCE')
602    FORMAT('10 ELBOW, CONVERGING OR DIVERGING * 25 FILTER',
+        ' FLOW, RECTANGULAR',14X,'* 26 MULTI-BAFFLE SILENCER',/
+        '11 ELBOWS, 90 DEG, Z-SHAPED, RECT * 27 GT MODULE')
603    FORMAT('12 ELBOWS, 90 DEG, IN DIFFERENT * 28 WASTE HEAT BOI
+LER',/,'PLANES, RECTANGULAR',11X,'* 29 EXIT ABRUPT,
+13 DIVERGING WYE, BRANCH SECTION * 30 FITTING NOT LISTED')
604    FORMAT(' **** USE TWO DIGIT NUMBER, PRESS ENTER****')
605    FORMAT(' >> YOU ARE WORKING ON FITTING NUMBER >> ',I6)
606    FORMAT(' ENTER THE FITTING TYPE NUMBER FROM THE MENU.')
      RETURN
END

```



```

GO TO 40
19 CALL FIT19 (SORI,GEOM,WKI,WKR)
CALL LOAD (M,GECM,WKI,WKR,WORKI,WORKR)
GO TO 40
20 CALL FIT20 (SORI,GEOM,WKI,WKR)
CALL LOAD (M,GECM,WKI,WKR,WORKI,WORKR)
GO TO 40
21 CALL FIT21 (SORI,GEOM,WKI,WKR)
CALL LOAD (M,GECM,WKI,WKR,WORKI,WORKR)
GO TO 40
22 CALL FIT22 (SORI,GEOM,WKI,WKR)
CALL LOAD (M,GECM,WKI,WKR,WORKI,WORKR)
GO TO 40
23 CALL FIT23 (SORI,GEOM,WKI,WKR)
CALL LOAD (M,GECM,WKI,WKR,WORKI,WORKR)
GO TO 40
24 CALL FIT24 (SORI,GEOM,WKI,WKR)
CALL LOAD (M,GECM,WKI,WKR,WORKI,WORKR)
GO TO 40
25 CALL FIT25 (SORI,GEOM,WKI,WKR)
CALL LOAD (M,GECM,WKI,WKR,WORKI,WORKR)
GO TO 40
26 CALL FIT26 (SORI,GEOM,WKI,WKR)
CALL LOAD (M,GECM,WKI,WKR,WORKI,WORKR)
GO TO 40
27 CALL FIT27 (SORI,GEOM,WKI,WKR)
CALL LOAD (M,GECM,WKI,WKR,WORKI,WORKR)
GO TO 40
28 CALL FIT28 (SORI,GEOM,WKI,WKR)
CALL LOAD (M,GECM,WKI,WKR,WORKI,WORKR)
GO TO 40
29 CALL FIT29 (SORI,GEOM,WKI,WKR)
CALL LOAD (M,GECM,WKI,WKR,WORKI,WORKR)
GO TO 40
30 CALL FIT30 (SORI,GEOM,WKI,WKR)
CALL LOAD (M,GECM,WKI,WKR,WORKI,WORKR)
C 40 A NEW FITTING WOULD REQUIRE ANOTHER CALL STATEMENT HERE
CONTINUE
RETURN
END

```



```
602  FORMAT('  SINCE THERE ARE TO BE TWO ORIFACES, ARE THE ORIFACES OPP
603  +OSITE OR ADJACENT (O/A)?')
604  FORMAT(1)
605  FORMAT('  YOU MUST ENTER A LETTER IN THE BRACKETS.')
605  FORMAT('  LAST QUESTION, ARE LOUVERS MOUNTED ON THE ORIFACES?  (Y/
+N)')
605  RETURN
605  END
```

```

***** **** FITTING 02: STRAIGHT DUCT, ROUND OR RECTANGULAR ****
C NO REFERENCE, ONLY THE DUCT GEOMETRY IS INPUT HERE. LATER ON IN
C THE COMPUTE PART OF THE PROGRAM A COEFFICIENT BASED ON F*L/D WILL
C BE DEVELOPED TO DETERMINE THE RESISTANCE OF THE DUCT. F IS THE
C FRICTION FACTOR. SEE FITDP FOR THE CORRELATION USED.
C
SUBROUTINE FITO2 (SOLR,GEOM,WKI,WKR)
REAL A,B,L,D,WKR
INTEGER SOLR,GEOM,WKI,ANS1,CIR,REC,SHORT
DIMENSION WKI(2),WKR(4)
DATA CIR/'C'/ REC/'R'/ SHORT/0/
C 5 IS DUCT CIRCULAR OR RECTANGULAR ???
WRITE(6,600)
READ(5,601,END=6,ERR=6) ANS1
IF ((ANS1.EQ.CIR).OR. (ANS1.EQ.REC)) GO TO 7
6 REWIND 5
WRITE(6,608)
GO TO 5
7 IF (ANS1.EQ.CIR) GO TO 30
IF (SOLR.EQ.SHORT) GO TO 10
WRITE(6,602)
CALL READR(A,5)
WRITE(6,603)
CALL READR(B,5)
WRITE(6,604)
CALL READR(L,5)
GO TO 20
10 WRITE(6,605)
CALL READR(A,5)
CALL READR(B,5)
CALL READR(L,5)
20 CONTINUE
AREA=A*B
C SINCE THE DUCT IS RECTANGULAR, THE EQUIVALENT CIRCULAR DIAMETER
C IS REQUIRED. THIS IS FROM THE ASHRAE HANDBOOK, CHAPTER 33, DUCTS
D=1.3*((A*B)**0.625)/(A+B)**0.250
R=L/D
GO TO 100
30 IF (SOLR.EQ.0) GO TO 40
WRITE(6,606)
CALL READR(D,5)
WRITE(6,604)
CALL READR(L,5)
GO TO 50
40 WRITE(6,607)
CALL READR(D,5)
CALL READR(L,5)
50 AREA=3.14*(D**2/4.0)
100 WKI(1)=GEOM
WKI(2)=2
WKE(1)=AREA
WKR(2)=D
WKR(3)=L
WKR(4)=AREA
600 FORMAT(' YOU HAVE SELECTED STRAIGHT DUCT. IT MAY BE ROUND OR REC
+TANGULAR. /*****FIRST QUESTION, IS THE DUCT CIRCULAR OR RECTANGULA
+R (C/R) ? ')
601 FORMAT(A1)
602 FORMAT(' THE DUCT IS RECTANGULAR, ENTER FIRST CROSS-SECTIONAL DIM
+ENSIONS. (FEET)')
603 FORMAT(' SECOND DIMENSION (FEET)')
604 FORMAT(' ENTER THE LENGTH OF THIS DUCT SECTION. (FEET) ')
605 FORMAT(' ENTER THE RECTANGULAR DUCT DIMENSIONS. (FEET) ')
+' FORMAT: FIRST DIMENSION SAMPLE: 10 '
+' SECND DIMENSION 8.35 '
+' LENGTH 18.5 '
606 FORMAT(' THE DUCT IS CIRCULAR, ENTER THE DIAMETER (FEET)')

```

```
607 FORMAT(' ENTER THE DIMENSIONS (FEET) OF THE CIRCULAR DUCT./'
+        ' FORMAT: DIAMETER           SAMPLE: 5.65 ,/'
+        ' LENGTH                  20;')
608 FORMAT(' YOU MUST ENTER A LETTER IN THE BRACKETS.')
      RETURN
      END
```

```

C***** FITTING 03: ELBOW, SMOOTH RADIUS, ROUND CROSS-SECTION C
C***** REF. ASHRAE HANDBOOK, PAGE 33.33, TABLE B-3, FITTING 3-1 C
C***** CURVE FIT TO THE TABULATED DATA C
C***** SHORT FITTING, FRICTION LOSSES NOT INCLUDED, CONNECTING DUCTS C
C***** TO THE CENTER OF THIS FITTING. C
C***** SUEROUTINE FIT03(SCRL,GEOM,WKI,WKR)
REAL R,D,THETA,KTHETA,C,AREA,CPRIME,WKR
INTEGER GEOM,SCRL,WKI
DIMENSION WKI(2),WKR(4)
WRITE(6,600)
CALL READR(D,5)
WRITE(6,601)
CALL READR(R,5)
WRITE(6,602)
CALL READR(THETA,5)
AREA=0.7854*D**2
KTHETA=0.0306*THETA**0.7825
CPRIME=0.02946*EXP(2.5627*(1.57138-(R/D)))+0.11746
C=KTHETA*CPRIME
WKI(1)=GEOM
WKI(2)=3
WKR(1)=AREA
WKR(2)=0.0
WKR(3)=C
WKR(4)=AREA
600 FORMAT(' YOU HAVE SELECTED A SMOOTH RADIUS ROUND CROSS-SECTION'/
+' ELBOW. '/ '**FIRST QUESTION, WHAT IS THE CROSS-SECTION DIAMETER'/
+' (FEET) **')
601 FORMAT(' ENTER THE RADIUS OF THE TURN OF THE ELBOW MEASURED TO'/
+' THE CENTERLINE OF THE DUCT.')
602 FORMAT(' LAST QUESTION, ENTER THE ANGLE OF THE ELBOW TURN. (DEGR'/
+' EES)')
RETURN
END

```

```

C*****FITTING 04: ELBOW, SEGMENTED ROUND CROSS-SECTION, 90 DEGREE*****
C*****REF. ASHRAE HANDBOOK, PAGE 33.33, TABLE B-3, FITTING 3-2*****
C*****CURVE FIT TO THE TABULATED DATA FOR EACH NUMBER OF SEGMENTS.*****
C*****THIS IS A SHORT FITTING, FRICTION LOSSES NOT INCLUDED, MEASURE*****
C*****CONNECTING DUCTS TO THE CENTER OF THIS FITTING.*****
C*****SUBROUTINE FIT04(SORL,GEOM,WKI,WKR)
      REAL D,R,WKR
      INTEGER SORL,GEOM,WKI,N,M
      DIMENSION WKI(2),WKR(4)
 5     WRITE(6,600)
      CALL READER(N,5)
      IF((N.LT.3).OR.(N.GT.5)) GO TO 5
      WRITE(6,601)
      CALL READER(D,5)
      WRITE(6,602)
      CALL READER(R,5)
      AREA=0.7854*5**2
      M=N-2
      GO TO 10,20,30
 10    C=4.4022*EXP(3.9394*(0.00282-R/D))+0.32829
      GO TO 40
 20    C=1.3428*EXP(2.4861*(-0.02393-R/D))+0.22798
      GO TO 40
 30    C=1.0456*EXP(1.74313*(0.01219-R/D))+0.15776
      CONTINUE
      WKI(1)=GEOM
      WKI(2)=4
      WKR(1)=AREA
      WKR(2)=0.0
      WKR(3)=C
      WKR(4)=R
 600    FORMAT(' YOU HAVE SELECTED A SEGMENTED ROUND CROSS-SECTION 90 DEG
      +REED ELBOW. ',' **FIRST QUESTION, HOW MANY SEGMENTS, INCLUDE ENTRY
      +AND EXIT? '(3,'FOR 3')')
 601    FORMAT(' ENTER THE CROSS-SECTIONAL DIAMETER.')
 602    FORMAT(' LAST QUESTION, WHAT IS THE RADIUS OF THE TURN OF THE ELB
      +OR ' ' MEASURED TO THE CENTERLINE OF THE DUCT?')
      RETURN
      END

```



```

C*****FITTING 3-6: ELBOW MITERED RECTANGULAR CROSS-SECTION*****
C*****REF. ASHRAE HANDBOOK PAGE 33.33, TABLE B-3, FITTING 3-6 AND ****
C*****THE HANDBOOK OF HYDRAULIC RESISTANCE, IEDL CHIK. ****
C*****CURVE FITS TO THE DATA. THIS IS A SHORT FITTING, MEASURE DUCT ****
C*****CONNECTED TO IT TO THE CENTER OF THIS FITTING. ****
C*****SUBROUTINE FIT06(SORL,GECM,WKI,WKR)
REAL H,THETA,C1,A,PHI,CPRIME,RAD,AREA,DH,WKR
INTEGER SORL,GECM,WKI
DIMENSION WKI(2),WKR(4)
WRITE(6,600)
CALL READR(H,5)
10  WRITE(6,601)
CALL READR(W,5)
WRITE(6,602)
CALL READR(THETA,5)
IF(THETA.LE.90.0) GO TO 20
WRITE(6,603)
GO TO 15
20  RAD=THETA*3.14159/180.0
DH=2.0*(H*W)/(H+W)
AREA=H*W
C1=0.23097*EXP(0.38896*(1.87338-(H/W)))+0.67819
A=1.2+1.0381*((1.5708-RAD)/1.047)**1.8233
PHI=0.95*((SIN(RAD/2.0))**2)+2.05*((SIN(RAD/2.0))**4.0)
CPRIME=C1*A*PHI
WKI(1)=GECM
WKI(2)=A
WKR(1)=AREA
WKR(2)=DH
WKR(3)=CPRIME
WKR(4)=AREA
600  FORMAT(' YOU HAVE SELECTED A MITERED RECTANGULAR CROSS-SECTION.',/
+ 'ELBOW. /* **FIRST QUESTION, WHAT IS THE HEIGHT OF THE ELBOW? /'
+ ' (THE DIMENSION PARALLEL TO THE TURN AXIS) ')
601  FORMAT(' WHAT IS THE WIDTH OF THE ELBOW CROSS-SECTION? /'
+ ' (THE DIMENSION IN THE PLANE OF THE TURN) ')
602  FORMAT(' LAST QUESTION, WHAT IS THE ANGLE OF THE ELBOW TURN (0 -'
+ '90 DEGREES)? ')
603  FORMAT(' ELBOW TURN ANGLE MUST NOT BE GREATER THAN 90 DEGREES.')
RETURN
END

```



```

***** FITTING 08: EELBOW SMOOTH RADIUS RECTANGULAR WITH SPLITTERS ****
C REF. ASHRAE HANDBOOK, PAGE 33.32 & 33.33, TABLE B-3, FITTING 3-7
C USES TABLE INTERPOLATION SCHEME
C THIS IS A SHORT FITTING, MEASURE CONNECTING DUCT TO THE CENTER
C OF THIS FITTING TO INCLUDE FRICTION.
C
C SUBROUTINE FIT08 (SORL, GEOM, WKI, JKR)
REAL WKR, H/W, R, THETA, KTHETA, AREA, X, C, CPRIIME, T1, T2, T3
INTEGER WKI, JKR, XOUT, SORL, GEOM
DIMENSION WKI(2), WKR(4), X(2), T1(100), T2(100), T3(100), XOUT(2)
C ONE SPLITTER
C DATA T1/8.00, 10.00, 0.25, 0.50, 1.00, 1.50, 2.00, 3.00, 4.00, 5.00,
+ 0.55, 0.60, 0.65, 0.70, 0.75, 0.80, 0.85, 0.90, 0.95, 1.00,
+ 0.52, 0.40, 0.45, 0.49, 0.55, 0.59, 0.75, 0.84,
+ 0.36, 0.27, 0.25, 0.28, 0.30, 0.35, 0.39, 0.42,
+ 0.28, 0.21, 0.18, 0.19, 0.20, 0.22, 0.25, 0.26,
+ 0.22, 0.16, 0.14, 0.14, 0.15, 0.16, 0.17, 0.18,
+ 0.18, 0.13, 0.11, 0.11, 0.11, 0.12, 0.13, 0.14,
+ 0.15, 0.11, 0.09, 0.09, 0.09, 0.09, 0.10, 0.10,
+ 0.13, 0.09, 0.08, 0.07, 0.07, 0.08, 0.08, 0.08,
+ 0.11, 0.08, 0.07, 0.06, 0.06, 0.06, 0.06, 0.07,
+ 0.10, 0.07, 0.06, 0.05, 0.05, 0.05, 0.05, 0.05,
+ 0.09, 0.06, 0.05, 0.05, 0.04, 0.04, 0.04, 0.05/
C TWO SPLITTERS
C DATA T2/8.00, 10.00, 0.25, 0.50, 1.00, 1.50, 2.00, 3.00, 4.00, 5.00,
+ 0.55, 0.60, 0.65, 0.70, 0.75, 0.80, 0.85, 0.90, 0.95, 1.00,
+ 0.26, 0.20, 0.22, 0.25, 0.28, 0.33, 0.37, 0.41,
+ 0.17, 0.13, 0.11, 0.12, 0.13, 0.15, 0.16, 0.17,
+ 0.12, 0.09, 0.08, 0.09, 0.08, 0.09, 0.10, 0.10,
+ 0.09, 0.07, 0.06, 0.06, 0.06, 0.06, 0.06, 0.06,
+ 0.08, 0.05, 0.04, 0.04, 0.04, 0.04, 0.05, 0.05,
+ 0.06, 0.04, 0.03, 0.03, 0.03, 0.03, 0.03, 0.03,
+ 0.05, 0.04, 0.03, 0.03, 0.03, 0.03, 0.03, 0.03,
+ 0.05, 0.03, 0.03, 0.02, 0.02, 0.02, 0.02, 0.02,
+ 0.04, 0.03, 0.03, 0.02, 0.02, 0.02, 0.02, 0.02,
+ 0.03, 0.02, 0.02, 0.02, 0.02, 0.01, 0.01, 0.01/
C THREE SPLITTERS
C DATA T3/8.00, 10.00, 0.25, 0.50, 1.00, 1.50, 2.00, 3.00, 4.00, 5.00,
+ 0.55, 0.60, 0.65, 0.70, 0.75, 0.80, 0.85, 0.90, 0.95, 1.00,
+ 0.11, 0.10, 0.12, 0.13, 0.14, 0.16, 0.18, 0.19,
+ 0.07, 0.05, 0.06, 0.06, 0.06, 0.07, 0.07, 0.08,
+ 0.05, 0.04, 0.04, 0.04, 0.04, 0.04, 0.04, 0.04,
+ 0.03, 0.03, 0.03, 0.03, 0.03, 0.03, 0.03, 0.03,
+ 0.03, 0.02, 0.02, 0.02, 0.02, 0.02, 0.02, 0.02,
+ 0.03, 0.02, 0.02, 0.02, 0.02, 0.01, 0.01, 0.01,
+ 0.02, 0.02, 0.01, 0.01, 0.01, 0.01, 0.01, 0.01,
+ 0.01, 0.01, 0.01, 0.01, 0.01, 0.01, 0.01, 0.01,
+ 0.01, 0.01, 0.01, 0.01, 0.01, 0.01, 0.01, 0.01/
C
C 10 WRITE(6,600)
C HOW MANY SPLITTERS ???
C WRITE(6,601)
C CALL READIN(N,5)
C IF((N.LT.1).OR.(N.GT.3)) GO TO 10
C WRITE(6,602)
C CALL READER(H,5)
C WRITE(6,603)
C CALL READER(R,5)
C WRITE(6,604)
C CALL READER(B,5)
C WRITE(6,605)
C CALL READER(THETA,5)
C KTHETA=0.0306*THETA**0.7825
C X(1)=H/W
C X(2)=R/W
C AREA=H*W
C GO TO (20,30,40), N

```

```

20 CALL TABLE (T1,X,XOUT,CPRIME)
GO TO 50
30 CALL TABLE (T2,X,XOUT,CPRIME)
GO TO 50
40 CALL TABLE (T3,X,XOUT,CPRIME)
50 CONTINUE
IF ((XOUT(1).GT.0).OR. (XOUT(2).GT.0)) GO TO 60
WRITE(6,606)
GO TO 10
60 C=CPRIME*KTHETA
WKI(1)=GEOM
WKI(2)=S
WKR(1)=AREA
WKR(2)=0.0
WKR(3)=C
WKR(4)=AREA
600 FORMAT(' YOU HAVE SELECTED A SMOOTH RADIUS RECTANGULAR ELBOW WITH
+ SPLITTERS: / IT MAY HAVE 1, 2, OR 3 SPLITTERS.')
601 FORMAT(' **FIRST QUESTION, HOW MANY SPLITTERS ARE IS THE ELBOW (1
+ 2 OR 3)?')
602 FORMAT(' WHAT IS THE HEIGHT OF THE ELBOW? /
+ (THE CROSS-SECTONAL DIMENSION PARALLEL TO THE TURN AXIS)')
603 FORMAT(' WHAT IS THE WIDTH OF THE ELBOW (THE CROSS-SECTONAL
+ DIMENSION IN THE PLANE OF THE TURN)? ')
604 FORMAT(' WHAT IS THE RADIUS OF THE ELBOW, MEASURED TO THE CENTER
+ OF THE ELBOW CROSS-SECTION?')
605 FORMAT(' LAST QUESTION, WHAT IS THE ANGLE OF THE TURN (0-90 DEGR
+EES)?')
606 FORMAT(' CROSS-SECTION EXTREMELY NARROW, RE-ENTER BETTER DATA.')
RETURN
END

```





```

C*****FITTING 11: ELBOWS 90 DEGREE RECTANGULAR IN Z-SHAPED CONFIG.*****
C*****REF. ASHRAE HANDBOOK, PAGE 33.32, TABLE B-3, FITTING 3-11*****
C*****CURVE FIT TO TEE TABLE DATA*****
C*****SUBROUTINE FIT11(SORI,GEOM,WKI,WKR)
C      REAL WKR, AREA,DH,L,W,H,CPRIME,X,Y,K
C      INTEGER SORI,GEOM,WKI
C      DIMENSION WKI(2),WKR(4)
C      WRITE(6,600)
C      CALL READR(H,5)
C      WRITE(6,601)
C      CALL READR(W,5)
C      WRITE(6,602)
C      CALL READR(L,5)
C      X=L/H
C      Y=W/H
C      IF((X.GT.0.01)AND.(X.LT.2.8)) GO TO 10
C      C=3.4547-0.0992*X
10    GO TO 20
20    C=(0.85045*X)-5.21052)*X+9.1399)*X-2.168)*X+0.0545
CONTINUE
K=0.4704*EXP(-0.3558*Y)+0.67
CPRIME=C*K
DH=2.0*(H*W)/(H+W)
AREA=H*W
WKI(1)=GEOM
WKI(2)=11
WKI(3)=AREA
WKI(4)=DH
WKI(5)=CPRIME
WKI(6)=AREA
600  FORMAT(' YOU HAVE SELECTED A SERIES 90 DEGREE RECTANGULAR ELBOW//'
+' SETTING IN A Z-SHAPED CONFIGURATION!// **FIRST QUESTION: WHAT IS//'
+' THE HEIGHT OF THE ELBOW CROSS-SECTION?// (DIMENSION IN THE PLA//'
+' NE OF THE TURN) ')
601  FORMAT(' WHAT IS THE WIDTH OF THE ELBOW CROSS-SECTION?//'
+' (THE DIMENSION PARALLEL TO THE TURN AXIS) ')
602  FORMAT(' LAST QUESTION: WHAT IS THE LENGTH BETWEEN CENTERLINES?//'
+' (OF THE "Z" ENTRANCE AND "Z" EXIT?)')
      RETURN
      END

```





```

C***** FITTING 14: MAIN SECTION DIVERGING WYE **** C
C***** REF. IDEL'CHIK, HANDBOOK OF HYDRAULIC RESISTANCE, SECTION SEVEN C
C***** PAGES 247-253 **** C
C***** SUBROUTINE FIT14(SORL,GEOM,WKI,WKR)
C      REAL WKR,AM
C      INTEGER SORL,GEOM,WKI
C      DIMENSION WKI(2),WKR(4)
C      WRITE(6,600)
C      CALL READER(AM,5)
C      WKI(1)=GEOM
C      WKI(2)=14
C      WKR(1)=AM
C      WKR(2)=0.0
C      WKR(3)=0.0
C      WKR(4)=AM
C
600  FORMAT(' YOU HAVE SELECTED THE MAIN SECTION OF A DIVERGING WYE.'//'
+! THE AIR TO THE ENGINE SHOULD BE FLOWING THRCUGH THIS SECTION.'//'
+! JUST ONE QUESTION. WHAT IS THE CROSS-SECTIONAL AREA OF THE '//
+! MAIN SECTION? THIS SHOULD BE THE AREA JUST DOWNSTREAM OF THE '//
+! JUNCTION AND DIRECTS FLOW TO THE ENGINE. IT ALSO SHOULD BE'//'
+! THE FIRST FITTING OF THE BRANCH.')
C      RETURN
C      END

```

```

***** FITTING 15: BRANCH SECTION CONVERGING WYE ****
REF. IDEL'CHIK, HANDBOOK OF HYDRAULIC RESISTANCE, SECTION SEVEN
PAGES 247-253

***** SUBROUTINE FIT15(SORL,GEOM,WKI,WKR)
      REAL WKR,ALFAC,AC,AB
      INTEGER SORL,ECM,WKI
      DIMENSION WKf(2),WKR(4)
      WRITN(6,600)
      CALL READR(ALFAC,5)
      WRITN(6,601)
      CALL READR(AC,5)
      CALL READR(AB,5)
      WKI(1)=GEOM
      WKI(2)=15
      WKI(3)=AC
      WKI(4)=AB
      WKI(5)=ALFAC
      WKI(6)=AB
 600  FORMAT(' YOU HAVE SELECTED THE BRANCH SECTION OF A CONVERGENT //'
        +' WYE. THE HOT MODULE COOLING AIR SHOULD BE JOINING THE MAIN //'
        +' ENGINE EXHAUST IN THIS WYE. THIS FITTING SHOULD BE THE LAST //'
        +' FITTING IN THE BRANCH. //'
        +' **FIRST QUESTION, WHAT IS THE ANGLE BETWEEN THE MAIN FLOW //'
        +' AXIS AND THE BRANCH AXIS (DEGREES)?')
 601  FORMAT(' WHAT IS THE CROSS-SECTIONAL AREA OF THE COMBINED FLOW? //'
        +' SECTION? THIS IS WHERE ENGINE EXHAUST AND MODULE COOLING AIR //'
        +' FLOW JUST DOWNSTREAM OF THE BRANCH.')
 602  FORMAT(' LAST QUESTION, WHAT IS THE CROSS-SECTIONAL AREA OF THE //'
        +' BRANCH?')
      RETURN
      END

```

```

C*****FITTING 16: MAIN SECTION CONVERGING WYE*****
C*****REF. IDEL'CHIK, HANDBOOK OF HYDRAULIC RESISTANCE, SECTION SEVEN*****
C*****PAGES 247-253*****
C*****SUBROUTINE FIT16(SORL,GEOM,WKI,WKR)*****
REAL WKR,AM
INTEGER SORL,GEOM,WKI
DIMENSION WKI(2),WKR(4)
WRITE(6,600)
CALL READR(AM,5)
WKI(1)=GEOM
WKI(2)=16
WKI(3)=AM
WKR(2)=0.0
WKR(3)=0.0
WKR(4)=AM
600 FORMAT(' YOU HAVE SELECTED THE MAIN SECTION OF A CONVERGING //',
+ ' YES, THE ENGINE EXHAUST ALONE SHOULD BE FLOWING THROUGH //',
+ ' THIS SECTION. IT SHOULD BE THE LAST FITTING OF THE BRANCH //',
+ ' **JUST ONE QUESTION, WHAT IS THE CROSS-SECTIONAL AREA OF THE //',
+ ' MAIN BRANCH?')
RETURN
END

```

```

***** FITTING 17: CONICAL DIFFUSER *****
C REF. IDEL'CHIK, HANDBOOK OF HYDRAULIC RESISTANCE, SECTION FIVE,
C PAGE 167
C
C SUBROUTINE FIT17(SORL,GEOM,WKI,WKR)
REAL WKRL,D1,K1,K2,A0,A1,THETA,CEXP,CFRPRI
INTEGER GEOM,SCRL,WKI(ANS,YES,NO)
DIMENSION WKI(2),WKR(4)
DATA YES/'Y'/,NC/'N'/
WRITE(6,600)
CALL READR(L,5)
600 WRITE(6,601)
CALL READR(D0,5)
WRITE(6,602)
CALL READR(D1,5)
WRITE(6,603)
READ(5,604,END=14,ERR=14) ANS
IF ((ANS.EQ.YES).OR.(ANS.EQ.NO)) GO TO 16
14 REWIND 5
WRITE(6,608)
GO TO 12
16 CONTINUE
K1=1.0
IF (ANS.EQ.YES) K1=0.8
A0=0.7854*D0**2
A1=0.7854*D1**2
IF (A1.GT.A0) GO TO 20
WRITE(6,605)
GO TO 13
13 THETA=2.0*ATAN((D1-D0)/(2.0*L))
IF (THETA.LT.0.524) GO TO 30
20 WRITE(6,606)
READ(5,604,END=24,ERR=24) ANS
IF ((ANS.EQ.YES).OR.(ANS.EQ.NO)) GO TO 26
24 REWIND 5
WRITE(6,608)
GO TO 22
22 CONTINUE
K2=1.0
IF (ANS.EQ.YES) K2=0.65
30 IF (THETA.GT.0.7) GO TO 40
CEXP=1.3454*(THETA**1.2)*(1.0-A0/A1)**2
GO TO 50
40 IF (THETA.GT.1.05) GO TO 50
CEXP=(((-0.3637*THETA)-0.8715)*THETA+3.0218)*THETA-0.6410)*
+((0-A0/A1)**2
GO TO 60
50 CEXP=(((-0.0061*THETA)-0.0139)*THETA-0.09293)*THETA+1.2623)*
+((0-A0/A1)**2
60 CONTINUE
WRITE(6,607)
CFRPRI=(1.0-(A0/A1)**2)/(8.0*SIN(THETA/2.0))
WKI(1)=GEOM
WKI(2)=17
WKR(1)=A0
WKR(2)=CFRPRI*K2
WKR(3)=CEXP*K1*K2
WKR(4)=A1
600 FORMAT(' YOU HAVE SELECTED A CONICAL DIFFUSER WITH CIRCULAR //',
+ ' INLET AND OUTLET SECTIONS. //',
+ ' **FIRST QUESTION: WHAT IS THE LENGTH OF THE DIFFUSER?')
601 FORMAT(' WHAT IS THE INLET DIAMETER?')
602 FORMAT(' WHAT IS THE OUTLET DIAMETER?')
603 FORMAT(' IS THERE A NON-UNIFORM VELOCITY DISTRIBUTION AT THE INLE
+ T (Y/N)?')

```

```
504  FORMAT(A1)
505  FORMAT(' DOWNSHIFT AREA IS NOT GREATER THAN UPSTREAM AREA.'/
+        ' FITTING IS NOT A DIFFUSER. ENTER DIAMETERS.')
506  FORMAT(' SINCE THERE IS A WIDE DIVERGING ANGLE THE PROPER /'
+        ' INSTALLATION OF DIVIDING WALLS OR BAFFLES CAN REDUCE /'
+        ' THE RESISTANCE OF THIS FITTING. DO YOU WANT TO INSTALL /'
+        ' DIVIDING WALLS OR BAFFLES (Y/N)?')
507  FORMAT(' NO MORE QUESTIONS THIS FITTING.')
508  FORMAT(' YOU MUST ENTER A LETTER IN THE BRACKETS.')
      RETURN
      END
```

```

C*****FITTING 18: PLANE IN-LINE DIFFUSER*****
C*****REF. IDEL'CHIK, HANDBOOK OF HYDRAULIC RESISTANCE, SECTION FIVE,
C*****PAGE 171
C
C*****SUBROUTINE PIT18(SCRL,GECM,WKI,WKP)
REAL WKR(L,H),W0,A1,K1,K2,A0,L1,THETA,CEXP,CFRPRI
INTEGER GECM,SCRL,WKI,ANS,YES,NO
DIMENSION L(2),WKP(4)
DATA YES/'Y',NO/'N'
WRITE(6,600)
CALL READR(L,5)
WRITE(6,601)
CALL READR(H,5)
10  WRITE(6,602)
CALL READR(W0,5)
WRITE(6,603)
CALL READR(W1,5)
12  WRITE(6,604)
READ(5,605,END=14,ERR=14) ANS
IF ((ANS.EQ.YES).OR.(ANS.EQ.NO)) GO TO 16
14  REWIND 5
      WRITE(6,609)
      GO TO 12
16  CONTINUE
K1=1.0
IF (ANS.EQ.YES) K1=6.3
A0=W0*H
A1=W1*H
IF (A1.GT.A0) GO TO 20
WRITE(6,606)
GO TO 10
20  THETA=2.0*ATAN((W1-W0)/(2.0*L))
IF (THETA.LT.0.524) GO TO 30
22  WRITE(6,607)
READ(5,605,END=24,ERR=24) ANS
IF ((ANS.EQ.YES).OR.(ANS.EQ.NO)) GO TO 26
24  REWIND 5
      WRITE(6,609)
      GO TO 22
26  CONTINUE
K2=1.0
IF (ANS.EQ.YES) K2=0.65
30  IF (THETA.GT.0.7) GO TO 40
      CEXP=1.3454*(THETA**1.2)*(1.0-A0/A1)**2
      GO TO 60
40  IF (THETA.GT.1.05) GO TO 50
      CEXP=((0.3637*THETA)-0.3715)*THETA+3.0218)*THETA-0.6410)*
+ ((0-A0/A1)**2
      GO TO 60
50  CEXP=(((-0.0061*THETA)-0.0139)*THETA-0.0929)*THETA+1.2623)*
+ ((0-A0/A1)**2
60  CONTINUE
      CFRPRI=((W0/H)*(1.0-A0/A1)+0.5*(1.0-(A0/A1)**2))/(
+ ((0.5*SIN(THETA/2.0)))
      WRITE(6,608)
      WKI(1)=GEOM
      WKI(2)=18
      WKI(3)=A0
      WKI(4)=CFRPRI*K2
      WKI(5)=CEXP*K1*K2
      WKI(6)=A1
600  FORMAT(' YOU HAVE SELECTED A PLANE INLINE DIFFUSER WITH ONE! /
+           ' DIMENSION CONSTANT THROUGHOUT AND RECTANGULAR INLET! /
+           ' AND OUTLET! /
+           ' **FIRST QUESTION, WHAT IS THE LENGTH OF THE DIFFUSER?')

```

```
601  FORMAT('WHAT IS THE CONSTANT HEIGHT OF THE INLET AND OUTLET /*  
602  FORMAT('WHAT IS THE WIDTH OF THE INLET CROSS-SECTIONAL AREA?')  
603  FORMAT('WHAT IS THE WIDTH OF THE OUTLET CROSS-SECTIONAL AREA?')  
604  FORMAT('IS THERE A NON-UNIFORM VELOCITY DISTRIBUTION AT THE INLE  
605  FORMAT('T(Y/N)?')  
606  FORMAT('DOWNSTREAM AREA IS NOT GREATER THAN UPSTREAM AREA.'/  
607  FORMAT('FITTING IS NOT A DIFFUSER. RE-ENTER DATA.')  
608  FORMAT('SINCE THERE IS A WIDE DIVERGING ANGLE, THE PROPER /  
609  FORMAT('INSTALLATIONS OF DIVIDING WALLS OR BAFFLES CAN REDUCE /  
FORMAT('THE RESISTANCE OF THIS FITTING. DO YOU WANT TO INSTALL /  
FORMAT('DIVIDING WALLS OR BAFFLES (Y/N)?')  
FORMAT('NO MORE QUESTIONS THIS FITTING.')  
RETURN  
END
```

```

C*****FITTING 19: PYRAMIDAL DIFFUSER, IN LINE*****
C*****REF. IDEL'CHIK, HANDBOOK OF HYDRAULIC RESISTANCE, SECTION FIVE,
C*****PAGE 169
C
C*****SUBROUTINE FIT19(SORL, GECM, WKI, WKR)
REAL WKB, L, H0, W0, H1, W1, K1, K2, A0, A1, ALFA, BETA, THETA, CEXP, CFRPRI
INTEGER GECM, SORL, WKI, ANS, YES, NO
DIMENSION WKI(2), WKR(4)
DATA YES/'Y'/, NO/'N'/
WRITE(6, 600)
CALL READR(L, 5)
10  WRITE(6, 601)
CALL READR(H0, 5)
WRITE(6, 602)
CALL READR(W0, 5)
WRITE(6, 603)
CALL READR(H1, 5)
WRITE(6, 604)
CALL READR(W1, 5)
12  WRITE(6, 605)
READ(5, 506, END=14, ERR=14) ANS
IF ((ANS.EQ.YES).OR.(ANS.EQ.NO)) GO TO 16
14  REWIND 5
WRITE(6, 610)
GO TO 12
16  CONTINUE
K1=1.0
IF (ANS.EQ.YES) K1=6.3
A0=W0*H0
A1=W1*H1
IF (A1.GT.A0) GO TO 20
WRITE(6, 607)
GO TO 19
20  ALFA=2.0*ATAN((W1-W0)/(2.0*L))
BETA=2.0*ATAN((H1-H0)/(2.0*L))
THETA=AMAX1(ALFA, BETA)
IF (THETA.LT.0.524) GO TO 30
22  WRITE(6, 608)
READ(5, 506, END=24, ERR=24) ANS
IF ((ANS.EQ.YES).OR.(ANS.EQ.NO)) GO TO 26
24  REWIND 5
WRITE(6, 610)
GO TO 22
26  CONTINUE
K2=1.0
IF (ANS.EQ.YES) K2=0.65
30  IF (THETA.GT.0.44) GO TO 40
CEXP=1.6818*(THETA**1.2)*(1.0-A0/A1)**2
GO TO 60
40  IF (THETA.GT.1.05) GO TO 50
CEXP=((3.3598*THETA)-9.7924)*THETA+9.4559)*THETA-1.9220)*
     +(1.0-A0/A1)**2
GO TO 60
50  CEXP=1.1*(1.0-A0/A1)**2
CONTINUE
CFPRI=(1.0-(A0/A1)**2)/(8.0*SIN(THETA/2.0))
WRITE(6, 609)
WKI(1)=GECM
WKI(2)=19
WKR(1)=A0
WKR(2)=CFPRI*K2
WKR(3)=CEXP*K1*K2
WKR(4)=A1
600  FORMA1(' YOU HAVE SELECTED A PYRAMIDAL INLINE RECTANGULAR DIFFUSER
     +' '/' **FIRST QUESTION, WHAT IS THE LENGTH OF THE DIFFUSER/')

```

```
501 FORMAT(;; WHAT IS THE SMALLER DIMENSION OF THE INLET AREA?'')
502 FORMAT(;; WHAT IS THE LARGER DIMENSION OF THE INLET AREA?'')
503 + FORMAT(;; WHAT IS THE DIMENSION OF THE OUTLET AREA PARALLEL'/
504 + FORMAT(;; TO THE SMALLER INLET AREA DIMENSION?'')
505 + FORMAT(;; TO THE LARGER INLET AREA DIMENSION?'')
506 + FORMAT(;; IS THERE A NON-UNIFORM VELOCITY DISTRIBUTION AT THE INLE
507 + FORMAT(;; (Y/N)?')
508 + FORMAT(;; DOWNSTREAM AREA IS NOT GREATER THAN UPSTREAM AREA.''
509 + FORMAT(;; FITTING IS NOT A DIFFUSER. PLEASE ENTER DATA.')
510 + FORMAT(;; SINCE THERE IS A WIDE DIVERGING ANGLE, THE PROPER'
511 + FORMAT(;; INSTALLATIONS OF DIVIDING WALLS OR BAFFLES CAN REDUCE'
512 + FORMAT(;; THE RESISTANCE OF THIS FITTING. DO YOU WANT TO INSTALL'
513 + FORMAT(;; DIVIDING WALLS OR BAFFLES (Y/N)?')
514 FORMAT(;; NO MORE QUESTIONS THIS FITTING.')
515 FORMAT(;; YOU MUST ENTER A LETTER IN THE BRACKETS.')
516 RETURN
517 END
```



```

K1=20
K2=A0
K3=CFRPRI*K2
K4=CEXP*K1*K2
500 ORIGLA2=A1
600 +. SCND TO RECTANGULAR OR RECTANGULAR TO ROUND CROSS-SECTION.'}
601 FORMAT(' **FIRST QUESTION IS HIS FITTING ROUND TO RECTANGULAR?')
602 +'/ {Y/N....NO MEANS RECTANGULAR TO ROUND)'})
603 FORMAT(A1)
604 FORMAT(' WHAT IS THE LENGTH OF THE DIFFUSER?')
605 FORMAT(' WHAT IS THE HEIGHT OF THE RECTANGULAR CROSS-SECTIONAL AREA?')
606 FORMAT(' WHAT IS THE WIDTH OF THE RECTANGULAR CROSS-SECTIONAL AREA?')
607 FORMAT(' WHAT IS THE DIAMETER OF THE ROUND CROSS-SECTIONAL AREA?')
608 FORMAT(' DOWNSTREAM AREA IS NOT GREATER THAN THE UPSTREAM AREA.')
609 FORMAT(' FITTING IS NOT A DIFFUSER. RE-ENTER DATA.')
610 FORMAT(' IS THERE A NON-UNIFORM VELOCITY DISTRIBUTION AT THE INLET?')
611 FORMAT(' (Y/N)?')
612 FORMAT(' SINCE THERE IS A WIDE DIVERGING ANGLE, THE PROPER')
613 INSTALLATIONS OF DIVIDING WALLS OR BAFFLES CAN REDUCE')
614 THE RESISTANCE OF THIS FITTING. DO YOU WANT TO INSTALL')
615 DIVIDING WALLS OR BAFFLES (Y/N)?')
616 FORMAT(' NO MORE QUESTIONS THIS FITTING.')
617 FORMAT(' YOU MUST ENTER A LETTER IN THE BRACKETS.')
618 RETURN
END

```

```

*****C
C FITTING 21: CIRCULAR CONTRACTION
C *****C
C REF. ASHRAE HANDBOOK, PAGE 33.34, TABLE B-5, FITTING 5-1
C TABLE INTERPOLATION
C
C
C*****C
C SUBROUTINE FIT21(SORL,GEOM,WKI,WKR)
REAL WKR,D0,D1,I,THETA,A1,A0,X
INTEGER SORL,GEOM,WKI,WKR
DIMENSION WKI(2),WKR(4),T(55),X(2),XOUT(2)
DATA T/8.0,5.0
+ 0.0,10.0,30.0,55.0,90.0,120.0,150.0,180.0,
+ 1.0,2.0,4.0,6.0,10.0
+ 0.0,0.0,0.0,0.0,0.0,0.0,0.0,0.0,0.0,0.0
+ 0.0,0.05,0.05,0.05,0.06,0.12,0.18,0.24,0.26,
+ 0.0,0.05,0.04,0.07,0.17,0.27,0.35,0.41,
+ 0.0,0.05,0.04,0.07,0.18,0.23,0.36,0.42,
+ 0.0,0.05,0.05,0.08,0.19,0.29,0.37,0.43/
WRITE(6,600)
CALL READR(1,5)
IF(L.LT.3.05) I=0.05
WRITE(6,601)
CALL READR(0,1,5)
WRITE(6,602)
CALL READR(D0,5)
CALL READR(D1,5)
THETA=114.59156*ATAN((D1-D0)/(2.0*L))
A1=0.7854*D1**2
A0=0.7854*D0**2
X(1)=THETA
X(2)=A1/A0
CALL TABLE(T,X,XOUT,C)
WKI(1)=GEOM
WKI(2)=2
WKR(1)=A1
WKR(2)=0.0
WKR(3)=C
WKR(4)=A0
600 FORMAT(' YOU HAVE SELECTED A CIRCULAR CONTRACTION. ')
+ '** FIRST QUESTION, WHAT IS THE LENGTH OF THE CONTRACTION?')
601 FORMAT(' WHAT IS THE UPSTREAM DIAMETER?')
602 FORMAT(' WHAT IS THE DOWNSTREAM DIAMETER?')
RETURN
END

```



```

C*****FITTING 23: SCREEN*****C
C*****REF. ASHRAE HANDBOOK, PAGE 33-42, TABLE B-7 FITTING 7-8*****C
C*****CURVE FIT TO TABULATED DATA, BASED ON DUCT AREA AND SCREEN*****C
C*****FREE FLOW AREA.*****C
C*****ROUTINE FIT23 (S0RL,GEOM,WKI,WKR)
REAL WKR,DUCTA,SCRNA,N,C
INTEGER S0RL,GEOM,WKI
DIMENSION WKI(2),WKR(4)
WRITE(6,600)
CALL READR(DUCTA,5)
WRITE(6,601)
CALL READR(SCRNA,5)
N=SCRNA/DUCTA
C=((97.9021*N)-92.445)*N+32.066)*N-1.9557)*N+0.025
WKI(1)=GEOM
WKI(2)=23
WKR(1)=DUCTA
WKR(2)=0.0
WKR(3)=C
WKR(4)=DUCTA
600 FORMAT(' YOU HAVE SELECTED A SCREEN OBSTRUCTION IN THE DUCT. /',
+ '** FIRST QUESTION, WHAT IS THE DUCT CROSS-SECTIONAL AREA?')
601 FORMAT(' LAST QUESTION, WHAT IS THE FREE FLOW AREA OF THE SCREEN?')
+ RETURN
END

```

```

***** **** FITTING 24: LOUVER ENTRANCE **** **** ****
C REF. HANDBOOK OF HYDRAULIC RESISTANCE, IDEL'CHIK
C CURVE FIT TO DYNAMIC LOSS INFORMATION, NO FRICTION INCLUDED
C
C***** **** SUEROOUTINE FIT24(SORI,GEOM,WKI,WKR) **** ****
C
REAL DX,DB,N,DUCTA,P
INTEGER WKI(4),SORI,GEOM
DIMENSION WKI(2),WKR(4)
WRITE (6,600)
CALL READD(DB,5)
WRITE (6,601)
CALL READD(DB,5)
WRITE (6,602)
CALL READD(N,5)
WRITE (6,603)
CALL READD(DB/DX)
F=N*DB/DX
C=62.144*EXP(-4.47543*F)
WKI(1)=GEOM
WKI(2)=24
WKI(3)=DUCTA
WKR(2)=0.0
WKR(3)=C
WKR(4)=DUCTA
600 FORMAT(' YOU HAVE SELECTED A LOUVERED ENTRANCE.'/
+       ' **FIRST QUESTION, WHAT IS THE DISTANCE ACROSS THE '/
+       ' LOUVER OPENINGS?')
601 FORMAT(' WHAT IS THE DISTANCE BETWEEN THE LOUVERS, USE THE '/
+       ' CLOSEST DISTANCE.')
602 FORMAT(' HOW MANY OPENINGS ARE THERE BETWEEN THE LOUVERS?')
603 FORMAT(' LAST QUESTION, WHAT'S THE AREA OF THE DUCT JUST'/
+       ' INSIDE THE LOUVER ENTRANCE?')
RETURN
END

```

```

***** * * * * * ***** * * * * * ***** * * * * * ***** * * * * * ***** * * * * *
C   FITTING 25: INLET FILTER
C   ***** * * * * * ***** * * * * * ***** * * * * * ***** * * * * * ***** * * * * *
C   REF. NAVSEA INLET DESIGN HANDBOOK
C   DEFAULT SYSTEM DD963 TYPE FILTER, CURVE FIT TO DATA
C   OPERATIONAL FILTERS, POWER CURVE FIT IS MADE TO PRESSURE LOSS DATA
C   BASED ON FACE VELOCITY ON FILTER. DATA SUPPLIED BY USER.
C   ***** * * * * * ***** * * * * * ***** * * * * * ***** * * * * * ***** * * * * *
C   SUBROUTINE FIT25(SQRL,GEOM,WKR)
C   WKR AREAVL,DEL2,X,Y,SUMX,SUMY,SUMX2,SUMY2,SUMXY,A,B
C   NPTS,N,ANS,I3S,NPTS NO
C   DIMENSION WK1(2),WKR(4),VEL(10),DELP(10),XX(10),YY(10)
C   DATA YES/'Y',NC/'N'
C   WRITE(6,600)
C   CALL READR(AR23,5)
2    WRITE(6,601)
     READ(5,602,END=4,ERR=4) ANS
4    IF(ANS.EQ.'Y'.OR.(ANS.EQ.NC)) GO TO 6
     READ(5,603)
     WRITE(6,607)
     GO TO 2
6    CONTINUE
     IF(ANS.QYES) GO TO 30
     WRITE(6,603)
     CALL READI(NPTS,5)
     DO 10 I=1,NPTS
       WRITE(6,604) I
       CALL READR(VEL(I),5)
       WRITE(6,605) I
       CALL READR(DELP(I),5)
       XX(I)=ALOG(VEL(I))
       YY(I)=ALOG(DELP(I))
10   CONTINUE
     SUMX=0.0
     SUMY=0.0
     SUMX2=0.0
     SUMY2=0.0
     SUMXY=0.0
     DO 20 I=1,NPTS
       SUMX=SUMX+XX(I)
       SUMY=SUMY+YY(I)
       SUMX2=SUMX2+XX(I)**2
       SUMY2=SUMY2+YY(I)**2
       SUMXY=SUMXY+XX(I)*YY(I)
20   CONTINUE
     N=FLCAT(NPTS)
     B=(N*SUMXY-SUMX*SUMY)/(N*SUMX2-(SUMX**2))
     A=EXPE(SUMY/N-B*SUMX/N)
     WRITE(6,606)
     GO TO 40
30   A=0.0167
     B=1.6287
     WRITE(6,606)
40   CONTINUE
     WK1(1)=ZOM
     WK1(2)=ZOM
     WK1(1)=AREA
     WK1(2)=1
     WK1(3)=B
     WK1(4)=AREA
600   FORMAT(' YOU HAVE SELECTED THE INLET FILTER. //')
601   + '**FIRST QUESTION: WHAT IS THE TOTAL FACE AREA OF THE FILTER?')
602   FORMAT(' DO YOU WANT TO USE THE DD963 TYPE FILTER IN THE DRY COND')
603   +ITION(Y/N)?')
602   FORMAT(A1)
603   FORMAT(' THE OPERATING CHARACTERISTICS OF YOUR FILTER WILL BE'//)
   + DEFINED BY A POWER CURVE FIT OF THE FORM: //'
   + DELTA PRESSURE = COEFA * FACE VELOCITY ** COEPS //'
   + APPLIED TO PERFORMANCE DATA TO BE INPUT BY THE USER. //'

```

```
+! ** HOW MANY DATA POINTS DO YOU HAVE (1 TO 9)?/  
+! DO NOT PUT IN THE POINT {0.0,0.0}!  
604 FORMAT(' FLOW VELOCITY ({11},{1})=? (FEET PER SECOND)')  
605 FORMAT(' DELTA PRESSURE ({11},{1})=? (INCHES H2O)')  
606 FORMAT(' NO MORE QUESTIONS.')  
607 FORMAT(' YOU MUST ENTER A LETTER IN THE BRACKETS.')  
RETURN  
END
```

```

C*****FITTING 26: SILENCER MULTI-BAFFLE TYPE*****
C*****REF. NAVSEA INLET DESIGN HANDBOOK*****
C*****COMPOSITE LOSS COEFICIENT BASED ON A SUDDEN CONTRACTION,
C*****FRICTION AND A SUDDEN EXPANSION*****
C*****SUBROUTINE FIT26(SORL,GEOM,WKI,WKR)
C*****REAL WKR,G,T,L,H,CX,A0,A1,DH,R,C1,C2,C3,C,N
C*****INTEGER SORL,GEOM,WKI
C*****DIMENSION WKR(2),WKR(4)
C*****WRITE(6,600)
C*****CALL READR(G,5)
C*****WRITE(6,601)
C*****CALL READR(T,5)
C*****WRITE(6,602)
C*****CALL READR(L,5)
C*****WRITE(6,603)
C*****CALL READR(H,5)
C*****WRITE(6,604)
C*****CALL READR(CX,5)
C*****WRITE(6,605)
C*****CALL READR(N,5)
A0=CX*H
A1=N*G*H
DH=2.0*G*H/(G+H)
P=(CX-N*G)/(2.0*N)
C SUDDEN CONTRACTION
C1=0.1141*((E/DH+0.1)**14.4405)*(1.0-A1/A0)
C FRICTION
C2=0.05*L/DH
C SUDDEN EXPANSION
C3=0.47*(1.0-N*G/CX)**2+0.02
C COMPOSITE COEFFICIENT
C=C1+C2+C3
WKI(1)=GEOM
WKI(2)=26
WKR(1)=A0
WKR(2)=0.0
WKR(3)=C
WKR(4)=A0
600 FORMAT(' YOU HAVE SELECTED A MULTI-BAFFLE TYPE SILENCER.',/
+ ' EACH BAFFLE HAS A STREAMLINED SHAPE. IT IS THE TYPE',/
+ ' USED IN THE INLETS OF THE DD963.'/>
+ '** FIRST QUESTION, WHAT IS THE GAP BETWEEN THE BAFFLES?')
601 FORMAT(' WHAT IS THE THICKNESS OF THE BAFFLES?')
602 FORMAT(' WHAT IS THE LENGTH OF THE BAFFLES?')
603 FORMAT(' WHAT IS THE DIMENSION OF THE BAFFLES PARALLEL TO THE GAP'
+ '?')
604 FORMAT(' WHAT IS THE DIMENSION OF THE MAIN DUCT ACROSS THE GAPS?')
605 FORMAT(' LAST QUESTION, HOW MANY GAPS ARE THERE?')
RETURN
END

```

```

C***** FITTING 27: GAS TURBINE MODULE *****C
C*** MASS FLOW THROUGH THE MODULE. LOSSES IN THE MODULE BASED ON THE C
C*** MASS FLOW THROUGH THE MODULE. NO QUESTIONS ASKED HERE. THIS C
C*** SUBROUTINE JUST LOCATES THE MODULE. NOTE THAT THE MODULE IS C
C*** THE FLOW PATH NOT THE ENGINE. LOSSES WILL BE IN THE COOLING FLOW. C
C***** SUBROUTINE FIT27(SORL,GEOM,WKI,WKR)
C
      REAL WKRA0
      INTEGER SORL,GEOM,WKI
      DIMENSION WKI(2),WKR(4)
      DOUBLE PRECISION (6,6)0
      WKI(1)=GEOM
      WKI(2)=27
      WKR(1)=1.0
      WKR(2)=1.0
      WKR(3)=1.0
      WKR(4)=1.0
600  FORMAT(' YOU HAVE SELECTED THE GAS TURBINE MODULE AS A PART OF',/
           +        ' THE COOLING FLOW PASSAGE. NO QUESTIONS, JUST NEEDED',/
           +        ' TO KNOW WHERE YOU WANTED THE MODULE.')
      RETURN
END

```

```

***** FIITING 28 : WASTE HEAT RECOVERY BOILER ****
***** REF. EXTENDED SURFACE HEAT TRANSFER, D.Q. KERNS AND A.D. KRAUSS ****
***** PAGES 582-589 PRELIMINARY DRAWINGS ON THE RACER SYSTEM ****

SUBROUTINE FIT28(SORL,GEOM,WKI,WKR)
REAL WKR,DV,DE,ST,N,T,L,VFACT,TEST,CPRIME,AREA
INTEGER SORL,GEOM,WKI,ANS,STAG,INLINE,YES,NO
DIMENSION WKI(2),KE(4)
DATA STAG/'S'/,INLINE/'I'/,YES/'Y'/,NO/'N'/
10 WRITE(6,600)
READ(5,601,END=20,ERR=20) ANS
IF((ANS.EQ.YES).OR.(ANS.EQ.NO)) GO TO 30
20REWIND 5
WRITE(6,602)
GO TO 30
30CONTINUE
AREA=68.75
VFACT=1.35095
CPRIME=35.02027
DV=0.03987
IF(ANS.EQ.YES) GO TO 80
40WRITE(6,603)
CALL READR(DV,5)
WRITE(6,604)
CALL READR(DE,5)
WRITE(6,605)
CALL READR(ST,5)
WRITE(6,606)
50READ(5,601,END=50,ERR=50) ANS
IF((ANS.EQ.STAG).OR.(ANS.EQ.INLINE)) GO TO 60
REWIND 5
WRITE(6,602)
GO TO 30
60CONTINUE
70WRITE(6,607)
CALL READR(N,5)
WRITE(6,608)
CALL READR(SL,5)
WRITE(6,609)
CALL READR(TL,5)
WRITE(6,610)
CALL READR(XL,5)
80FIND HIGHEST VELOCITY OF THE TUBE BANK
VFACT=ST/(ST-DE)
IF(ANS.EQ.INLINE) GO TO 70
90EST=(ST+DE)/2.0
SD=SQR((SL**2+(ST/2.0)**2))
100(SD**2-TEST) VFACT=ST/(2.0*(SD-DE))
CONTINUE
110FORMAT('WASTE HEAT RECOVERY BOILER')
120FORMAT('USE THE PROPOSED RACER DESIGN DEVELOPED BY SOLAR')
130FORMAT('TURBINES (Y/N)?')
140FORMAT(A1)
150FORMAT('YOU MUST USE A LETTER IN THE BRACKETS.')
160FORMAT('A NUMBER OF QUESTIONS ARE REQUIRED ABOUT THE TUBE')
170FORMAT('AND THE GEOMETRY TO OBTAIN LOSS COEFFICIENTS.')

```

```
+      USE CONSISTENT UNITS (FEET).'/  
+      **FIRST QUESTION: WHAT IS THE VOLUMETRIC HYDRAULIC //  
+      DIAMETER? IF YOU DO NOT KNOW 0.040 FEET IS A GOOD.//  
+      GUSS FOR THIS APPLICATION.')
```

604 FORMAT('WHAT IS THE DIAMETER OR EQUIVALENT DIAMETER OF A '/  
+ FINNED TUBE IN THE BUNDLE (FEET)? IF YOU DO NOT.//  
+ KNOW, 1.4 TIMES THE BARE TUBE DIAMETER IS A GOOD.//  
+ GUESS.')

605 FORMAT('WHAT IS THE TUBE SPACING IN A BANK OF TUBES (FEET)?'/  
+ TUBE CENTERLINE TO TUBE CENTERLINE.')

606 FORMAT('ARE THE TUBE BANKS STAGGERED OR INLINE (S/I) ?')

607 FORMAT('HOW MANY TUBE BANKS ARE THERE ?')

608 FORMAT('WHAT IS THE DISTANCE BETWEEN THE TUBE BANKS ?'/  
+ FROM THE PLANE OF A TUBE CENTERLINE TO TUBE CENTERLINE.//  
+ PLANE OF THE NEXT BANK.')

609 FORMAT('WHAT IS THE DUCT DIMENSION PARALLEL TO THE TUBES ?')

610 FORMAT('WHAT IS THE DUCT DIMENSION ACROSS THE TUBES ?')

RETURN  
END

```

C*****FITTING 29: ABRUPT EXIT*****
C*****REF. ASHRAE HANDBOOK, PAGE 33-29, TABLE B-2, FITTING 2-1*****
C*****THIS SHOULD ALWAYS BE USED FOR THE LAST FITTING OF THE ENGINE*****
C*****EXHAUST BRANCH NODE SIX. IT MAY BE REQUIRED FOR THE COOLING*****
C*****PLATE IF IT GOES DIRECTLY TO THE ATMOSPHERE (CLASS 1&2).*****
C*****SUBROUTINE FIT29(SORL,GEOM,WKI,WKR)
C
      REAL WKR, AREA
      INTEGER SORL, GEOM, WKI
      DIMENSION WKI(2), WKR(4)
      WRITE(6,600)
      CALL READR(AREA,5)
      WKI(1)=GEOM
      WKI(2)=29
      WKR(1)=AREA
      WKR(2)=0.0
      WKR(3)=0.0
      WKR(4)=1.0
      WKR(5)=AREA
600   FORMAT(' YOU HAVE SELECTED AN ABRUPT EXIT TO THE ATMOSPHERE. /',
+        '**JUST ONE QUESTION, WHAT IS THE AREA OF THE EXIT PLANE?'
+        ')
      RETURN
END
C*****FITTING 30: FITTING OF YOUR CHOICE, NOT ON MENU*****
C
C*****NO REFERENCE. THIS IS INTENDED TO BE A CATCH ALL FITTING FOR*****
C*****THOSE FITTINGS NOT LISTED ON THE MENU. IT INPUTS A CONSTANT*****
C*****COEFFICIENT FOR MULTIPLICATION TO THE PRESSURE VELOCITY. THE*****
C*****VELOCITY IS COMPUTED THROUGH THE AREA INPUT REQUESTED.*****
C*****SUBROUTINE FIT30(SORL,GEOM,WKI,WKR)
C
      REAL WKR, AI, AO
      INTEGER SORL, GEOM, WKI
      DIMENSION WKI(2), WKR(3)
      WRITE(6,600)
      CALL READR(AI,5)
      WRITE(6,601)
      CALL READR(AO,5)
      WKI(1)=GEOM
      WKI(2)=30
      WKR(1)=AI
      WKR(2)=0.0
      WKR(3)=0
      WKR(4)=AO
600   FORMAT(' SINCE THE PROGRAM IS LIMITED IN THE NUMBER OF FITTINGS/',
+        'FOR WHICH IT CAN PRODUCE PERFORMANCE CHARACTERISTICS, /',
+        'THIS OPTION ALLOWS THE USER TO INPUT CHARACTERISTICS /',
+        'OF A FITTING NOT LISTED. /',
+        '** FIRST QUESTION, WHAT IS THE CHARACTERISTIC AREA OF /',
+        'THE FITTING? THROUGH THIS AREA THE PROGRAM PRODUCES /',
+        'A VELOCITY USED TO CALCULATE THE VELOCITY PRESSURE. /',
+        '** WHAT IS THE MULTIPLIER COEFFICIENT USED IN THE /',
+        'VELOCITY PRESSURE EXPRESSION: //',
+        'P=CO*RHOM*(VELOCITY**2)/(2.0*GC) ? ')
601   FORMAT(' LAST QUESTION, WHAT IS THE OUTLET AREA? ')
602   FORMAT(' ')
      RETURN
END

```

```

C***** **** C
C      TABLE INTERPOLATION SUBROUTINE: PRODUCES VALUE FROM 2-D TABLE  C
C
C      INPUT A ONE DIMENSIONAL ARRAY "T", CONTAINING THE FOLLOWING    C
C      INFORMATION: NUMBER OF X'S, NUMBER OF Y'S, THE X'S, THE Y'S, THE    C
C      TABLE STARTING WITH THE SMALLEST X-Y VALUE INPUT BY ROW        C
C      INCREASING X VALUES WITH ROWS INPUT WITH INCREASING Y VALUES.    C
C***** **** C
C
C      SUBROUTINE TABLE(T,X,XOUT,FF)
C      INPUT: T(1).....OUTPUT: XOUT,F
C      DIMENSION T(200),X(2),NN(2),XOUT(2),F(100)
C      REAL NEV
C      INTEGER V(2),XINIT(2),YINC(2)
C      NXI=1
C      NN(1)=3
C      NN(2)=3
C      IQ=3
C      NXI=3
C      M=1
C      LOOP DETERMINES STARTING POINTS IN T ARRAY FOR INTERPOLATION
C      DO 20 I=1,2
C      K=NXI+T(I)-1
C      IF(X(I).GE.T(NXI).AND.X(I).LE.T(K)) GO TO 32
C      IF(X(I) OUT OF RANGE, INFORM USER THAT TABLE INTERPOLATION IS NOT
C      POSSIBLE.
C      XOUT(I)=0
C      GO TO 999
32 XOUT(I)=1
J=NXI
21 L=(J+K)/2
IF((X(I)-T(J))*(X(I)-T(L)).GT.0.) GO TO 23
K=L
GO TO 24
23 J=L
24 IF((K-J).GT.1) GO TO 21
L=K-NN(I)/2
IF(L.LT.NXI) GO TO 25
K=NXI+T(I)-NN(I)
IF(L.GT.K) L=K
GO TO 26
25 L=NXI
26 IQ=IQ+T(I)+(L-NXI)*M
IA=0
IF(I.NE.1) IA=NN(I)
YINC(I)=M*(T(I)-IA)
XINIT(I)=L
NXI=NXI+T(I)
M=4*T(I)
20 CONTINUE
V(2)=L
L=NN(1)
NXI=NN(1)
C      INTERPOLATE IN FIRST DIMENSION
V(1)=NXI
DO 11 J=1,NX
F(J)=NEV(X(1),T,XINIT(1),T,IQ,L)
C      INTERPOLATE IN SECOND DIMENSION
11 IQ=IQ+YINC(1)
M=NN(1)
F(M,V(2))=NEV(X(2),T,XINIT(2),F,1,M)
FF=F(M+V(2))
RETURN
999 FF=1000.0
RETURN
END
C      FUNCTION TO RETURN INTERPOLATED VALUE FROM TABLE
FUNCTION NEV(X,AX,NX,AY,NY,N)
C      FUNCTION NEV PERFORMS AN "N" POINT INTERPOLATION FOR X
STARTING AT ABSISSA ARRAY AX(NX) AND ORDINATE ARRAY

```

```
C      AY(NY) WITH THE INTERPOLATED VALUE RETURNED IN NEV
      DIMENSION AX(1),AY(1),F(100)
      REAL NEW
10      DO 10 J=1,N
      F(J)=AY(NY+J-1)
      N=N-1
      DO 20 J=1,N1
      NJ=N-J
      DO 20 I=1,NJ
      KI=NX+I-1
      F(I)=(F(I+1)-F(I))*(X-AX(KI))/(AX(KI+J)-AX(KI))+F(I)
      CONTINUE
      NEV=F(1)
      RETURN
      END
```

```

***** **** * **** * **** * **** * **** * **** * **** * **** * **** * **** * C
C      LCAD SUBROUTINE: PLACES FITTING INFORMATION IN A STORAGE ARRAY C
C
C      SUBROUTINE ALSC CHECKS FOR AREA CONTINUITY IN A BRANCH. IF THE C
C      PRESENT FITTING AND THE LAST FITTING DO NOT MATCH A WARNING C
C      IS GIVEN TO THE USER. AN OPPORTUNITY TO NOT LOAD THE FITTING C
C      IS PROVIDED AND THE USER IS RETURNED TO THE MENU. C
C
C      ***** **** * **** * **** * **** * **** * **** * **** * **** * **** * C
C      SUBROUTINE LOAD(M,GEOM,WKI,WKR,WORKA,WORKI,WORKR)
C      REAL WKR,WORKR,TESTI,LASTA,THISA
C      INTEGER M,WKI,WORKI(ANS,YES,NO),GEOM,TESTI,TYPE,LASTYP
C      DIMENSION WKI(2),WKR(3),WORKI(200,2),WORKR(200,4)
C      DATA YES,NO/'Y','N'
C      IF(M.EQ.1) GO TO 10
C      TYPEP=WORKI(M,2)
C      LASTYP=WORKI(M-1,2)
C      SOME FITTINGS MAY NOT EXHIBIT AREA CONTINUITY
C      IF(TYPEP.EQ.13) GO TO 10
C      IF(TYPEP.EQ.15) GO TO 10
C      IF(LASTYP.EQ.23) GO TO 10
C      IF(TYPEP.EQ.23) GO TO 10
C      IF(LASTYP.EQ.25) GO TO 10
C      IF(TYPEP.EQ.251) GO TO 10
C      IF(TYPEP.EQ.27) GO TO 10
C      IF(LASTYP.EQ.27) GO TO 10
C      IF(LASTYP.EQ.28) GO TO 10
C      IF(TYPEP.EQ.29) GO TO 10
C      TESTI=THE INTERVAL BETWEEN FITTING ID NUMBERS
C      TESTI=WKI(2)-WORKI(M-1,1)
C      CHECK TO SEE IF FITTING IS THE START OF A BRANCH
C      IF(TESTI.GT.1) GO TO 10
C      LASTA=AREA, EXIT FROM FITTING
C      LASTA=WORKR(M-1,4)
C      IF(LASTYP.EQ.7) LASTA=WCRKR(M-1,1)
C      THIS AREA, ENTRY TO FITTING
C      THISA=WKR(1)
C      TESTR=ABS(THISA-LASTA)/THISA
C      IF(TESTR.LT.0.05) GO TO 10
C      WRITE(6,600)
10     WRITE(6,601)
11     READ(5,602,END=12,ERR=12) ANS
12     IF((ANS.EQ.YES).OR.(ANS.EQ.NO)) GO TO 20
13     REWIND 3
14     WRITE(6,603)
15     GO TO 20
20     CONTINUE
21     IF(ANS.EQ.YES) GO TO 30
22     GEOM=GEOM-1
23     M=M-1
24     GO TO 40
30     WORKI(M,1)=WKI(1)
31     WORKI(M,2)=WKI(2)
32     WORKR(M,1)=WKR(1)
33     WORKR(M,2)=WKR(2)
34     WORKR(M,3)=WKR(3)
35     WORKR(M,4)=WKR(4)
40     CONTINUE
41     CALL ERICMS('CLRSCRN ')
42     FORMAT('/* *** WARNING: AREA CONTINUITY BETWEEN THIS FITTING AND'/
43           ' LAST FITTING IS OFF BY AT LEAST FIVE PERCENT. */')
44     FORMAT(' DO YOU WANT TO ENTER THIS FITTING (Y/N)?')
45     FORMAT(A1)
46     FORMAT(' YOU MUST ENTER A LETTER INDICATED IN THE BRACKETS.')
47     RETURN
48 END

```

```

***** DUCT DATA FILE OUTPUT SUBROUTINE *****
C
C      WRITES THE SYSTEM ARRAYS WORKI AND WORKR TO THE DUCT DATA FILE.
C      ALLOWS THE USER TO SERIALIZE EACH FILE CREATED.
C      *WARNING* WRITES OVER OLD FILES, SAVE THEM UNDER A DIFFERENT NAME.C
*****
C      SUBROUTINE SUMCUT(WORKI,WORKR,M)
REAL WORKR
INTEGER WORKI " SERIAL
DIMENSION WORKI(200,2),WORKR(200,4)
WRITE (6,600)
CALL READI(SERIAL,5)
WRITE (8,601) SERIAL
WRITE (8,602) M
DO 10 I=1,3
    WRITE (8,603) I,WORKI(I,1),WORKI(I,2),WORKR(I,1),WORKR(I,2),
    + WORKR(I,3),WORKR(I,4)
10 CONTINUE
REWIND 8
600 FORMAT(' ', 'WHAT SERIAL NUMBER WOULD YOU LIKE TO GIVE THIS DUCT DATA
+ FILE? //', 'YOU MAY USE UP TO A SIX DIGIT INTEGER NUMBER.')
601 FORMAT(I6)
602 FORMAT(I3)
603 FORMAT(I3,3X,I6,3X,I2,3X,F10.4,3X,F10.4,3X,F10.4,3X,F10.4)
RETURN
END
*****
C      REAL NUMBER READ SUBROUTINE: FREE FORMAT
C      PREVENTS THE INADVERTENT ENTRY OF NULL DATA (HITTING THE RETURN
C      KEY WITH NO ENTRY) AND INCORRECT DATA. THIS ROUTINE IS USED.
C      IT ALLOWS FREE FORMAT INPUT. TWO NULLS KILLS THE PROGRAM.
*****
C      SUBROUTINE REALL (ANSR,FD)
REAL ANSR
INTEGER COUNT, FE
COUNT=0
10 CONTINUE
COUNT=COUNT+1
IF (COUNT.LT.3) GO TO 20
CALL FRICMS ('CIRSCRY ')
WRITE (6,600)
GO TO 40
20 CONTINUE
READ (FD,* ,END=30,ERR=30) ANSR
RETURN
30 REWIND FD
WRITE (6,601)
GO TO 15
40 CONTINUE
STOP
600 FORMAT ('////', 'PROGRAM KILLED - TWO NULL STRINGS ENTERED!//',
601 'WARNING: NULL STRINGS ARE NOT ALLOWED, ENTER A NUMERIC
+AL VALUE.')
END

```

```

***** * ***** * ***** * ***** * ***** * ***** * ***** * ***** * ***** * C
C   INTEGER READ SUBROUTINE: FREE FORMAT
C   PREVENTS THE INADVERTENT ENTRY OF NULL DATA (HITTING THE RETURN
C   KEY WITH NO ENTRY) AND INCORRECT DATA. THIS ROUTINE IS USED.
C   IT ALLOWS FREE FORMAT INPUT. TWO NULLS KILLS THE PROGRAM.
***** * ***** * ***** * ***** * ***** * ***** * ***** * ***** * ***** * C
C   SUBROUTINE READI (ANSI,FD)
C   INTEGER COUNT, ANSI,FD
C   COUNT=0
10   COUNTINUE
    COUNT=COUNT+1
    IF ((COUNT>13)) GO TO 20
    CALL FRTCMIS ('CLRSCRN ')
    WRITE(6,600)
    GO TO 40
20   COUNTINUE
    READ (FD, *,END=30,ERR=30) ANSI
    RETURN
30   REWIND FD
    WRITE(6,601)
    GO TO 10
40   COUNTINUE
    STOP
600   FORMAT ('//', ' PROGRAM KILLED - TWO NULL STRINGS ENTERED! ')
601   FORMAT ('//', ' WARNING: NULL STRINGS ARE NOT ALLOWED, ENTER A NUMERIC
        + AL VALUE.')
    END
***** * ***** * ***** * ***** * ***** * ***** * ***** * ***** * ***** * C
C   OPERATING CONDITIONS INPUT SUBROUTINE: TEMP, PRESS, HUMIDITY
C   SUBROUTINE TO INPUT THE FOLLOWING PARAMETERS:
C       AMBIENT TEMPERATURE (DEGREES F)
C       AMBIENT PRESSURE (PSIA)
C       RELATIVE HUMIDITY (GRAINS PER POUND MASS DRY AIR)
C
C   THE PROGRAM COULD BE MODIFIED TO ACCEPT RELATIVE HUMIDITY (%) AND
C   CONVERT IT TO GRAINS REQUIRED FOR USE LATER IN THE PROGRAM. THAT
C   MODIFICATION SHOULD BE ACCOMPLISHED HERE.
***** * ***** * ***** * ***** * ***** * ***** * ***** * ***** * ***** * C
C   SUBROUTINE OPCND(TO,PO,HUMID)
    READ (TO,PO,HUMID)
    WRITE(6,600)
    CALL READR(TO,5)
    WRITE(6,601)
    CALL READR(PO,5)
    WRITE(6,602)
    CALL READR(HUMID,5)
    CALL FRTCMIS ('CLRSCRN ')
600   FORMAT(' ', ' THIS PORTION OF THE PROGRAM INPUTS THE ENVIRONMENTAL COND
        +ITIONS.', ' WHAT IS THE AMBIENT TEMPERATURE (DEGREES F)?')
601   FORMAT(' ', ' WHAT IS THE AMBIENT PRESSURE (PSIA)?')
602   FORMAT(' ', ' WHAT IS THE RELATIVE HUMIDITY (GRAINS PER POUND AIR)?')
    RETURN
    END

```



```

***** ENGINE SUBROUTINE: COMPUTES OPERATING POINT FOR GIVEN CONDITIONS *****
C
REF. 7LM2500 MARINE GAS TURBINE PERFORMANCE DATA, PREPARED BY
GENERAL ELECTRIC COMPANY MARINE AND INDUSTRIAL PROJECTS
DEPARTMENT NUMBER MTD-2-2500 B, REVISED NOVEMBER 1973.
ENGINE PERFORMANCE IS REPRODUCED BY STOREING A STANDARD CONDITION
OPERATING MAP AND APPLYING CORRECTIONS FOR OFF-STANDARD
OPERATING CONDITIONS. MAIN INTEREST IS TO OBTAIN N2,78, AND T8.
SFC 154 AND NG ARE ALSO PROVIDED.
C
***** SUBROUTINE ENGINE(INLOSS,EXLOSS,T0,P0,HUMID,BHP,NPT,W2C,T8C,
+ P2C,T8C,SFC,T54C,NGC,OFF)
+ REAL T0,P0,HUMID,INLOSS,EXLOSS,BHP,NPT,W2C,T8C,P2C,DELTA,THETA,BHPTP,
+ BHPT,E,NPT,W2S,W8S,T8S,P8S,SFCS,T54S,NGS,NGC,W2C,W8C,T8C,P2C,
+ SFC,T54C
+ INTEGER OFF
+ P2C=10459.67
+ T2C=P2C
+ DELTA IS THE PRESSURE CORRECTION, THETA THE TEMPERATURE CORRECTION
INLET AND EXHAUST LOSSES ARE A SEPARATE CORRECTION
DELTA=P2C/14.696
THETA=T2C/518.67
C
CORRECT DESIRED BHP,NPT TO STANDARD CONDITIONS, INPUT TO ENGINE.
BHEE=BHP/(DELTA*SORT(THETA))
NPT=NPT/SORT(THETA)
CALL LM2500(BHEE,NPT,W2S,W8S,T8S,P8S,SFCS,T54S,NGC)
IF(OFF.GT.0) GC TO 20
C
CORRECT STANDARD ENGINE PARAMETERS TO OPERATING CONDITIONS.
NGC=CFNG(NGC,THETA,INLOSS,EXLOSS,HUMID)
W2C=CFW(W2S,THETA,DELTA,INLOSS,EXLOSS,HUMID,NGC)
W8C=CFW(W8S,THETA,DELTA,INLOSS,EXLOSS,HUMID,NGC)
T8C=CFT8(T8S,THETA,INLOSS,EXLOSS,HUMID,NGC)
P8C=CFP8(P8S,DELTA,EXLOSS)
SFC=SFC(SFC,T54S,THETA,INLOSS,EXLOSS,HUMID,NGC)
CONTINUE
RETURN
END
C
FUNCTION TO CORRECT GAS GENERATOR SPEED
FUNCTION CFNG(NGC,THETA,INLOSS,EXLOSS,HUMID)
REAL THETA,INLOSS,EXLOSS,HUMID,NGC,DELPI,ADELPE,ADELH,
+ CF,CFNG
IF(NGC.LE.9100.0) GO TO 10
IF(NGC.GE.9200.0) GO TO 20
ADELPI=0.000733+(NGC-9100.0)*0.0005e7/100.0
GO TO 30
ADELPI=0.000733
GO TO 30
ADELPI=-0.0013
CONTINUE
ADELPE=0.00035
ADELH=-0.002200/100.0
CF=(1.0+ADELPI*INLOSS)*(1.0+ADELPE*EXLOSS)*(1.0+ADELH*HUMID)*
+ SORT(THETA)
CFNG=NGC*CF
RETURN
END
C
FUNCTION TO CORRECT MASS FLOW RATE
FUNCTION CFW(NGC,THETA,DELTA,INLOSS,EXLOSS,HUMID,NGC)
REAL NGC,THETA,DELTA,INLOSS,EXLOSS,HUMID,NGC,ADELPI,ADELPE,ADELH,
+ CF,CFW
IF(NGC.LE.9100.0) GO TO 10
IF(NGC.GE.9200.0) GO TO 20
ADELPI=-0.00075-(NGC-9100.0)*0.000917/100.0

```

```

      GO TO 30
10    ADELPI=-0.00075
      GO TO 30
20    ADELPI=-0.001667
      CONTINUE
      ADELPE=0.000475
      ADELH=-0.005423/100.0
      CF=(1.0+ADELPI*INLOSS)*(1.0+ADELPE*EXLOSS)*(1.0+ADELH*HUMID)*
      + DELTA/SQRT(THETA)
      CF=NEW*CF
      RETURN
      END

C     FUNCTION TO CORRECT T8
FUNCTION CFT8(T8,THETA,INLOSS,EXLOSS,HUMID,NGC)
REAL T8,THETA,INLOSS,EXLOSS,HUMID,NGC,ADELPI,ADELPE,ADELH,
      CF
      IF(NGC.LE.9100.0) GO TO 10
      IF(NGC.LE.9200.0) GO TO 20
      ADELPI=0.00105*(NGC-9100.0)*0.001242/100.0
      GO TO 30
10    ADELPI=0.00105
      GO TO 30
20    ADELPI=0.002292
      CONTINUE
      ADELPE=0.00095
      ADELH=-0.000643/100.0
      CF=(1.0+ADELPI*INLOSS)*(1.0+ADELPE*EXLOSS)*(1.0+ADELH*HUMID)*
      + THETA
      CF=TB*CF
      RETURN
      END

C     FUNCTION TO CORRECT 28
FUNCTION CFP8(28,DELTA,EXLOSS)
REAL TB,DELTA,EXLOSS,C,CFP8
CF=(1.0+0.50241*EXLOSS)*DELTA
CF=28*CF
RETURN
END

C     FUNCTION TO CORRECT T54
FUNCTION CFT54(T54,THETA,INLOSS,EXLOSS,HUMID,NGC)
REAL T54,THETA,INLOSS,EXLOSS,HUMID,NGC,ADELPI,ADELPE,ADELH,
      CF
      IF(NGC.LE.9100.0) GO TO 10
      IF(NGC.LE.9200.0) GO TO 20
      ADELPI=0.000958*(NGC-9100.0)*0.001/100.0
      GO TO 30
10    ADELPI=0.000958
      GO TO 30
20    ADELPI=0.001958
      CONTINUE
      ADELPE=0.00056
      ADELH=-0.002057/100.0
      CF=(1.0+ADELPI*INLOSS)*(1.0+ADELPE*EXLOSS)*(1.0+ADELH*HUMID)*
      + DELTA
      CF=CF*T54
      RETURN
      END

```

LM2500 ENGINE TABULATION OF PERFORMANCE DATA FOR STD. CONDITIONS

THIS DATA IS TAKEN FROM CASE NUMBERS 536 TO 607 PAGES 171-185  
OF THE GE MANUAL. EXTRAPOLATED VALUES PROVIDED BY THE AUTHOR  
USING GRAPHICAL TECHNIQUES.

---

```

SUBROUTINE LM2500(BHP,NPT,W2,W8,T8,P8T,SFC,T54,NG,OFF)
REAL BHP,NPT,W2,W8,T8,P8T,SFC,T54,NG,X,
+ 2T,NGT,P8T,SFC,T54T,NGT
INTEGER OFF,XOUT
DIMENSION X(2),XOUT(2),W2T(64),W8T(64),T8T(64),P8TT(64),SFC(64),
+ T54T(64),NGT(64)
DATA W2T/ 8.0, 6.0/
+ 1000.0, 3000.0, 5000.0, 10000.0, 15000.0, 17500.0, 20000.0, 22500.0,
+ 12000.0, 18000.0, 24000.0, 30000.0, 33000.0, 36000.0,
+ 41.3, 57.6, 87.2, 121.2, 148.0, 158.0, 169.0, 175.0,
+ 40.2, 61.6, 77.2, 105.6, 127.5, 137.6, 146.4, 156.0,
+ 43.3, 61.2, 74.8, 98.7, 117.5, 125.7, 133.6, 141.3,
+ 44.4, 62.7, 73.8, 98.4, 113.3, 120.9, 127.3, 134.3,
+ 51.7, 65.5, 75.1, 98.4, 112.2, 119.2, 126.4, 132.9,
+ 54.7, 66.4, 76.6, 98.7, 112.2, 119.2, 125.5, 131.6/
DATA W8T/ 8.0, 6.0/
+ 1000.0, 3000.0, 5000.0, 10000.0, 15000.0, 17500.0, 20000.0, 22500.0,
+ 12000.0, 18000.0, 24000.0, 30000.0, 33000.0, 36000.0,
+ 41.3, 57.7, 87.2, 122.0, 149.3, 160.0, 172.5, 181.0,
+ 40.2, 61.7, 77.4, 106.1, 128.5, 138.3, 148.0, 158.0,
+ 43.3, 61.3, 74.2, 99.1, 118.3, 126.7, 134.0, 143.3,
+ 48.5, 62.9, 74.1, 96.9, 114.1, 121.8, 128.0, 135.6,
+ 51.3, 64.8, 75.4, 96.9, 113.2, 120.9, 127.5, 134.1,
+ 54.3, 66.6, 77.3, 97.3, 113.1, 120.2, 126.6, 132.9/
DATA T8T/ 8.0, 6.0/
+ 1000.0, 3000.0, 5000.0, 10000.0, 15000.0, 17500.0, 20000.0, 22500.0,
+ 12000.0, 18000.0, 24000.0, 30000.0, 33000.0, 36000.0,
+ 114.4, 115.3, 116.1, 119.6, 125.3, 137.4, 143.1, 187.7, 2000.0,
+ 118.5, 115.3, 116.1, 119.1, 125.3, 137.4, 143.1, 149.9, 156.0,
+ 123.4, 119.6, 119.1, 121.4, 128.3, 132.4, 136.4, 139.3,
+ 128.1, 125.3, 124.2, 124.3, 128.0, 130.3, 132.3, 135.2,
+ 130.6, 128.7, 127.2, 126.9, 129.6, 131.2, 133.5, 139.8,
+ 133.4, 132.1, 130.4, 129.8, 132.0, 133.2, 134.7, 136.6.0/
DATA P8TT/ 8.0, 6.0/
+ 1000.0, 3000.0, 5000.0, 10000.0, 15000.0, 17500.0, 20000.0, 22500.0,
+ 12000.0, 18000.0, 24000.0, 30000.0, 33000.0, 36000.0,
+ 14.70, 14.72, 14.73, 14.78, 14.85, 14.89, 14.94, 15.01,
+ 14.70, 14.71, 14.73, 14.75, 14.79, 14.81, 14.83, 14.85,
+ 14.71, 14.71, 14.72, 14.74, 14.77, 14.78, 14.80, 14.81,
+ 14.71, 14.72, 14.72, 14.74, 14.76, 14.77, 14.79, 14.80,
+ 14.71, 14.72, 14.73, 14.75, 14.78, 14.77, 14.78, 14.79,
+ 14.71, 14.72, 14.73, 14.75, 14.78, 14.77, 14.78, 14.79/
DATA SFT/ 8.0, 6.0/
+ 1000.0, 3000.0, 5000.0, 10000.0, 15000.0, 17500.0, 20000.0, 22500.0,
+ 12000.0, 18000.0, 24000.0, 30000.0, 33000.0, 36000.0,
+ 1.4967, 0.8832, 0.7360, 0.6802, 0.7135, 0.7400, 0.7740, 0.8180,
+ 1.5551, 0.7993, 0.6416, 0.5303, 0.5126, 0.5081, 0.5105, 0.5210,
+ 1.7335, 0.8384, 0.6420, 0.4852, 0.4433, 0.4343, 0.4287, 0.4245,
+ 2.0262, 0.9162, 0.6784, 0.4916, 0.3131, 0.4151, 0.4032, 0.3947,
+ 2.2151, 0.9755, 0.7106, 0.5943, 0.3552, 0.4159, 0.4031, 0.3938,
+ 2.4083, 1.0374, 0.7476, 0.5210, 0.4445, 0.4222, 0.4056, 0.3940/
DATA T54T/ 8.0, 6.0/
+ 1000.0, 3000.0, 5000.0, 10000.0, 15000.0, 17500.0, 20000.0, 22500.0,
+ 12000.0, 18000.0, 24000.0, 30000.0, 33000.0, 36000.0,
+ 1214., 1278., 1359., 1615., 1891., 2030., 2177., 2310.,
+ 1258., 1290., 1392., 1509., 1684., 1762., 1850., 1940.,
+ 1303., 1334., 1378., 1489., 1623., 1691., 1755., 1808.,
+ 1343., 1387., 1429., 1524., 1633., 1685., 1739., 1788.,
+ 1364., 1417., 1455., 1548., 1650., 1697., 1749., 1795.,
+ 1389., 1447., 1483., 1575., 1673., 1718., 1764., 1810.0/
DATA NGT/ 8.0, 6.0/
+ 1000.0, 3000.0, 5000.0, 10000.0, 15000.0, 17500.0, 20000.0, 22500.0,
```

```

+ 1200.0, 1800.0, 2400.0, 3000.0, 3300.0, 3600.0,
+ 6900.0, 7623.1, 7941.3, 8458.3, 8955.9, 10160.5, 10880.3, 11700.0,
+ 6900.0, 7529.7, 7779.3, 8150.7, 8585.9, 9044.5, 937.0, 980.0,
+ 7041.5, 7323.2, 7729.4, 8135.3, 8473.0, 8804.0, 9160.0, 9633.0,
+ 7223.5, 7547.9, 7746.5, 8093.2, 8381.5, 8694.5, 89711.0, 92880.0,
+ 7334.0, 7576.3, 7746.7, 8098.3, 8380.4, 86317.8, 89676.0, 92844.2,
+ 7415.0, 7604.3, 7772.3, 8105.0, 8380.4, 86308.0, 89660.0, 92812.7,
X(1) = BHE
X(2) = NPT
CALL TABL(W2T,X,XOUT,W2)
CALL TABL(W3BT,X,XOUT,W3)
CALL TABL(W3BT,X,XOUT,W3)
CALL TABL(SFC,X,XOUT,SFC)
CALL TABL(ST54,X,XOUT,ST54)
CALL TABL(NGG,X,XOUT,NG)
IF ((XOUT(1).GT.0).OR.(XOUT(2).GT.0)) GO TO 10
OFF=1
GO TO 20
OFF=0
CONTINUE
RETURN
END

```

10  
20

```

***** FAN CHARACTERISTICS INPUT SUBROUTINE *****
THE DEFAULT FAN CHARACTERISTIC WAS PROVIDED BY JOY MANUFACTURING
COMPANY AND IS FOR THE FAN INSTALLED ON THE SPRUANCE CLASS
DESTROYER. OTHER FANS ARE MODELED AS A QUADRATIC EQUATION
WITH A MAXIMUM AT MAXIMUM FAN PRESSURE AND DISCHARGE
AND ANOTHER POINT AT MAXIMUM DISCHARGE AND ZERO FAN PRESSURE.
***** SUBROUTINE FAN(RHOSTD,CFM0,CFMMAX,DPMAX,K)
REAL RHOSTD,CFM0,CFMMAX,DPMAX,K
INTEGER YES,ANS,NO
DATA YES/'Y'/,NO/'N'/
C 2 DO YOU WANT THE DEFAULT FAN, THE DD 963 CLASS DESTROYER FAN ???
WRITE(6,600)
READ(5,601,END=4,ERR=4) ANS
IF ((ANS.EQ.YES).OR.(ANS.EQ.NO)) GO TO 3
4    REWIND 5
    WRITE(6,602)
    GO TO 2
8 CONTINUE
IF (ANS.EQ.YES) GO TO 10
C A DIFFERENT FAN HAS BEEN SELECTED, INPUT REQUIRED PARAMETERS
WRITE(6,602)
CALL READR(RHOSTD,5)
WRITE(6,603)
CALL READR(CFM0,5)
WRITE(6,604)
CALL READR(CFMMAX,5)
WRITE(6,605)
CALL READR(DPMAX,5)
K=-1.0*DPMAX/(CFM0-CFMMAX)**2
GO TO 20
C 10 FCILCWING ARE VALUES FOR THE DEFAULT FAN
RHOSTD=0.071
CFM0=24000.0
CFMMAX=11000.0
DPMAX=27.7
K=-1.0*DPMAX/(CFM0-CFMMAX)**2
CONTINUE
600 FORMAT(' YOU HAVE SELECTED A SYSTEM WITH A COOLING FAN. THE//'
+ ' DEFAULT SPECIFICATIONS ARE FOR THE FAN INSTALLED ON//'
+ ' THE DD963 CLASS SHIP. //'
+ ' DO YOU WANT TO USE THE DEFAULT SPECIFICATIONS (Y/N)?')
601 F05MAT(A1)
602 FORMAT(' THE PROGRAM WILL APPROXIMATE YOUR FAN WITH A QUADRATIC//'
+ ' EQUATION. TWO POINTS ARE READBED FROM THE FAN PERFORMANCE//'
+ ' CURVES AND THE REFERENCE AIR DENSITY (LBM/FT^3)?')
603 FORMAT(' WHAT IS THE FLOW AT ZERO GAGE PRESSURE (CFM)?')
604 FORMAT(' WHAT IS THE FLOW AT MAXIMUM GAGE PRESSURE (CFM)?'
+ ' D(CFM)/DP=0.')
605 FORMAT(' WHAT IS THE MAXIMUM FAN DISCHARGE GAGE PRESSURE (INCHES
+ ' H.G.L)?'
RETURN
END

```

```

***** FITTING PRESSURE LOSS CALCULATION SUBROUTINE *****

FOR THE 30 FITTINGS AVAILABLE IN THE MENU THERE ARE 13 DIFFERENT
WAYS TO COMPUTE PRESSURE LOSS FOR THE FLOW TYPE AND BRANCH WHICH SUBROUTINE MUST
BE ABLE TO RECOGNIZE THE FITTING TYPE AND BRANCH SO THAT THE CORRECT
COMPUTATION AREA OF THE SUBROUTINE. FOR EXAMPLE, IF THE DP IS
A FUNCTION OF FACE VELOCITY, STRAIGHT DUCTING IS USED AND THE TIME OF THE
PRESSURE VELOCITY. WHERE A COEFFICIENT IS COMPUTED HERE WITH THE INPUT
REYNOLDS NUMBER, THE COEFFICIENT IS COMPUTED HERE WITH THE INPUT
DATA. ADDING ANOTHER FITTING WOULD REQUIRE MODIFICATION OF THIS
SUBROUTINE.

***** SUBROUTINE PITDP(W,D5,TIN,TOUT,TOUT,PV,DATA1,DATA2,DATA3,
+ DATA4,TYPE,D5,ALEAF,ALFA0,ACWB,ACWC,ADWB,ADWC,
+ VCWB,VCWB,VCWC,VDWB,VDWC,SHOCG,TO)
REAL RHO,ALFA0,ALFA5,ACWB,ACWC,PIN,TIN,PV,TO,LAMDA,RHOT,
+ TOOUT,RHOT,RHO,AN,V,DATA1,DATA2,DATA3,E,KFEE,PS,RHOT,
+ CX,CX,VCWB,VCWC,VCWB,VCWC,VDWB,VDWC,TEST,K2,RR,DATA4,DP,K1
INTEGER I,J,K,L,M,N,X(2),I(45)
GAS CONSTANT AND ROUGHNESS
DATA R/53.3424/ E/3/0.00015/
A REYNOLDS NUMBER CORRECTION FOR SMOOTH RADIUS RECT ELBOWS
+ T/10.0*3.0
+ 1.0, 2.0, 3.0, 4.0, 6.0, 8.0, 10.0, 14.0, 20.0, 100.0,
+ 0.5, 0.7, 0.5
+ 1.26, 1.19, 1.14, 1.09, 1.06, 1.04, 1.00, 1.00, 1.00,
+ 1.45, 1.36, 1.31, 1.26, 1.22, 1.18, 1.15, 1.10, 1.00,
+ 2.00, 1.77, 1.64, 1.56, 1.46, 1.33, 1.30, 1.15, 1.00, 1.00,
+ 2.00, 1.77, 1.64, 1.56, 1.46, 1.33, 1.30, 1.15, 1.00, 1.00
C COMPUTE VISCOSITY OF AIR BASED ON TEMPERATURE OF AIR
MU=(29.95+0.189304*TIN-2.07587E-5*TIN**2)*1E-7
C ASSUME A VALUE FOR RHO
SHC=PIN/(R*TIN)
C VELOCITY IS THE MASS FLOW RATE DIVIDED BY DENSITY AND THE FLOW
AREA: V=Q/A ==> Q = MASS FLOW RATE/RHO
C V=RHO*(DATA1)
C PRESSURE VELOCITY (PSF)
PV=RHO*V**2/(2.0*32.174)
C COMPUTE THE STATIC PRESS: EQUALS TOTAL PRESS - VELOCITY PRESS
C ASSESS PIN-PV
C COMPUTE DENSITY OF GAS ENTERING FITTING USING PERFECT GAS LAW
RHCT=PS/(R*TIN)
C COMPARE ASSUMED RHO AND COMPUTED RHO
TEST=ABS(RHO-RHCT)
C ASSIGN NEW VALUE FOR RHO
RHCT=RHO
C IF ASSUMED RHO NOT EQUAL TO COMPUTED RHO RESUME INTERATION
IF (TEST.GT.0.001) GO TO 5
C REYNOLDS NUMBER
RN=RHO*DATA2*V/MU
C BRANCH FITTING TO CORRECT DP COMPUTATION CODE
GO TO (10,20,10,10,30,30,40,10,10,30,30,30,50,60,70,80,90,
+ 90,90,90,105,100,10,10,110,10,120,130,10,10),TYPE
C SIMPLE FITTING COEFFICIENT TIMES VELOCITY PRESSURE
10 20
FITTING: 1,3,4,8,9,22,24,28,29
DATA3=DATA3*PV
PITDP=PIN-DP
PCUT=PIN-DP
PCUT=PIN
GO TO 140
C
C STRAIGHT DUCT FRICTION FACTOR IS COMPUTED BY CORRELATION IN
SHAMES, MECHANICS OF FLUIDS, PAGE 280, CORRELATION OF SWAMEE AND
JAIN.
C
FITTING: 2
F=0.25/(ALOG10((E/(3.7*DATA2))+5.74/RN**0.9))**2
LOSS=(F*L/D)*VELOCITY PRESSURE
DP=F*DATA3/DATA2*PV

```

```

TOUT=PIN
PTOUT=PTIN-DP
GO TO 140

C
C      ELBOW WITH REYNOLDS NUMBER CORRECTION FACTOR
C
30   F1=1.3701-0.1485*ALOG(PN*1E-4)
     DP=DATA3*KRE*PV
     TOUT=PIN
     PTOUT=PTIN-DP
     GO TO 140

C
C      SMCOTH RADIUS RECTANGULAR ELBOW WITHOUT VAVES, REYNOLDS NUMBER
C      CORRECTION FROM TABLE LISTED IN DATA THIS SUBROUTINE.
C
40   FITTING: 7
     RW=DATA4
     C=DATA3
     IF (RN.GT.10000.0) GO TO 41
     KRE=1.7
     GO TO 42
41   X(1)=RN
     X(2)=RW
     CALL TABLE(T,X,XOUT,KRE)
42   DP=C*KRE*PV
     TOUT=PIN
     PTOUT=PTIN-DP
     GO TO 140

C
C      BRANCH SECTION OF A DIVERGING WYE. LOSS IS DEPENDENT ON
C      VELOCITIES IN MAIN SECTION (VDWM), COMBINED SECTION (VDWC)
C      BRANCH SECTION (VDWB) AND DIVERGENCE ANGLE OF FITTING.
C      VELOCITIES COMPUTED IN THE SYSTEM SUBROUTINE, PASSED TO FITDP AS
C      INPUT DATA.
C
50   FITTING: 13
     IEST=(ADWM-ADWC)/ADWC
     IF (IEST.LT.-0.05) GO TO 51
     K2=((1.59147E-8*ALFAD+3.8309E-6)*ALFAD+0.0000574)*
     + ALFAD+0.0010399*ALFAD+0.000017
     C=1.0+(VDWB/VDWC)**2-2.0*(VDWB/VDWC)*COS(ALFAD/57.3)-K2*(VDWB/
     + VDWC)**2
     GO TO 52
51   K1=1.0
     RR=VDWB/VDWM
     IF (RR.GT.0.8) K1=0.9
     C=K1*(1.0+(VDWE/VDWC)**2-2.0*(VDWB/VDWC)*COS(ALFAD/57.3))
52   PV=RHC*VDWB**2/(2.0*32.174)
     DP=C*PV
     PV=RHC*VDWM**2/(2.0*32.174)
     PTOUT=PTIN-DP
     TOUT=PIN
     GO TO 140

C
C      MAIN SECTION OF A DIVERGING WYE
C
60   FITTING: 14
     COEFFICIENT BASED ON THE RATIO OF VELOCITIES VDWM AND VDWC
     COMPUTED IN THE SYSTEM PART OF THE PROGRAM
     C=0.4*(1.0-VDWM/VDWC)**2
     PV=RHO*VDWM**2/(2.0*32.174)
     DP=C*PV
     PV=RHC*VDWM**2/(2.0*32.174)
     PTOUT=PTIN-DP
     TOUT=PIN
     GO TO 140

C
C      BRANCH SECTION OF A CONVERGING WYE, THE JUNCTION OF MODULE
C      COOLING AIR (BRANCH) WITH THE ENGINE EXHAUST (MAIN), NODE 5
C
70   FITTING: 15
     ALL INPUT COMPUTED IN THE SYSTEM SUBROUTINE PASSED TO FITDP
     C=1.0+(VCWB/VCWC)**2-2.0*ACWM/ACWC*(VCWA/VCWC)**2-2.0*ACWB/ACWC*

```

```

* (VCWB/VCWC) **2*COS(ALFAC/57.3)
PV=RHCC*(VCWC**2/(2.0*32.174))
DP=C*27
FCUT=PTIN-OP
TOUT=PTIN/(R*RHCC)
GO TO 140

MAIN SECTION OF A CONVERGING WYE, THE PATH FOR ENGINE EXHAUST
NODE 5 FITTING: 16
ALL YELOCITIES COMPUTED IN SYSTEM PART OF PROGRAM AND
PASSED TO TIN-OP
K1=1.15*(ACWB/ACWC)**2.21+(1-ALFAC/6.0)*(ACWB/ACWC)*0.4
TEST=ABS((ACWB-ACWC)/ACWC)
IF(TEST>1.0*.05) K1=0.0
C=1.0*(VCWB/VCWC)**2-2.0*ACB*1/ACWC*(VCWB/VCWC)**2-2.0*
+(ACWB/ACWC)*(VCWB/VCWC)**2*COS(ALFAC/57.3)*K1
PV=RHCC*(VCWC**2/(2.0*32.174))
DP=C*PV
FCUT=PTIN-OP
TOUT=PTIN/(R*RHCC)
GO TO 140

DIFFUSERS
FITTINGS: 17 18 19 20
FRICTION INCLUDED IN THIS FITTING
LNSOR=(4.0*DATA1/3.1416)
RN=RRHC*L*V/MU
LAMDA=0.3164/RN**0.25
CFR=DATA2*LAMDA
C=CFR+DATA3
DP=C*PV
FCUT=PTIN-OP
TOUT=TIN
GO TO 140

CONTRACTS
FITTINGS: 21 22
V=(RHO*DATA4)
PV=RHC*V**2/(2.0*32.174)
DP=DATA3*PV
FCUT=PTIN-OP
TOUT=TIN
GO TO 140

INLET FILTER
FITTING: 24
PRESSURE LOSS BASED ON FACE VELOCITY
5.19696 IS A CONVERSION FACTOR TO CONVERT INCH WG TO PSF
DP=(DATA4*V**DATA3)*5.19696
FCUT=PTIN-OP
TOUT=TIN
GO TO 140

GAS TURBINE MODULE, THIS IS NOT THE ENGINE, BUT THE PATH FOR
COOLING AIR AROUND THE ENGINE
FITTING: 36
LOSS BASED OF THE MASS FLOW OF COOLING AIR THROUGH THE MODULE
DP=(1.61E-3*W**2.15)*5.19696
V=.0
FCUT=PTIN-OP
THE FOLLOWING MODEL FOR MODULE TEMP CUT SHOULD BE REFINED
IT'S JUST A BEST "GUESS-MATE"
TOUT=TIN+25.0/W*(HP/20000.0*100.0)
GO TO 140

WASTE HEAT BOILER, GAS SIDE PRESSURE LOSS
FITTING: 27
BASED ON TUBE BUNDLE GEOMETRY, VELOCITY IN THE NARROW PASSAGE OF
OF THE TUBE BUNDLE, FRICTION FACTOR, F, A FUNCTION OF REYNOLDS

```

```
C 130      NUMBER  
V=V*DATA2  
PV=RHO*V**2/(2.0*32.174)  
RN=RHO*V*DATA4/MU  
T=1.334*RN**(-0.1453)  
DP=F*DATA3*PV  
PTCUT=PTIN-DP  
TOUT=0.00185*HP+247.0+T0  
RHO=(ZS-DP)/(R*TOUT)  
V=V/(RHO*DATA1)  
PV=RHO*V**2/(2.0*32.174)  
GO TO 140  
  
C NO MORE FITTINGS, IF YOU ADD A DIFFERENT TYPE OF FITTING  
C REQUIRING A DIFFERENT METHOD OF COMPUTATION, THE METHOD  
C SHOULD GO HERE.  
C 140      CONTINUE  
        RETURN  
        END
```

```

***** SYSTEM ONE MATCHING SUBROUTINE *****
C
C IN THIS SYSTEM THE COOLING AIR AND ENGINE COMBUSTION DO NOT
C MIX. THE COOLING SYSTEM COMPUTED INDEPENDENTLY. A FAN IS REQUIRED
C TO FORCE THE COOLING SYSTEM TO OPERATE. SYSTEM MATCHING INVOLVES TWO
C DUCTS. FIRST MAKE THE ENGINE LOSSES AGREE WITH THE COMPUTED
C DUCT LOSSES. SECOND MAKE THE SAME PERFORMANCE MATCH THE COOLING
C DUCT LOSSES. NO JUNCTIONS ARE PRESENT.
C
C***** SUBROUTINE SYS1(SERIAL,N,WORKI,WORKR,HP,NPT,FIT1ST,T0,P0,HUMID,
C + RHOST,D,CFM,CFMAX,DPMAX,K,W2,W8,P8,T9
C + REAL WORKB,HP,NFT,T0,P0,HUMID,CFM,CFMAX,DPMAX,K,W2,W8,P8,T9
C + INLOSS,ELLOSS,ENDP,DP13,DP24,DP36,DP45,PV,PTCPV,DATA1,
C + DATA1,DATA3,DATA4,DP13,DP24,DP36,DP45,PV,PTCPV,DATA1,
C + DATA4,SFC,NG,DATA4,DP13,DP24,DP36,DP45,PV,PTCPV,DATA1,
C + INTEGRATE WORK1(FIT1ST,OFF,NFT,2,3,A,B,C,SERIAL,TYPE)
C + DIMENSION WORK1(200,2),WORKR(200,4),FIT1ST(4),DP(200),PTCPV(200)
C + THE FOLLOWING ARE THE STARTING AND STOPPING POINTS FOR THE
C + BRANCHES. START AND STOP BY THE SEQUENTIAL INDEX NUMBER IN DUCT
C DATA FILES
C DATA FIT1ST(2)-1
C DATA FIT1ST(3)-1
C DATA FIT1ST(4)-1
C DATA FIT1ST(2)
C DATA FIT1ST(3)
C DATA FIT1ST(4)
C
C INITIALIZE INLET AND EXHAUST DUCT LOSSES (INCH WG)
C INLOSS=4.0
C EXLOSS=3.0
C
C INITIALIZE COOLING FLOW
C NC=20.0
C
C INITIALIZE LOSS IN BRANCH 4-5 (PSF)
C DP45=100.0
C
C WITH ASSUMED LOSSES GET THE ENGINE PERFORMANCE
C CALL ENGINE(INLOSS,EXLOSS,T0,P0,HUMID,HP,NPT,W2,W8,P8,T8,SFC,
C + T54,NG,OFF)
C IF(OFF.EQ.0) GO TO 0
C WRITE(6,000)
C GO TO 500
C
C CONTINUE
C INITIALIZE CONDITIONS FOR START OF BRANCH 1-3, ENGINE INLET FLOW
C DP13=0.0
C
C INLET PRESSURE IS AMBIENT (PSF)
C PTIN=P0*144.0
C
C INLET TEMPERATURE IS AMBIENT (DEG R)
C TIN=T0+459.7
C DO 10 I=1,2
C     TYPE=WORKI(I,2)
C     DATA1=WORKR(I,1)
C     DATA2=WORKR(I,2)
C     DATA3=WORKR(I,3)
C     DATA4=WORKR(I,4)
C     CALL FCFCP(W2,HP,PTIN,TIN,PIOUT,TOUT,PV,DATA1,DATA2,DATA3,
C + DATA4,TYPE,DELP,5.,0.,5.,0.,5.,0.,0.,0.,0.,0.,0.,0.)
C     DP(I)=DELP
C     DP13=DP13+DELP
C     PTCPV(I)=PV
C     PTIN=PTOUT
C     TIN=TOUT
C
C CONTINUE
C INITIALIZE INLET CONDITIONS FOR BRANCH 3-6
C PTIN=28*144.0
C
C 20 TIN=T9
C DP36=0.0
C DO 30 I=3,6
C     TYPE=WORKI(I,2)

```

```

DATA1=WORKR(I,1)
DATA2=WORKR(I,2)
DATA3=WORKR(I,3)
DATA4=WORKR(I,4)
CALL FITDP(WC,HP,PTIN,TIN,PTOUT,TOUT,PV,DATA1,DATA2,DATA3,
+ DATA4,TYPE,DELP,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,
+ 0.,0.,0.,10)
DP(I)=DELP
DP36=DP36+DELP
FITPV(I)=PV
PTIN=PTOUT
TIN=TOUT
CONTINUE
IF THE EXIT PRESSURE IS NOT AMBIENT, REPEAT UNTIL IT IS
TEST=ABS(PTOUT-PO*144.0)
IF (TEST.LT.1.0) GO TO 40
PTIN=PO*144.0+DP36
GO TO 20
CONTINUE2
COMPARE ASSUMED INLET AND EXHAUST LOSS WITH THE COMPUTED LOSSES
IF THEY DO NOT AGREE REPEAT
INLOSS=INLOSS*5.19696
EXLOSS=EXLOSS*5.19696
TEST1=ABS(DP13-INLOSS)
TEST2=ABS(DP36-EXLOSS)
INLOSS=DP13/(144.0*0.03609)
EXLOSS=DP36/(144.0*0.03609)
IF ((TEST1.GT.1.0).OR.(TEST2.GT.1.0)) GO TO 5
INITIALIZE INLET CONDITIONS FOR BRANCH 2-4
PTIN=PO*144.0
DP24=0.0
TIN=T0+459.7
DO 50 I=A,Q
    TYPE=WORKR(I,2)
    DATA1=WORKR(I,1)
    DATA2=WORKR(I,2)
    DATA3=WORKR(I,3)
    DATA4=WORKR(I,4)
    CALL FITDP(WC,HP,PTIN,TIN,PTOUT,TOUT,PV,DATA1,DATA2,DATA3,
+ DATA4,TYPE,DELP,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,
+ 0.,0.,0.,10)
    DP(I)=DELP
    DP24=DP24+DELP
    FITPV(I)=PV
    PTIN=PTOUT
    TIN=TOUT
    IF (TYPE.EQ.26) TMOD=TOUT
CONTINUE
INITIALIZE CONDITIONS FOR BRANCH 4-5
T4=TOUT
PTIN=PO*144.0+DP45
TIN=T4
DP45=0.0
DO 60 I=C,N
    TYPE=WORKR(I,2)
    DATA1=WORKR(I,1)
    DATA2=WORKR(I,2)
    DATA3=WORKR(I,3)
    DATA4=WORKR(I,4)
    CALL FITDP(WC,HP,PTIN,TIN,PTOUT,TOUT,PV,DATA1,DATA2,DATA3,
+ DATA4,TYPE,DELP,0.,5.,5.,5.,0.,5.,5.,5.,5.,5.,5.,5.,
+ 0.,5.,5.,10)
    DP(I)=DELP
    DP45=DP45+DELP
    FITPV(I)=PV
    PTIN=PTOUT
    TIN=TOUT
    IF (TYPE.EQ.26) TMOD=TOUT
CONTINUE

```

```

C IF EXIT CONDITION CONDITION IS NOT AMBIENT PRESSURE REPEAT
C INPUT ABS (P1OUT-P0*144.0)
C INPUT L(1.0) GO TO 70
C FAN PRESSURE RISE
C FANDEP=(DP24+DP45)/((144.0*0.03609))
C MATCH FAN TO SYSTEM FOR NEXT ITERATION WITH WCN
C CALL FANMAT(RCN,20,20,FANDEP,CFM0,CFMMAX,DPMAX,K,WCN)
C IF ASSUMED FLOW MATCHES MATCHED FLOW YOU ARE FINISHED
C IF STATE=ABS(RCN-WCN)
C IF STATE<GT.0.1 GO TO 45
C WRITE THE INFORMATION TO AN OUTPUT FILE
C CALL CPUT(20,20,HUMID,HP,NPT,N,WORKI,DP,FITPV,INLOSS,EXLOSS,RC,
C DP13=DP15//5.19696
C DP36=DP38//5.19696
C DP24=DP24//5.19696
C DP45=DP45//5.19696
C WRITE SUMMARY OF BRANCH LOSSES
C WRITE(4,601) DP13,DP36,DP24,DP45
500 CONTINUE
600 FORMAT(' POWER POINT IS NOT ON THE PERFORMANCE MAP.')
601 FORMAT(' /5X,'LOSS BRANCH 1-3:',F12.3,'/5X,'LOSS BRANCH 3-6:',F12.2,
C '/5X,'LOSS BRANCH 2-4:',F12.3,'/5X,'LOSS BRANCH 4-5:',F12.2)
C RETURN
END

```

```

C***** SYSTEM TWO MATCHING SUBROUTINE *****C
C
C THIS SYSTEM HAS A COMBINED INLET. ENGINE AIR AND COOLING AIR
C ENTER THROUGH THE SAME ENTRY. THE COOLING AIR SEPARATES IN THE
C MAIN INLET DUCT BRANCHING OFF TO THE COOLING FAN AND THEN TO
C THE MODULE. THE COOLING AIR DOES NOT JOIN THE EXHAUST FLOW.
C IT IS DUCTED SEPARATELY TO THE ATMOSPHERE. *****C
C
C***** SUBROUTINE SYS 2(SERIAL,N,WORKR,HP,NPT,FIT1ST,TO,PO,HUMID,
C
C      ALFAD,ADWB,ADWC,ADWM,
C      RHOST,D,CFMO,CFMMAX,DPMAX,K)
C
C      REAL WORKR,HP,NPT,TO,PO,HUMID,CFMO,CFMMAX,DPMAX,K,W2,W8,P8,T8,
C      INLOSS,EXLOSS,FANDP,DP12,DP24,DP36,DP45,PV,PTOUT,DATA1,
C      DATA2,DATA3,TEST,DP,FITPV,FC,RHOST,DESS41,EST2,NCN,GC,
C      TS4,SFC,NG,ALFAD,ADWB,ADWC,ADWM,DP25,PT2,RHO2,VWB,VWC,VWM,
C      DATA4,R
C
C      INTEGER WORKI,FIT1ST,OFF,N,PP,DP,RR,SS,A,B,C,D,SERIAL,TYPE
C      DIMENSION WORKI(200,2),WORKR(200,4),FIT1ST(5),DP(200),FITPV(200)
C
C      GAS CONSTANT
C      DATA R/53.3424/
C
C      THE STARTING AND STOPPING POINTS FOR BRANCH COMPUTATION LOOPS
C
C      PP=FIT1ST(2)-1
C      QQ=FIT1ST(3)-1
C      RR=FIT1ST(4)-1
C      SS=FIT1ST(5)-1
C      A=FIT1ST(2)
C      B=FIT1ST(3)
C      C=FIT1ST(4)
C      D=FIT1ST(5)
C
C      INITIALIZE INLET AND EXHAUST LOSSES (INCH WG)
C      INLOSS=4.0
C      EXLOSS=3.0
C
C      INITIALIZE COOLING FLCW
C      WC=20.0
C      DP45=100.0
C
C      GET THE ENGINE PERFORMANCE WITH THE ASSUMED LOSSES
C      CALL ENGINE(INLOSS,EXLOSS,TO,PO,HUMID,HP,NPT,W2,W8,P8,T8,SFC,
C      TS4,NG,OFF)
C      IF(OFF.EQ.0) GO TO 0
C      WRITE(6,500)
C      GO TO 500
C
C      CONTINUE
C      INITIALIZE THE INLET CONDITIONS FOR BRANCH 1-2
C      DP12=0.0
C      PTIN=PO*144.0
C      TIN=TO+459.7
C
C      COMPUTE FITTING LOSSES
C      DO 10 I=1,PP
C          TYPE=WORKI(I,2)
C          DATA1=WORKR(I,1)
C          DATA2=WORKR(I,2)
C          DATA3=WORKR(I,3)
C          DATA4=WORKR(I,4)
C          CALL FITDP(F2,HP,PTIN,TIN,PTOUT,PTOUT,PV,DATA1,DATA2,DATA3,
C          + DATA4,TYPE,DELP,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,
C          + 0.)
C          DP(I)=DELP
C          DP12=DP12+DELP
C          FITPV(I)=PV
C          PTIN=PTOUT
C          TIN=PTOUT
C
C      10 CONTINUE
C      COMPUTE VELOCITIES IN THE DIVERGING WYE SECTION
C      PT2=PO*144.0-DP12
C      RHC2=(PT2-PV)/((TO+459.7)*R)
C      VWB=WC/(RHO2*ADWB)
C      VWC=(WC+W2)/(RHC2*ADWC)

```

```

C      VDWM=R2/(RHO2*ADWM)
C      INITIATE INLET CONDITIONS FOR BRANCH 2-3
C      PTIN=10+459.7
C      TIN=T2+WC
C      DP23=0.0
C      COMPUTE LOSSES FOR FITTINGS
DO 20 I=1,20
  TYPE=WORKI(I,2)
  DATA1=WORKR(I,1)
  DATA2=WORKR(I,2)
  DATA3=WORKR(I,3)
  DATA4=WORKR(I,4)
  CALL FITDP(WC,HP,PTIN,TIN,PTOUT,PTOUT,PV,DATA1,DATA2,DATA3,
  +          DATA4,TYPE,DEL2,0.,ALFAD,0.,0.,0.,ADWM,ADWC,0.,0.,0.,
  +          VDWB,VDM,VDWC,0.,T0)
  DP(I)=DEL2
  DP23=DP23+DEL2
  FITPV(I)=PV
  PTIN=PTOUT
  TIN=PTOUT
CONTINUE
C      INITIALIZE CONDITIONS FOR BRANCH 3-6
C      PTIN=144.0
30   TIN=T0
  DP36=0.0
C      COMPUTE FITTING LOSSES
DO 35 I=1,35
  TYPE=WORKI(I,2)
  DATA1=WORKR(I,1)
  DATA2=WORKR(I,2)
  DATA3=WORKR(I,3)
  DATA4=WORKR(I,4)
  CALL FITDP(WC,HP,PTIN,TIN,PTOUT,PTOUT,PV,DATA1,DATA2,DATA3,
  +          DATA4,TYPE,DEL2,0.,ALFAD,0.,0.,0.,15WB,ADWM,ADWC,0.,0.,0.,
  +          VDWB,VDM,VDWC,0.,T0)
  DP(I)=DEL2
  DP36=DP36+DEL2
  FITPV(I)=PV
  PTIN=PTOUT
  TIN=PTOUT
CONTINUE
C      IF THE EXIT PRESSURE IS NOT AMBIENT REPEAT
TEST1=ABS(PTOUT-PO*144.0)
IF (TEST1.GT.1.0) GO TO 40
PTIN=PO*144.0+DP36
GO TO 30
CONTINUE
C      TEST THE ASSUMED LOSSES AGAINST THE COMPUTED LOSSES
INLOSS=INLOSS*5.19696
EXLOSS=EXLOSS*5.19696
TEST1=ABS(DP12+DP23-INLOSS)
TEST2=ABS(DP36-EXLOSS)
INLOSS=(DP12+DP23)/5.19696
EXLOSS=DP36/5.19696
C      REPEAT ITERATION IF ASSUMED LOSSES DO NOT MATCH THE COMPUTED LOSS
IF (TEST1.GT.1.0).OR.(TEST2.GT.1.0) GO TO 5
INITIALIZE THE INLET CONDITIONS FOR BRANCH 2-4
45   PTIN=PT2
  DP24=0.0
  TIN=T0+459.7
C      COMPUTE FITTING LOSSES
DO 50 I=1,20
  TYPE=WORKI(I,2)
  DATA1=WORKR(I,1)
  DATA2=WORKR(I,2)
  DATA3=WORKR(I,3)
  DATA4=WORKR(I,4)
  CALL FITDP(WC,HP,PTIN,TIN,PTOUT,PTOUT,PV,DATA1,DATA2,DATA3,

```

```

+      DATA 4, TYPE CELP, 0., ALFAD, 0., 0., 0., ADWB, ADWM, ADWC, 0., 0., 0.,
+      VDAB, VCM, VDW, 0., TO)
+      DP(I)=DELP
DP24=DP24+DELP
FITPV(I)=PV
PTIN=PTOUT
TIN=TOUT
IF (TYPE.EQ. 26) TMOD=TOUT
50  CONTINUE
C      INITIALIZE THE INLET CONDITIONS FOR BRANCH 4-5
T4=TOUT
55  PTIN=PO*144.0+DE45
TIN=T4
DP45=0.0
C      COMPUTE LOSSES FOR FITTINGS
DO 60 I=D_N
      TYPE=WORKI(I,2)
      DATA1=WORKR(I,1)
      DATA2=WORKR(I,2)
      DATA3=WORKR(I,3)
      DATA4=WORKR(I,4)
      CALL FITTP(WC,HP,PTIN,TIN,PTOUT,TOUT,PV,DATA1,DATA2,DATA3,
+      DATA4,TYPE,DELP,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,
+      0.,0.,10)
      DP(I)=DELP
DP45=DP45+DELP
FITPV(I)=PV
PTIN=PTOUT
TIN=TOUT
IF (TYPE.EQ. 26) TMOD=TCUT
60  CONTINUE
C      IF EXIT PRESSURE NOT AMBIENT REPEAT
TEST=ABS(PTOUT-PO*144.0)
IF (TEST.LT.1.0) GO TO 70
GO TO 55
C      COMPUTE FAN PRESSURE AND MATCH FAN PERFORMANCE TO SYSTEM
70  FANDE=(DP24+DP45+DP12)/5.19696
CALL FANMAT(WC,TO,PO,FANDP,RHOSTD,CFM0,CFMAX,DPMAX,K,WCN)
C      IF COOLING FLOW MATCHES YOU ARE FINISHED
TEST=ABS(WCN-WC)
WC=WCN
IF (TEST.GT.0.1) GO TO 5
C      WRITE PERFORMANCE INFORMATION TO THE OUTPUT FILE
CALL OUTPUT(TO,PO,HUMID,HP,NPT,N,WORKI,DP,FITPV,INLOSS,EXLOSS,WC,
+      W2,W8,P8,F8,SFC,I54,NG, SERIAL, TMOD)
DP12=DP12/5.19696
DP23=DP23/5.19696
DP36=DP36/5.19696
DP24=DP24/5.19696
DP45=DP45/5.19696
C      WRITE THE BRANCH LOSS SUMMARY
WRITE (4,601) DP12,DP23,DP36,DP24,DP45
500  CONTINUE
600  FORMAT(' POWER POINT IS NOT ON THE PERFORMANCE MAP.')
601  FORMAT('/5X,'LOSS BRANCH 1-2:',F12.2,'/5X,'LOSS BRANCH 2-3:',F12.2,
+      '/5X,'LOSS BRANCH 3-4:',F12.2,'/5X,'LOSS BRANCH 2-4:',F12.2,
+      '/5X,'LOSS BRANCH 4-5:',F12.2)
RETURN
END

```

```

C***** SYSTEM THREE MATCHING SUBROUTINE *****
C
C THIS SYSTEM UTILIZES A COMBINED INLET AND EXAUST DUCT FOR BOTH
C ENGINE AIR AND COOLING AIR. NODE 2 IS A DIVERGING WYE. NODE 5
C IS THE JUNCTION OF MODULE AIR AND ENGINE EXHAUST. THE SCHEME IS
C TO FIX THE PRESSURES AT NODES 2&5 AND WORK THE PARALLEL BRANCHES
C SO THAT THEY HAVE THE SAME INLET AND OUTLET PRESSURE, P2 AND P5.
C CHECK ASSUMED LOSSES AGAINST COMPUTED LOSSES REPEAT IF NECESSARY.
C
C***** SUBROUTINE SYS3(SERIAL,N,WORKI,WORKR,HP,NPT,FIT1ST,I0,P0,HUMID,
C
C          ALFAD,ADWB,ADWC,ADM1,ALFAC,ACWB,ACWC,ACF4,
C          RHOSTD,CFM0,CFMMAX,DPMAX,K,DPMAX,K,DPMAX,K,
C          INLOSS,EXLOSS,FANDP,DP12,DP24,DP36,D245,PV2FIN,PFCUT,DATA1,
C          DATA22,DATA3,TEST,DP,FITPV,WC,RHOSTD,TEST1,TEST2,WCN,TMOD,
C          TS4,SFC,NG,ALFAD,ADWB,ADWC,ADM1,DP23,DT2,EHO2,VDB3,VDCM,VDCN,VDCM,
C          DATA4,R,ALFAC,ACWB,ACWC,ACF4,VCMB,VCC,VCCM,VMAIN,IMOD,SEC,
C          HMAIN,HSTACK,T5,GAIN,LOSS,PSEC,PMAIN,P14,PTS1,TEST1,TEST2,
C          PVB,PVC,PVM,PSB,PSM,RHOCBT,RHOCCT,RHCCMT,TEST1,TEST2,
C          INTEGER,WORKI,FIT1ST,OFF,N,PP,QQ,RR,SS,TT,A,B,C,D,E,SERIAL,TYPE,
C          IND
C
C DIMENSION WORKI(200,2),WCRKR(200,4),FIT1ST(6),DP(200),FITPV(200)
C
C GAS CONSTANT
C DATA R/53.3424/
C
C SET UP STARTING AND STOPPING POINTS FOR BRANCHES
C I0=FIT1ST(2)-1
C OME=FIT1ST(3)-1
C MAIN=FIT1ST(4)-1
C LOSS=FIT1ST(5)-1
C TT=FIT1ST(6)-1
C A=FIT1ST(2)
C B=FIT1ST(3)
C C=FIT1ST(4)
C D=FIT1ST(5)
C E=FIT1ST(6)
C
C INITIALIZE LOSSES (INCH WG)
C INLOSS=4.0
C EXLOSS=8.0
C
C INITIALIZE GAIN IN THE MODULE EXHAUST EDUCTOR (PSF)
C GAIN=-30.0
C
C INITIALIZE DUCT LOSS IN THE COOLING FLOW PASSAGE (PSF)
C LOSS=30.0
C
C INITIALIZE THE COOLING FLOW
C WC=CFMMAX*RHOSTD/60.0
C
C INITIALIZE THE BRANCH LOSSES REQUIRE TO START THE PROGRAM
C DP45=100.0
C DP56=100.0
C TMOD=710.0
C PTS5=P0*144.0+DP56
C
C CHECK TO SEE IF THERE IS A WASTE HEAT BOILER INSTALLED
C IN BRANCH 3-5. IT DOES NOT MAKE SENSE TO PUT IT ANYWHERE ELSE.
C IND=0
C DO 4 I=C,SS
C     TYPE=WORKI(I,2)
C     IF (TYPE.EQ.24) IND=1
C
C CONTINUE
C GET ENGINE PERFORMANCE BASED ON ASSUMED CONDITIONS
C CALL ENGINE(INLOSS,EXLOSS,I0,P0,HUMID,HP,NPT,W2,W8,P8,T8,SFC,
C             TS4,NG,OFF)
C IF (OFF.EQ.0) GO TO 6
C     WRITE(6,600)
C     GO TO 500
C
C CONTINUE
C INITIALIZE THE INLET CONDITIONS FOR BRANCH 1-2
C DP12=0.0
C PMAIN=PTS5+LOSS
C PSEC=PTS5+GAIN

```

```

C PTIN=PO*144.0
C TIN=T0+459.7
C COMBINED MASS FLOW WC+W2
C W=WC+W2
C FIND FITTING LOSSES
C DO 3 I=1,PP
C   TYPE=WORKI(I,2)
C   DATA1=WORKR(I,1)
C   DATA2=WORKR(I,2)
C   DATA3=WORKR(I,3)
C   DATA4=WORKR(I,4)
C   CALL FITDP(W,I,PTIN,TIN,Ptout,Tout,PV,DATA1,DATA2,DATA3,
C   + DATA4,TYPE,DELP,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,
C   + 0.,0.,0.,T0)
C   DP(I)=DELP
C   DP12=DP12+DELP
C   FITPV(I)=PV
C   PTIN=Ptout
C   TIN=Tout
C CONTINUE
C THE JUNCTION PARAMETERS AT NODE 2 AND 5 ARE COMPUTED HERE
C BASED ON THE CURRENT ASSUMPTIONS. THE PARALLEL BRANCHES MUST
C MEET THE VALUES AT THE NODES 2 AND 5. THE PARAMETERS ARE AS
C NOTED IN THE COMMENTS
C TOTAL PRESSURE AT NODE 2
C PT2=PO*144.0-DEP12
C DENSITY AT NODE 2
C RHC2=(PT2-PV)/(T0+459.7)*R
C VELOCITY IN THE COOLING BRANCH
C VDWB=RHC/(RHO2*ADWB)
C VELOCITY IN THE COMBINED INLET SECTION ABOVE NODE 2
C VDWc=(WC+W2)/(RHO2*ADWC)
C VELOCITY OF THE AIR FLOWING TO THE ENGINE FROM NODE 2
C VDWm=W2/(RHO2*ADWM)
C TEMPERATURE OF THE AIR IN THE PRIMARY FLOW OF THE JUNCTION AT
C NODE 5, ENGINE EXHAUST TEMPERATURE
C TMAIN=48
C IF A BOILER IS IN BRANCH 3-5 THE TEMP IS THE TEMP OUT OF THE
C BOILER
C IF(IND.EQ.1) TMAIN=770.0+3.70E-3*HP
C COMPUTATION TO FIND THE TEMPERATURE OF THE COMBINED FLOW
C BASED ON THE ENTHALPY OF THE TWO MIXING FLOWS
C HSEC=(1.421385E-5*TMOD+2.210911)*TMOD+5.6373
C HMAIN=(1.56051E-5*TMAIN+2.2388)*TMAIN+4.75396
C HSTACK=(W8/(W8+WC))*HMAIN+(WC/(W8+WC))*HSEC
C TS=(-C.3008417*HSTACK+4.33577)*HSTACK-9.5778
C ASSUME THE DENSITIES AT NODE 5 ,COMBINED, MAIN, AND BRANCH
C RHCC=PT5/(R*T5)
C RHOCCE=PS2C/(R*TMOD)
C RHCCM=PMAIN/(R*TMAIN)
C COMPUTE THE VELOCITIES AT NODE 5, BRANCH, COMBINED, AND MAIN
C VCWB=WC/(RHOCB*ACCB)
C VCWC=(WC+W8)/(RHOC*ACWC)
C VCWM=(W8/(RHOCM*ACWM))
C COMPUTE THE VELOCITY PRESSURES AROUND NODE 5
C PVBC=RHOCB*VCWB**2/(2.0*32.174)
C PVAC=RHOC*VCWC**2/(2.0*32.174)
C PVFM=RHOCM*VCWM**2/(2.0*32.174)
C COMPUTE STATIC PRESSURES AROUND NODE 5
C PSBC=PS2C-PVB
C PSC=PT5-PVC
C PSM=EMAIN-PVM
C COMPUTE DENSITIES AROUND NODE 5
C RHOCBT=PSB/(R*TMOD)
C RHOCCT=PSC/(R*T5)
C RHOCMT=PSM/(R*TMAIN)
C TEST ASSUMED DENSITIES AND COMPUTED DENSITIES
C TEST1=ABS(RHOCBT-RHOCB)
C TEST2=ABS(RHOCCT-RHOC)

```



```

DP(I) = DELP
DP35=DP35+DELP
FITPV(I)=PV
PTIN=PTOUT
TIN=TOUT
C      LOSS IN THE MAIN ENGINE EXHAUST FLOW FOR NOLE 5, ENERGY IS
C      TRANSFERRED TO THE MODULE COOLING FLOW AS A PRESSURE GAIN.
C      IF (TYPE.EQ.16) LOSS=DELP
35  CONTINUE
C      COMPARE EXIT PRESSURE TO PTS, REVISE INLET CONDITION TO BRANCH
C      3-5 AND REPEAT IF NECESSARY
TEST=ABS(PTOUT-PTS)
IF (TEST.LT.1.0) GO TO 40
PTIN=P0*144.0+DP35+DP56
GO TO 30
40  CONTINUE
C      COMPARE ASSUMED LOSSES TO COMPUTED LOSSES REPEAT ITERATION
IF REQUIRED
INLOSS=INLOSS*5.19696
EXLOSS=EXLOSS*5.19696
TEST1=ABS(DP12+DP23-INLOSS)
TEST2=ABS(DP35+DP56-EXLOSS)
INLOSS=(DP12+DP23)/5.19696
EXLOSS=(DP35+DP56)/5.19696
IF ((TEST1.GT.1.0).OR.(TEST2.GT.1.0)) GO TO 5
C      INITIALIZE LOSSES FOR BRANCH 2-4
45  PTIN=PT2
DP24=0.0
TIN=T0*459.7
C      COMPUTE FITTING LOSSES
DO 50 I=8,RR
    TYPE=WORKR(I,2)
    DATA1=WORKR(I,1)
    DATA2=WORKR(I,2)
    DATA3=WORKR(I,3)
    DATA4=WORKR(I,4)
    CALL FITDP(WC,HP,PTIN,TIN,PTOUT,TOUT,PV,DATA1,DATA2,DATA3,
    +           DATA4,TYPE,DELP,0.,ALFAD,0.,0.,0.,ADWB,ADWM,ADWC,0.,0.,0.,
    +           VDWB,VDM,VDWC,0.,T0)
    DP(I)=DELP
    DP24=DP24+DELP
    FITPV(I)=PV
    PTIN=PTOUT
    TIN=TOUT
    IF (TYPE.EQ.26) TMOD=TOUT
50  CONTINUE
C      INITIALIZE INLET CONDITIONS FOR BRANCH 4-5
T4=TOUT
PTIN=PTOUT+(K*((WC/RHOSTD*60.0)-CFMMAX)**2+DPMAX)*5.19696
TIN=T4
DP45=0.0
C      COMPUTE FITTING LOSSES
DO 60 I=D,TT
    TYPE=WORKR(I,2)
    DATA1=WORKR(I,1)
    DATA2=WORKR(I,2)
    DATA3=WORKR(I,3)
    DATA4=WORKR(I,4)
    CALL FITDP(WC,HP,PTIN,TIN,PTOUT,TOUT,PV,DATA1,DATA2,DATA3,
    +           DATA4,TYPE,DELP,ALFAC,0.,ACWB,ACWM,ACWC,0.,0.,0.,VCUB,VCUM,
    +           VCWC,0.,0.,0.,RHOC,10)
    DP(I)=DELP
    DP45=DP45+DELP
    FITPV(I)=PV
    PTIN=PTOUT
    TIN=TOUT
    C      THE MODULE FLOW GET A BOOST IN PRESSURE BY A TRANSFER
    C      OF MOMENTUM FROM THE HIGHER VELOCITY MAIN EXHAUST FLOW
    IF (TYPE.EQ.15) GAIN=DELP

```

```

      IF (TYPE.EQ.26) TMOD=TOUT
C   60  CONTINUE
      TEST=ABS(PTOUT-PTS)
      TEST=ABS(PTOUT-PTS)
      IF (TEST.LT.-1.0) GO TO 70
C      COOLING FLOW IS INCREASED BY SMALL STEPS UNTIL SYSTEM IS
C      MATCHED
      WC=WC+0.1
      GO TO 5
C   70  SYSTEM IS MATCHED PRINT RESULTS
      CALL OUTPUT(40,PO,HUMID,HP,NPT,N,WORKI,DP,FITPV,INLOSS,EXLOSS,WC,
      +    2,3,P0,5FC,154,NG,SERIAL,TMOD)
      DP12=DP12/5.19696
      DP23=DP23/5.19696
      DP35=DP35/5.19696
      DP56=DP56/5.19696
      DP24=DP24/5.19696
      DP45=DP45/5.19696
C      PRINT BRANCH LOSS SUMMARY
      WRITE (4,601) LP12,DP23,DP35,DP56,DP24,DP45
500  CONTINUE
500  FORMAT(' POWER POINT IS NOT ON THE PERFORMANCE MAP.')
601  FORMAT('/5X','LOSS BRANCH 1-2:',F12.2,'/5X','LOSS BRANCH 2-3:',F12.2,
      +    '/5X','LOSS BRANCH 3-5:',F12.2,'/5X','LOSS BRANCH 5-6:',F12.2,
      +    '/5X','LOSS BRANCH 2-4:',F12.2,'/5X','LOSS BRANCH 4-5:',F12.2)
      RETURN
END

```

```

***** SYSTEM FOUR MATCHING SUBROUTINE *****
C
C THIS SYSTEM HAS SEPARATE INLETS FOR THE ENGINE AIR FLOW AND
C MODULE COOLING. NODE 5 IS THE JUNCTION OF MODULE AIR AND
C ENGINE EXHAUST. FOR THE ASSUMED FLOW THE PRESSURE AT NODE
C 5 IS COMPUTED FROM THE COMBINED EXHAUST. THEN THE EXIT
C PRESSURE FROM BRANCHES 3-5 AND 4-5 SHOULD MATCH PT5. IF NOT
C THE ITERATION PROCESS CONTINUES.
C
C***** SUBROUTINE SYS4(SERIAL,N,WORKI,WORKR,HP,NPT,FIT1ST,T0,P0,HUMID,
C+          ALFAC,ACWB,ACWC,ACWM,
C+          RHOST,CFM0,CFMAX,DPMAX,K)
C+          REAL WORKR,HP,NPT,T0,P0,HUMID,CFMAX,CFM0,DPMAX,K,W2,W8,P8,T8
C+          INLOSS,EXLOSS,FANDP,DP13,DP24,DP35,DP45,PV,PTIN,PTOUT,DATA1,
C+          DATA2,DATA3,TEST,DP,FITPV,WC,RHOSTD,TEST1,TEST2,WCN,TMOD,
C+          TS4,FC,NG,DP56,
C+          DATA4,R,ALFAC,ACWB,ACWC,ACWM,VCWB,VCWC,VCWM,TMAIN,TMOD,SEC,
C+          H41-N,HSTACK,T4,T5,GAIN,LOSS,PSEC,PMAIN,PT4,PT5,TEST3,
C+          PV,PVC,PM,PSM,RHOCBT,RHOCCBT,RHOCAT,RHOCCAT,TEST1,TEST2,
C+          INTEGER WORKI,FIT1ST,OFF,N,PP,QQ,RR,SS,TT,A,B,C,D,E,SERIAL,TYPE,
C+          IND
C+          DIMENSION WORKI(200,2),WORKR(200,4),FIT1ST(6),DP(200),FITPV(200)
C+          GAS CONSTANT
C+          DATA R/53.3424/
C+          THE STARTING AND STOPPING INDEX FOR A BRANCH IS COMPUTED
C+          FP=FIT1ST(2)-1
C+          QQ=FIT1ST(3)-1
C+          RR=FIT1ST(4)-1
C+          SS=FIT1ST(5)-1
C+          A=FIT1ST(6)
C+          B=FIT1ST(3)
C+          C=FIT1ST(4)
C+          D=FIT1ST(5)
C+          INITIALIZE THE INLET AND EXHAUST LOSSES
C+          INLOSS=4.0
C+          EXLOSS=8.0
C+          INITIALIZE THE GAIN AND LOSS AT NODE 5
C+          GAIN=-30.0
C+          LOSS=30.0
C+          INITIALIZE THE COOLING FLOW
C+          WC=CFMAX*RHOSTD/60.0
C+          INITIALIZE THE BRANCH LOSSES
C+          DP45=100.0
C+          DP56=100.0
C+          INITIALIZE THE MODULE TEMPERATURE
C+          TMCD=710.0
C+          INITIALIZE THE PRESSURES AT NODE 5
C+          PT5=P0*144.0+DP56
C+          PMAIN=PT5+LOSS
C+          PSEC=PT5+GAIN
C+          SEARCH FOR A WASTE HEAT BOILER IN BRANCH 3-5
C+          IND=0
C+          DO 4 I=C,SS
C+              TYPE=WORKI(I,2)
C+              IF (TYPE.EQ.2) IND=1
C+          CONTINUE
C+          GET INITIAL PERFORMANCE OF ENGINE WITH ASSUMED CONDITIONS
C+          CALL ENGINE(INLOSS,EXLOSS,T0,P0,HUMID,HP,NPT,W2,W8,P8,T8,SFC,
C+          + TS4,NG,OFF)
C+          IF (OFF.EQ.0) GC TO 6
C+              WRITE(6,600)
C+              GC TO 500
C+          CONTINUE
C+          INITIALIZE INLET CONDITIONS FOR BRANCH 1-3
C+          DP13=0.0
C+          PTIN=P0*144.0
C+          TIN=T0+459.7

```

```

C COMPUTE FITTING LOSSES
DO 8 I=1,2
  TYPE=WORKI(I,2)
  DATA1=WORKR(I,1)
  DATA2=WORKR(I,2)
  DATA3=WORKR(I,3)
  DATA4=WORKR(I,4)
  CALL FITDP(12,HP,PTIN,TIN,PTOUT,TOUT,PV,DATA1,DATA2,DATA3,
+ DATA4,TYPE,DELP,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,
+ 0.,TO)
  DP(I)=DEL_P
  DP(J)=DP(I)+DELP
  FIT_PV(I)=PV
  PTIN=PTOUT
  TIN=TOUT
8 CONTINUE
C COMPUTE NODE 5 PARAMETERS
C TEMPERATURE OF MAIN JET, ENGINE EXHAUST
TMAIN=TS
C IF A BOILER IS INSTALLED THE TEMPERATURE IS THE BOILER EXIT TEMP
IF(IND.EQ.1) TMAIN=770.0+3.70E-3*HP
C COMPUTE THE COMBINED FLOW TEMPERATURE BY MIXING ENTHALPIES
HSEC=(1.421385E-5*TMOD+.221091)*TMOD+5.6373
HMAIN=(1.36051E-5*TMAIN+.223388)*TMAIN+4.75396
HSTACK=(W8/(W8+WC))*HMAIN+(WC/(W8+WC))*HSEC
T5=(-0.3008417*HSTACK+4.33577)*HSTACK-9.5778
C ASSUME DENSITIES AT NODE 5, COMBINED, BRANCH, MAIN
RHCCC=PT5/(R*T5)
RHCC3=PSEC/(B*TOD)
RHCCM=PMAIN/(R*TMAIN)
C COMPUTE VELOCITIES AT NODE 5, BRANCH, COMBINED, MAIN
VCWB=WC/(RHOCB*ACWB)
VCWC=(WC+W8)/(RHOC*ACWC)
VCWM=W8/(RHOC*ACWM)
C COMPUTE THE VELOCITY PRESSURES AROUND NODE 5
PVB=RHOCB*VCWB**2/(2.0*32.174)
PVC=RHOC*VCWC**2/(2.0*32.174)
PVM=RHOC*VCWM**2/(2.0*32.174)
C COMPUTE STATIC PRESSURES AROUND NODE 5
PSE=PSEC-PVB
PSC=PT5-PVC
PSM=EMAIN-EVM
C COMPUTE DENSITIES AROUND NODE 5
RHCCBT=PSC/(R*T5)
RHCCCT=PSC/(R*TS)
RHCCMT=PSM/(R*TMAIN)
C TEST ASSUMED DENSITIES AND COMPUTED DENSITIES
ST1=ABS(RHOCBT-RHOCB)
ST2=ABS(RHCCCT-RHOC)
ST3=ABS(RHCCMT-RHOCM)
RHCCBT=RHOCBT
RHCCCT=RHOCCT
RHCCMT=RHOCMT
IF({T1,T2,T3}>0.001} GO TO 10
IF({T1,T2,T3}<0.001} GO TO 10
10 INITIALIZED INLET CONDITIONS FOR BRANCH 5-6
TIN=TS
PTIN=PO*144.0+DP56
W=WC+W8
DP56=0.0
C COMPUTE FITTING LOSSES
DO 11 I=DN
  TYPE=WORKI(I,2)
  DATA1=WORKR(I,1)
  DATA2=WORKR(I,2)
  DATA3=WORKR(I,3)
  DATA4=WORKR(I,4)
  CALL FITDP(12,HP,PTIN,TIN,PTOUT,TOUT,PV,DATA1,DATA2,DATA3,

```

```

+ DATA4, TYPE, DELP, 0., 0., 0., 0., 0., 0., 0., 0., 0., 0., 0., 0., 0.,
+ 0., TO}
DP(I)=DELP
DP56=DP56+DELP
FITPV(I)=PV
PTIN=PTOUT
TIN=TOUT
C CONTINUE
EXIT PRESSURE MUST BE ATMOSPHERIC
TEST=ABS(PTOUT-P0*144.0)
IF(TEST.LT.1.0) GO TO 14
GO TO 11
C CONTINUE
TOTAL PRESSURE AT NODE FIVE BASED ON FLCW IN BRANCH 5-6
ET5=P0*144.0+DP56
C INITIALIZE INLET CONCITIONS FOR BRANCH 3-5
PTIN=P8*144.0
TIN=T8
DP35=0.0
C COMPUTE FITTING LOSSES
DO 35 I=C SS
TYPE=WORKR(I,2)
DATA1=WORKR(I,1)
DATA2=WORKR(I,2)
DATA3=WORKR(I,3)
DATA4=WORKR(I,4)
CALL FITDP(WC,HP,PTIN,TIN,PTOUT,TOUT,PV,DATA1,DATA2,DATA3,
+ DATA4,TYPE,DELP,ALFAD,0.,ACWB,ACWC,0.,0.,0.,VCWB,VCWM,
+ VCWC,0.,0.,0.,RHOCC,TO)
DP(I)=DELP
DP35=DP35+DELP
FITPV(I)=PV
PTIN=PTOUT
TIN=TOUT
LCSS OF PRESSURE DUE TO MOMENTUM EXCHANGE WITH SLOWER JET,
THE MODULE COOLING FLCW
IF(TYPE.EQ.16) LOSS=DELP
C CONTINUE
BRANCH EXIT PRESSURE MUST BE PT5 OR REPEAT
TEST=ABS(PTOUT-PT5)
IF(TEST.LT.1.0) GO TO 40
PTIN=P0*144.0+DP35+DP56
GO TO 30
C CONTINUE
COMPUTE ASSUMED LOSSES TO COMPUTED LOSSES, REPEAT ITERATION IF
REQUIRED
INLOSS=INLOSS*5.19696
EXLOSS=EXLOSS*5.19696
TEST1=ABS(DP13-INLOSS)
TEST2=ABS(DP35+DP56-EXLOSS)
INLOSS=DP13/5.19696
EXLOSS=(DP35+DE56)/5.19696
IF((TEST1.GT.1.0).OR.(TEST2.GT.1.0)) GO TO 5
C INITIALIZE INLET CONCITIONS FOR BRANCH 2-4
PTIN=P0*144.0
TIN=TC+459.7
DP24=0.0
C COMPUTE FITTING LOSSES
DO 20 I=B QQ
TYPE=WORKR(I,2)
DATA1=WORKR(I,1)
DATA2=WORKR(I,2)
DATA3=WORKR(I,3)
DATA4=WORKR(I,4)
CALL FITDP(WC,HP,PTIN,TIN,PTOUT,TOUT,PV,DATA1,DATA2,DATA3,
+ DATA4,TYPE,DELP,0.,ALFAD,0.,0.,0.,ADWB,ADWC,0.,0.,
+ VDWB,VDWL,VDWC,0.,0.,TO)
DP(I)=DELP
DP24=DP24+DELP

```

```

      FITPV(I)=PV
      PTIN=PTOUT
      TIN=TOUT
      IF (TYPE.EQ.26) TMOD=TOUT
20    CCNTINUE
      PT4=PTOUT
      T4=TOUT
C     INITIALIZE INLET CONDITIONS FOR BRANCH 4-5
      PTIN=PT4*(K*((WC/RHOS TD*60.0)-CFMMAX)**2+DP MAX)*5.19696
      TIN=T4
      DP45=0.0
C     COMPUTE FITTING LOSSES
      DC 60 I=B,PR
      TYPE=WORKI(I,2)
      DATA1=WORKR(I,1)
      DATA2=WORKR(I,2)
      DATA3=WORKR(I,3)
      DATA4=WORKR(I,4)
      CALL FITDP(WC,HP,PTIN,TIN,PTOUT,TOUT,PV,DATA1,DATA2,DATA3,
      +          DATA4,TYPE,DELTA,ALFA,0.,ACFB,ACWM,ACWC,0.,0.,VCWB,VCWM,
      +          VCWC,0.,0.,0.,RHOCC,10)
      DP(I)=DELTA
      DP45=DP45+DELTA
      FITPV(I)=PV
      PTIN=PTOUT
      TIN=TOUT
C     GAIN IS RESULT OF MOMENTUM TRANSFER FROM EXHAUST FLOW
      IF (TYPE.EQ.15) GAIN=DELTA
      IF (TYPE.EQ.26) TMOD=TOUT
      C60  CONTINUE
C     EXIT PRESSURE SHOULD BE PT5 OR REPEAT ITERATION
      TEST=ABS(PTOUT-PT5)
      IF (TEST.LT.1.0) GO TO 70
C     ADD A SMALL INCREMENT TO THE COOLING FLOW AND REPEAT ITERATION
      WC=WC+0.1
      GO TO 5
C     SYSTEM IS MATCHED, OUTPUT RESULTS
      70    CALL OUTPUT(TO,PO,HUMID,HE,NPT,N,WORKI,DP,FITPV,INLOSS,EXLOSS,WC,
      +          W2,W8,W8,T8,SFC,I54,NG,SERIAL,TMOD)
      DP13=DP13/5.19696
      DP24=DP24/5.19696
      DP35=DP35/5.19696
      DP45=DP45/5.19696
      DP56=DP56/5.19696
C     COMPUTE BRANCH ICSS SUMMARY
      WRITE(4,601) DP13,DP24,DP35,DP45,DP56
500    CCNTINUE
500    FORMAT(' POWER POINT IS NOT ON THE PERFORMANCE MAP.')
601    FORMAT('/5X,'LOSS BRANCH 1-3:',F12.2,/5X,'LOSS BRANCH 2-4:',F12.2,
      +        '/5X,'LOSS BRANCH 3-5:',F12.2,/5X,'LOSS BRANCH 4-5:',F12.2,
      +        '/5X,'LOSS BRANCH 5-6:',F12.2)
      RETURN
END

```



```

D12=0.0
TIN=20*144.0
TIN=T0+459.7
W=W+C+H2
C COMPUTE PITTING LOSSES
DO 8 I=1,P
  TYPE=WORKI(I,2)
  DATA1=WORK2(I,1)
  DATA2=WORKR(I,2)
  DATA3=WORKR(I,3)
  DATA4=WORKR(I,4)
  CALL PITDP(W,HP,PTIN,TIN,PTOUT,TOUT,PV,DATA1,DATA2,DATA3,
  + DATA4,TYPE,DELP,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,
  + C,T0)
  DP(I)=DEL_P
  DP12=DP12+DEL_P
  PITPV(I)=PV
  PTIN=PTOUT
  TIN=TOUT
CONTINUE
C COMPUTE PARAMETERS AT NODES 2 & 5
C TOTAL PRESSURE AT NODE 2 (PSF)
C BT2=FO*144.0-DP12
C DENSITY AT NODE 2
C RHC2=(BT2-PV)/((T0+459.7)*R)
C VELOCITIES AT NODE 2, BRANCH, COMBINED, MAIN
C VDWB=WC/(RHO2*ADWB)
C WDWC=(WC+W2)/(RHC2*ADWC)
C VDW_M=W2/(RHO2*ADWM)
C TEMPERATURE IN MAIN JET (ENGINE EXHAUST) AT NODE 5
C TMAIN=T9
C IF A BOILER IS INSTALLED TMAIN IS BOILER EXIT TEMP
C IF (IND.EQ.1) TMAIN=770.0+3.70E-3*HP
C COMPUTE COMBINED FLOW TEMPERATURE BASE ON ENTHALPIES
C HSEC=(1.421385E-5*TMOD+.221091)*TMOD+5.6373
C HMAIN=(1.56051E-5*TMAIN+.222388)*TMAIN+4.75396
C HSTACK=(1.8/(W8+WC))*HMAIN+(WC/(W8+WC))*HSEC
C T5=(-0.3008417*HSTACK+4.33577)*HSICK-9.5778
C ASSUME DENSITIES AT NODE 5, COMBINED, BRANCH, MAIN
C RHCCC=PT5/(R*T5)
C RHCCCB=PEC/(R*TMOD)
C RHCCCM=PMAIN/(R*TMAIN)
C COMPUTE VELOCITIES AT NODE 5, BRANCH, COMBINED, MAIN
C VCWB=WC/(RHO2*ACWB)
C VCAC=(WC+W8)/(RHCCCB*ACWC)
C VCM=WC/(RHO_M*ACWM)
C COMPUTE THE VELOCITY PRESSURES AROUND NODE 5
C PVE=RHCCCB*VCWB**2/(2.0*32.174)
C PVC=RHCCCB*VCAC**2/(2.0*32.174)
C PVM=RHO_M*VCM**2/(2.0*32.174)
C COMPUTE STATIC PRESSURES AROUND NODE 5
C PSE=PSEC-PVB
C PSC=PT5-PVC
C PSM=PMAIN-PVM
C COMPUTE DENSITIES AROUND NODE 5
C RHCCCB=PB/(R*TMOD)
C RHCCCT=PSC/(R*T5)
C RHCCM=PSM/(R*TMAIN)
C TEST ASSUMED DENSITIES AND COMPUTED DENSITIES
TEST1=ABS(RHOCCB-RHOCE)
TEST2=ABS(RHOCCCT-RHOCC)
TEST3=ABS(RHOCCM-RHOCM)
RHCCB=RHOCE
RHCCC=RHOCC
RHCCM=RHOCM
IF (TEST1.GT.0.001) GO TO 10
IF (TEST2.GT.0.001) GO TO 10
IF (TEST3.GT.0.001) GO TO 10
C INITIALIZE INLET CONDITIONS FOR BRANCH 5-6

```

```

11      TIN=TS
      PTIN=P0*144.0+DP56
      DP56=0.0
      W=WC+X8
C      COMPUTE FITTING LOSSES
      DO 12 I=1,N
        TYPE=WORKI(I,2)
        DATA1=WORKR(I,1)
        DATA2=WORKR(I,2)
        DATA3=WORKR(I,3)
        DATA4=WORKR(I,4)
        CALL FITDP(W,HP,PTIN,TIN,PTOUT,TOUT,PV,DATA1,DATA2,DATA3,
+        DATA4,TYPE,DELP,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,
+        0.,TO)
        DP(I)=DELP
        DP56=DP56+DELP
        FITPV(I)=PV
        PTIN=PTOUT
        TIN=TOUT
12      CONTINUE
C      EXIT PRESSURE SHOULD BE ATMOSPHERIC, IF NOT REPEAT
      TEST=ABS(PTOUT-P0*144.0)
      IF(TEST.LT.1.0) GO TO 14
      GO TO 11
14      CONTINUE
      PTS=P0*144.0+DP56
C      INITIALIZE INLET CONDITIONS FOR BRANCH 2-3
      PTIN=PTS
      TIN=TO+459.7
      DP23=0.0
C      COMPUTE FITTING LOSSES
      DO 20 I=A,OO
        TYPE=WORKI(I,2)
        DATA1=WORKR(I,1)
        DATA2=WORKR(I,2)
        DATA3=WORKR(I,3)
        DATA4=WORKR(I,4)
        CALL FITDP(W2,HP,PTIN,TIN,PTOUT,TOUT,PV,DATA1,DATA2,DATA3,
+        DATA4,TYPE,DELP,0.,ALFAD,0.,0.,0.,ADWB,ADWM,ADWC,0.,0.,
+        VDWB,VDWM,VDWC,0.,0.,TO)
        DP(I)=DELP
        DP23=DP23+DELP
        FITPV(I)=PV
        PTIN=PTOUT
        TIN=TOUT
20      CONTINUE
C      INITIALIZE INLET CONDITIONS FOR BRANCH 3-5
      PTIN=PTS*144.0
      30      TIN=TS
      DP35=0.0
C      COMPUTE FITTING LOSSES
      DO 35 I=CS,SS
        TYPE=WORKI(I,2)
        DATA1=WORKR(I,1)
        DATA2=WORKR(I,2)
        DATA3=WORKR(I,3)
        DATA4=WORKR(I,4)
        CALL FITDP(W3,HP,PTIN,TIN,PTOUT,TOUT,PV,DATA1,DATA2,DATA3,
+        DATA4,TYPE,DELP,ALFAC,0.,ACAB,ACWM,ACRC,0.,0.,0.,0.,0.,0.,
+        VCWB,VCWM,VCWC,0.,0.,0.,0.,RHOCC,TO)
        DP(I)=DELP
        DP35=DP35+DELP
        FITPV(I)=PV
        PTIN=PTOUT
        TIN=TOUT
C      LCSS IS FROM MOMENTUM TRANSFER TO COOLING FLOW
      IF(TYPE.EQ.16) LOSS=DELP
      35      CONTINUE
C      EXIT PRESSURE SHOULD BE PTS, IF NOT REPEAT

```

```

TEST=ABS(PTOUT-PT5)
IF(TEST.LT.1.0) GO TO 40
    PTIN=P0*144.0+DP35+DP56
    GO TO 30
C 40 CCNTINUE
COMPARE ASSUMED LOSSES WITH COMPUTED LOSSES
INLOSS=INLOSS*5.19696
EXLOSS=EXLOSS*5.19696
TEST1=ABS(DP12+DP23-INLOSS)
TEST2=ABS(DP35+DP56-EXLOSS)
INLOSS=(DP12+DP23)/5.19696
EXLOSS=(DP35+DP56)/5.19696
IF((TEST1.GT.1.0).OR.(TEST2.GT.1.0)) GO TO 5
INITIALIZE INLET CONDITIONS FOR BRANCH 2-5, NO FAN (NODE 4)
PTIN=PT2
TIN=T0+459.7
DP25=0.0
DO 60 I=3,RR
    TYPE=W6RKI(I,2)
    DATA1=WORKR(I,1)
    DATA2=WORKR(I,2)
    DATA3=WORKR(I,3)
    DATA4=WORKR(I,4)
    CALL FITDP(WC,HP,PTIN,TIN,PTOUT,TCUT,PV,DATA1,DATA2,DATA3,
    + DATA4,TYPE,DELP,ALFAC,0.,ACWB,ACWM,ACWC,0.,0.,0.,VCVB,VCWM,
    + VCWC,0.,0.,0.,RHOC,C,T0)
    DP12=DELP
    DP25=DP25+DELP
    FITPV(I)=PV
    PTIN=PTCUT
    TIN=TIOUT
C      GAIN IS FROM MOMENTUM TRANSFER FROM ENGINE EXHAUST
    IF(TYPE.EQ.15) GAIN=DELP
    IF(TYPE.EQ.26) TMOD=TIOUT
C 60 CONTINUE
EXIT PRESSURE SHOULD BE PT5, IF NOT REPEAT ITERATION
TEST=ABS(PTOUT-PT5)
IF(TEST.LT.1.0) GO TO 70
C      INCREASE COOLING FLOW UNTIL SYSTEM IS MATCHED
WC=WC+0.1
GO TO 5
C 70 SYSTEM IS MATCHED, OUTPUT RESULTS
CALL OUTPUT(TO,P0,HUMID,HP,NPT,N,WORKI,IP,FITPV,INLOSS,EXLOSS,AC,
    + W2,W3,W4,W5,W6,SFC,T54,NG,SERIAL,TMOD)
    DP12=DP12/5.19696
    DP25=DP25/5.19696
    DP35=DP35/5.19696
    DP56=DP56/5.19696
    DP25=DP25/5.19696
C      CUTOFF BRANCH LOSS SUMMARY
WRITE(4,601) DP12,DP23,DP35,DP56,DP25
500 CCNTINUE
600 FORMAT(' POWER POINT IS NOT ON THE PERFORMANCE MAP.')
601 FORMAT('/5X,'LOSS BRANCH 1-2:',F12.2,'/5X,'LOSS BRANCH 2-3:',F12.2,
    + '/5X,'LOSS BRANCH 3-5:',F12.2,'/5X,'LOSS BRANCH 5-6:',F12.2,
    + '/5X,'LOSS BRANCH 2-5:',F12.2')
    RETURN
END

```

```

C***** SYSTEM SIX MATCHING SUBROUTINE *****
C
C THIS SYSTEM HAS SEPARATE INLETS FOR COOLING FLOW AND ENGINE AIR.
C THE TWO FLOW JET IN AT AN EDUCTOR ARRANGEMENT AT THE ENGINE EXHAUST
C PLANE. THERE IS NO COOLING FAN INSTALLED. THE EDUCTOR PROVIDES
C ALL THE PUMPING ACTION BY MOMENTUM TRANSFER FROM A HIGH VELOCITY JET
C (ENGINE EXHAUST THROUGH A NOZZLE) TO A LOW VELOCITY JET
C (MODULE COOLING FLOW).
C***** SUBROUTINE SYS6(SERIAL,N,WORKI,WORKR,HP,NPT,FIT1ST,T0,P0,HUMID,
C      + ALFAC,ACWB,ACWC,ACWM)
C      + REAL WORKR,HP,NPT,T0,P0,HUMID,CF1MAX,CFM0,DPMAX,K,W2,W8,P8,T8,
C      + INLOSS,EXLOSS,DP13,DP25,DP35,DP56,PV,PTIN,PTOUT,DATA1,
C      + DATA2,DATA3,TEST,DP,FITPV,AC,RHOSID,TEST1,TEST2,WCN,TMOD,
C      + TS4,SFC,NG,
C      + DATA4,R,ALFAC,ACWB,ACWC,ACWM,VCWB,VCWC,VCNM,IMAIN,TMOD,HSEC,
C      + HMAIY,HSTACK,15,W,GAIN,LOSS,PSEC,PMAIN,PT5,TEST3,
C      + PV,PVC,PVM,PSB,PSC,PS4,RHOGBT,RHOCC,T,HCCMT,TEST1,TEST2
C      + INTEGER WORKI,FIT1ST,OFF,N,PP,QQ,RR,A,B,C,SERIAL,TYPE,
C      + IND
C      + DIMENSION WORKI(200,2),WORKR(200,4),FIT1ST(6),DP(200),FITPV(200)
C      + GAS CCNSTANT
C      + DATA R/53.3424/
C      + STARTING AND STOPPING POINTS FOR THE BRANCH FITTING INDEX
C      + PP=FIT1ST(2)-1
C      + QQ=FIT1ST(3)-1
C      + RR=FIT1ST(4)-1
C      + A=FIT1ST(2)
C      + B=FIT1ST(3)
C      + C=FIT1ST(4)
C      + INITIALIZE THE INLET AND EXHAUST DUCT LOSSES (INCH WG)
C      + INLOSS=4.0
C      + EXLOSS=8.0
C      + INITIALIZE THE GAIN AND LOSS IN THE EDUCTOR (PSF)
C      + GAIN=-30.0
C      + LOSS=30.0
C      + INITIALIZE THE COOLING FLOW TO THE MINIMUM REQUIRED
C      + WC=7.5
C      + INITIALIZE OTHER VALUES
C      + DP56=100.0
C      + IMCD=710.0
C      + PT5=P0*144.0+DP56
C      + PMAIN=PT5+LOSS
C      + PSEC=PT5+GAIN
C      + SEARCH FOR A BOILER, THERE PROBABLY IS NOT ONE INSTALLED FOR THIS
C      + SYSTEM
C      + IND=0
C      + DO 4 I=C,RR
C          TYPE=WORKI(I,2)
C          IF(TYPE.EQ.27) IND=1
C        4 CONTINUE
C        5 GET ENGINE PERFORMANCE FOR THE ASSUMED CONDITIONS
C        + CALL ENGINE(INLOSS,EXLOSS,T0,P0,HUMID,HP,NPT,W2,W8,P8,T8,SFC,
C          TS4,NG,OFF)
C          IF(OFF.EQ.0) GC TO 6
C          WRITE(6,600)
C          GO TO 500
C        6 CONTINUE
C        + INITIALIZE THE INLET CONDITIONS FOR BRANCH 1-3
C        + DP13=0.0
C        + PTIN=20*144.0
C        + TIN=T0+459.7
C        + COMPUTE FITTING LOSSES
C        DO 8 I=1,PP
C            TYPE=WORKI(I,2)
C            DATA1=WORKR(I,1)
C            DATA2=WORKR(I,2)

```

```

      DATA3=WORKR(I,3)
      DATA4=WORKR(I,4)
      CALL FITDP2(1,2,H2,PTIN,TIN,PTOUT,TOUT,PV,DATA1,DATA2,DATA3,
+     DATA4,TYPE,DELP,5.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,
+     0.,TO)
      DP(I)=DELP
      DP13=DP13+DELP
      FITPV(I)=PV
      PTIN=PTOUT
      TIN=TOUT

8   CCNTINUE
C   COMPUTE PARAMETERS FOR NODE 5
C   MAIN JET TEMPERATUFE (ENGINE EXHAUST)
      TMAIN=T8
C   IF A BOILER IS INSTALLED, TMAIN IS BOILER EXIT TEMPERATURE
      IF (IND.EQ.1) TMAIN=770.0+3.70E-3*H2
C   COMPUTE COMBINED FLOW TEMPERATUFE FOR NODE 5, USING ENTHALPIES
      HSEC=(1.421385E-5*TMOD+.221091)*TMOD+5.6373
      HMAIN=(1.56051E-5*TMAIN+.223388)*TMAIN+4.75396
      HSTACK=(W8/(W8+WC))*HMAIN+(WC/(W8+WC))*HSEC
      TS=(-0.008417*HSTACK+4.33577)*HSTACK-9.5778
C   ASSUME NODE 5 DENSITIES, COMBINED, BRANCH, AND MAIN
      RHCCC=PTS/(R*TS)
      RHCCS=PSEC/(R*TMOD)
      RHCCM=PMAIN/(R*TMAIN)
C   COMPUTE NODE 5 VELOCITIES BRANCH, COMBINED AND MAIN
      VCWB=(WC*ACAB)/(RHOC*B)
      VCWC=(WC*W8)/(RHOC*ACWC)
      VCM=W8/(RHOCM*ACWM)
C   COMPUTE THE VELOCITY PRESSURES AROUND NODE 5
      PVE=RHOCB*VCWB**2/(2.0*32.174)
      PVC=RHOC*VCWC**2/(2.0*32.174)
      PVM=RHOCM*VCM**2/(2.0*32.174)
C   COMPUTE STATIC PRESSURES AROUND NODE 5
      PSE=PSEC-PVB
      PSC=PTS-PVC
      PSM=PMAIN-PVM
C   COMPUTE DENSITIES AROUND NODE 5
      RHOCET=PSB/(R*TMOD)
      RHCCCT=PSC/(R*TS)
      RHCCMT=PSM/(R*TMAIN)
C   TEST ASSUMED DENSITIES AND COMPUTED DENSITIES
      TEST1=ABS(RHOCET-RHOCCE)
      TEST2=ABS(RHCCCT-RHOCCT)
      TEST3=ABS(RHCCMT-RHOCM)
      RHCCB=RHOCT
      RHCCC=RHOCC
      RHCCM=RHOCT
      IF (TEST1.GT.0.001) GO TO 10
      IF (TEST2.GT.0.001) GO TO 10
      IF (TEST3.GT.0.001) GO TO 10
C   11   INITIALIZE INLET CONDITIONS FOR BRANCH 1-2
      TIN=TS
      PTIN=PO*144.0+DP56
      DP56=0.0
C   COMPUTE FITTING LOSSES
      DO 12 I=1,N
      TYPE=H6,RKI(I,2)
      DATA1=WORKR(I,1)
      DATA2=WORKR(I,2)
      DATA3=WORKR(I,3)
      DATA4=WORKR(I,4)
      CALL FITDP2(2,H2,PTIN,TIN,PTOUT,TOUT,PV,DATA1,DATA2,DATA3,
+     DATA4,TYPE,DELP,5.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,0.,
+     0.,TO)
      DP(I)=DELP
      DP56=DP56+DELP
      FITPV(I)=PV
      PTIN=PTOUT

```

```

      TIN=TOUT
C CONTINUE
C EXIT TEMPERATURE SHOULD BE ATMOSPHERIC IF NOT REPEAT ITERATION
TEST=ABS(PTOUT-PO*144.0)
IF (TEST.LT.1.0) GO TO 14
GO TO 11
14 CONTINUE
PT5=PO*144.0+DP56
INITIALIZE INLET CONDITIONS FOR BRANCH 3-5
PTIN=PB*144.0
TIN=T8
DP35=0.0
C COMPUTE FITTING LOSSES
DO 20 I=B,RR
  TYPE=WORKI(I,2)
  DATA1=WORKR(I,1)
  DATA2=WORKR(I,2)
  DATA3=WORKR(I,3)
  DATA4=WORKR(I,4)
  CALL FITDP(WC,HP,PTIN,TIN,PTOUT,TOUT,PV,DATA1,DATA2,DATA3,
+    DATA4,TYPE,DELP,0.,ALFAD,0.,0.,ADWB,ADWM,ADWC,0.,0.,
+    VDWB,VDMW,VDWC,0.,0.,T0)
  DP(I)=DELP
  DP35=DP35+DELP
  FITPV(I)=PV
  PTIN=PTOUT
  TIN=TOUT
  IF (TYPE.EQ.16) LOSS=DELP
20 CONTINUE
C COMPARE ASSUMED LOSSES AND COMPUTED LOSSES, IF NOT THE SAME REPEAT
INLOSS=INLOSS*5.19696
EXLOSS=EXLOSS*5.19696
TEST1=ABS(DP12+DP23-INLOSS)
TEST2=ABS(DP35+DP56-EXLOSS)
INLOSS=(DP12+DP23)/5.19696
EXLOSS=(DP35+DELP)/5.19696
IF ((TEST1.GT.1.0).OR.(TEST2.GT.1.0)) GO TO 5
INITIALIZE INLET CONDITIONS FOR BRANCH 2-5
PTIN=PO*144.0
TIN=T0+459.7
DP25=0.0
C COMPUTE FITTING LOSSES
DO 35 I=A,QQ
  TYPE=WORKI(I,2)
  DATA1=WORKR(I,1)
  DATA2=WORKR(I,2)
  DATA3=WORKR(I,3)
  DATA4=WORKR(I,4)
  CALL FITDP(WC,HP,PTIN,TIN,PTOUT,TOUT,PV,DATA1,DATA2,DATA3,
+    DATA4,TYPE,DELP,ALFAC,0.,ACWB,ACWM,ACWC,0.,0.,0.,0.,TCWB,VCAM,
+    VCWC,0.,0.,0.,0.,RHOCB,IB)
  DP(I)=DELP
  DP25=DP25+DELP
  FITPV(I)=PV
  PTIN=PTOUT
  TIN=TOUT
  GAIN IS RESULT OF MOMENTUM TRANSFER FROM EXHAUST TO COOLING
  FLCW
  IF (TYPE.EQ.15) GAIN=DELP
  IF (TYPE.EQ.26) TMOD=TOUT
35 CONTINUE
C EXIT PRESSURE SHOULD BE PT5, IF NOT REPEAT ITERATION
TEST=ABS(PTOUT-PT5)
IF (TEST.LT.1.0) GO TO 40
C NEXT ITERATION IS DONE WITH INCREASED COOLING FLOW, INCREASE
UNTIL SYSTEM IS MATCHED
WC=WC+0.1
GC TO 5
40 CONTINUE

```

```
C 70   SYSTEM IS MATCHED, OUTPUT RESULTS
      + W2,W3,W8,SFC,T54,NG,SERIAL,TMOD)
DP13=DP21/5.19696
DP25=DP29/5.19696
DP35=DP39/5.19696
DP56=DP59/5.19696
C   OUTPUT BRANCH LOSS SUMMARY
      + CONTINUE
      + FORMAT(' POWER POINT IS NOT ON THE PERFORMANCE MAP.')
      + FORMAT('/5X,'LOSS BRANCH 1-3:',F12.2,/5X,'LOSS BRANCH 2-5:',F12.2,
      +        'LOSS BRANCH 3-5:',F12.2,/5X,'LOSS BRANCH 5-6:',F12.2,
      +        RETURN
      END
```

```

C***** **** FAN MATCHING SUBROUTINE **** C
C THIS SUBROUTINE PRODUCES THE NEXT GUESS AT COOLING FLOW BY C
C LOCATING THE INTERSECTION OF THE SYSTEM MODEL CURVE AND THE C
C FAN CHARACTERISTIC CURVE. C
C***** **** SUBROUTINE FANMAT(WC,T0,P0,FANDP,RHOSTD,CFM0,CFMMAX,DPMAX,K,WCN) C
C REAL CFMSTD,DPSTD,WC,RHOSTD,FANDP,P0,T0,C,CFM,WCN,CFM0,CFMMAX,
C + DPMAX,K,R
C GAS CONSTANT
C DATA R/3.3424/
C CONVERT MASS FLOW TO STANDARD VOLUME FLOW (CFM)
C CFMSTD=WC/RHOSTD*60.0
C CONVERT FAN DELTA PRESSURE TO STANDARD CONDITIONS FOR THE FAN
C DPSTD=FANDP*(RHOSTD*R*(T0+459.7)/(P0*144.0))**2
C C IS THE PROPORTIONALITY CONSTANT FOR THE QUADRATIC MODEL ASSUMED
C TO REPRESENT THE SYSTEM
C=C=DPSTD/CFMSTD**2
C CFM IS THE INTERSECTION OF THE FAN CHARACTERISTIC AND SYSTEM
C MODEL
C CFM=(2.0*K*CFMMAX-SQRT((2.0*K*CFMMAX)**2-4.0*(K-C)*(K*CFMMAX)**2
C + DPMAX))/ (2.0*(K-C))
C CONVERT CFM TO MASS PLOW
C WCN=RHOSTD*CFM/60.0
C RETURN
C END

```

```

***** COMPUTE OUTPUT SUBROUTINE: PRINTS SYSTEM DATA *****
C THIS SUBROUTINE WRITES TO THE OUTPUT FILE. IF YOU HAVE AN OUTPUT C
C FILE ALREADY IT WILL BE WRITTEN OVER BY THIS PROGRAM. IF YOU C
C WANT TO SAME THE PREVIOUS RESULTS RENAME THE FILE. IF YOU ADD C
C OR CHANGE FITTINGS YOU MUST MAKE SOME CHANGES HERE. C
C***** SUBROUTINE OUTPUT(TO,PO,HUMID,HP,NPT,N,WORKI,DP,FITPV,INLOSS,
+ EXLOSS,WC,W2,W8,P8,T8,SFC,T54,NG,SERIAL,TMOD)
+ REAL TO,PO,HUMID,HP,NPT,DP,FITPV,INLOSS,EXLOSS,WC,W2,TMOD,
+ W8,P8,T8,SFC,T54,NG,SERIAL,TMOD
+ INTEGER N,WORKI,SERIAL,TMOD
+ DIMENSION DP(200),FITPV(200),WORKI(200,2)
+ WRITE(4,600) SERIAL,TO,PO,HUMID,HP,NPT
+ WRITE(4,601) INLOSS,EXLOSS
+ IMOD=IMOD-459.7
+ WRITE(4,602) WC,W2,W8,P8,T8,SFC,T54,NG,TMOD
DC 100 I=1 N
      DP(I)=DP(I)/5.19696
      TYPE=WORKI(I,2)
      FITPV(I)=FITPV(I)/5.19696
      GO TO (1,2,3,4,5,6,7,8,9,10,11,12,13,14,15,16,17,18,19,20,
      21,22,23,24,25,26,27,28,29,30),TYPE
1   WRITE(4,603) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
2   WRITE(4,604) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
3   WRITE(4,605) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
4   WRITE(4,606) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
5   WRITE(4,607) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
6   WRITE(4,608) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
7   WRITE(4,609) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
8   WRITE(4,610) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
9   WRITE(4,611) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
10  WRITE(4,612) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
11  WRITE(4,613) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
12  WRITE(4,614) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
13  WRITE(4,615) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
14  WRITE(4,616) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
15  WRITE(4,617) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
16  WRITE(4,618) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
17  WRITE(4,619) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
18  WRITE(4,620) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
19  WRITE(4,621) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
20  WRITE(4,622) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
21  WRITE(4,623) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
22  WRITE(4,624) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
GO TO 100
23  WRITE(4,625) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)

```


```


24      GO TO 100
25      WRITE (4,626) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
26      GO TO 100
27      WRITE (4,627) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
28      GO TO 100
29      WRITE (4,628) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
30      GO TO 100
31      WRITE (4,629) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
32      GO TO 100
33      WRITE (4,630) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
34      GO TO 100
35      WRITE (4,631) WORKI(I,1),WORKI(I,2),DP(I),FITPV(I)
36      CONTINUE
37      WRITE (6,633)
38      FORMAT(//,*' THIS PERFORMANCE RUN WAS DEVELOPED FROM DUCT DATA FIL
39      *E, *,16,/*' INLET CONDITIONS: AMBIENT TEMP (DEG F)',F10.2,/
40      *+          AMBIENT PRESS (PSIA)',F10.2,/
41      *+          HUMIDITY (GRAINS)',F10.2,/
42      *+          HORSEPOWER:',F12.1,/
43      *+          NET (RPM)',F12.1,/
44      *+          ENGINE DUCT LOSSES (IN.W.G.): INLET',F8.2,3X,'EXHAUST',
45      *+          F8.2,1
46      *+          ENGINE PERFORMANCE PARAMETERS:/'
47      *+          WC=',F10.2,' LBM/SEC',/
48      *+          W2=',F10.2,' LBM/SEC',/
49      *+          W8=',F10.2,' LBM/SEC',/
50      *+          P8=',F10.2,' PSIA',/
51      *+          T8=',F10.2,' DEG R',/
52      *+          SFC=',F9.3,' LBM(FUEL)/HP*HR',/
53      *+          TSU=',F10.1,' DEG R',/
54      *+          NG=',F10.1,' RPM',/
55      *+          MODULE COOLING TEMP OUT=',F10.1,' DEG F',/
56      *+          FITTING PRESSURE LOSS VELOCITY PRESSURE',/
57      *+          ID TYPE INCH W.G. INCH W.G.',/
58      *+          103 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'INTAKE SHAFT INLET')
59      *+          104 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'STRAIGHT DUCT')
60      *+          105 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'ELBOW,END,SMOOTH RAD')
61      *+          106 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'ELBOW,END,SEGMT,90 DEG')
62      *+          107 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'ELBOW,INTERRED,ROUND')
63      *+          108 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'ELBOW,MIEXT RED,RECT')
64      *+          109 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'ELBOW,BRECT,SMOOTH RAD')
65      *+          110 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'ELBOW,BRECT,SMOOTH RAD,4/SPLT')
66      *+          111 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'ELBOW,BRECT,MIEXT RED,4/VANES')
67      *+          112 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'ELBOW,BRECT,CONV/DIV FLOW')
68      *+          113 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'ELBOWS,Z-SHAPED')
69      *+          114 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'ELBOWS,IN DIFF PLANES')
70      *+          115 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'BRANCH,DIV WYE')
71      *+          116 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'BRANCH,MAIN SECT, DIV WYE')
72      *+          117 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'BRANCH,CONV WYE')
73      *+          118 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'MAIN SECT, CONV WYE')
74      *+          119 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'DIFF,CONICAL')
75      *+          120 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'DIFF,PLANE IN LINE')
76      *+          121 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'DIFF,PYRAMIDAL')
77      *+          122 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'DIFF,TRANSITIONAL')
78      *+          123 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'CONTRACT,ROUND')
79      *+          124 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'CONTRACT,RECT')
80      *+          125 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'DUCT,SCREEN')
81      *+          126 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'DUCT,LOUVER,ENTRANCE')
82      *+          127 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'DUCT,PIPE')
83      *+          128 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'DUCT,SECTION')
84      *+          129 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'GAS TURBINE MODULE')
85      *+          130 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'WASTE HEAT BOILER')
86      *+          131 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'EXIT,ABRUPT')
87      *+          132 FORMAT(I6,7X,I2,9X,F8.2,9X,F8.2,3X,'YOUR CHOICE')
88      *+          133 FORMAT(' SEE OUTPUT DATA FILE ON YOUR DISK FOR RESULTS')
89      RETURN
90      END

```

APPENDIX B  
FLOW CHARTS


I. MAIN PROGRAM NO INPUT OR OUTPUT VARIABLES

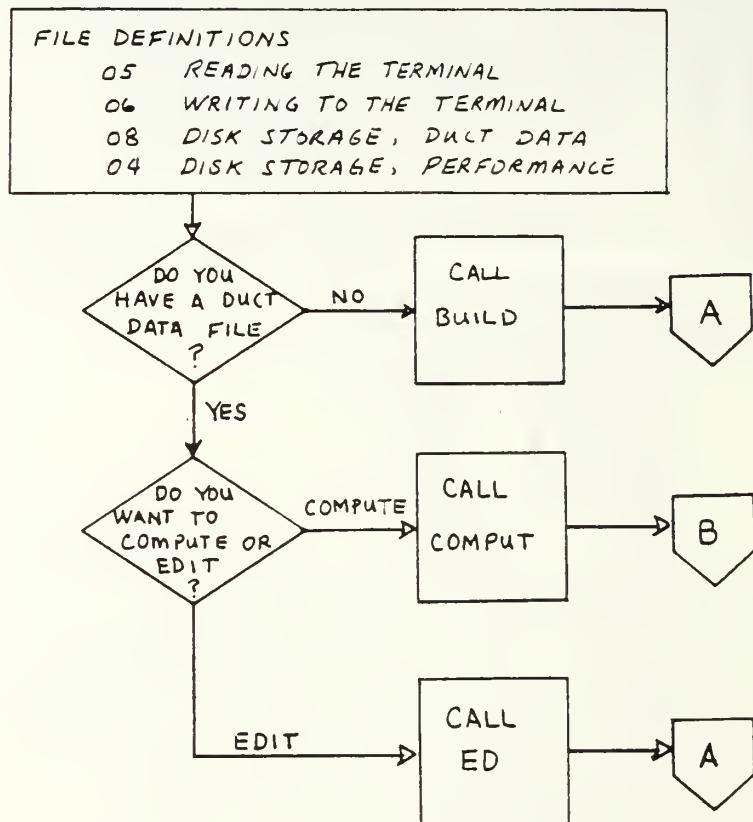


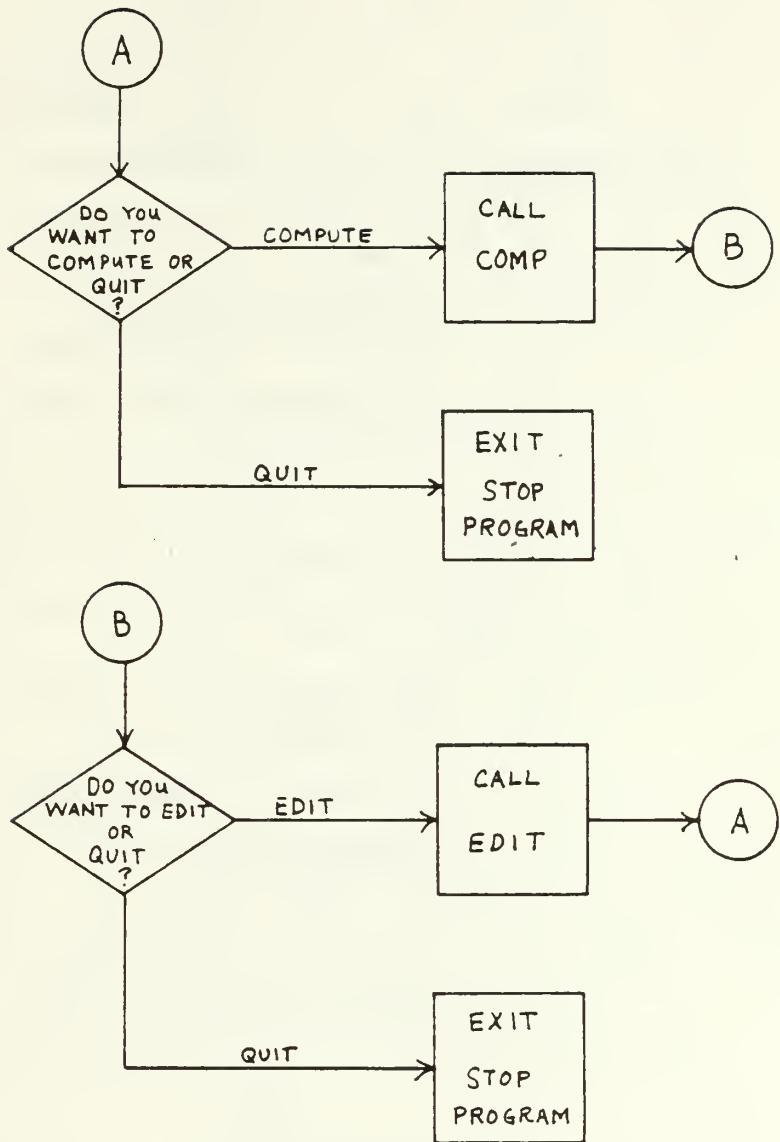


## II. BUILD SUBROUTINE


THERE ARE NO INPUT OR OUTPUT VARIABLES FOR THIS SUBROUTINE, HOWEVER SUBROUTINES CALLED BY THE BUILD SUBROUTINE DO HANDLE INPUT AND OUTPUT DATA.

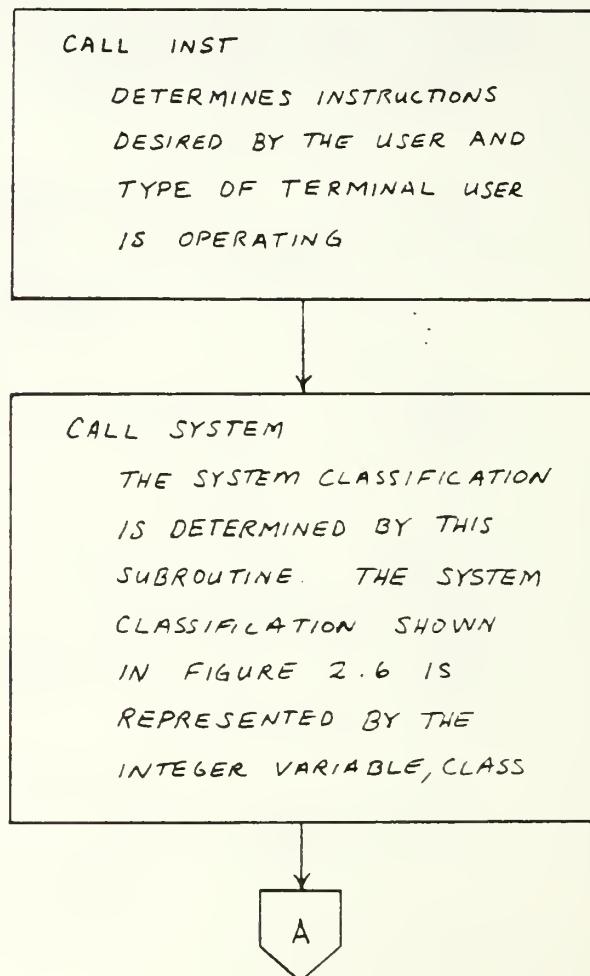

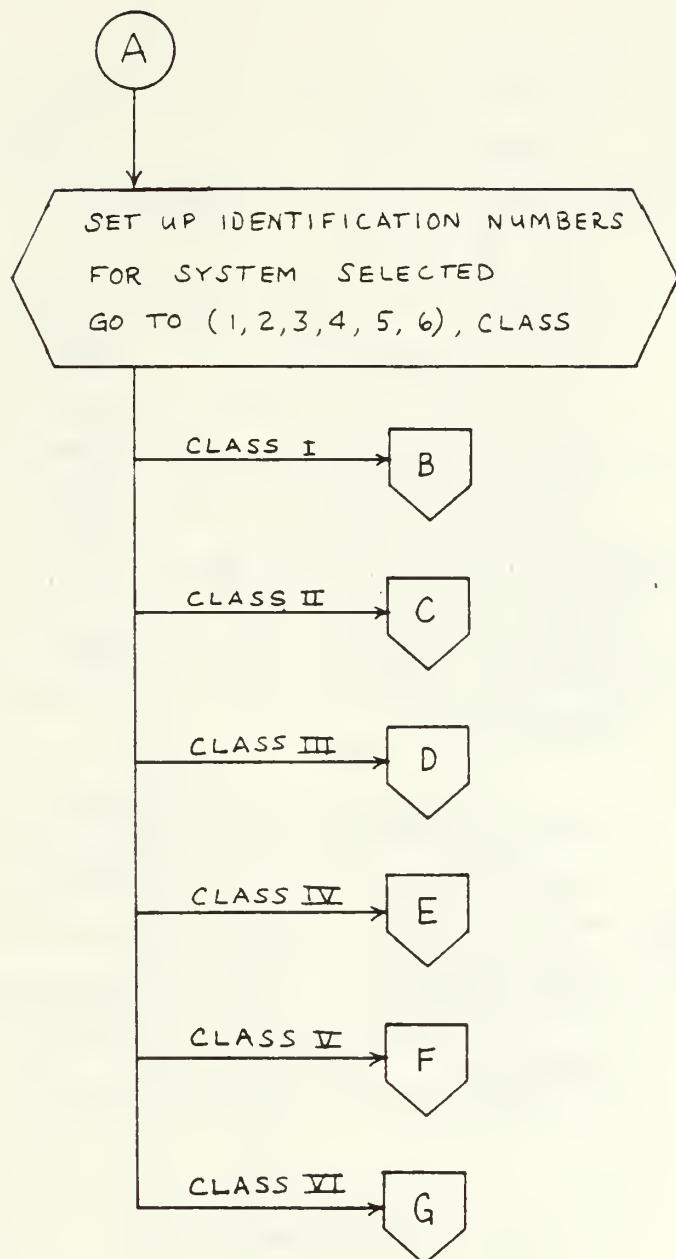

SEE THE PRELIMINARY SECTION OF THE  
USERS MANUAL FOR EXPLANATION OF  
IDENTIFICATION NUMBERS.

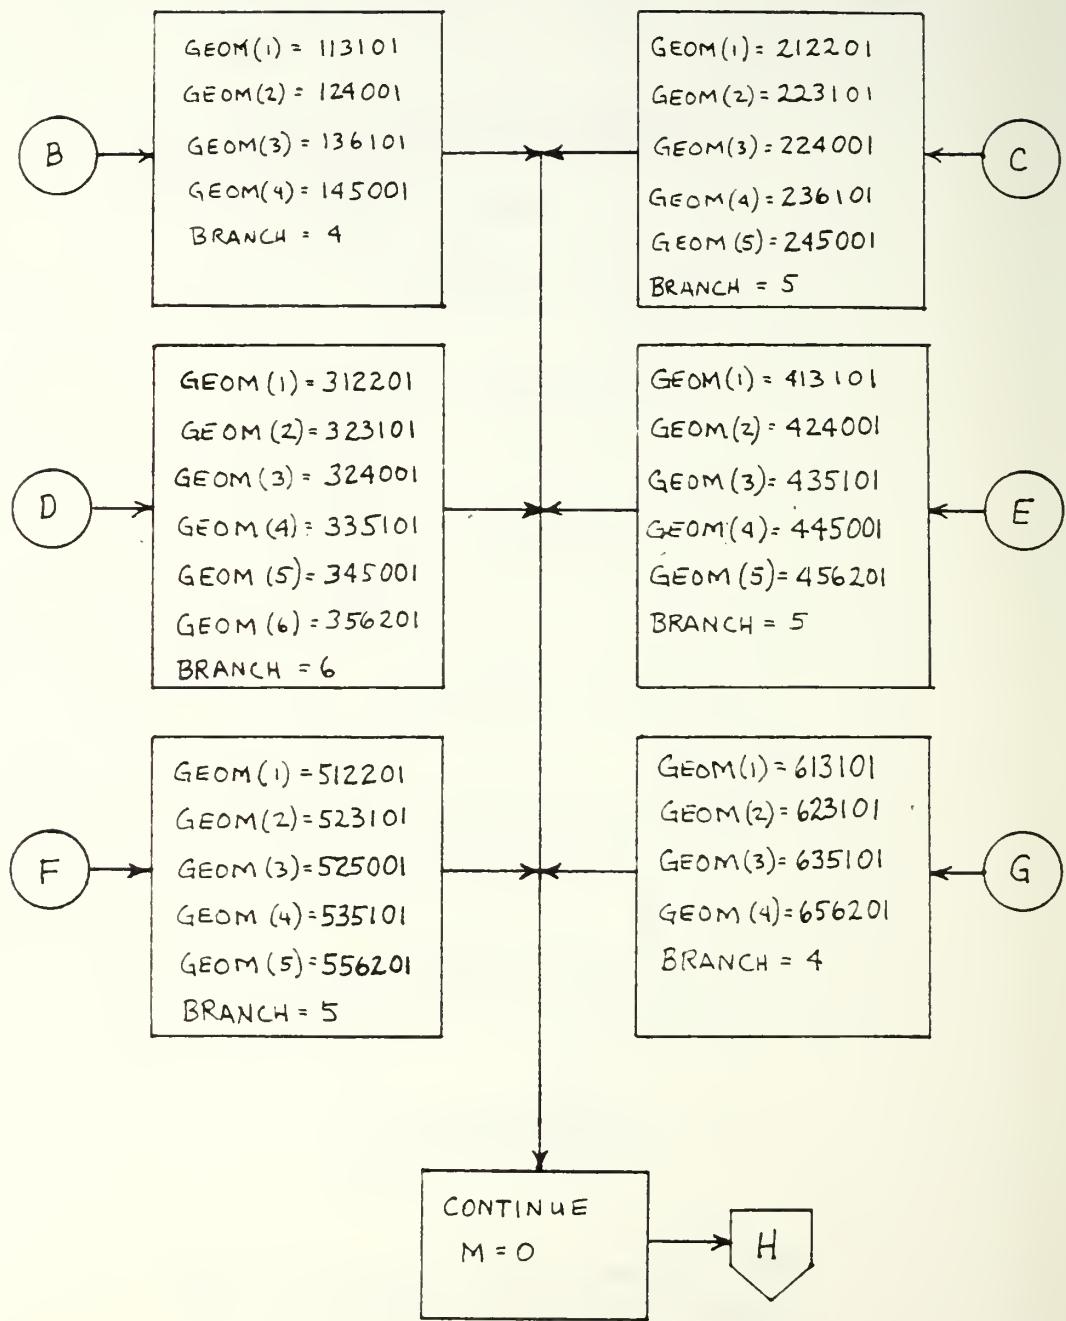

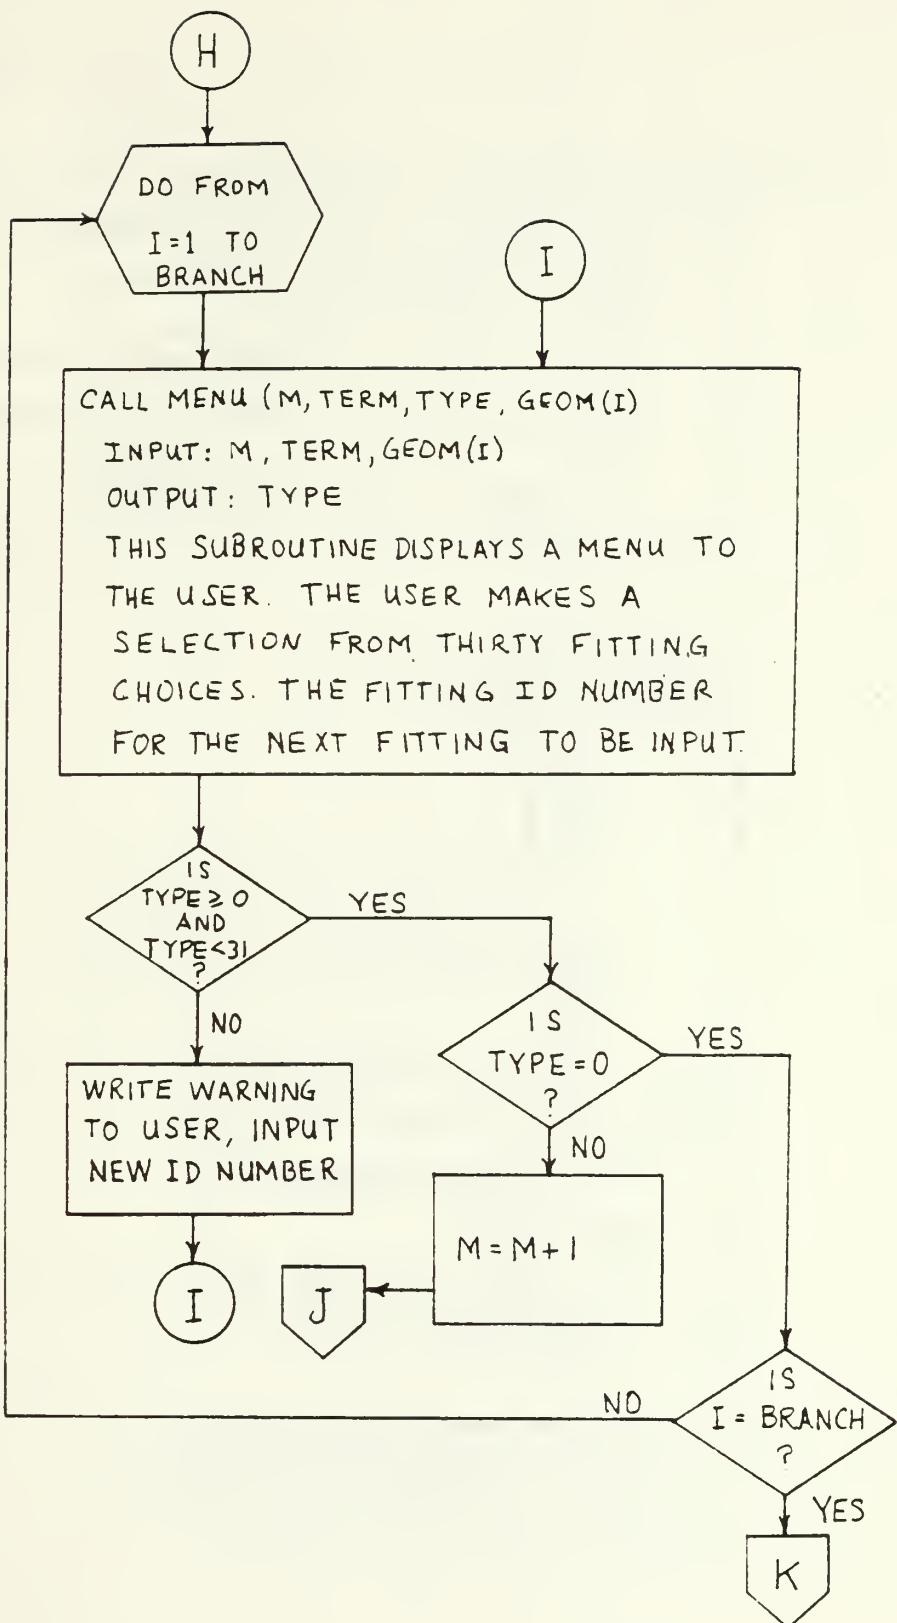

J

```
CALL SELECT (M, SORL, GEOM(I), TYPE, WORKI, WORKR)
INPUT M, SORL, GEOM(I), TYPE
OUTPUT: WORKI , WORKR
THIS SUBROUTINE BRANCHES TO THE FITTING
SELECTED FROM THE MENU. INFORMATION
ABOUT THE FITTING IS CONTAINED IN
THE ARRAYS WORKI AND WORKR
```

I


K


```
CALL SUMOUT (WORKI, WORKR, M)
INPUT: WORKI, WORKR, M
OUTPUT: NONE
THIS SUBROUTINE WRITES A DUCT DATA FILE
ON THE USER'S DISK.
```


```
RETURN TO THE MAIN PROGRAM
```


### III. EDITING SUBROUTINE (ED)

THERE ARE NO INPUT OR OUTPUT VARIABLES FOR THIS SUBROUTINE, HOWEVER SUBROUTINES CALLED BY THE ED SUBROUTINE DO HANDLE INPUT AND OUTPUT DATA.

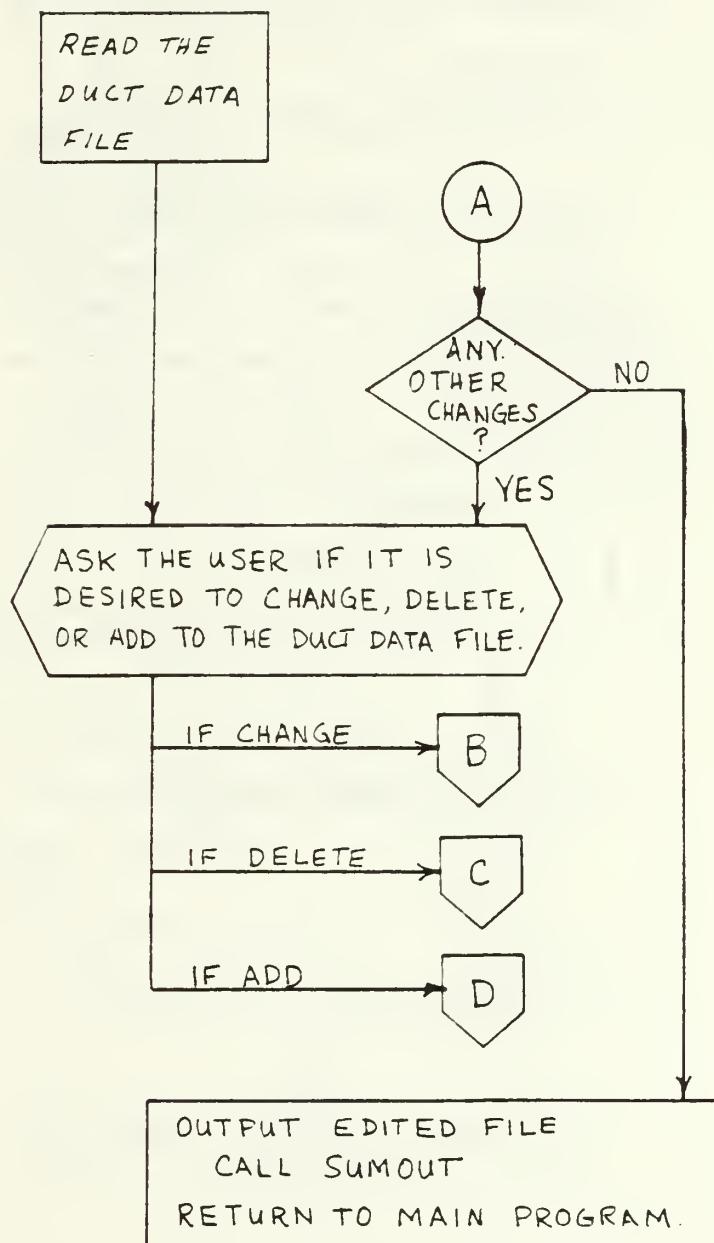


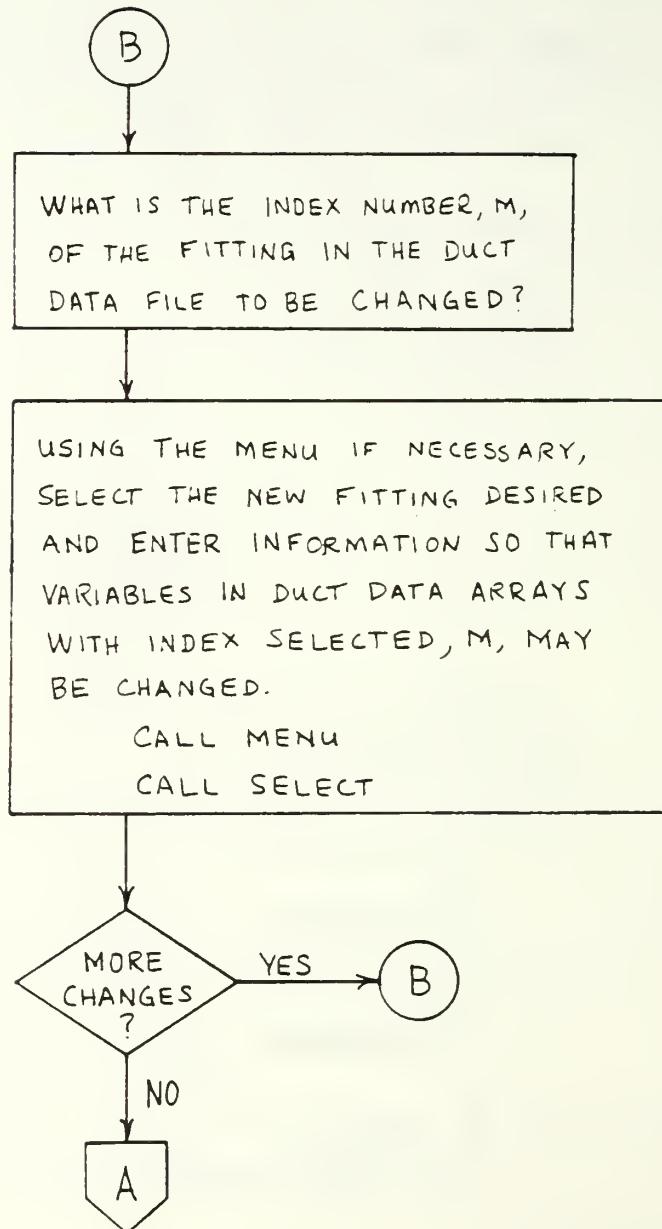


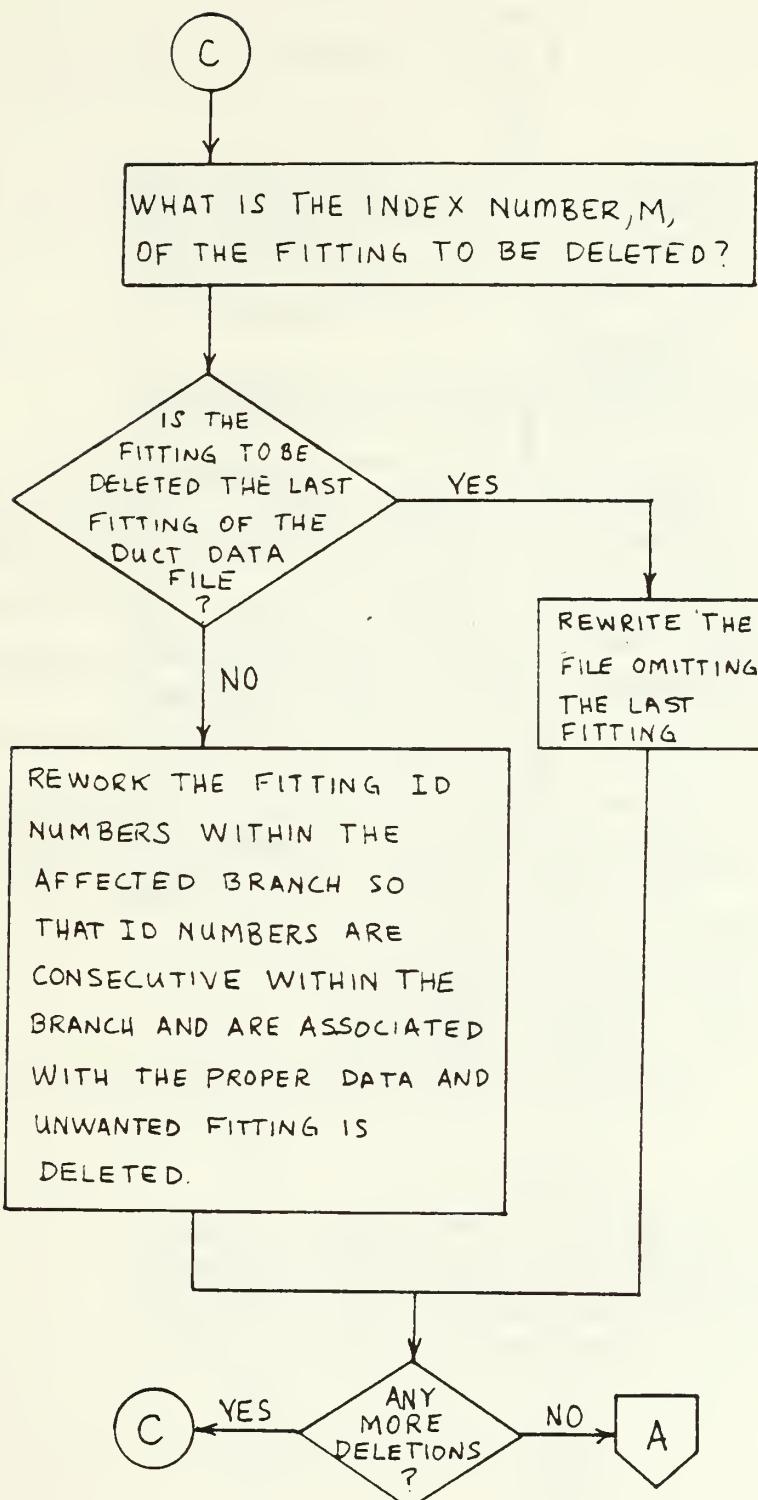


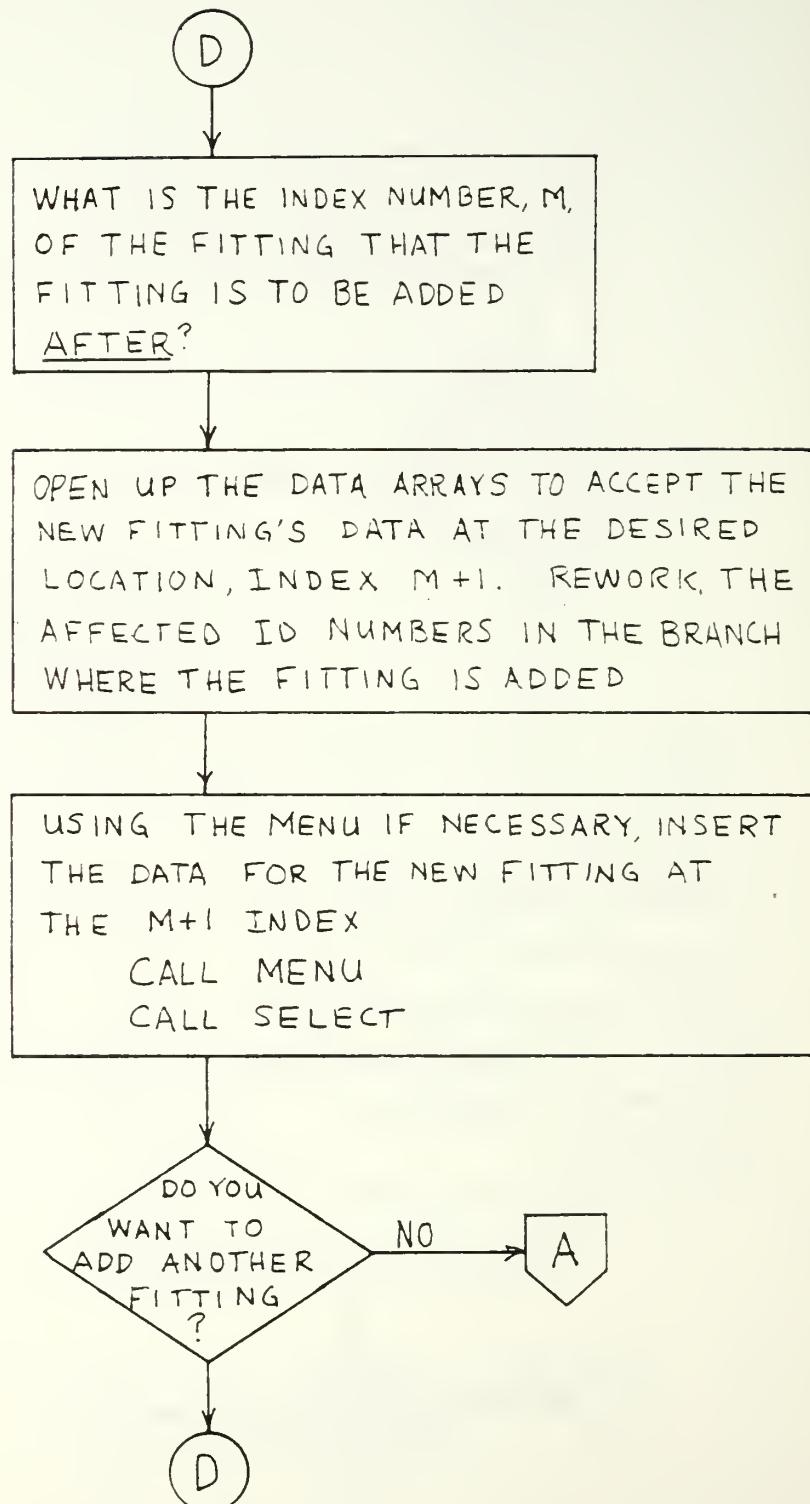


#### IV. COMPUTE SUBROUTINE

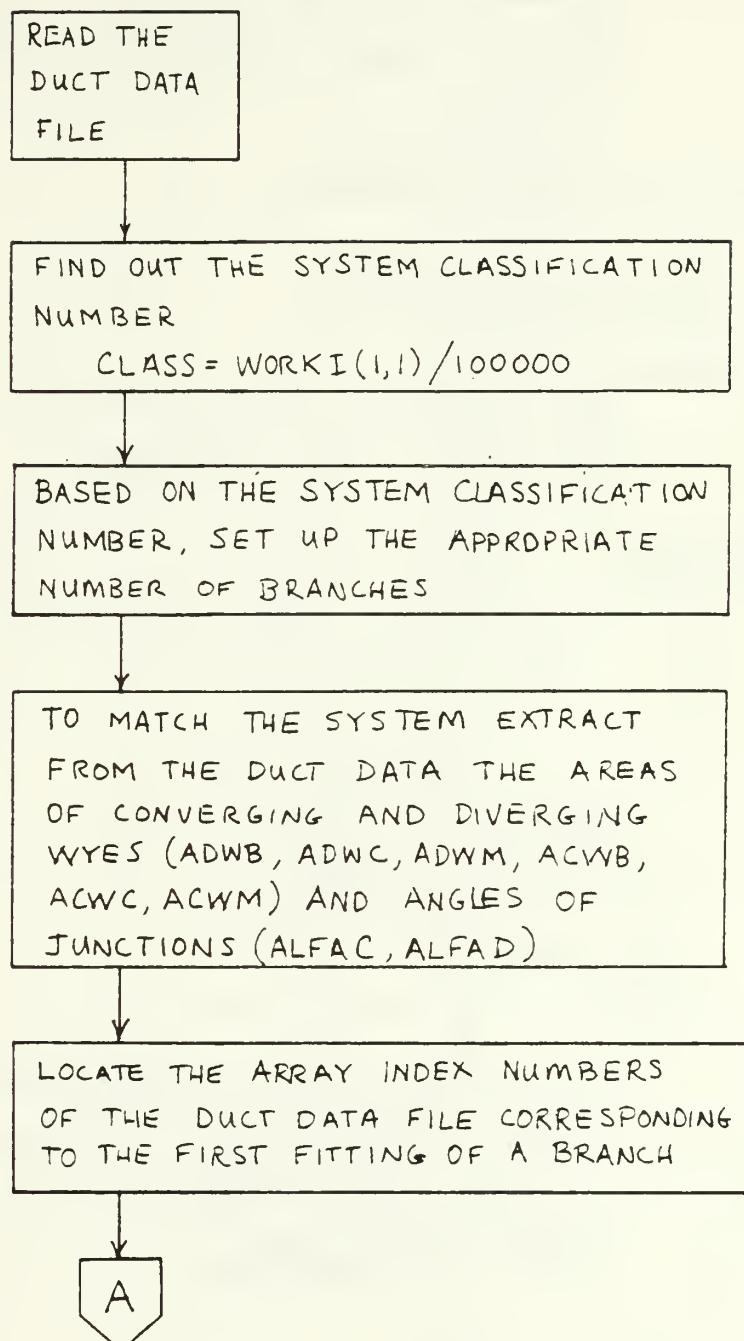


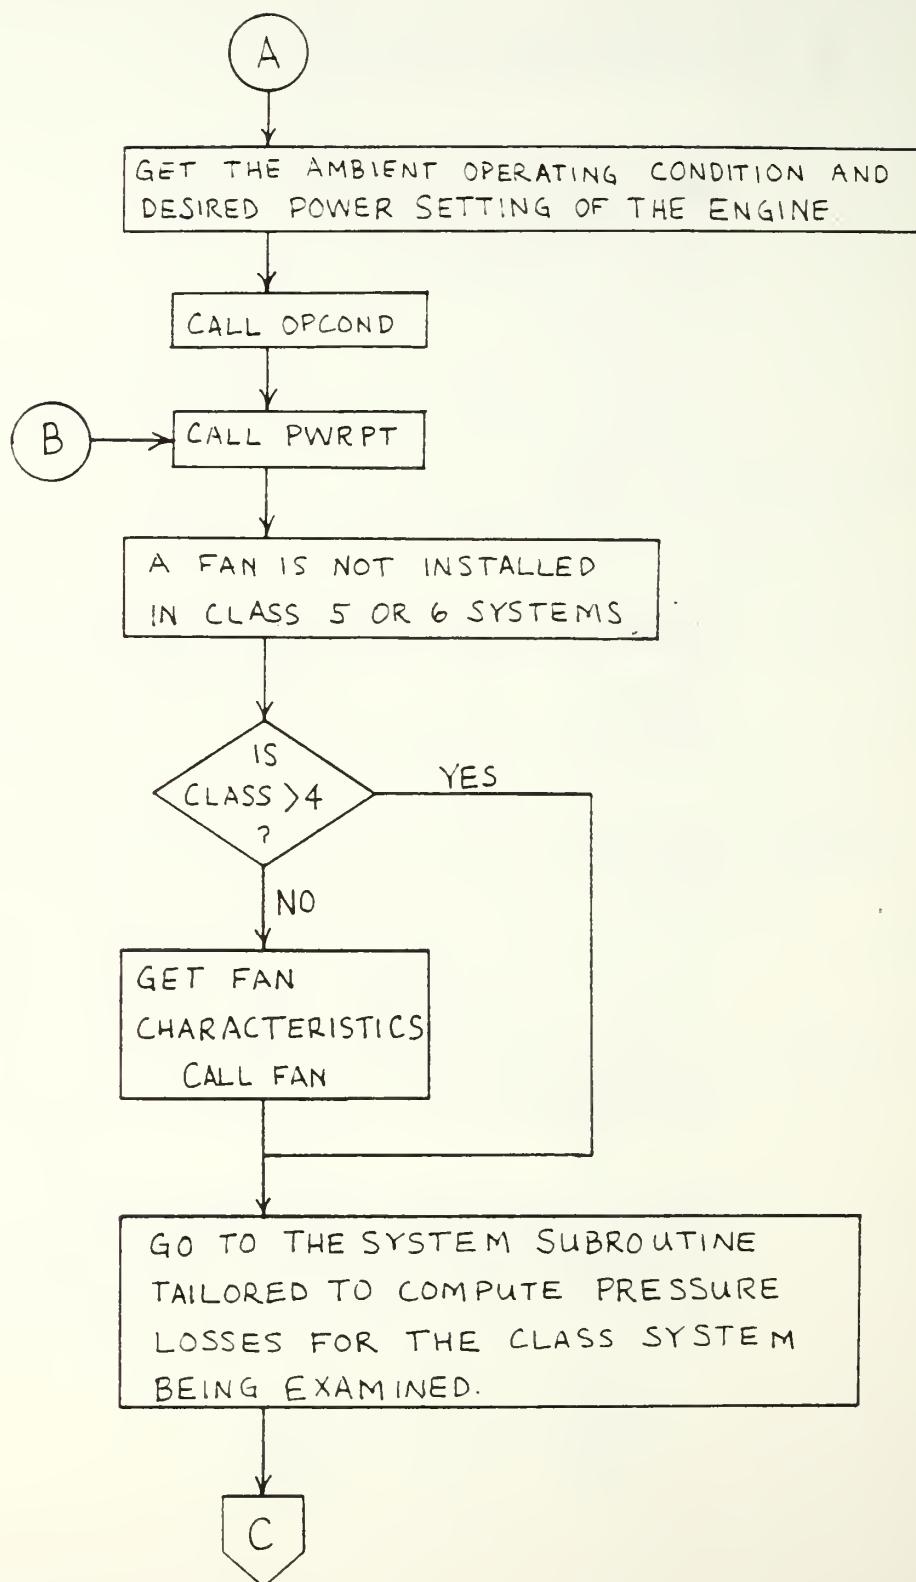

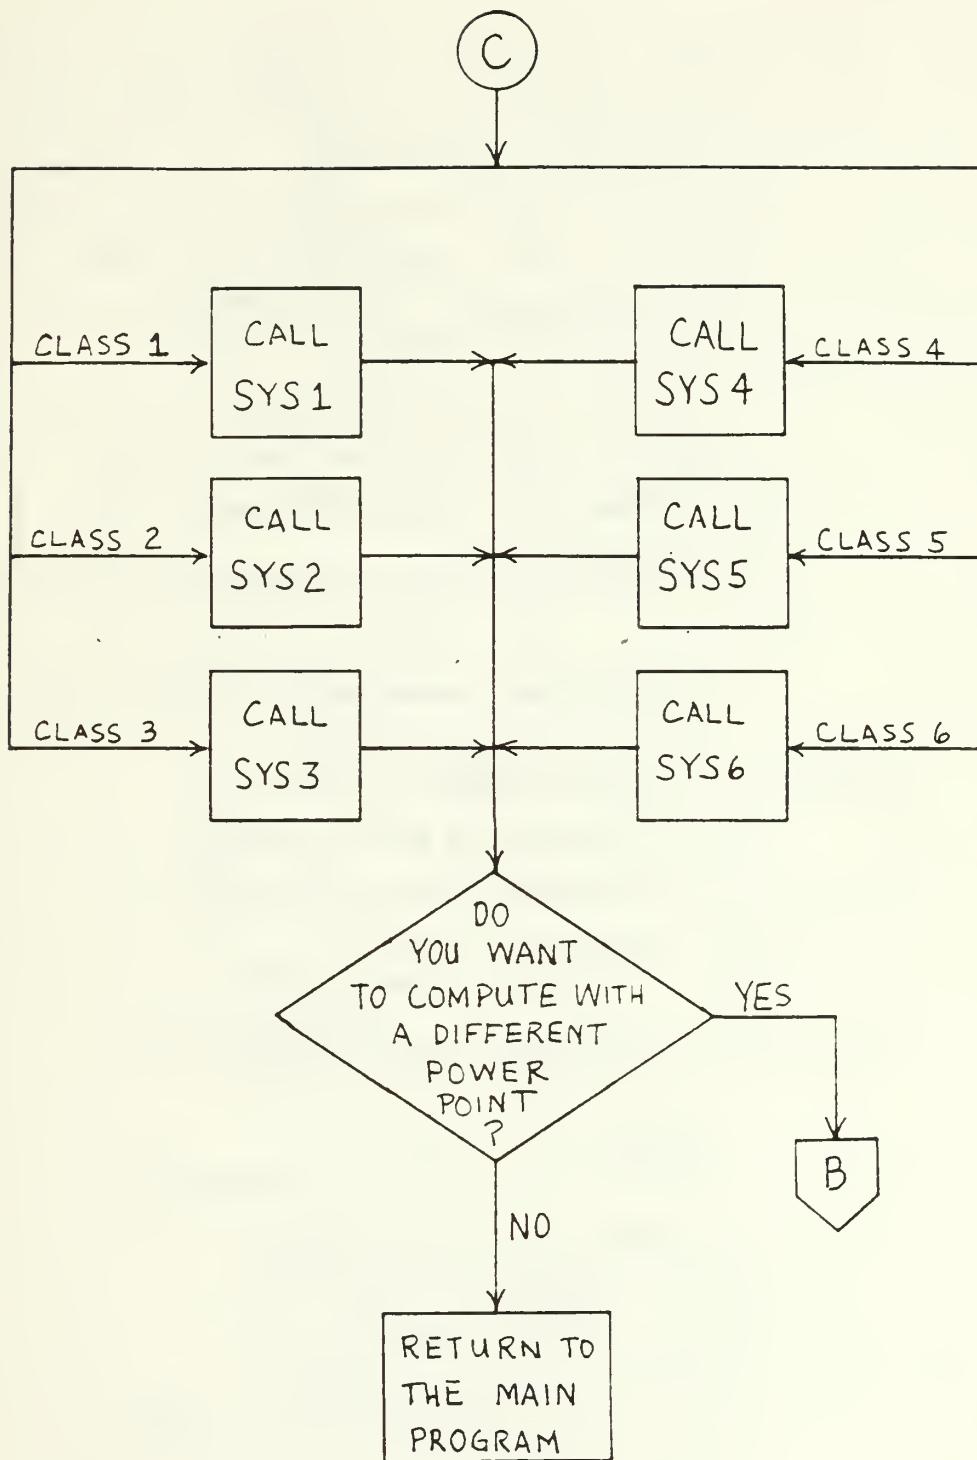

IV SYSTEM THREE MATCHING SUBROUTINE (SYS3)  
THIS SUBROUTINE IS CALLED BY THE COMPUTE  
SECTION OF THE PROGRAM. ALL VARIABLES  
ARE INPUT FROM COMP SUBROUTINE. THERE  
ARE NO OUTPUT VARIABLES RETURNED TO  
COMP, ALL OUTPUT IS WRITTEN TO THE  
PERFORMANCE FILE.

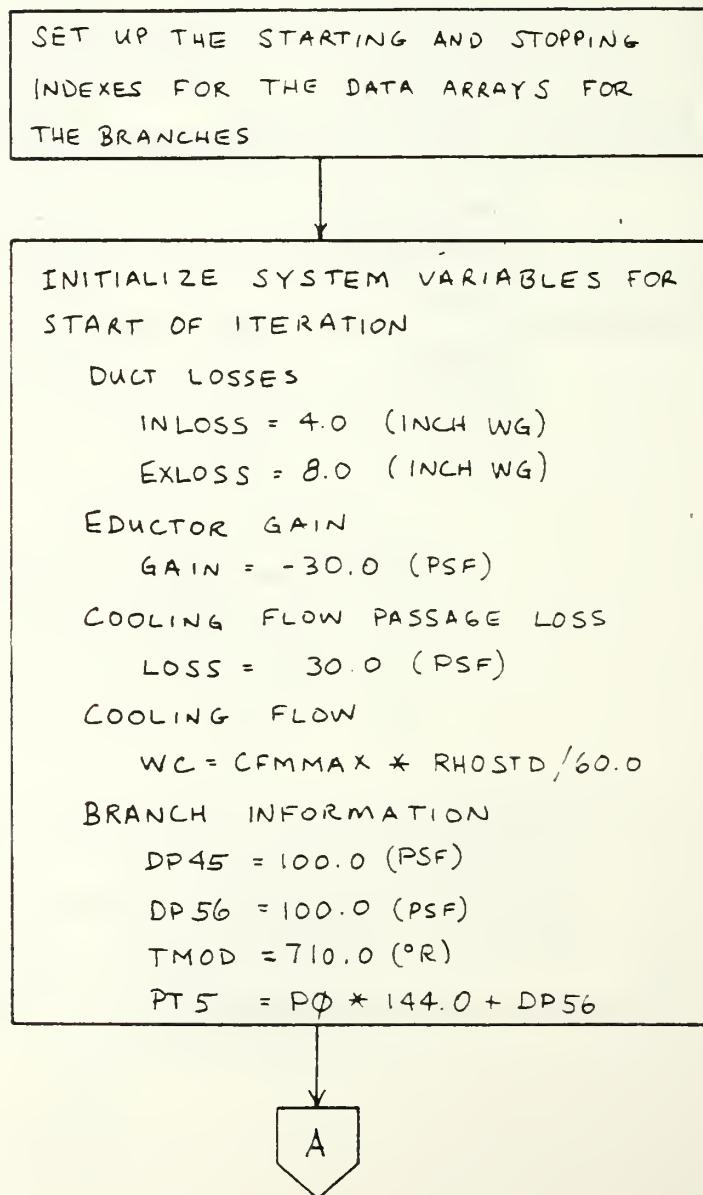

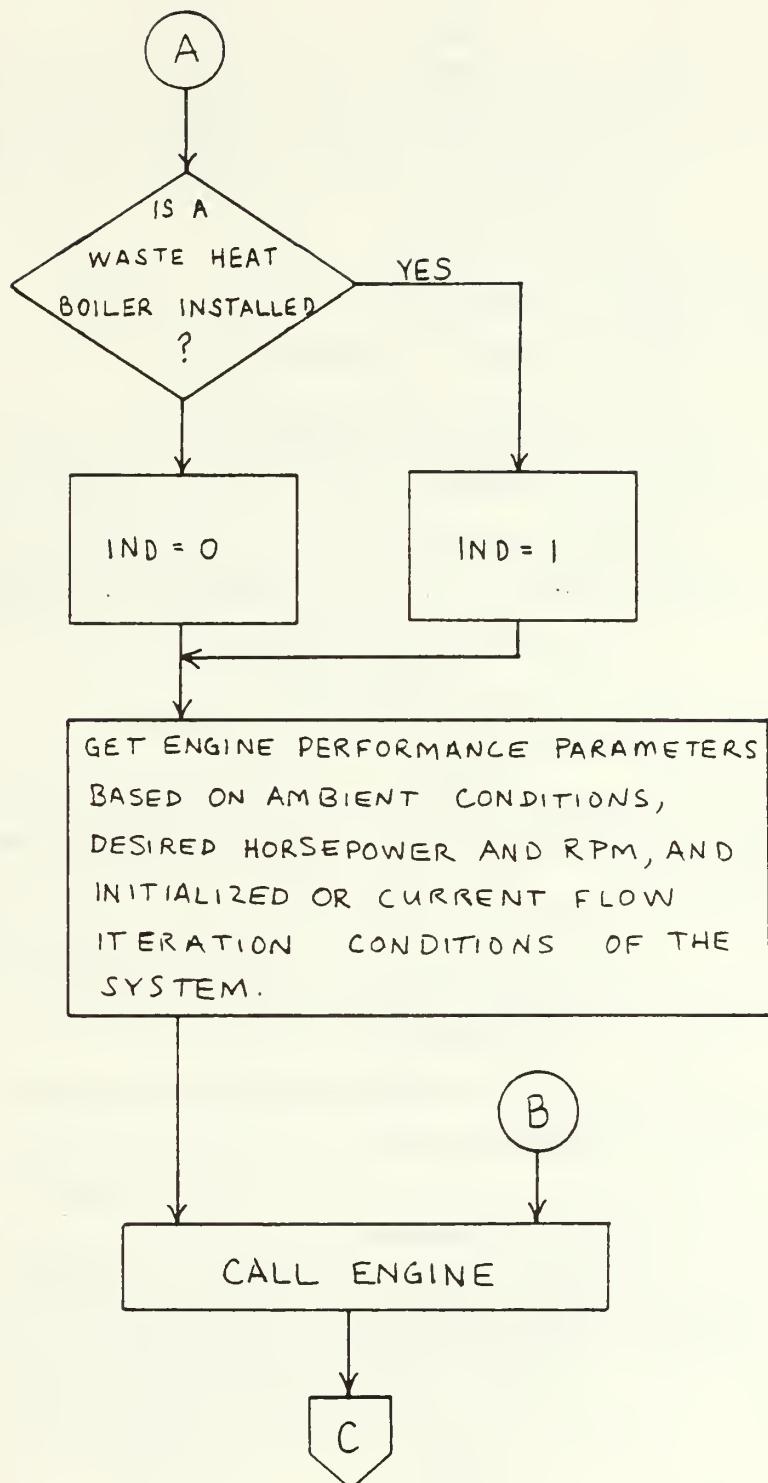

C

INITIALIZE INLET CONDITIONS FOR  
BRANCH 1-2

$$DP12 = 0.0$$

$$PMAIN = PT5 + LOSS$$

$$PSEC = PT5 + GAIN$$

$$PTIN = P\phi \times 144.0$$

$$TIN = T\phi + 459.7$$

BRANCH 1-2 HAS COMBINED COOLING  
AND ENGINE AIRFLOW

$$W = WC + WC$$

FOR EACH FITTING IN BRANCH 1-2,

CALL FITDP

TO COMPUTE PRESSURE LOSS IN  
THE FITTING. THE SUM

$$DP12 = DP12 + DELP$$

IS THE PRESSURE LOSS FOR THE  
BRANCH.

NODE 2 IS A JUNCTION. COMPUTE  
TOTAL PRESSURE AND DENSITY AT NODE.

$$PT2 = P\phi \times 1440 - DP12$$

$$\rho_{02} = (PT2 - PV) / ((T\phi + 459.7) * R)$$

D

D

COMPUTE THE AVERAGE VELOCITIES IN THE THREE BRANCHES ENTERING AND LEAVING NODE 2, A DIVERGENT WYE.

$$\text{BRANCH COOLING AIR: } V_{DWB} = W_C / (RHO_2 * A_{DWB})$$

$$\text{COMBINED INLET: } V_{DWC} = (W_C + W_2) / (RHO_2 * A_{DWC})$$

$$\text{MAIN ENGINE: } V_{DWM} = W_2 / (RHO_2 * A_{DWM})$$

COMPUTE NODE 5 PARAMETERS. NODE 5 IS A CONVERGENT WYE, MIXING STREAMS OF DIFFERENT TEMPERATURES. IF NO WASTE HEAT BOILER IS INSTALLED TEMPERATURE OF THE MAIN BRANCH, EXHAUST FROM THE ENGINE IS:

$$T_{MAIN} = T_8 \quad \text{ELSE,}$$

$$T_{MAIN} = 770.0 + (370 * 10^{-3} * HP)$$

COMPUTE TEMPERATURE IN COMBINED EXHAUST STACK BASED ON MIXING ENTHALPY OF COOLING AND EXHAUST STREAMS.


$$\text{COOLING ENTHALPY: } H_{SEC} = (1.421385E-5 * T_{MOD} + .221091) * T_{MOD} + 5.6373$$


$$\text{EXHAUST ENTHALPY: } H_{MAIN} = (1.56051E-5 * T_{MAIN} + .22388) * T_{MAIN} + 4.75396$$


$$\text{COMBINED ENTHALPY: } H_{STACK} = (W_8 / (W_8 + W_C)) * H_{MAIN} + (W_C / (W_8 + W_C)) * H_{SEC}$$


$$\text{EXHAUST TEMPERATURE: } T_5 = (0.000841) * H_{STACK} + 4.33577 * H_{STACK} - 9.5778$$


E

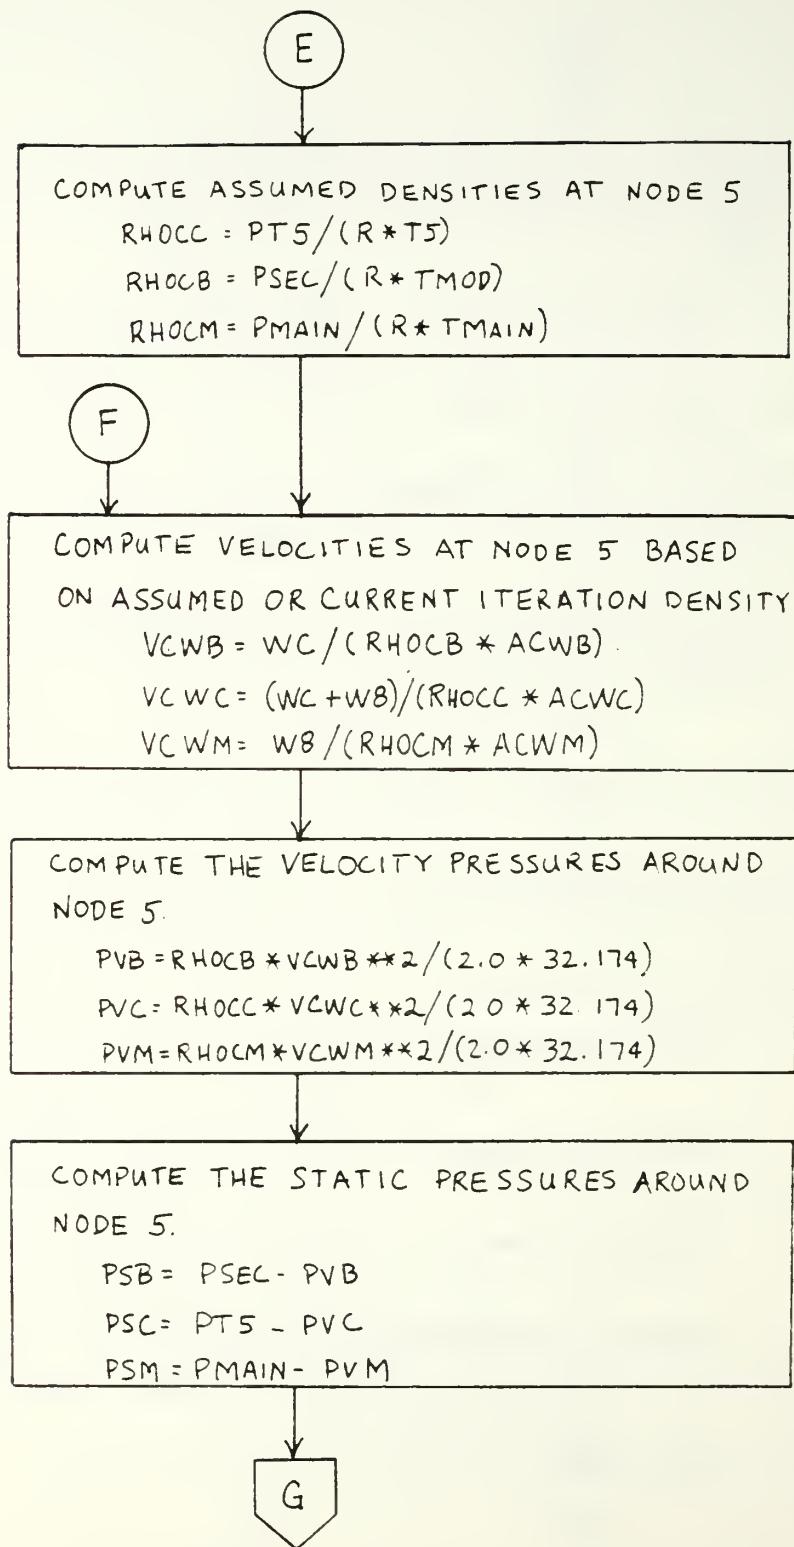


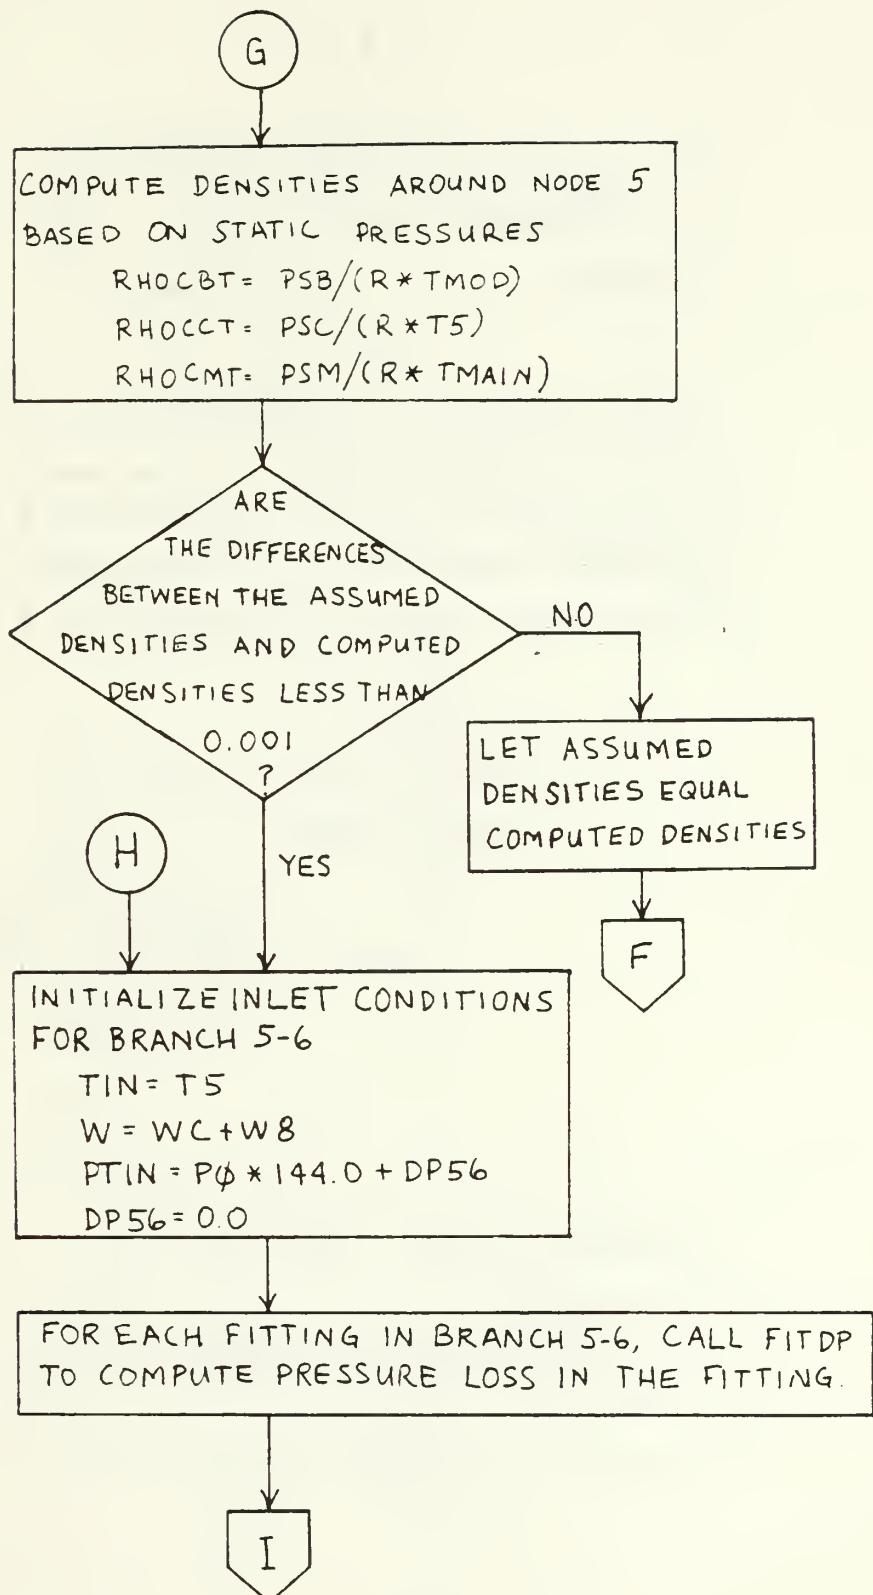

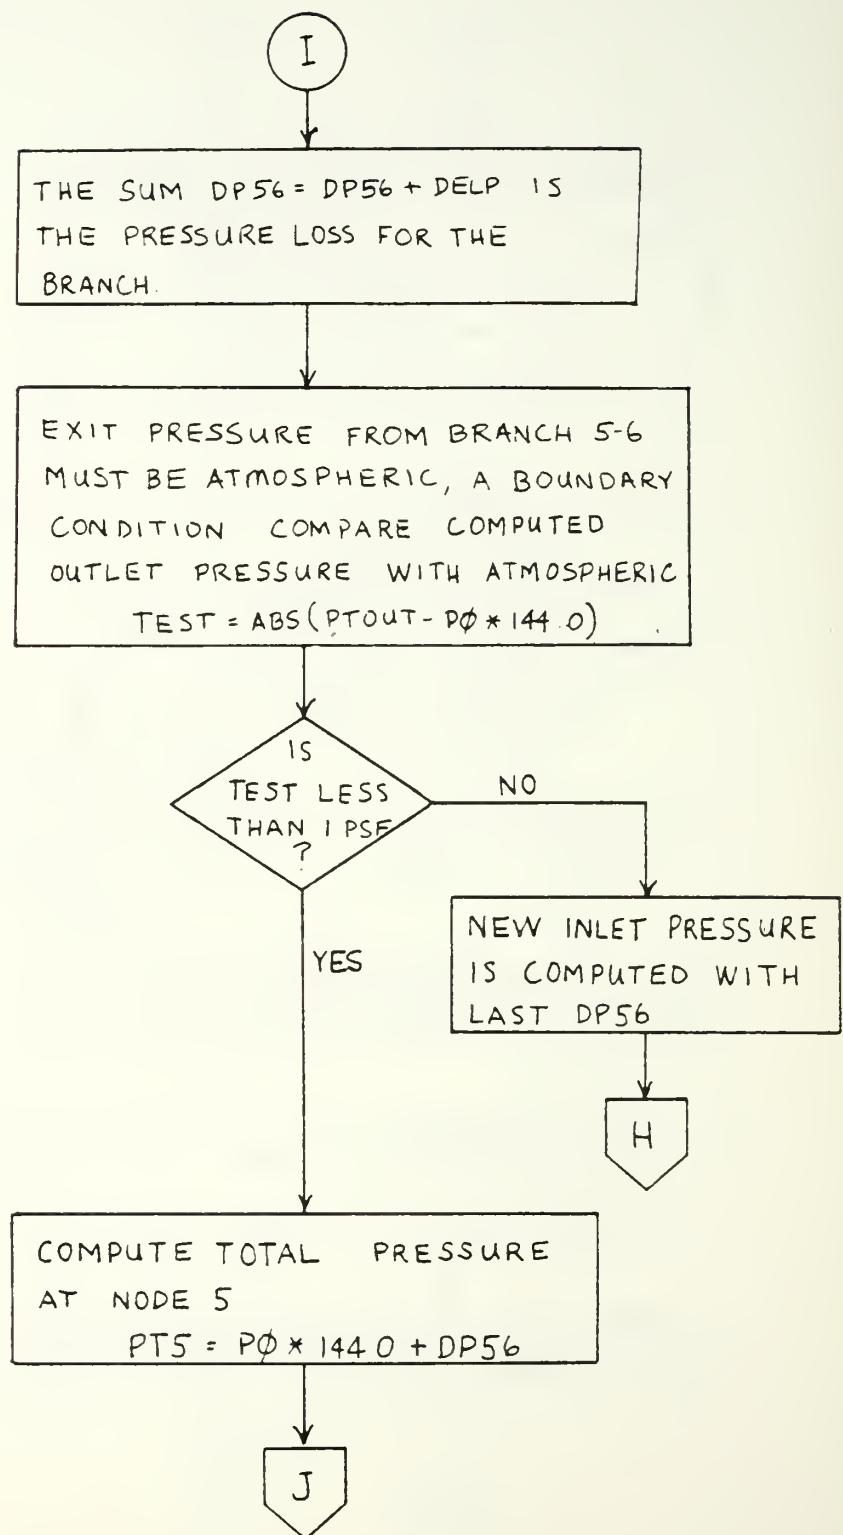

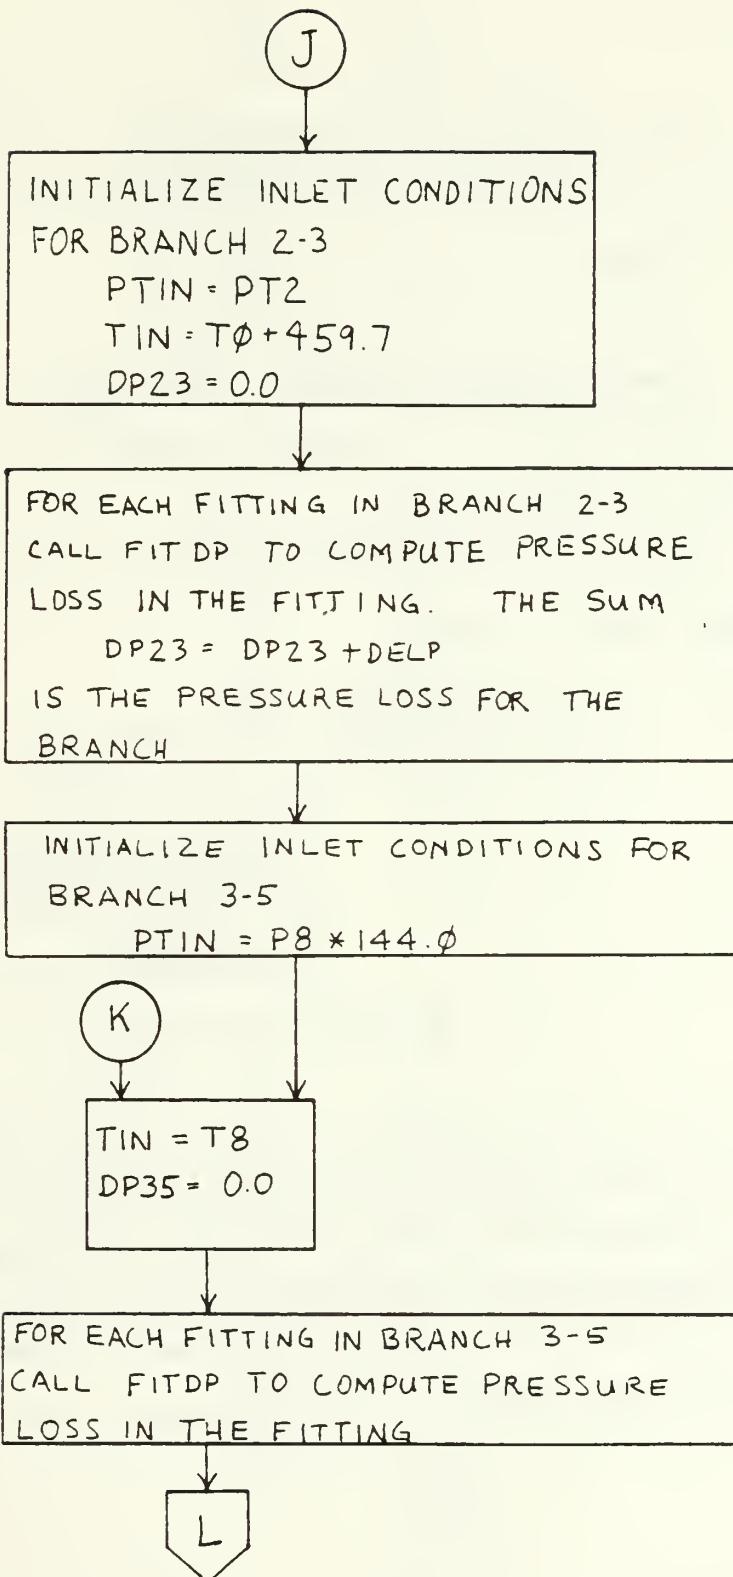

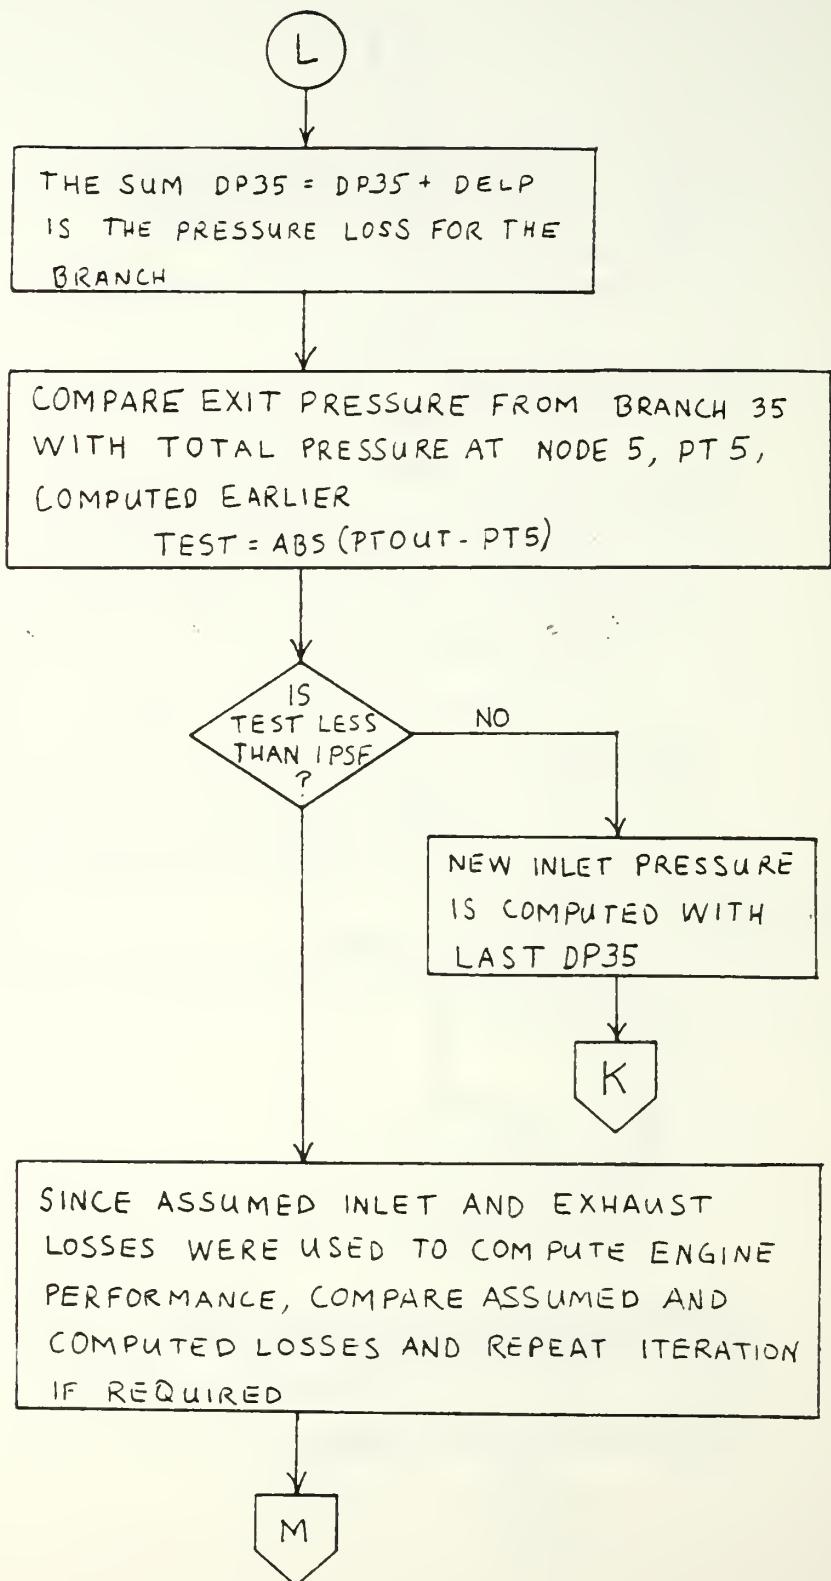

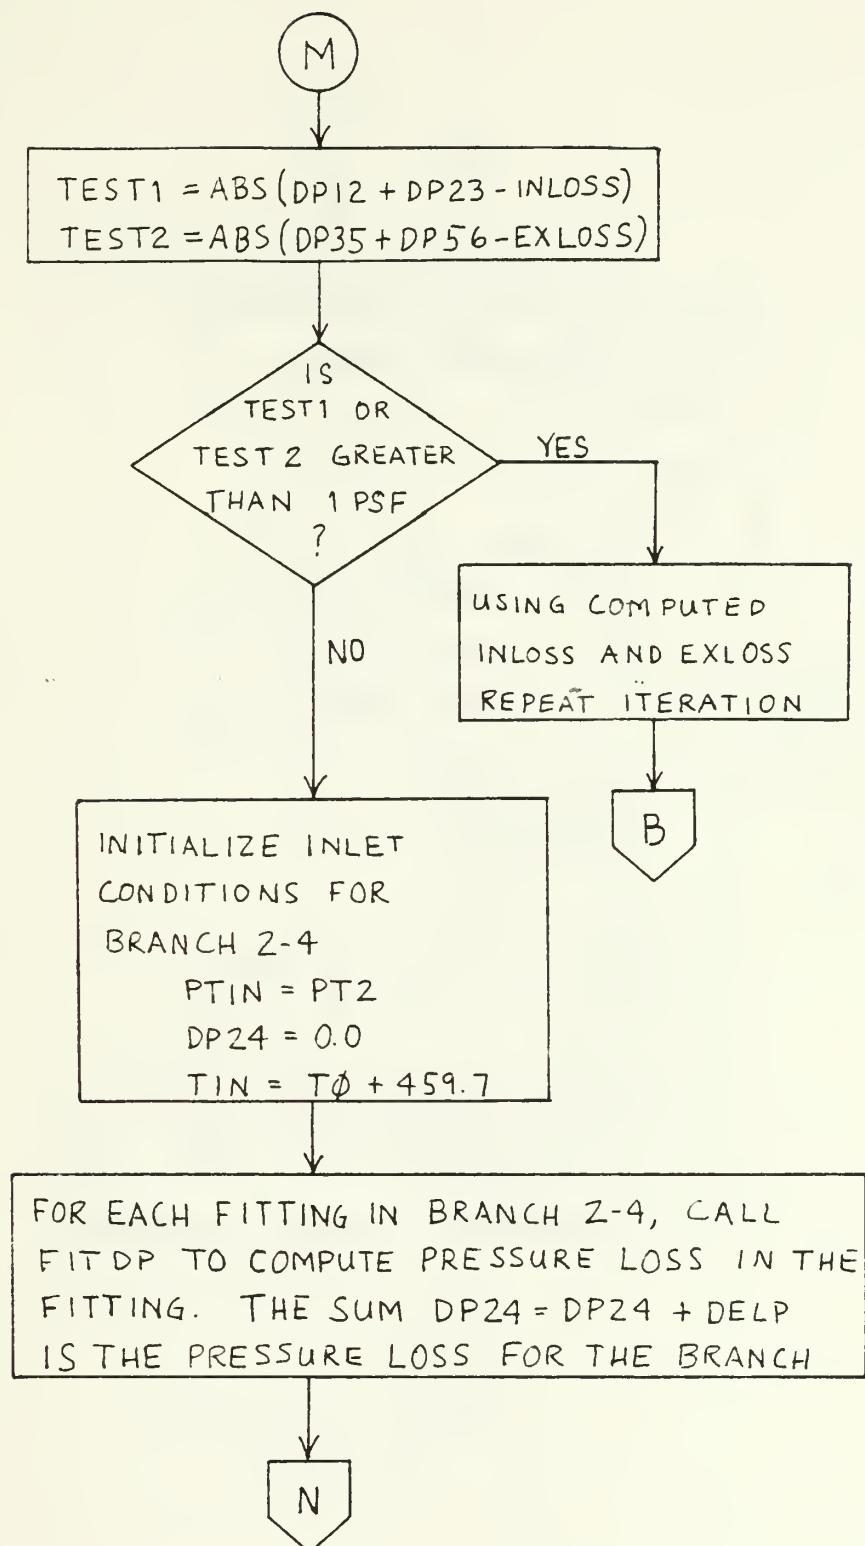

N

INITIALIZE INLET CONDITIONS  
FOR BRANCH 4-5. INLET  
PRESSURE IS A FUNCTION OF  
FAN CHARACTERISTICS AND  
FLOW


$$T_{IN} = T_4$$

$$P_{IN} = P_{OUT} + (K * ((W_C / \rho_{STD} * 60.0) - CFM_{MAX})^{**2} + DP_{MAX}) * 5.19696$$


$$DP_{45} = 0.0$$


FOR EACH FITTING IN BRANCH  
4-5, CALL FITDP TO COMPUTE  
PRESSURE LOSS IN THE FITTING.  
THE SUM  $DP_{45} = DP_{45} + DELP$   
IS THE PRESSURE LOSS FOR  
THE BRANCH

O

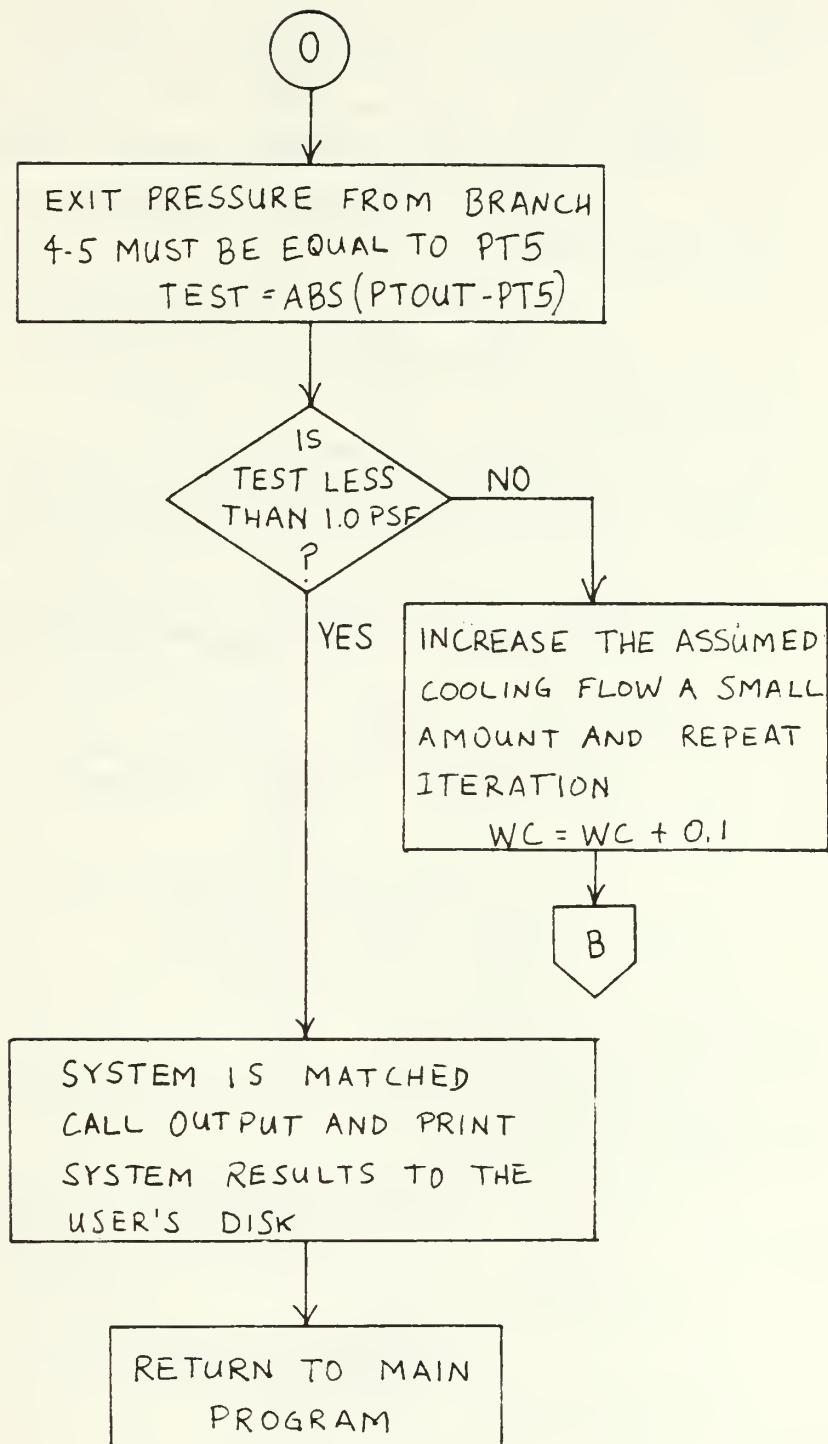

VI. FITTING PRESSURE LOSS CALCULATION  
SUBROUTINE. SET UP TO COMPUTE  
PRESSURE LOSS AND VELOCITY DATA FOR  
30 FITTINGS LISTED IN THE MENU

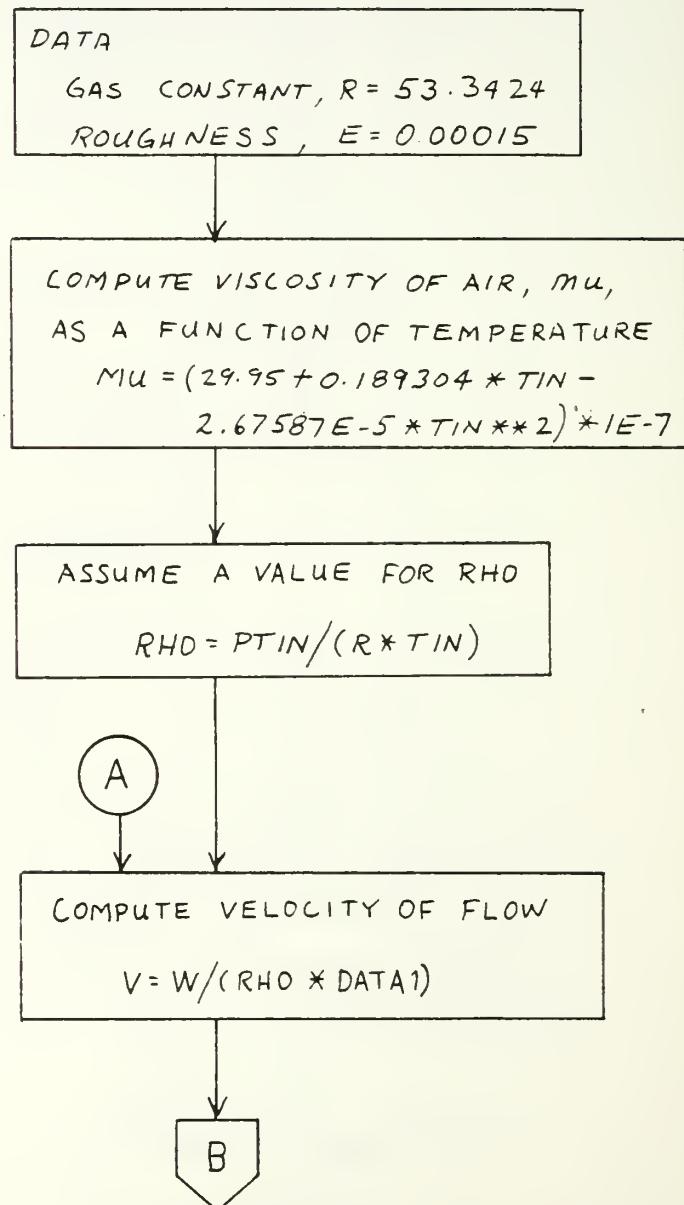

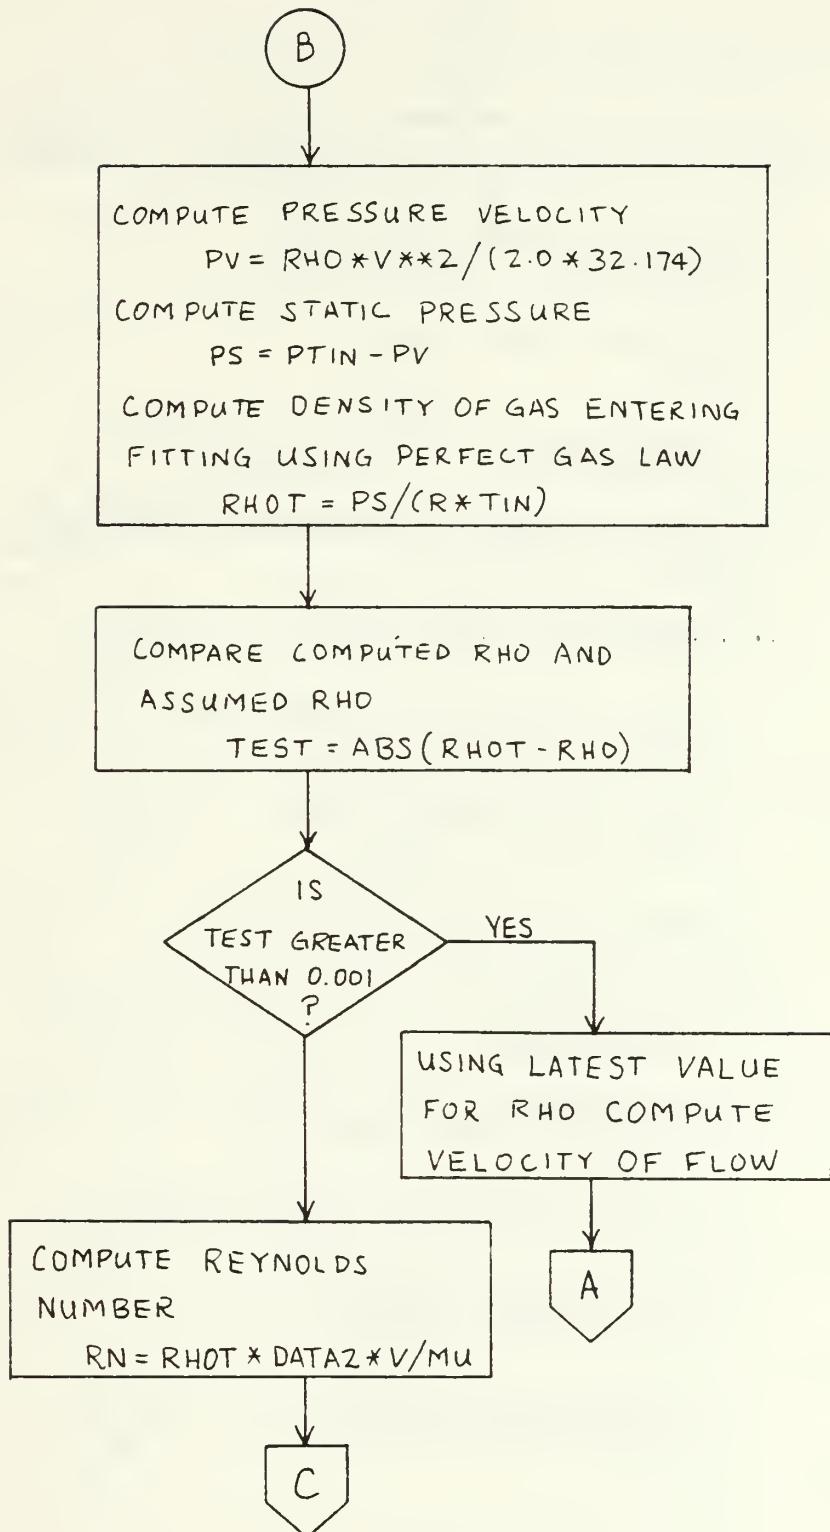



GO TO THE COMPUTATION FOR THE TYPE OF FITTING

SIMPLE FITTING

#1, 3, 4, 8, 9, 22, 24, 28, 29

D

STRAIGHT DUCT

#2

E

ELBOW

#5, 6, 10, 11, 12

F

SMOOTH RADIUS RECTANGULAR ELBOW

#7

G

BRANCH SECTION DIV. WYE

#13

H

MAIN SECTION DIVERGENT WYE

#14

I

BRANCH SECTION CONV. WYE

#15

J

MAIN SECTION CONVERGENT WYE

#16

K

DIFFUSER

#17, 18, 19, 20

L

CONTRACTION

#21, 22

M

INLET FILTER

#24

N

GAS TURBINE MODULE


#26

O

WASTE HEAT BOILER

#27

P

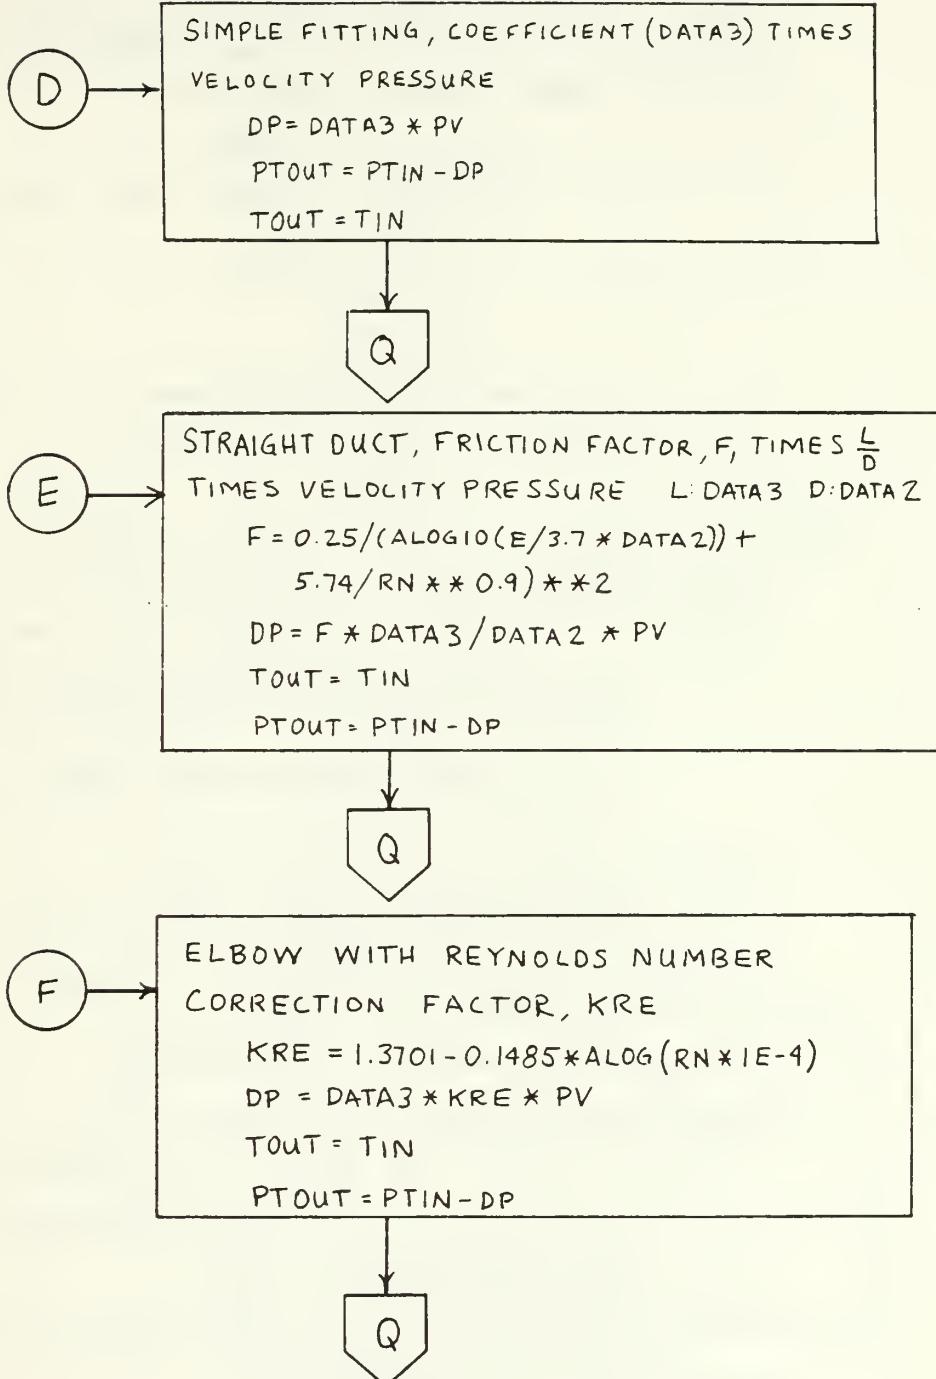

SMOOTH RADIUS RECTANGULAR ELBOW  
 WITHOUT VANES, REYNOLDS NUMBER CORRECTION  
 FROM TABLE IN THIS SUBROUTINE  
 $RN \leq 10000 \rightarrow KRE = 1.7$   
 $RN > 10000 \rightarrow KRE \text{ FROM TABLE}$   
 $C = DATA3$   
 $DP = C * KRE * PV$   
 $TOUT = TIN$   
 $PTOUT = PTIN - DP$



BRANCH SECTION OF A DIVERGING WYE. LOSS  
 IS DEPENDENT ON VELOCITIES IN MAIN SECTION  
 (VDWM), COMBINED SECTION (VDWC), BRANCH  
 SECTION (VDWB), AND DIVERGENCE ANGLE  
 $TEST = (ADWM - ADWC) / ADWC$

IS

TEST < 0.05

?

YES


NO




$$\begin{aligned}
 K2 &= (((-3.59147E-8 * ALFAD + \\
 &\quad 3.8309E-6) * ALFAD + 5.74E-5) \\
 &\quad * ALFAD + 1.04E-3) * ALFAD \\
 &\quad + 0.000017 \\
 C &= 1.0 + (VDWB / VDWC)^2 - 2.0 \\
 &\quad * (VDWB / VDWC) * \cos(ALFAD / \\
 &\quad 57.3) - K2 * (VDWB / VDWC)^2
 \end{aligned}$$


$$\begin{aligned}
 K1 &= 1.0 \\
 RR &= VDWB / VDWM \\
 \text{IF } RR > 0.8 \quad K1 = 0.9 \\
 C &= K1 * (1.0 + (VDWB / VDWC)^2 - \\
 &\quad 2.0 * (VDWB / VDWC) * \cos(ALFAD / \\
 &\quad 57.3))
 \end{aligned}$$

$$\begin{aligned}
 PV &= RHO * VDWC^2 / (2.0 * 32.174) \\
 DP &= C * PV \\
 PV &= RHO * VDWB^2 / (2.0 * 32.174) \\
 PTOUT &= PTIN - DP \\
 TOUT &= TIN
 \end{aligned}$$



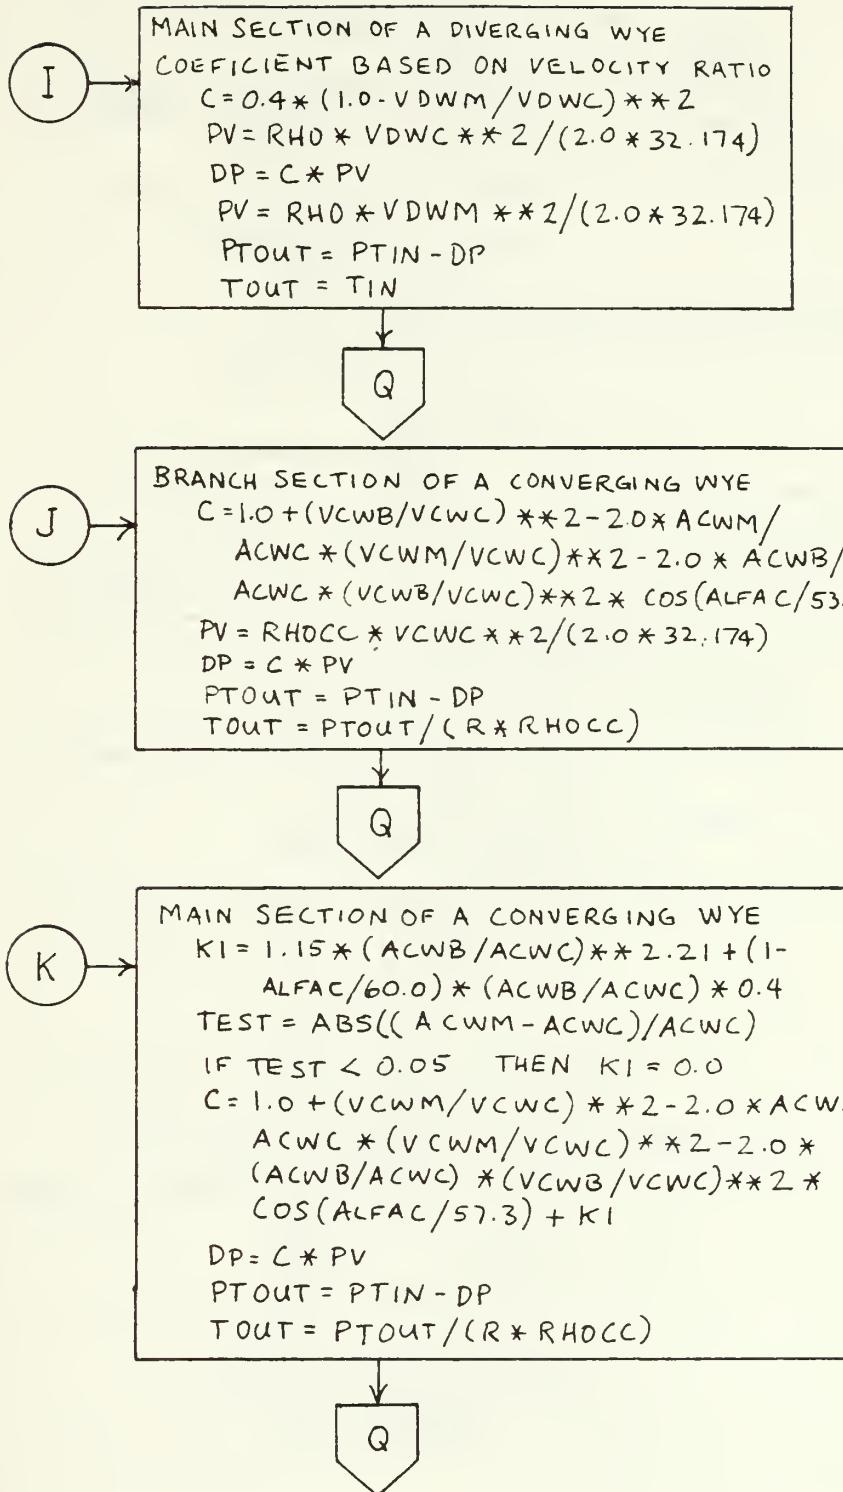

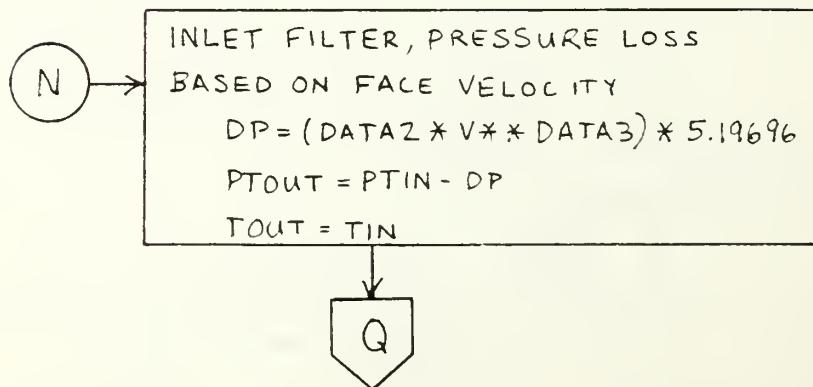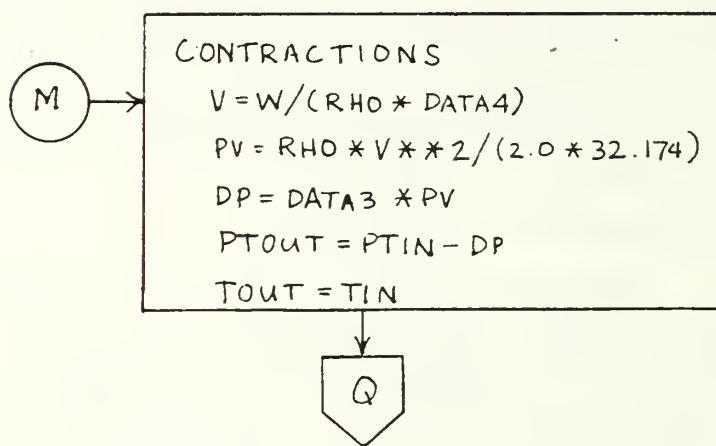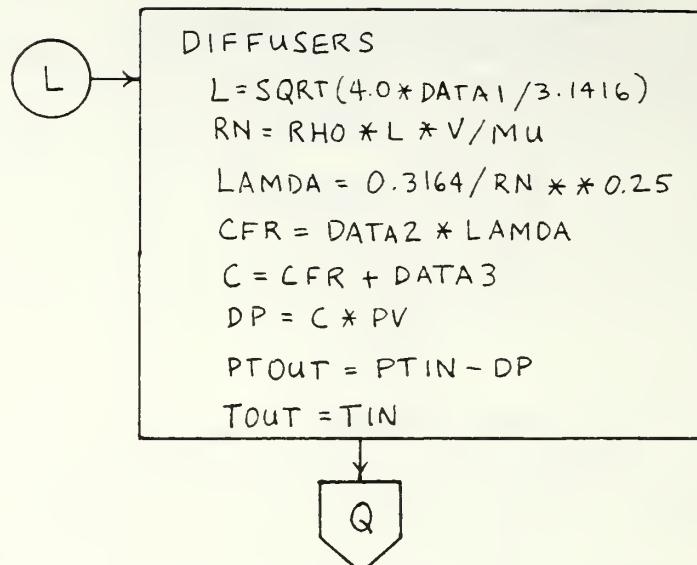

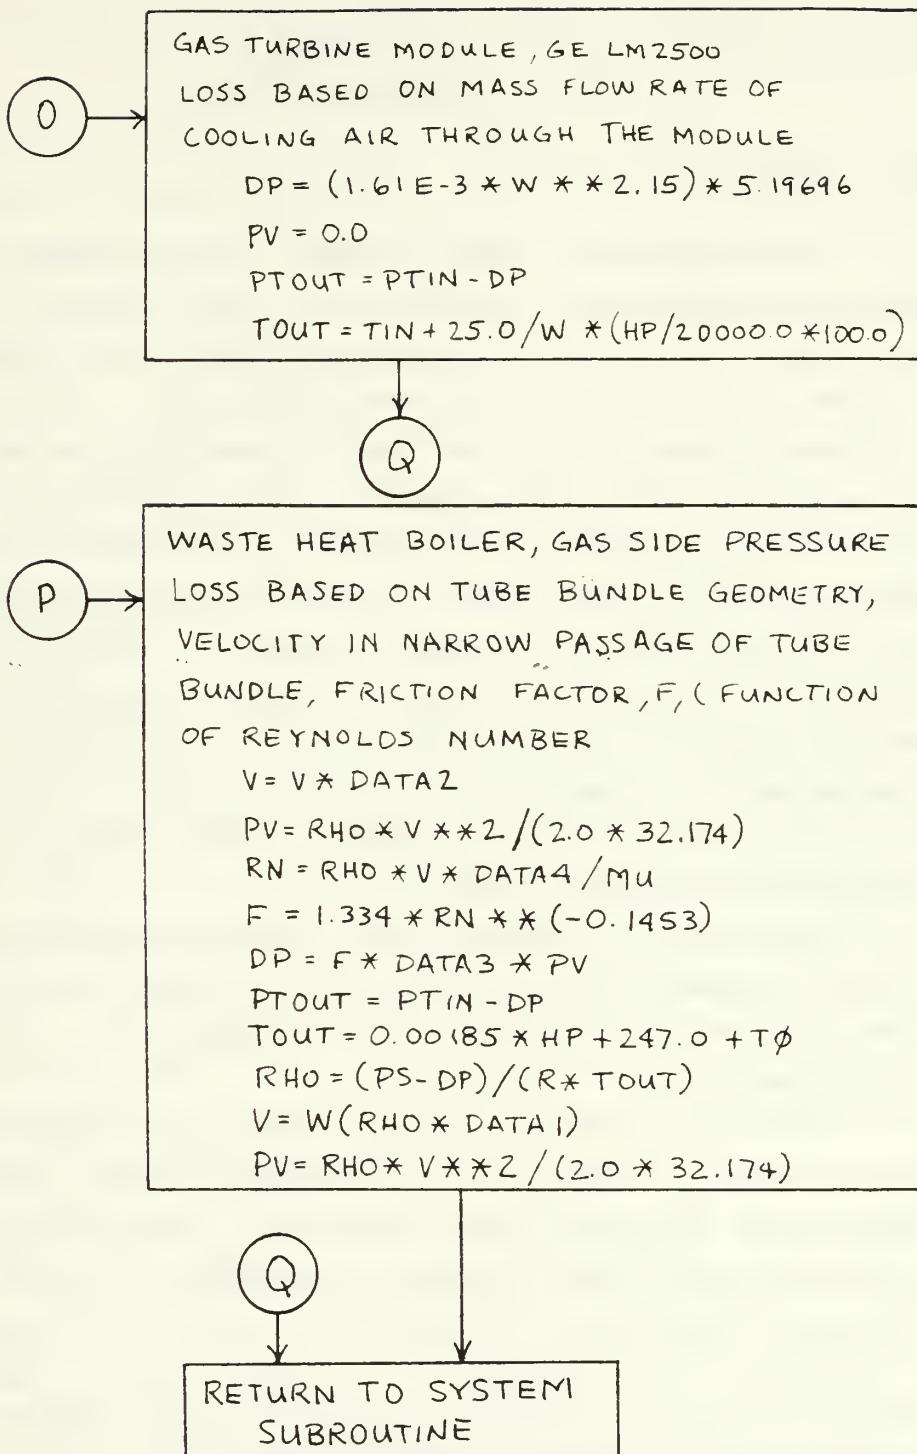

## APPENDIX C

### USER'S MANUAL

#### A. GENERAL

The purpose of this program is to analyze a marine gas turbine installation on board a ship complete with inlet, exhaust, and cooling ductwork. The duct geometry must be input to the program to accomplish this. The program makes a file called "duct data" which contains resistance information on each fitting entered. This file may be edited with the built in editor or if the user is satisfied with the current design the file is read by the program and used in the COMPUTE section of the program. COMPUTE uses the duct data file and inputs dealing with the operating point of the engine to produce the performance parameters of the system. Performance includes both engine parameters and duct losses. All procedures in the program are accomplished using an interactive terminal session.

There are two versions of the program discussed in this user's manual. Version 1.0 is implemented on the NPS IBM 3033 computer. Version 1.1 is implemented on the NPS VAX-11 computer.

This user's manual will discuss the questions posed by the program. Familiarity with the program sections and the questions asked in each section will facilitate program execution and help produce reasonable results. The most critical area for familiarity is in the BUILD and EDIT sections of the program. It is not so critical in the COMPUTE section of the program because only two questions are asked for each operating point run after the ambient conditions are input.

## B. PRELIMINARY

The program does not design ducts or read mechanical drawings. The user plays a vital role by interpreting the system for the program. Some fittings are easy to recognize such as elbows, straight duct, transitions, diffusers and contractions. Some are harder to understand, like diverging and converging wyes. Each fitting listed in the menu is sketched for the user. The sketches show a typical view but remember that the dimensions shown on the drawings are variable inputs so the configuration can change drastically by looking at a fitting over the range of variable dimensions.

Before running the program the user should become familiar with the fitting sketches. Comparing the sketch to the fitting to be modeled will assist the user in preparing a list of fittings for the system. The user should note the dimensions and be prepared to input them to the program.

The program looks for fittings in a definite sequence. Branches are groups of fittings or sections of the ductwork. Branches run from node to node. A node is an entry, exit, junction, fan, or engine. Refer to figure 2.6 for the various system configurations. Nodes are indicated in this figure by the numbered black dots. Nodes have numbers from one to six. The branches get their number designation from the end point nodes. The user should become familiar with the system schematics then it will be easy to understand the order that the program will be asking for fittings. Branches are entered in a sequence from the lowest number node to the next lowest number node until all fittings are entered. For example, a class three system enters branches in the following order; 1-2, 2-3, 2-4, 3-5, 4-5, 5-6. To assist the user when entering fittings the program displays the current fitting identification number on the screen with the menu. The ID number is a six digit number where the

first digit is the system class, the next two digits are the branch number and the last two numbers are the sequence number of the fitting in the branch. A terminal session has been recorded and the printout annotated to show this number.

It would be helpful to pencil in the node numbers in the system drawings. The following table may help.

TABLE II  
Node Designations

- 1 Main air inlet (engine only or combined)
- 2 Cooling air inlet or divergent wye off main inlet
- 3 The engine
- 4 A fan
- 5 Cooling air exit or convergent wye with main exhaust
- 6 Main exhaust (engine only or combined)

The user should prepare a list of fittings organized by branches and continuous with regard to the sequence of fittings. It's the old "toe bone connected to the foot bone" idea. As an example, the following list may help.

node 1  
vert intake, 3 orifices, with louvers  
straight duct  
rectangular contraction  
smooth radius rect elbow

node 3  
etc.


Do not forget to include abrupt exits where they appear. Sometimes it is easy to overlook an obvious fitting such as the engine module as part of the cooling air ductwork.

Only the class one system does not have either a divergent wye or a convergent wye. Class three and five have both. The divergent wye is fairly straight forward. The user only needs to enter the areas indicated in the sketch and the angle of divergence (0-90). The branch section of the divergent wye is the first fitting in branch 2-4 (2-5 if no fan) and the main section (combustion air) is the first fitting in branch 2-3. The combined area and the divergence angle are data entered when entering the branch of the diverging wye. The convergent wye is a more complex. It is located at node five. The branch of a convergent wye should be the last fitting of branch 4-5 (2-5 if no fan). It will usually be the fitting after the module. The main section (engine exhaust) of the convergent wye is the last fitting of branch 3-5. Usually there are just two fittings in branch 3-5. The first is the nozzle or extension bolted to the exhaust plane flange of the engine, and the last is the main section of the convergent wye. The combined area and convergence angle are data entered with the branch section. The convergence angle is usually zero and the combined area is about equal to the sum of the main and branch areas.

FITTING NAME:  
Vertical intake shaft with side orifices,  
with or without louvers

NUMBER:  
01

SKETCH:

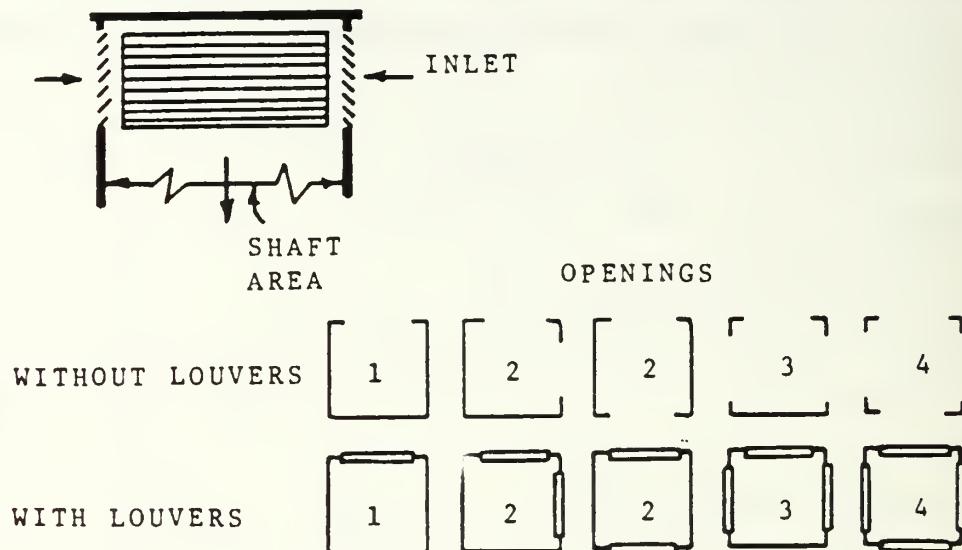

INPUT REQUIREMENTS:

1. The number of orifices (1, 2, 3, or 4)
2. The cross section area of the vertical shaft
3. With two orifices, whether they are adjacent  
or opposite
4. If there are louvers installed

DUCT DATA FILE ENTRIES:

WORKR(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
shaft area	0.0	resistance coefficient	shaft area

REMARKS:

The louvers are flat plates of standard configuration.  
The opening areas are not required but should be  
approximately proportional to those shown in the  
sketch.


REFERENCE:

Handbook of Hydraulic Resistance, Idel'chik


FITTING NAME:  
Straight duct, round or rectangular

NUMBER:  
02

SKETCH:

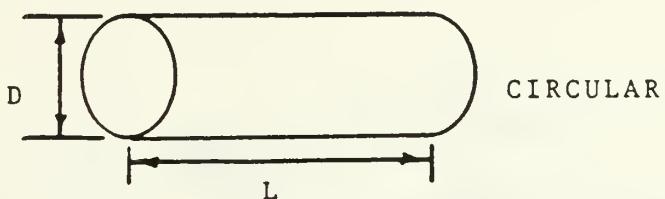

CIRCULAR

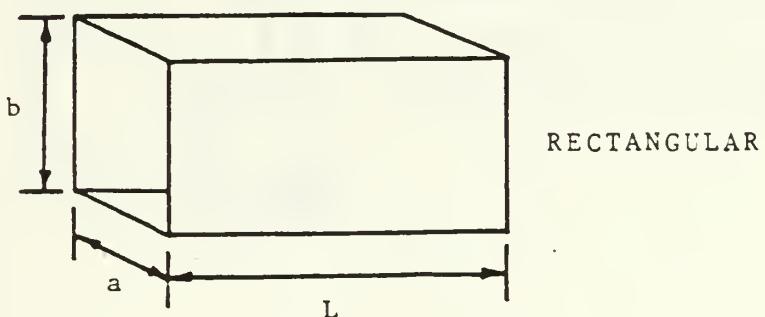

RECTANGULAR

INPUT REQUIREMENTS:

1. Round: diameter and length
2. rectangular: cross section dimensions (a, b)  
length

DUCT DATA FILE ENTRIES:

WORKR(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
section area	diameter or equivalent	length	section area

REMARKS:

Darcy-Wiesbach Equation used for resistance.  
Friction factor by correlation by Swamee & Jain.  
Equivalent circular diameter computed for rectangular sections.  
Length should be measured to the center of short fittings and to the start or end of a long fitting.


REFERENCE:

Mechanics of Fluids, Shames

FITTING NAME:  
Smooth radius round cross section elbow

NUMBER:  
03

SKETCH:

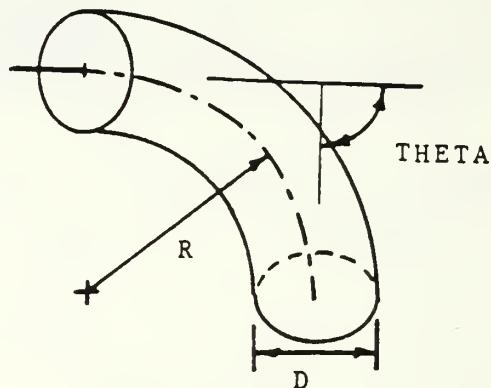

INPUT REQUIREMENTS:

1. Cross section diameter
2. Radius of the turn measured to the centerline of the section
3. The turn angle

DUCT DATA FILE ENTRIES:

WORKR(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
section area	0.0	resistance coefficient	section area

REMARKS:

Turn angle should be from 0 to 90 degrees.


REFERENCE:

ASHRAE FUNDAMENTALS 1981, chapter 33

FITTING NAME:  
Segmented round cross section elbow  
3, 4, or 5 segments, 90 degree turn

NUMBER:  
04

SKETCH:

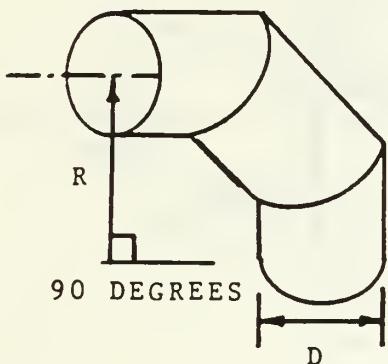

THREE SEGMENTS SHOWN  
(THERE MAY ALSO BE  
FOUR OR FIVE SEGMENTS)

INPUT REQUIREMENTS:

1. Number of segments
2. Cross section diameter
3. Radius of the turn measured to the centerline of the turn

DUCT DATA FILE ENTRIES:

WORKR(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
section area	0.0	resistance coefficient	section area

REMARKS:

Note that the number of segments includes the entry and exit segments.


REFERENCE:

ASHRAE FUNDAMENTALS 1981, chapter 33

FITTING NAME:  
Mitered round cross section elbow

NUMBER:  
05

SKETCH:

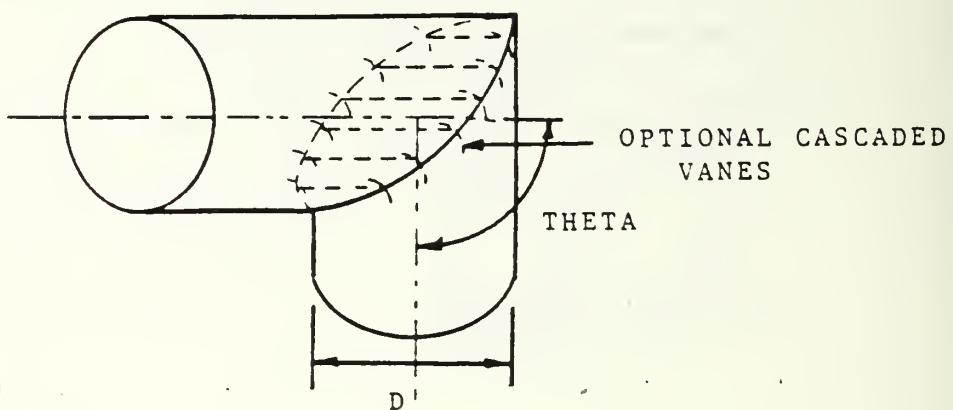

INPUT REQUIREMENTS:

1. Cross section diameter
2. Turn angle
3. Whether or not concentric guide vanes are installed

DUCT DATA FILE ENTRIES:

WCRKR(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
section area	diameter	resistance coefficient	section area

REMARKS:

A Reynolds number correction is applied to this fitting.


REFERENCE:

ASHRAE FUNDAMENTALS 1981, chapter 33

FITTING NAME:  
Mitered rectangular cross section elbow  
without turning vanes

NUMBER:  
06

SKETCH:

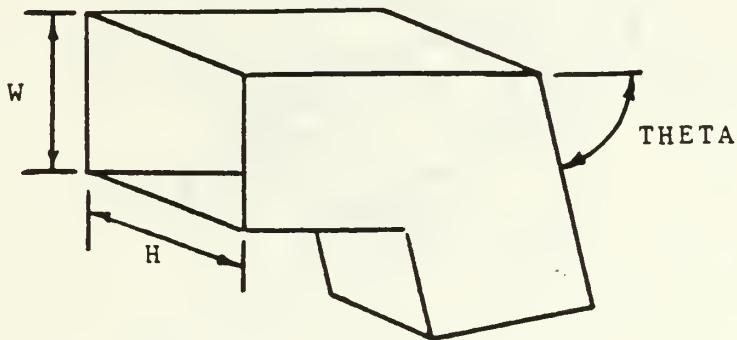

INPUT REQUIREMENTS:

1. Height of the elbow, dimension parallel to turn axis
2. Width of the elbow, dimension in the turn plane
3. Turn angle

DUCT DATA FILE ENTRIES:

WORKR(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
section area	hydraulic diameter	resistance coefficient	section area

REMARKS:

This fitting has a Reynolds number correction applied to the resistance coefficient.

REFERENCE:


ASHRAE FUNDAMENTALS 1981, chapter 33

FITTING NAME:

Smooth radius rectangular elbow without  
guide vanes

NUMBER:  
07

SKETCH:

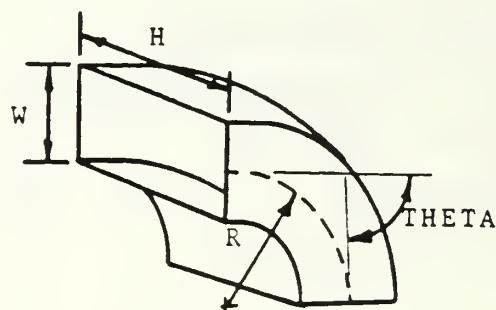

INPUT REQUIREMENTS:

1. Height of the elbow, the dimension parallel to the turn axis
2. Width of the elbow, the dimension in the turn plane.
3. Radius of the elbow measured to the centerline of the elbow.
4. Turn angle

DUCT DATA FILE ENTRIES:

WORKR(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
section area	hydraulic diameter	resistance coefficient	radius/width

REMARKS:

This fitting has a Reynolds number correction.  
The correction also varies with the R/W ratio.


REFERENCE:

ASHRAE FUNDAMENTALS 1981, chapter 33

FITTING NAME:  
Smooth radius rectangular elbow with  
splitters

NUMBER:  
08

SKETCH:

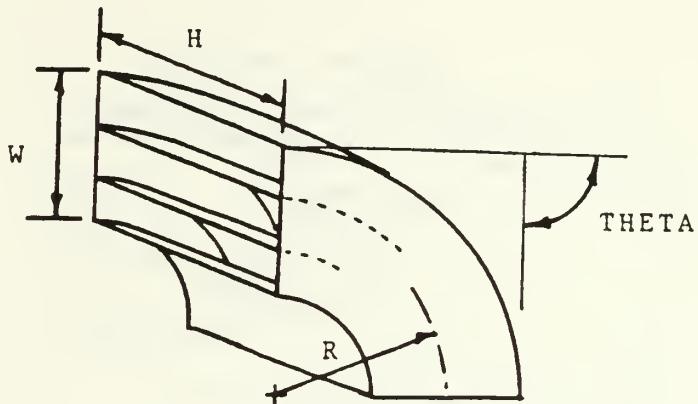

TWO SPLITTERS SHOWN  
(THERE MAY ALSO BE  
ONE OR THREE)

INPUT REQUIREMENTS:

1. Number of splitters, 1, 2, or 3
2. Height, distance parallel to turn axis
3. Width, distance in turn plane
4. Radius of elbow to section centerline
5. Turn angle

DUCT DATA FILE ENTRIES:

WCRKR(I,1)	WORKR(I,2)	WCRKR(I,3)	WORKR(I,4)
section area	0.0	resistance coefficient	section area


REMARKS:  
None

REFERENCE:  
ASHRAE FUNDAMENTALS 1981, chapter 33

FITTING NAME:  
Mitered rectangular elbow with vanes

NUMBER:  
09

SKETCH:

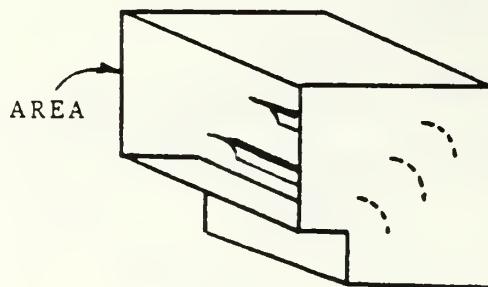

THREE VANES SHOWN

(THERE MAY ALSO BE  
ONE OR TWO)

INPUT REQUIREMENTS:

1. Number of vanes (1, 2, or 3)
2. Cross section area

DUCT DATA FILE ENTRIES:

WORKR(I,1) WORKR(I,2)  
section area 0.0

WORKR(I,3)  
resistance coefficient

WORKR(I,4)  
section area

REMARKS:

Flat plate turning vanes are used.


REFERENCE:

ASHRAE FUNDAMENTALS 1981, chapter 33

FITTING NAME:  
Rectangular elbow with converging or  
diverging flow

NUMBER:  
10

SKETCH:

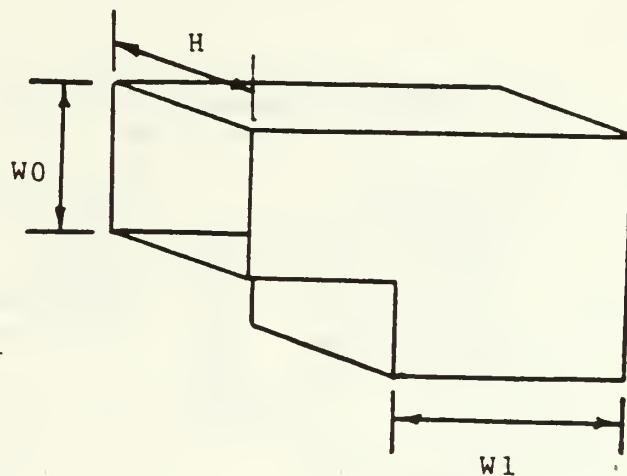

INPUT REQUIREMENTS:

1. Inlet height, dimension parallel to turn axis
2. Exit height, dimension parallel to turn axis
3. Constant width, dimension in turn plane

DUCT DATA FILE ENTRIES:

WORKR(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
inlet area	inlet hyd. diameter	resistance coefficient	outlet area

REMARKS:

Elbow should have a 90 deg turn.  
The width should remain constant in the elbow.

REFERENCE:


ASRHAE FUNDAMENTALS 1981, chapter 33

FITTING NAME:

Two 90 degree rectangular elbows in a  
Z-shaped configuration

NUMBER:  
11

SKETCH:

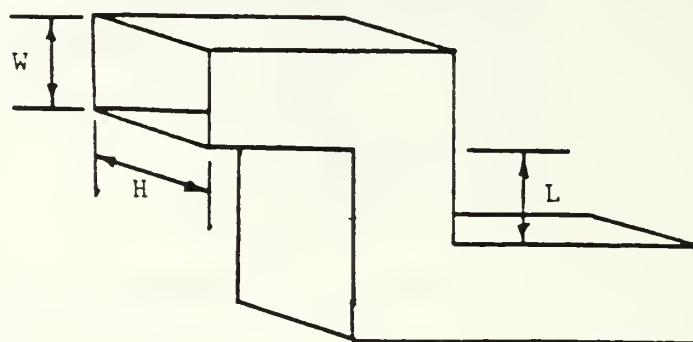

INPUT REQUIREMENTS:

1. Height of elbows, dimension parallel to turn axis
2. Width of elbows, dimension in turn axis
3. The distance between the centerlines of the offset duct

DUCT DATA FILE ENTRIES:

WORKR(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
section area	hydraulic diameter	resistance coefficient	area

REMARKS:  
None.


REFERENCE:

ASHRAE FUNDAMENTALS 1981, chapter 33

FITTING NAME:  
Two 90 degree elbows in different planes

NUMBER:  
12

SKETCH:

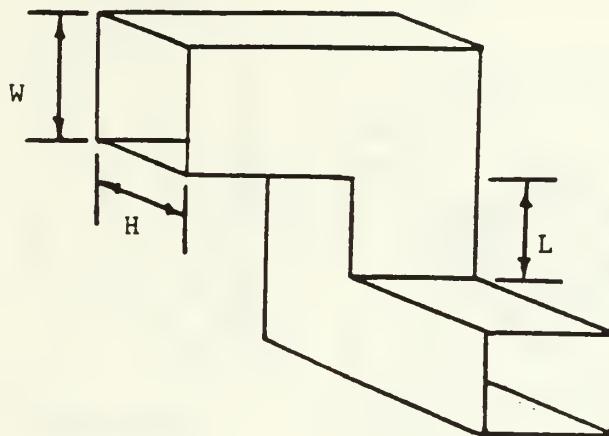

INPUT REQUIREMENTS:

1. Height of elbow, dimension parallel to turn axis
2. Width of elbow, dimension in the plane of the turn
3. Distance between the centerlines of the duct connected to this arrangement

DUCT DATA FILE ENTRIES:

WORKR(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
section area	Hydraulic Diameter	resistance coefficient	section area

REMARKS:

Resistance coefficient is a curve fit to the tabulated data.

REFERENCE:


ASHRAE FUNDAMENTALS 1981, chapter 33

FITTING NAME:

Diverging wye, branch and main sections

NUMBER:  
13 8 14

SKETCH:

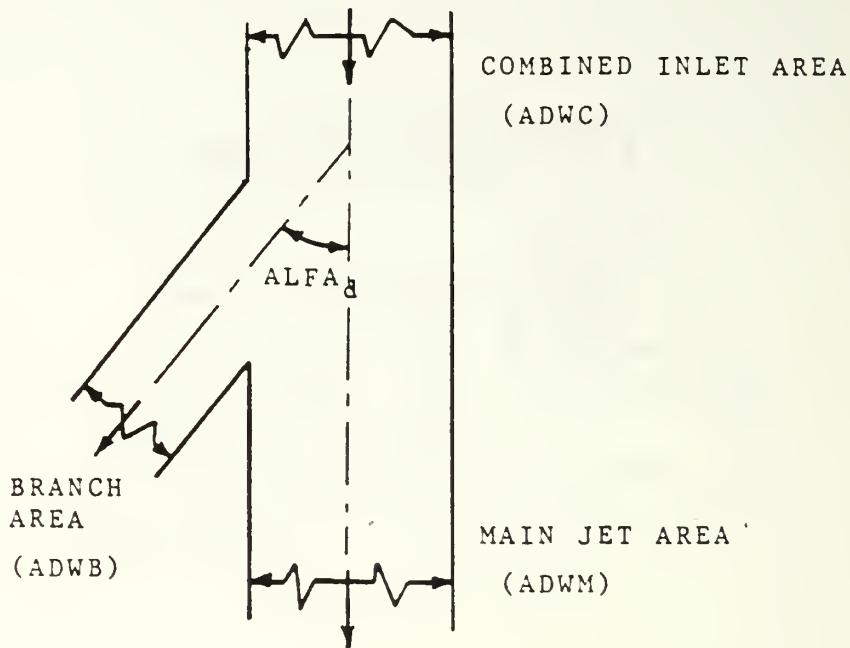

INPUT REQUIREMENTS:

- A. Branch section  
1. combined area  
2. branch area  
3. divergence angle

- B. Main section  
1. main area

DUCT DATA FILE ENTRIES: (fitting 13)

WORKR(I,1) WORKR(I,2) WORKR(I,3) WORKR(I,4)  
combined branch divergence branch  
area area angle area

REMARKS:

The divergence angle should follow some centerline streamline. The areas are cross section areas perpendicular to the streamline in the sections away from the dividing location. Cooling air flows through the branch section. Main inlet air to the engine flows through the main section. Both flow through the combined section.

REFERENCE:


Handbook of Hydraulic Resistance, Idel'chik

FITTING NAME:  
Convergent wye, branch and main sections

NUMBER:  
15 & 16

SKETCH:

SCHEMATIC

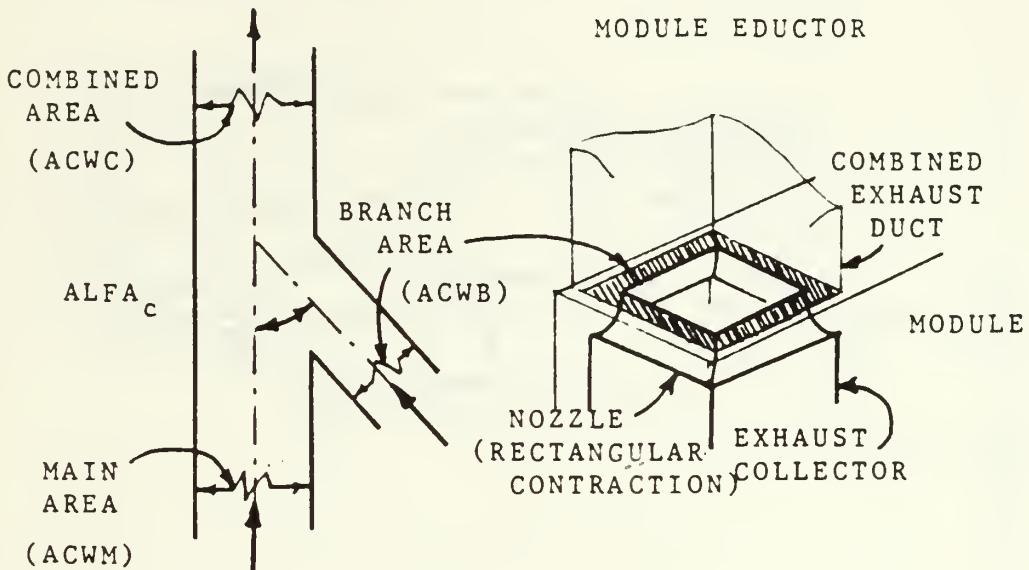

INPUT REQUIREMENTS:

A. Branch section

1. branch area
2. combined area
3. convergence angle

B. Main section

1. main area

DUCT DATA FILE ENTRIES: (fitting 15)

WORKR(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
combined area	branch area	convergence angle	branch area

REMARKS:

The branch area has module cooling air flowing through it. The main area has engine exhaust flowing through it. The combined area has both. The angle should be measured to representative streamlines at the plane where the two flows meet.


REFERENCE:

Handbook of Hydraulic Resistance, Idel'chik

FITTING NAME:  
Conical diffuser

NUMBER:  
17

SKETCH:

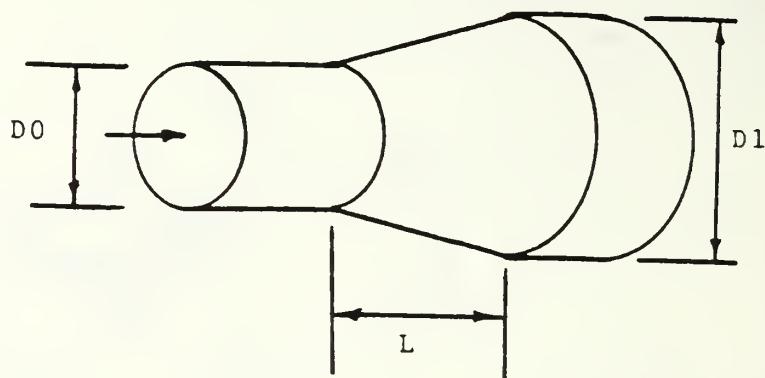

INPUT REQUIREMENTS:

1. Length of the diffuser
2. Inlet diameter
3. Cutout diameter
4. Is there distorted flow at the inlet
5. Are there dividing wall or baffles installed to reduce resistance

DUCT DATA FILE ENTRIES:

WCRRK(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
inlet area	friction coefficient	flow coefficient	outlet area

REMARKS:

The program recognizes a wide diverging angle and warns the user. Resistance in this case may be reduced by 35 % with installation of baffles.


REFERENCE:

Handbook of Hydraulic Resistance, Idel'chik

FITTING NAME:  
Plane in-line diffuser

NUMBER:  
18

SKETCH:

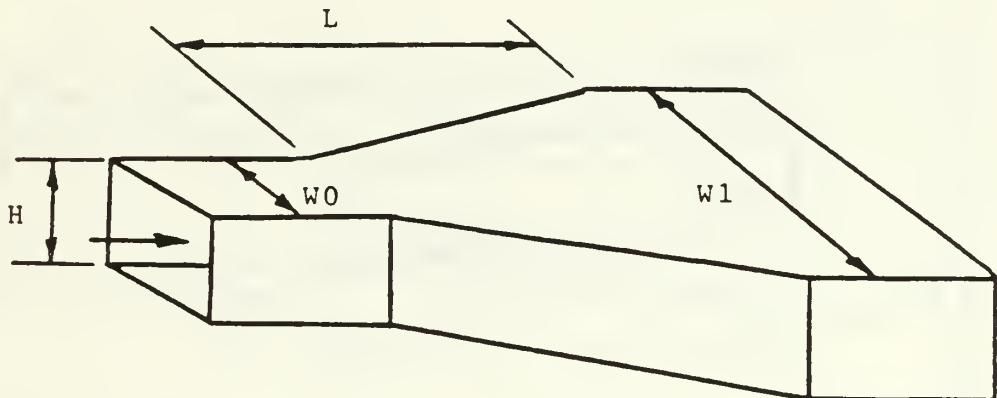

INPUT REQUIREMENTS:

1. Length of the diffuser
2. The constant height of the diffuser
3. The inlet width
4. The outlet width
5. Distorted flow
6. Installation of baffles

DUCT DATA FILE ENTRIES:

WORKR(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
inlet area	friction coefficient	flow coefficient	outlet area

REMARKS:

The divergence is assumed to be uniform with respect to the main centerline. A wide divergence angle is recognized and the user is asked if dividing walls or baffles are installed to reduce resistance.


REFERENCE:

Handbook of Hydraulic Resistance, Idel'chik

FITTING NAME:  
Pyramidal in-line diffuser

NUMBER:  
19

SKETCH:

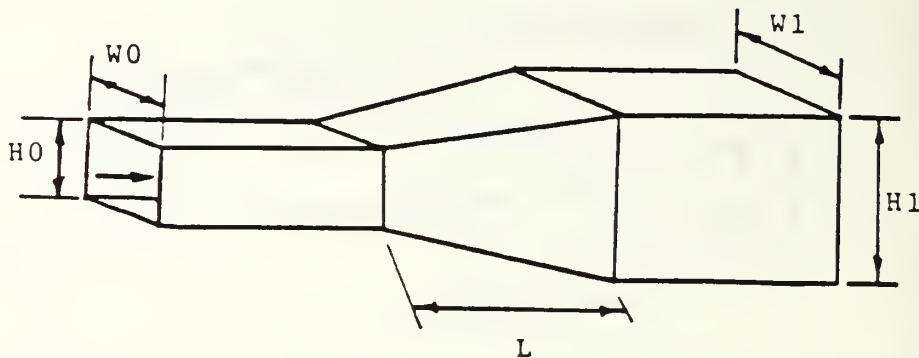

INPUT REQUIREMENTS:

1. Length of the diffuser
2. Smaller inlet dimension, larger inlet dimension
3. Dimensions parallel to inlet dimensions
4. Non-uniform velocity profile
5. Are baffles installed

DUCT DATA FILE ENTRIES:

WORKR(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
inlet area	friction coefficient	flow coefficient	outlet area

REMARKS:

A uniform divergence with respect to the centerline is assumed. Wide divergence angle is recognized by the program. With a wide angle the flow resistance can be reduced by 35% with baffles or dividing walls.


REFERENCE:

Handbook of Hydraulic Resistance, Idel'chik

FITTING NAME:  
Transition diffuser, round to rectangular  
or rectangular to round

NUMBER:  
20

SKETCH:

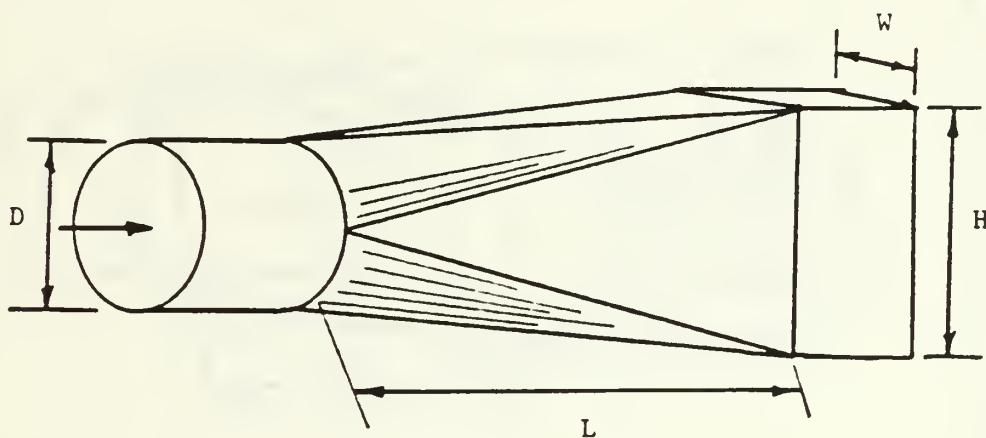

INPUT REQUIREMENTS:

1. Manner of transition
2. Diameter
3. rectangular dimensions
4. Length of the diffuser
5. Non-uniform velocity distribution
6. Installation of baffles or dividing walls

DUCT DATA FILE ENTRIES:

WCRKR(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
inlet area	friction coefficient	flow coefficient	outlet area

REMARKS:

Uniform divergence with respect to the centerline is assumed. Wide divergence angle is recognized and if baffles or dividing walls are installed the resistance is reduced by 35%.


REFERENCE:

Handbook of Hydraulic Resistance, Idel'chik

FITTING NAME:  
Circular contraction

NUMBER:  
21

SKETCH:

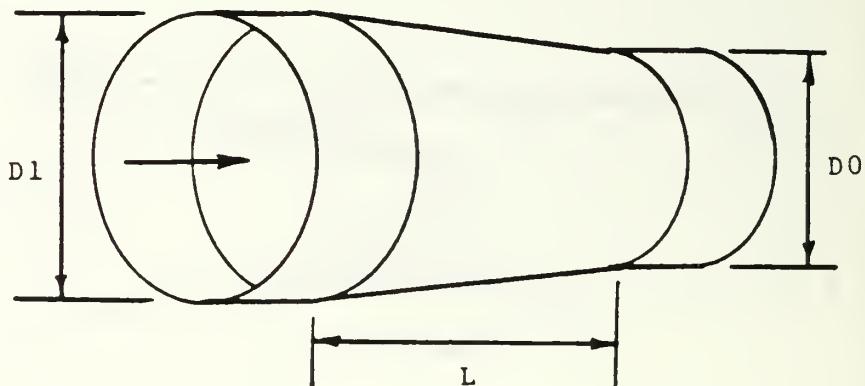

INPUT REQUIREMENTS:

1. Length of the contraction
2. Upstream diameter
3. Downstream diameter

DUCT DATA FILE ENTRIES:

WORKR(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
outlet area	0.0	resistance coefficient	inlet area

REMARKS:

If you need a transitional contraction you could use this fitting or fitting 22. The area of the inlet or outlet would have to be converted to a circle or rectangle as required by the geometry for input to the program.


REFERENCE:

ASHRAE FUNDAMENTALS 1981, chapter 33

FITTING NAME:  
Rectangular contraction

NUMBER:  
22

SKETCH:

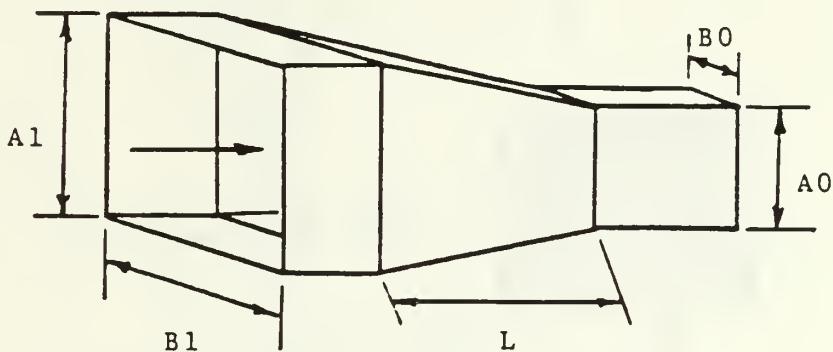

INPUT REQUIREMENTS:

1. Length of the contraction
2. Upstream dimensions
3. Downstream dimensions

DUCT DATA FILE ENTRIES:

WCRKR(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
outlet area	0.0	resistance coefficient	inlet area

REMARKS:

This fitting can be substituted for a transitional contraction. The inlet or outlet area should remain the same and the area for transition converted as required.


REFERENCE:

ASHRAE FUNDAMENTALS 1981, chapter 33

FITTING NAME:  
Screen

NUMBER:  
23

SKETCH:



SCREEN AREA  
(FREE FLOW MEANS HOLE SPACES)

DUCT AREA (OVERALL AREA)

INPUT REQUIREMENTS:

1. Overall duct cross section area
2. Screen free flow area

DUCT DATA FILE ENTRIES:

WORKR(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
duct area	0.0	resistance coefficient	duct area

REMARKS:

This fitting is useful for the screen in front of the engine inlet. The free flow area is the sum of all the holes in the screen.


REFERENCE:

ASHRAE FUNDAMENTALS 1981, chapter 33

FITTING NAME:  
Louver inlet

NUMBER:  
24

SKETCH:

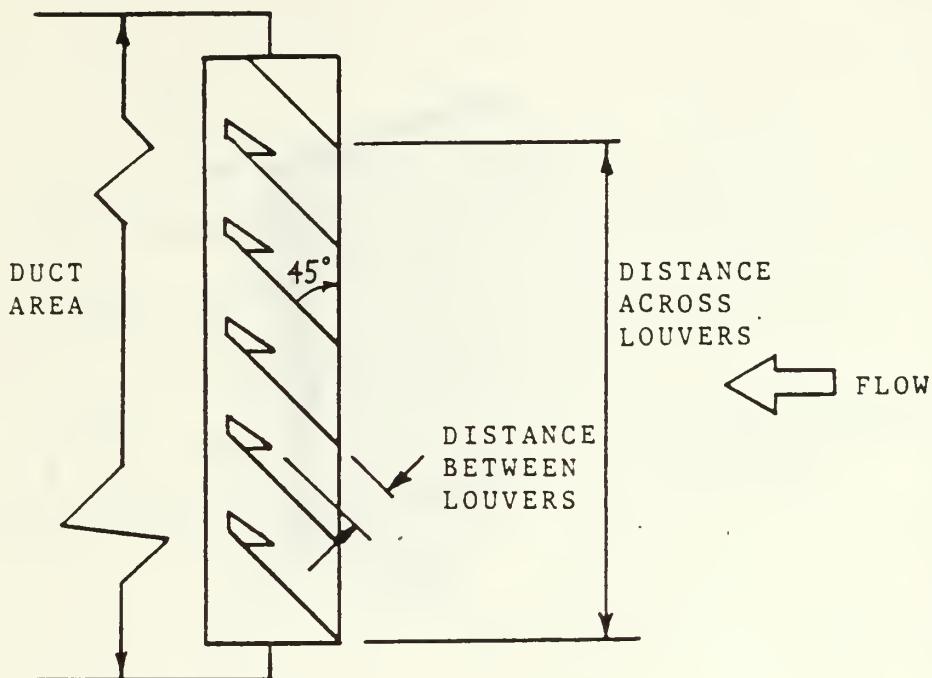

INPUT REQUIREMENTS:

1. Distance across the louver openings
2. Distance between the louvers
3. The number of openings between the louvers
4. Duct area just inside the louvers

DUCT DATA FILE ENTRIES:

WCRKR(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
duct area	0.0	resistance coefficient	duct area

REMARKS:

The correlation is for flat louvers with the front edges flat with the face of the louvers. No friction is included in this correlation. Better models need to be developed for louvers with moisture separator edges. The louver angle is 45 degrees to the face.


REFERENCE:

Handbook of Hydraulic Resistance, Idel'chik

FITTING NAME:  
Filter

NUMBER:  
25

SKETCH:

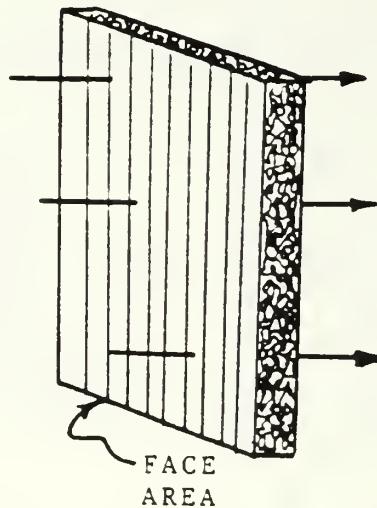

INPUT REQUIREMENTS:

None if the default value is used.  
If another filter type is to be used then the user should provide pressure loss data as a function of face velocity. Only a few points are required for the power curve fit to work. The number of points is an input (two min.)

DUCI DATA FILE ENTRIES:

WORKR(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
filter face area	multiplier (A)	exponent (B)	filter face area

REMARKS:

The power curve fit is of the form:

$$\text{delta pressure (in WG)} = A * (\text{velocity})^{**B}$$


REFERENCE:

Filter manufacturer's data

FITTING NAME:  
Multi-baffle type silencer

NUMBER:  
26

SKETCH:

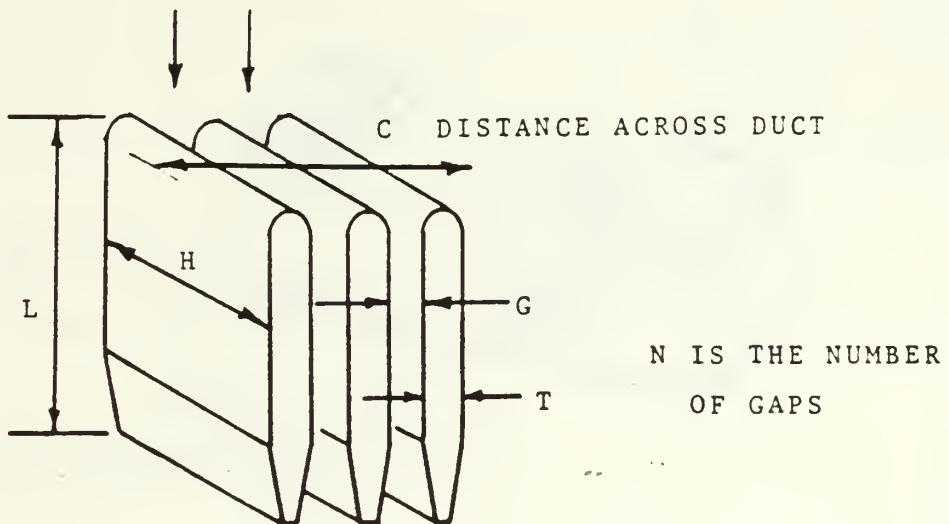

N IS THE NUMBER  
OF GAPS

INPUT REQUIREMENTS:

1. Gap between baffles
2. Baffle thickness
3. Baffle length (with flow)
4. Duct dimension parallel to gap
5. Duct dimension across gaps
6. The number of gaps

DUCT DATA FILE ENTRIES:

WCRKR(I,1)	WORKR(I,2)	WORKR(I,3)	WORKR(I,4)
duct area	0.0	resistance coefficient	duct area

REMARKS:

This is a composit model. The resistance coefficient is modeled as a sudden contraction, friction along the length of the baffle, and a sudden expansion. It is not a very good model and a model based on experimental data would be better.


REFERENCE:

NAVSEA Inlet Design Handbook for Marine Gas turbines

FITTING NAME:  
Gas turbine module

NUMBER:  
27

SKETCH:

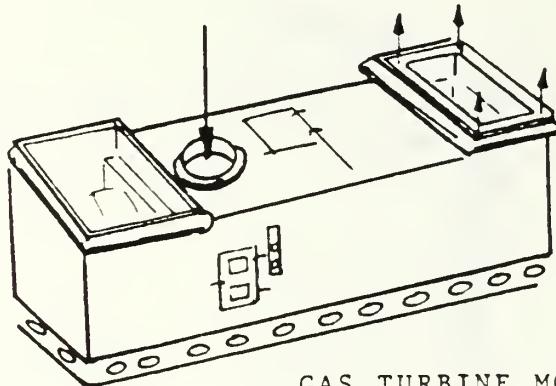

GAS TURBINE MODULE

\*\* COOLING AIR PASSAGES ONLY \*\*

INPUT REQUIREMENTS:  
None

DUCT DATA FILE ENTRIES:  
WCRKE(I,1) WORKR(I,2) WORKR(I,3) WORKR(I,4)  
1.0 1.0 1.0 1.0

REMARKS:


This model is based on the mass flow rate of cooling air through the module. It is a power fit to data from General Electric Co. It should be good as long as entry and exit areas remain about the same. The 1.0's in the duct data file are there to prevent division by zero in the program and are not actually used.

REFERENCE:  
Manufacturer's data

FITTING NAME:  
Waste heat recovery boiler

NUMBER:  
28

SKETCH:

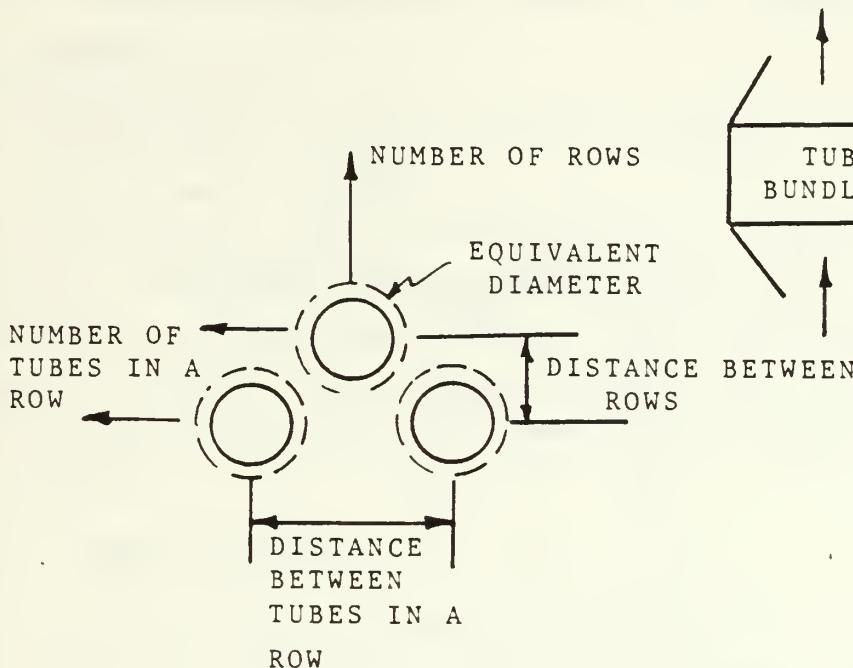

INPUT REQUIREMENTS:

A default is available. It is based on current design considerations in the racer program. Should you choose not to use it several inputs are required. Read the reference and be prepared to enter the values shown on the sketch and a few you will have to compute yourself (i.e. tube equiv. dia. and hydraulic dia.).

DUCT DATA FILE ENTRIES:

WORKR(I,1)	duct area	WORKR(I,2)	0.0	WORKR(I,3)	resistance coefficient	WORKR(I,4)	duct area
------------	-----------	------------	-----	------------	------------------------	------------	-----------

REMARKS:

If the manufacturer will provide the data, write your own model, but this should be close for preliminary studies.


REFERENCE:

Extended Surface Heat Transfer, Kerns and Krauss  
pages 582-589

FITTING NAME:  
Abrupt Exit

NUMBER:  
29

SKETCH:

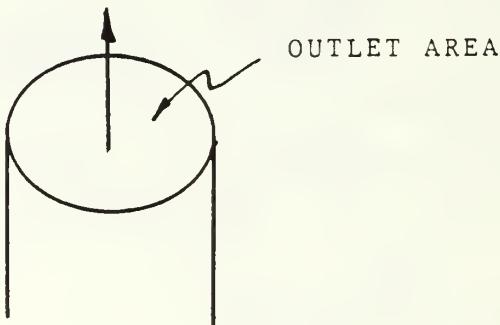

INPUT REQUIREMENTS:  
1. The exit area

DUCT DATA FILE ENTRIES:  
WORKR(I,1)      WORKR(I,2)      WORKR(I,3)      WORKR(I,4)  
exit                0.0                1.0                exit  
area                                 area

REMARKS:  
All velocity energy is assumed lost after exiting  
the duct, hence a coefficient of 1.0.

REFERENCE:  
ASHRAE FUNDAMENTALS 1981, chapter 33

## C. EXECUTING THE PROGRAM

### 1. IBM 3033 at NPS

Issue the following commands to compile and execute the program.

```
FCRTHX filename
```

```
GLOBAL TXTLIB FORTMOD2 MOD2EEH NONIMSL
```

```
LCAD filename (START)
```

"filename" is the name of the program in the user's files. NONIMSL is required because the program calls the NONIMSL library with FRTCMS when defining files and clearing the CRT screen. If the file has been compiled on the user's disk the lengthy compiling may be omitted and issue just the last two lines.

### 2. VAX-11 at NPS

The program version to be used is 1.1. This version is a modified version of the program listed in Appendix A. The modifications include elimination of all calls to FRTCMS. FRTcms is used for two purposes in version 1.0. First to set up file definitions and second to clear the screen at appropriate times to prevent the format of the display from being chopped up. The file definitions in version 1.1 are set up using the standard OPEN statement of FORTRAN 77 used on the VAX-11/780 at NPS. All calls to FRTcms to clear the screen were deleted and are not needed on the VAX because it scrolls the display from the bottom and does not cut off any continuous screen displays. One other change was made in the file definition area, all writes to the terminal were made to unit 5 and all reads from the terminal were made from unit 6. This agrees with the convention of FORTRAN 77 as implemented on the VAX. The program runs like any other program on the VAX, first the program must be compiled using the fortran compiler, then

linked and run. The program is still interactive on the VAX and about the only word of caution required is to remember to use CAPS ON or upper case input for logical replies. Using lower case leaves the user in a loop where the program keeps asking for a correct reply. The duct geometry file information is on a file called duct.dat and the performance information is on a file called output.dat.

#### D. BUILDING A DUCT DATA FILE

The following pages are a recorded session at the terminal where the author entered a system into the program. The system modeled is made up from drawings for the proposed Arleigh Burke class guided missile destroyer. The session has been annotated to point out features of the program.

GLOBAL TEXTLIB CMSLIB FORTMOD2 MODZEEH IMSLSP NONIMSL  
LOAD THESIS ( START  
EXECUTION BEGINS  
A ONE-DIMENSIONAL MODEL FOR THE SYSTEM PERFORMANCE  
OF A MARINE GAS TURBINE INSTALLATION

BY LCDR. STEPHEN M. EZZELL

OPTIONS: VERSION 1.0 MARCH 30, 1984  
BUILD A DATA FILE REPRESENTING THE DUCT SYSTEM  
EDIT OR CHANGE THE DUCT DATA FILE  
COMPUTE SYSTEM PERFORMANCE  
METHOD: INTERACTIVE INPUT OF DATA, BRANCHING TO DESIRED  
OPTION BY ANSWERING QUESTIONS

\*\*\* WARNING, TWO NULL ENTRIES ON NUMERICAL INPUT WILL \*\*\*  
\*\*\* KILL THE PROGRAM. \*\*\*

FIRST QUESTION:

DO YOU HAVE A DATA FILE OF DUCT FITTINGS (Y/N)?

n DO YOU WANT LONG OR SHORT INSTRUCTIONS (L/S)?

l YOU HAVE SELECTED THE LONG INSTRUCTIONS.  
ARE YOU WORKING ON A CRT OR TYPEWRITER TERMINAL (C/T)?

c YOU ARE WORKING ON A CRT TERMINAL.  
DOES THE MODULE COOLING AIR BRANCH OFF THE MAIN INLET?  
(Y, N)

y DOES THE MODULE COOLING AIR JOIN THE MAIN ENGINE EXHAUST?  
(Y, N)

y IS THERE A COOLING FAN INSTALLED?

t YOU MUST ENTER A LETTER IN THE BRACKETS.  
IS THERE A COOLING FAN INSTALLED?

NOTE INCORRECT RESPONSE,  
ANSWER SHOULD HAVE BEEN  
Y OR N

v SYSTEM IS CLASS THREE, COMBINED INLETS AND EXHAUST  
FLOWS FOR THE ENGINE AND MODULE COOLING. A COOLING FAN IS  
INSTALLED. YOU WILL BE ENTERING FITTINGS FOR SIX BRANCHES.

1. COMBINED INLET TO THE COMBINED SECTION  
OF A DIVERGENT WYE.
2. MAIN SECTION OF THE DIVERGENT WYE TO THE ENGINE.
3. BRANCH SECTION OF THE DIVERGENT WYE TO THE COOLING FAN.
4. ENGINE EXHAUST TO MAIN SECTION OF A CONVERGENT WYE.  
AN EDUCTOR INSTALLED AT THE EXHAUST PLANE OF THE ENGINE  
IS CONSIDERED TO BE A CONTRACTION FOLLOWED BY THE MAIN  
SECTION OF A CONVERGING WYE FOR THE PURPOSES OF THIS  
PROGRAM.
5. COOLING FAN EXHAUST TO THE BRANCH SECTION  
OF A CONVERGENT WYE.
6. COMBINED SECTION OF A CONVERGENT WYE TO THE ATMOSPHERE.

ENTER ZERO TO CONTINUE

?

0

MENU LOOKS LIKE THIS  
IT APPEARS WITH EACH FITTING  
BUT IS OMITTED IN THIS LISTING TO  
CONSERVE SPACE

00 NO ACCE FITTINGS THIS BRANCH	* 14 DIVERGING WYE, MAIN SECTION
01 INTAKE SHIFT, RECT SECTION, SIDE ORIFACES WITH (OUT) LOUVERS	* 15 CONVERGENT WYE, BRANCH SECTION
02 STRAIGHT DUCT	* 16 CONVERGENT WYE, MAIN SECTION
03 ELBOW, SMOOTH, RADIUS ROUND	* 17 DIFFUSER, CONICAL
04 ELBOW, 90 DEG, 3 1/2 PCS, ROUND	ROUND SECTION
05 ELBOW, MITERED, ROUND, W/W/O VANES	* 18 DIFFUSER, PLANE, IN-LINE
06 ELBOW, MITERED, RECTANGULAR	* 19 DIFFUSER, PYRAMIDAL, IN-LINE
07 ELBOW, SMOOTH, RADIUS, RECTANGULAR	* 20 DIFFUSER, TRANSITIONAL (ROUND
08 ELBOW, SMOOTH, RADIUS, WITH SPLITTERS, RECTANGULAR	* 21 TO RECT. OR RECT. TO ROUND)
09 ELBOW, MITERED, WITH VANES, RECT	* 22 CONTRACTION, ROUND
10 ELBOW, CONVERGING OR DIVERGING FLOW, RECTANGULAR	* 23 OBSTRUCTION SCREEN IN DUCT
11 ELBOWS, 90 DEG, Z-SHAPED, RECT	* 24 LOUVER ENTRANCE
12 ELBOWS, 90 DEG, IN DIFFERENT PLANES, RECTANGULAR	* 25 FILTER
13 DIVERGING WYE, BRANCH SECTION	* 26 MULTI-BAFFLE SILENCER
***** USE TWO DIGIT NUMBER, PRESS ENTER *****	
>> YOU ARE WORKING ON FITTING NUMBER >> 312201	

? 25  
YOU HAVE SELECTED THE INLET FILTER.  
\*\*FIRST QUESTION, WHAT IS THE TOTAL FACE AREA OF THE FILTER?

?  
DO YOU WANT TO USE THE DD963 TYPE FILTER  
IN THE DRY CONDITION (Y/N)?  
Y NO MORE QUESTIONS.  
DO YOU WANT TO ENTER THIS FITTING (Y/N)?

MENU OMITTED

?>> YOU ARE WORKING ON FITTING NUMBER >> 312201

? 24 ← FITTING SELECTED

YOU HAVE SELECTED A LOUVERED ENTRANCE.  
\*\*FIRST QUESTION, WHAT IS THE DISTANCE ACROSS THE  
LOUVER OPENINGS?

? 25.5  
WHAT IS THE DISTANCE BETWEEN THE LOUVERS, USE THE  
CLOSEST DISTANCE.

? 0.4021  
HOW MANY OPENINGS ARE THERE BETWEEN THE LOUVERS?

? 17  
LAST QUESTION, WHAT IS THE AREA OF THE DUCT  
JUST INSIDE THE LOUVER ENTRANCE?

? 197.75  
DO YOU WANT TO ENTER THIS FITTING (Y/N)?

Y >> YOU ARE WORKING ON FITTING NUMBER >> 312202

? 25  
YOU HAVE SELECTED THE INLET FILTER.  
\*\*FIRST QUESTION, WHAT IS THE TOTAL FACE AREA OF THE FILTER?

? 197.75  
DO YOU WANT TO USE THE DD963 TYPE FILTER IN  
THE DRY CONDITION (Y/N)?

Y NO MORE QUESTIONS.  
DO YOU WANT TO ENTER THIS FITTING (Y/N)?

?>> YOU ARE WORKING ON FITTING NUMBER >> 312203

?  
02  
YOU HAVE SELECTED STRAIGHT DUCT. IT MAY BE ROUND  
OR RECTANGULAR.  
\*\*\*FIRST QUESTION, IS THE DUCT CIRCULAR OR RECTANGULAR  
(C/F) ?  
F  
THE DUCT IS RECTANGULAR, ENTER FIRST CROSS-SECTIONAL  
DIMENSION. (FEET)  
?  
18.83  
SECOND DIMENSION (FEET)  
?  
10.5  
ENTER THE LENGTH OF THIS DUCT SECTION. (FEET)  
?  
17.75  
DO YOU WANT TO ENTER THIS FITTING (Y/N)?  
Y  
>> YOU ARE WORKING ON FITTING NUMBER >> 312204  
?  
00  
>> YOU ARE WORKING ON FITTING NUMBER >> 323101  
?  
14  
YOU HAVE SELECTED THE MAIN SECTION OF A DIVERGING WYE.  
THE AIR TO THE ENGINE SHOULD BE FLOWING THROUGH THIS SECTION.  
JUST ONE QUESTION, WHAT IS THE CROSS-SECTIONAL AREA OF THE  
MAIN SECTION? THIS SHOULD BE THE AREA JUST DOWNSTREAM OF THE  
JUNCTION AND DIRECTS FLOW TO THE ENGINE. IT ALSO SHOULD BE  
THE FIRST FITTING OF THE BRANCH.  
?  
81.375  
>> YOU ARE WORKING ON FITTING NUMBER >> 323102  
?  
26  
YOU HAVE SELECTED A MULTI-BAFFLE TYPE SILENCER.  
EACH BAFFLE HAS A STREAMLINED SHAPE. IT IS THE TYPE  
USED IN THE INLETS OF THE DD963.  
\*\*FIRST QUESTION, WHAT IS THE GAP BETWEEN THE BAFFLES?  
?  
0.333  
WHAT IS THE THICKNESS OF THE BAFFLES?  
?  
0.666  
WHAT IS THE LENGTH OF THE BAFFLES?  
?  
9.33  
WHAT IS THE DIMENSION OF THE BAFFLES PARALLEL TO THE GAP?  
?  
7.75  
WHAT IS THE DIMENSION OF THE MAIN DUCT ACROSS THE GAPS?  
?  
10.5  
LAST QUESTION, HOW MANY GAPS ARE THERE?  
?  
11  
DO YOU WANT TO ENTER THIS FITTING (Y/N)?  
Y  
>> YOU ARE WORKING ON FITTING NUMBER >> 323103  
?  
22  
YOU HAVE SELECTED A RECTANGULAR CONTRACTION.  
\*\*FIRST QUESTION, WHAT IS THE LENGTH OF THE CONTRACTION?  
?  
8.5  
WHAT IS THE LEAST UPSTREAM CROSS-SECTION DIMENSION?

?  
7.75  
WHAT IS THE GREATER UPSTREAM CROSS-SECTION DIMENSION?  
?  
10.5  
WHAT IS THE LEAST DOWNSTREAM CROSS-SECTION DIMENSION?  
?  
6.667  
LAST QUESTION, WHAT IS THE GREATER DOWNSTREAM  
CROSS-SECTION DIMENSION?  
?  
7.75  
DO YOU WANT TO ENTER THIS FITTING (Y/N)?  
Y>> YOU ARE WORKING ON FITTING NUMBER >> 323104  
?  
06  
YOU HAVE SELECTED A MITERED RECTANGULAR CROSS-SECTION, ELBOW.  
\*\*FIRST QUESTION, WHAT IS THE HEIGHT OF THE ELBOW?  
(THE DIMENSION PARALLEL TO THE TURN AXIS)  
?  
6.67  
WHAT IS THE WIDTH OF THE ELBOW CROSS-SECTION?  
(THE DIMENSION IN THE PLANE OF THE TURN)  
?  
7.75  
LAST QUESTION, WHAT IS THE ANGLE OF THE ELBOW TURN  
(0 - 90 DEGREES)? ...  
?  
90  
DO YOU WANT TO ENTER THIS FITTING (Y/N)?  
Y>> YOU ARE WORKING ON FITTING NUMBER >> 323105  
?  
23  
YOU HAVE SELECTED A SCREEN OBSTRUCTION IN THE DUCT.  
\*\*FIRST QUESTION, WHAT IS THE DUCT CROSS-SECTIONAL AREA?  
?  
50  
LAST QUESTION, WHAT IS THE FREE FLOW AREA OF THE SCREEN?  
?  
27.15  
DO YOU WANT TO ENTER THIS FITTING (Y/N)?  
Y>> YOU ARE WORKING ON FITTING NUMBER >> 323106  
?  
00  
>> YOU ARE WORKING ON FITTING NUMBER >> 324001  
?  
13  
YOU HAVE SELECTED THE BRANCH SECTION OF A DIVERGENT WYE.  
THE MODULE COOLING AIR SHOULD BE BRANCHING OFF THE MAIN  
INLET AND FLOWING THROUGH THIS SECTION. THIS SHOULD BE THE  
FIRST FITTING OF THIS BRANCH.  
\*\*FIRST QUESTION, WHAT IS THE ANGLE BETWEEN THE MAIN FLOW  
AXIS AND THE BRANCH FLOW AXIS (DEGREES)?  
?  
90  
WHAT IS THE CROSS-SECTIONAL AREA OF THE COMBINED FLOW  
SECTION? THIS IS WHERE BOTH ENGINE AIR AND COOLING AIR FLOW  
JUST UPSTREAM OF THE BRANCH.  
?  
197.75  
LAST QUESTION, WHAT IS THE CROSS-SECTIONAL AREA OF THE BRANCH?  
?  
5.761  
DO YOU WANT TO ENTER THIS FITTING (Y/N)?  
Y

>> YOU ARE WORKING ON FITTING NUMBER >> 324002  
?02  
YOU HAVE SELECTED STRAIGHT DUCT. IT MAY BE ROUND  
OR RECTANGULAR.  
\*\*\*FIRST QUESTION, IS THE DUCT CIRCULAR OR RECTANGULAR (C/R) ?  
C  
THE DUCT IS CIRCULAR, ENTER THE DIAMETER (FEET)  
?  
2.708  
ENTER THE LENGTH OF THIS DUCT SECTION. (FEET)  
?  
7.5  
DO YOU WANT TO ENTER THIS FITTING (Y/N)?  
Y  
>> YOU ARE WORKING ON FITTING NUMBER >> 324003  
?  
00  
>> YOU ARE WORKING ON FITTING NUMBER >> 335101  
?  
02  
YOU HAVE SELECTED STRAIGHT DUCT. IT MAY BE ROUND OR RECTANGULAR.  
\*\*\*FIRST QUESTION, IS THE DUCT CIRCULAR OR RECTANGULAR (C/R) ?  
C  
THE DUCT IS RECTANGULAR, ENTER FIRST CROSS-SECTIONAL DIMENSION. (FEET)  
?  
6.64  
SECOND DIMENSION (FEET)  
?  
4.58  
ENTER THE LENGTH OF THIS DUCT SECTION. (FEET)  
?  
1  
DO YOU WANT TO ENTER THIS FITTING (Y/N)?  
Y  
>> YOU ARE WORKING ON FITTING NUMBER >> 335102  
?  
16  
YOU HAVE SELECTED TEE MAIN SECTION OF A CONVERGING  
WYE. THE ENGINE EXHAUST ALONE SHOULD BE FLOWING THROUGH  
THIS SECTION. IT SHOULD BE THE LAST FITTING OF THE BRANCH.  
\*\*JUST ONE QUESTION, WHAT IS THE CROSS-SECTIONAL AREA OF THE  
MAIN BRANCH?  
?  
20.19  
DO YOU WANT TO ENTER THIS FITTING (Y/N)?  
Y  
>> YOU ARE WORKING ON FITTING NUMBER >> 335103  
?  
00  
>> YOU ARE WORKING ON FITTING NUMBER >> 345001  
?  
27  
YOU HAVE SELECTED TEE GAS TURBINE MODULE AS A PART OF  
THE COOLING FLOW PASSAGE. NO QUESTIONS, JUST NEEDED  
TO KNOW WHERE YOU WANTED THE MODULE.  
DO YOU WANT TO ENTER THIS FITTING (Y/N)?  
Y  
>> YOU ARE WORKING ON FITTING NUMBER >> 345002  
?  
15  
YOU HAVE SELECTED THE BRANCH SECTION OF A CONVERGENT  
WYE. THE HOT MODULE COOLING AIR SHOULD BE JOINING THE MAIN  
ENGINE EXHAUST IN THIS WYE. THIS FITTING SHOULD BE THE LAST  
FITTING IN THE BRANCH.  
\*\*FIRST QUESTION, WHAT IS THE ANGLE BETWEEN THE MAIN FLOW  
AXIS AND THE BRANCH AXIS (DEGREES)?

0 WHAT IS THE CROSS-SECTIONAL AREA OF THE COMBINED FLOW SECTION? THIS IS WHERE ENGINE EXHAUST AND MODULE COOLING AIR FLOW JUST DOWNSTREAM OF THE BRANCH.

? 30.46 LAST QUESTION, WHAT IS THE CROSS-SECTIONAL AREA OF THE BRANCH?

? 10.27 DO YOU WANT TO ENTER THIS FITTING (Y/N)?

Y >> YOU ARE WORKING ON FITTING NUMBER >> 345003

? 00 >> YOU ARE WORKING ON FITTING NUMBER >> 356201

? 21 YOU HAVE SELECTED A CIRCULAR CONTRACTION.  
\*\*FIRST QUESTION, WHAT IS THE LENGTH OF THE CONTRACTION?

? 9 WHAT IS THE UPSTREAM DIAMETER?

? 6.2374 WHAT IS THE DOWNSTREAM DIAMETER?

? 5.4667 DO YOU WANT TO ENTER THIS FITTING (Y/N)?

Y >> YOU ARE WORKING ON FITTING NUMBER >> 356202

? 02 YOU HAVE SELECTED STRAIGHT DUCT. IT MAY BE ROUND OR RECTANGULAR.  
\*\*\*FIRST QUESTION, IS THE DUCT CIRCULAR OR RECTANGULAR (C/R) ?

C THE DUCT IS CIRCULAR, ENTER THE DIAMETER (FEET)

? 5.4667 ENTER THE LENGTH OF THIS DUCT SECTION. (FEET)

? 7.11 DO YOU WANT TO ENTER THIS FITTING (Y/N)?

Y >> YOU ARE WORKING ON FITTING NUMBER >> 356203

? 05 YOU HAVE SELECTED A MITERED ROUND ELBOW.  
\*\*FIRST QUESTION, WHAT IS THE CROSS-SECTIONAL DIAMETER?

? 5.4667 WHAT IS THE ANGLE OF THE ELBOW TURN?

? 90 LAST QUESTION, ARE OPTIMUM NUMBER OF CONCENTRIC VANES INSTALLED TO REDUCE RESISTANCE AND TURBULANCE (Y/N)?

Y DO YOU WANT TO ENTER THIS FITTING (Y/N)?

Y >> YOU ARE WORKING ON FITTING NUMBER >> 356204

? 02 YOU HAVE SELECTED STRAIGHT DUCT. IT MAY BE ROUND OR RECTANGULAR.  
\*\*\*FIRST QUESTION, IS THE DUCT CIRCULAR OR RECTANGULAR (C/R) ?

C THE DUCT IS CIRCULAR, ENTER THE DIAMETER (FEET)

5.5667  
? ENTER THE LENGTH OF THIS DUCT SECTION. (FEET)  
6.23  
? DO YOU WANT TO ENTER THIS FITTING (Y/N)?  
Y >> YOU ARE WORKING ON FITTING NUMBER >> 356205  
? 05  
YOU HAVE SELECTED A MITERED ROUND ELBOW.  
\*\*FIRST QUESTION, WHAT IS THE CROSS-SECTIONAL DIAMETER?  
? 5.4667  
WHAT IS THE ANGLE OF THE ELBOW TURN?  
? 90  
LAST QUESTION, ARE OPTIMUM NUMBER OF CONCENTRIC VANES  
INSTALLED TO REDUCE RESISTANCE AND TURBULANCE (Y/N)?  
Y DO YOU WANT TO ENTER THIS FITTING (Y/N)?  
Y >> YOU ARE WORKING ON FITTING NUMBER >> 356206  
? 02  
YOU HAVE SELECTED STRAIGHT DUCT. IT MAY BE ROUND OR RECTANGULAR.  
\*\*\*FIRST QUESTION, IS THE DUCT CIRCULAR OR RECTANGULAR (C/R) ?  
C THE DUCT IS CIRCULAR, ENTER THE DIAMETER (FEET)  
? 5.4667  
ENTER THE LENGTH OF THIS DUCT SECTION. (FEET)  
? 3.033  
DO YOU WANT TO ENTER THIS FITTING (Y/N)?  
Y >> YOU ARE WORKING ON FITTING NUMBER >> 356207  
? 17  
YOU HAVE SELECTED A CONICAL DIFFUSER WITH CIRCULAR  
INLET AND OUTLET SECTIONS.  
\*\*FIRST QUESTION, WHAT IS THE LENGTH OF THE DIFFUSER?  
? 2.967  
WHAT IS THE INLET DIAMETER?  
? 5.4667  
WHAT IS THE OUTLET DIAMETER?  
? 7.1667  
IS THERE A NON-UNIFORM VELOCITY DISTRIBUTION AT THE INLET (Y/N)?  
N SINCE THERE IS A WIDE DIVERGING ANGLE, THE PROPER  
INSTALLATION OF DIVIDING WALLS OR BAFFLES CAN REDUCE  
THE RESISTANCE OF THIS FITTING. DO YOU WANT TO INSTALL  
DIVIDING WALLS OR BAFFLES (Y/N)?  
N NO MORE QUESTIONS THIS FITTING.  
DO YOU WANT TO ENTER THIS FITTING (Y/N)?  
Y >> YOU ARE WORKING ON FITTING NUMBER >> 356208  
? 02  
YOU HAVE SELECTED STRAIGHT DUCT. IT MAY BE ROUND OR RECTANGULAR.  
\*\*\*FIRST QUESTION, IS THE DUCT CIRCULAR OR RECTANGULAR (C/R) ?  
C THE DUCT IS CIRCULAR, ENTER THE DIAMETER (FEET)

7.1667  
ENTER THE LENGTH OF THIS DUCT SECTION. (FEET)  
?1.7  
DO YOU WANT TO ENTER THIS FITTING (Y/N)?  
Y>> YOU ARE WORKING ON FITTING NUMBER >> 356209  
?21  
YOU HAVE SELECTED A CIRCULAR CONTRACTION.  
\*\*FIRST QUESTION, WHAT IS THE LENGTH OF THE CONTRACTION?  
?0.1  
WHAT IS THE UPSTREAM DIAMETER?  
?7.1667  
WHAT IS THE DOWNSTREAM DIAMETER?  
?4.533  
DO YOU WANT TO ENTER THIS FITTING (Y/N)?  
Y>> YOU ARE WORKING ON FITTING NUMBER >> 356210  
?29  
YOU HAVE SELECTED AN ABRUPT EXIT TO THE ATMOSPHERE.  
\*\*JUST ONE QUESTION, WHAT IS THE AREA OF THE EXIT PLANE?  
?16.1384  
DO YOU WANT TO ENTER THIS FITTING (Y/N)?  
Y>> YOU ARE WORKING ON FITTING NUMBER >> 356211  
?00  
WHAT SERIAL NUMBER WOULD YOU LIKE TO GIVE THIS DUCT DATA FILE?  
YOU MAY USE UP TO A SIX DIGIT INTEGER NUMBER.  
?510001  
DO YOU WANT TO COMPUTE WITH THE FILE OR QUIT (C/Q)?  
Q

## E. EDITING THE DUCT DATA FILE

This section demonstrates the editing capability of the program. The editor will be demonstrated by changing a fitting. The fitting chosen is an elbow in the exhaust duct. It has cascaded turning vanes installed. By using the editor the turning vanes will be removed and an ordinary mitered round elbow will be substituted. Any fitting that also serves the purpose could be substituted as well.

The program can also add or delete a fitting. It is somewhat limited in the addition ability. The program can not add a fitting to the first of a branch in one step. To add a fitting to the duct data file select the index of the fitting in the file that the fitting is to be placed after. The program will ask what fitting is to be added and then the user can enter the fitting directly or from the menu. To add a fitting at the first of a branch, first add the same first fitting presently in the branch after itself, then change the same index fitting as the first step to the desired new first fitting.

It should be emphasized that the editor does not change a system class. If the user wants a different duct arrangement a new file will have to be entered.

GLOBAL CXTLIB CASLIB FORTMOD2 MOD2EEH IMSLSP NONIMSL  
LOAD THESIS (START  
EXECUTION BEGINS  
A ONE-DIMENSIONAL MODEL FOR THE SYSTEM PERFORMANCE  
OF A MARINE GAS TURBINE INSTALLATION

BY LCDR. STEPHEN M. EZZELL

VERSION 1.0 MARCH 30, 1984  
OPTIONS: BUILD A DATA FILE REPRESENTING THE DUCT SYSTEM  
EDIT OR CHANGE THE DUCT DATA FILE  
COMPUTE SYSTEM PERFORMANCE  
METHOD: INTERACTIVE INPUT OF DATA, BRANCHING TO DESIRED  
OPTION BY ANSWERING QUESTIONS

\*\*\* WARNING, TWO NULL ENTRIES ON NUMERICAL INPUT WILL \*\*\*  
\*\*\* KILL THE PROGRAM. \*\*\*

FIRST QUESTION:  
DO YOU HAVE A DATA FILE OF DUCT FITTINGS (Y/N)?

y

DO YOU WANT TO EDIT THE FILE OR USE IT FOR COMPUTATION (E/C)?

e  
DO YOU WANT TO CHANGE, DELETE, OR ADD (C/D/A)?  
YOUR OLD FILE WILL BE PERMANENTLY CHANGED. DID YOU  
COPY THE OLD FILE UNDER A NEW NAME IF YOU WANTED TO  
SAVE IT? IF NOT, ENTER TWO NULL STRINGS TO KILL THE  
PROGRAM.

c  
WHAT LINE DO YOU WANT TO EDIT?

19  
DO YOU NEED A MENU (Y/N)?

y  
00 NC MCRE FITTINGS THIS BRANCH \* 14 DIVERGING WYE, MAIN SECTION  
01 INTAKE SHAFT, RECT SECTION SIDE \* 15 CONVERGENT WYE, BRANCH SECTION  
ORIFACES, WITH (OUT) LOUVERS \* 16 CONVERGENT WYE, MAIN SECTION  
02 STRAIGHT DUCT \* 17 DIFFUSER, CONICAL ROUND SECTION  
03 ELBOW, SMOOTH, RADIUS ROUND \* 18 DIFFUSER, PLANE, IN-LINE  
04 ELBOW: 90 DEG; 3 1/2 PCS, ROUND \* 19 DIFFUSER, PYRAMIDAL, IN-LINE  
05 ELBOW, MITERED, ROUND, W/E/VANES \* 20 DIFFUSER, TRANSITIONAL (ROUND TO  
06 ELBOW, MITERED, RECTANGULAR \* RECT, OR RECT TO ROUND)  
07 ELBOW, SMOOTH, RADIUS, RECTANGULAR \* 21 CONTRACTION, ROUND  
08 ELBOW, SMOOTH, RADIUS, WITH \* 22 CONTRACTION, RECTANGULAR  
SPLITTERS, RECTANGULAR \* 23 OBSTRUCTION, SCREEN IN DUCT  
09 ELBOW, MITERED, RECTANGULAR \* 24 LOUVER ENTRANCE  
10 ELBOW, CONVERGING OR DIVERGING \* 25 FILTER  
FLOW, RECTANGULAR \* 26 MULTIBAFFLE SILENCER  
11 ELBOW, 90 DEG, Z-SHAPED, RECT \* 27 GT MODULE  
12 ELBOWS, 90 DEG, IN DIFFERENT \* 28 WASTE HEAT EXCHANGER  
PLANES, RECTANGULAR \* 29 EXIT, ABRUPT  
13 DIVERGING WYE, BRANCH SECTION \* 30 FITTING, NOT LISTED  
\*\*\*\*\* USE TWO DIGIT NUMBER, PRESS ENTER \*\*\*\*\*  
<> YOU ARE WORKING ON FITTING NUMBER, >> 356205

?  
05  
YOU HAVE SELECTED A MITERED ROUND ELBOW.  
\*\*FIRST QUESTION, WHAT IS THE CROSS-SECTORIAL DIAMETER?

?  
5.4667  
WHAT IS THE ANGLE OF THE ELBOW TURN?

?  
90  
LAST QUESTION, ARE OPTIMUM NUMBER OF CONCENTRIC VANES  
INSTALLED TO REDUCE RESISTANCE AND TURBULANCE (Y/N)?  
n  
DO YOU WANT TO ENTER THIS FITTING (Y/N)?

Y  
WANT TO CHANGE ANOTHER FITTING (Y/N) ?  
N  
WANT TO MAKE ANY OTHER CHANGES (Y/N) ?  
N  
WHAT SERIAL NUMBER WOULD YOU LIKE TO GIVE THIS DUCT DATA FILE?  
YOU MAY USE UP TO A SIX DIGIT INTEGER NUMBER.  
?  
\$10002  
DO YOU WANT TO COMPUTE WITH THE FILE OR QUIT (C/Q) ?  
q

## **F. COMPUTING SYSTEM PERFORMANCE**

This section also contains a recorded terminal session. The computing section of the program was exercised here. The session has been annotated to point out program features.

GLOBAL TXTLIB CMSLIB FORTMOD2 MOD2EEH IMSLSP NONIMSL  
LOAD THESIS ( START  
EXECUTION BEGINS:  
A ONE-DIMENSIONAL MODEL FOR THE SYSTEM PERFORMANCE  
OF A MARINE GAS TURBINE INSTALLATION

BY LCDR. STEPHEN M. EZZELL

OPTIONS: VERSION 1.0 MARCH 30, 1984  
BUILD A DATA FILE REPRESENTING THE DUCT SYSTEM  
EDIT OR CHANGE THE DUCT DATA FILE  
COMPUTE SYSTEM PERFORMANCE  
METHOD: INTERACTIVE INPUT OF DATA, BRANCHING TO DESIRED  
OPTION BY ANSWERING QUESTIONS

\*\*\* WARNING, TWO NULL ENTRIES ON NUMERICAL INPUT WILL \*\*\*  
\*\*\* KILL THE PROGRAM. \*\*\*

FIRST QUESTION:  
DO YOU HAVE A DATA FILE OF DUCT FITTINGS (Y/N)?  
y  
DO YOU WANT TO EDIT THE FILE OR USE IT FOR COMPUTATION (E/C)?  
c  
THIS PORTION OF THE PROGRAM INPUTS THE ENVIRONMENTAL CONDITIONS.  
WHAT IS THE AMBIENT TEMPERATURE (DEGREES F)?  
?  
75  
WHAT IS THE AMBIENT PRESSURE (PSIA)?  
?  
14.6  
WHAT IS THE RELATIVE HUMIDITY (GRAINS PER POUND AIR)?  
?  
70  
YOU HAVE SELECTED A SYSTEM WITH A COOLING FAN. THE  
DEFAULT SPECIFICATIONS ARE FOR THE FAN INSTALLED ON  
THE DD963 CLASS SHIP.  
DO YOU WANT TO USE THE DEFAULT SPECIFICATIONS (Y/N)?  
y  
INPUT THE POWER SETTING YOU DESIRE.  
\*\*WHAT IS THE HORSEPOWER?  
?  
20000  
\*\*WHAT IS THE POWER TURBINE SPEED (RPM)?  
?  
3600  
THE RESULTS OF THIS RUN HAVE BEEN ENTERED  
INTO A FILE CALLED "CUTPUT DATA".  
DO YOU WANT TO COMPUTE WITH DIFFERENT OPERATING CONDITIONS (Y/N)?  
y  
INPUT THE POWER SETTING YOU DESIRE.  
\*\*WHAT IS THE HORSEPOWER?  
?  
10000  
\*\*WHAT IS THE POWER TURBINE SPEED (RPM)?  
?  
2200  
THE RESULTS OF THIS RUN HAVE BEEN ENTERED  
INTO A FILE CALLED "CUTPUT DATA".  
DO YOU WANT TO COMPUTE WITH DIFFERENT OPERATING CONDITIONS (Y/N)?  
n  
DO YOU WANT TO EDIT THE DUCT DATA FILE OR QUIT (E/Q)?  
q

## **G. EXAMINING THE OUTPUT**

Included in this section are copies of two files. The first is a copy of the file the author built using the Arleigh Burke class example. The other one is a copy of the results from the runs made in the compute section using the sample file at two operating points.

FILE ID NUMBER  
 510001 ← NUMBER OF FITTINGS  
 24

FILE LINE NUMBER	FITTING ID #	FITTING TYPE #, LISTED ON MENU.	NUMBER OF FITTINGS	FILE ID NUMBER
1	12201	24	197.7500	0.0
2	12202	25	197.7500	0.0167
3	12203	2	197.7150	15.2104
4	12201	14	81.3750	0.0
5	12202	26	81.3750	0.0
6	12203	22	81.3750	0.0
7	12204	6	51.6925	7.1696
8	12205	23	50.0000	0.0
9	122001	13	197.7500	5.7610
10	122002	22	5.7566	2.7080
11	12201	2	30.4112	6.0026
12	12202	16	20.1900	0.0
13	122001	27	1.0000	1.0000
14	122002	15	30.4600	10.2700
15	122021	21	30.5561	0.0
16	122022	2	23.4596	5.4667
17	122023	5	23.4715	5.4667
18	122024	25	24.3257	5.5607
19	122025	25	23.4715	5.4667
20	122026	25	23.4596	5.4667
21	122007	17	23.4715	0.3002
22	122008	2	40.3188	7.1667
23	122009	21	40.3394	0.0
24	122010	29	16.1384	0.0

FITTING ID # ← FILE LINE NUMBER, USED IN EDIT

THIS PERFORMANCE RUN WAS DEVELOPED FROM DUCT DATA FILE, S10001

INLET CONDITIONS: AMBIENT TEMP (DEG F) 75.00  
 AMBIENT PRESS (PSIA) 14.60  
 HUMIDITY (GRAINS) 70.00

HORSEPOWER: 20000.0  
 NPT (REM) : 3600.0

ENGINE DUCT LOSSES (IN.W.G.): INLET 1.98 EXHAUST 13.95

ENGINE PERFORMANCE PARAMETERS:

WC= 24.32 LBM/SEC  
 W2= 122.71 LBM/SEC  
 X8= 123.78 LBM/SEC  
 P8= 15.18 PSIA  
 T8= 1405.49 DEG R  
 SFC= 0.406 LB4(FUEL)/HP\*HR  
 TS4= 1827.1 DEG R  
 NG= 8827.0 RPM  
 MODULE COOLING TEMP OUT= 250.3 DEG F

FITTING ID	FITTING TYPE	PRESSURE LOSS INCH W.G.	VELOCITY PRESSURE INCH W.G.	
312201	24	0.42	0.02	LOUVER ENTRANCE
312202	25	0.72	0.92	FILTER STRAIGHT DUCT
312203	26	0.00	0.02	STRaight Duct
323101	14	0.04	0.09	MAIN SECT, DIV WYE
323102	26	0.09	0.99	SILENCER SECTION
323103	22	0.01	0.23	CONTRACTIOn, RECT
323104	20	0.18	0.23	ELBOW, MITERED, RECT
323105	23	0.52	0.25	SCREEN, MITERED, RECT
324001	13	0.67	0.72	BRANCH, MITERED, WYE
324002	22	0.02	0.73	BRANCH, MITERED, DUCT
355101	16	0.00	1.71	STRaight Duct
355102	27	1.30	2.24	MAIN SECTION, CONV WYE
355001	27	1.54	2.0	GAS TURBINE MODULE
355002	15	-3.24	0.0	BRANCH, MITERED, WYE
2201	21	0.04	0.01	CONTRACTIOn, ROUND
556202	22	0.05	0.79	STRaight Duct
556203	25	0.74	0.79	ELBOW, MITERED, ROUND
556204	25	0.04	0.54	STRaight Duct
556205	25	0.74	0.80	ELBOW, MITERED, ROUND
556206	22	0.02	0.31	STRaight Duct
556207	17	0.46	0.30	DIFF CONICAL
556208	2	0.00	1.29	STRaight Duct
556209	21	2.46	0.08	CONTRACTIOn, ROUND
556210	29	8.10	0.10	EXIT, ABRUPT
LCS5	BRANCH 1-2		1.14	
LOSS5	BRANCH 1-2		0.89	
LOSS5	BRANCH 3-5		1.31	
LOSS5	BRANCH 3-5		12.65	
LCS5	BRANCH 2-4		0.66	
LOSS5	BRANCH 4-5		-1.70	

THIS PERFORMANCE RUN WAS DEVELOPED FROM DUCT DATA FILE, 510001

INLET CONDITIONS: AMBIENT TEMP (DEG F) 75.00  
 AMBIENT PRESS (PSIA) 14.60  
 HUMIDITY (GRAINS) 70.00

HORSEPOWER: 10000.0  
 NFT (REM) : 2200.0

ENGINE DUCT LOSSES (IN.W.G.): INLET 1.40 EXHAUST 9.10

ENGINE PERFORMANCE PARAMETERS:

W<sub>C</sub>= 25.42 LBM/SEC  
 W<sub>2</sub>= 99.45 LBM/SEC  
 W<sub>8</sub>= 99.88 LBM/SEC  
 E<sub>B</sub>= 14.97 PSIA  
 T<sub>B</sub>= 1281.00 DEG R  
 SFC= 0.508 LBM(FUEL)/HP\*HR  
 T<sub>S4</sub>= 1549.0 DEG R  
 NG= 8332.3 RPM

MODULE COOLING TEMP OUT= 250.3 DEG F

FITTING ID	FITTING TYPE	PRESSURE LOSS INCH W.G.	VELOCITY PRESSURE INCH W.G.	
312201	24	0.30	0.02	LOUVER ENTRANCE
312202	25	0.55	0.32	FILTER
312203	25	0.50	0.34	STRAIGHT DUCT
323101	14	0.02	0.06	MAIN SECT DIV WYE
323102	26	0.06	0.06	SILENCER SECTION
323103	22	0.00	0.15	CONTRACTIION, RECT
323104	26	0.12	0.15	ELBOW, MITERED, RECT
323105	23	0.34	0.16	SCREEM, MAIN DUCT
324001	13	0.73	0.79	BRANCH DIV WYE
324002	22	0.02	0.79	STRAIGHT DUCT
335101	22	0.00	1.03	STRAIGHT DUCT
335102	16	0.85	1.46	MAIN SECT, CONV WYE
345001	27	1.69	0.0	GAS TURBINE MODULE
345002	15	-1.84	1.46	BRANCH, CONV WYE
3562201	21	0.03	2.48	CONTRACTIION, ROUND
3562202	2	0.03	2.47	STRAIGHT DUCT
3562203	25	0.49	2.47	ELBOW, MITERED, ROUND
3562204	25	0.49	2.30	STRAIGHT DUCT
3562205	25	0.49	2.48	ELBOW, MITERED, ROUND
3562206	22	0.01	2.48	STRAIGHT DUCT
3562207	17	0.30	2.48	DIFF, CONICAL
3562208	21	0.00	5.84	STRAIGHT DUCT
356210	29	1.60	5.27	CONTRACTIION, ROUND
		5.27		EXIT, ABRUPT
LOSS BRANCH	1-2:	0.86		
LCSS BRANCH	2-3::	0.55		
LCSS BRANCH	3-5::	0.85		
LCSS BRANCH	5-6::	0.25		
LOSS BRANCH	2-4::	0.75		
LCSS BRANCH	4-5::	-0.15		

#### LIST OF REFERENCES

1. I. Schweiger, "The Aerodynamic Aspects of Gas Turbine Ducting Design - Their Model Testing, Correlation of Model Testing and Full Scale Results" (paper presented at the Gas Turbine Conference, by the Institute of Marine Engineers, London, November 1975)
2. Irving H. Shames, Mechanics of Fluids, (New York 1982)
3. American Society of Heating, Refrigeration, and Air-conditioning Engineers, ASHRAE Handbook 1981 Fundamentals
4. 7LM2500 Marine Gas Turbine Performance Data, Report Number MID-TD-2500-8, Marine and Industrial Projects Department, General Electric Company, November 1978
5. I.E. Idel'chik, Handbook of Hydraulic Resistance, trans. from the Russian by A. Barouch (Israel, 1960)
6. Naval Ship Engineering Station Philadelphia, Gas Turbine Inlet Design Handbook, 25 April, 1983

## INITIAL DISTRIBUTION LIST

	No. Copies
1. Defense Technical Information Center Cameron Station Alexandria, Virginia 22314	2
2. Library, Code 0142 Naval Postgraduate School Monterey, California 93943	2
3. Department Chairman, Code 69 Department of Mechanical Engineering Naval Postgraduate School Monterey, California 93943	2
4. Professor Paul F. Pucci (Code 69Pc) Department of Mechanical Engineering Naval Postgraduate School Monterey, California 93943	5
5. LCDR Stephen M. Ezzell 1388 Old Salem Road Kernersville, North Carolina 27284	1
6. Joseph Londino NAVSEA Code 56X11 Naval Sea Systems Command Washington, D.C. 20362	5
7. Dan Groghan NAVSEA Code 05R Naval Sea Systems Command Washington, D.C. 20362	1
8. Donald Tempesco NAVSEA Code 56X3 Naval Sea Systems Command Washington, D.C. 20362	1
9. General Electric Company Attn: Mr. Werner Hoeimer Aircraft Engine Group Cincinnati, Ohio 45215	1







298349

Thesis

E992 Ezzell

c.1 An analytic model of  
gas turbine engine in-  
stallations.

298349

Thesis

E992 Ezzell

c.1 An analytic model of  
gas turbine engine in-  
stallations.



thesE992  
An analytic model of gas turbine engine



3 2768 002 06632 6  
DUDLEY KNOX LIBRARY